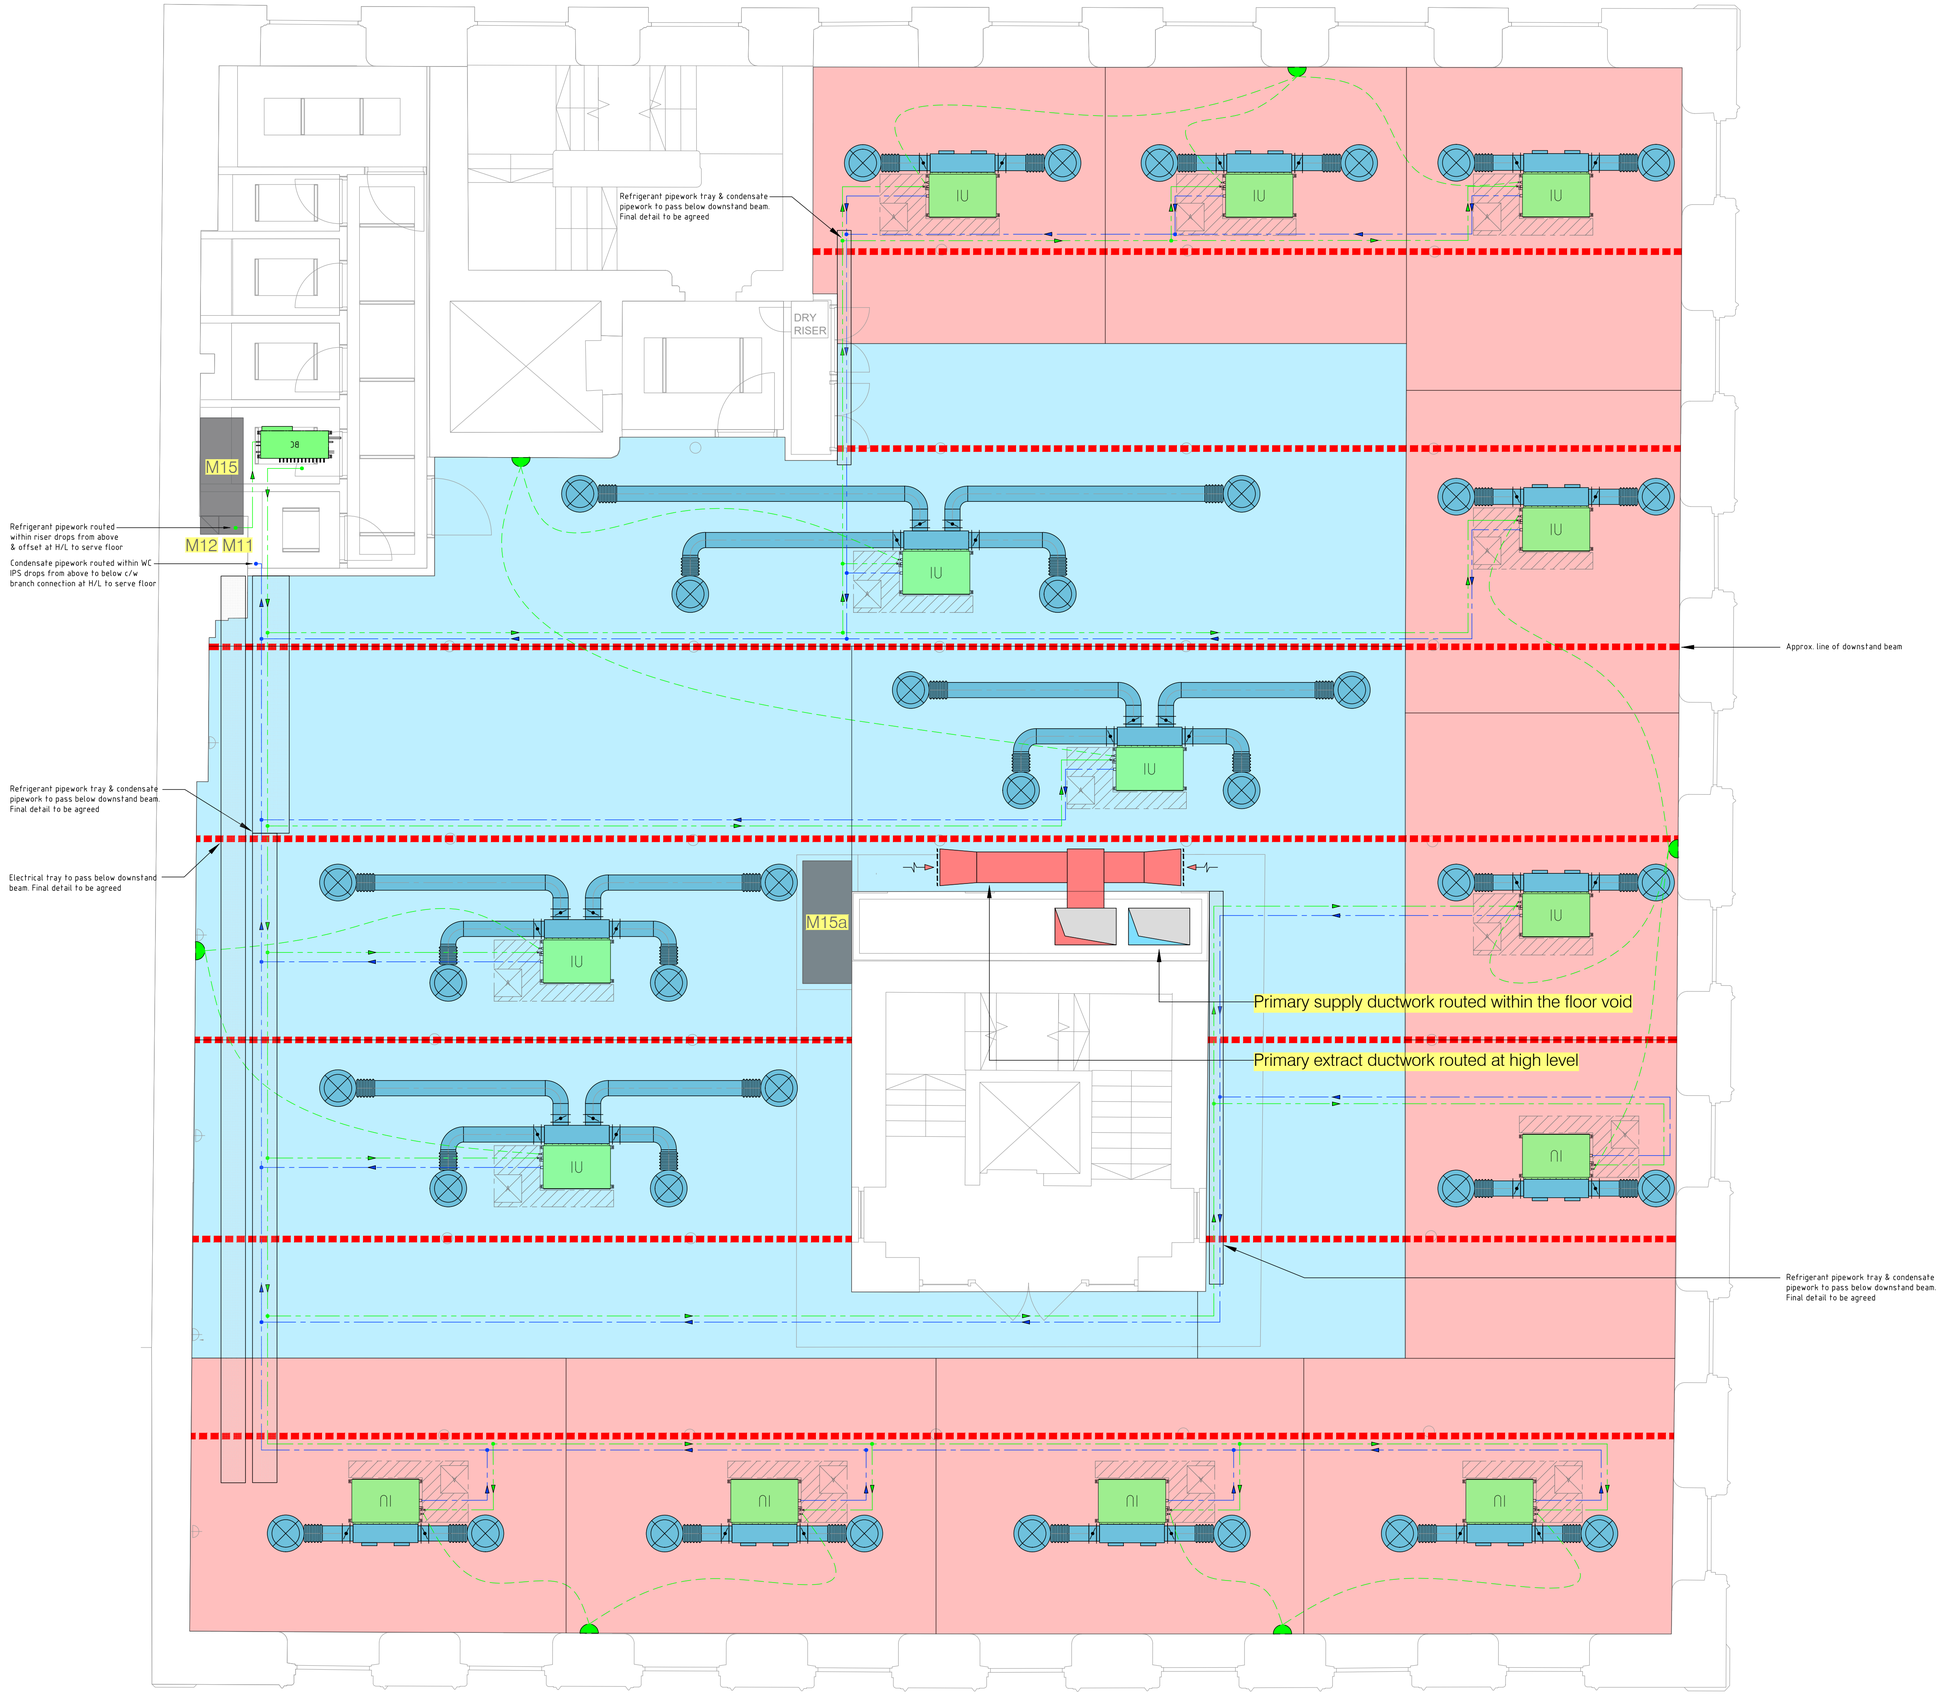


This drawing was produced in AutoCAD, DO NOT change manually.
DO NOT scale from this drawing. The contractor must verify all site dimensions.

Legend

Key	Description
	Approx. line of downstand beam
IU	VRF Indoor Unit
IC	Acoustically wrapped BC Controller c/w port isolation valves
	Refrigerant Pipework
	Condensate Pipework
	Local Wall Mounted Controller
	Control Wiring
	Secondary Supply Air Ductwork
	Supply Air Grille
	Flexible Connection
VCD	Volume Control Damper
VCD	Volume Control Damper

Notes

1. All ducting runs, indoor VRF unit locations and diffuser positions must be checked and set out against a fully detailed ceiling layout, structural engineering and electrical services drawings. all dimensions must be checked out on site prior to the installation being executed. The contractor will be expected to co-ordinate, the ductwork and piped services with all other trades.
2. All indoor VRF units shall be independently supported using the appropriate fixings and hangers suitably supported from the soffit.
3. All refrigerant pipework distribution to be within ceiling void zone.
4. All refrigerant pipework to be in half hard copper clipped to cable tray.
5. Condensate drainage pipework to connect to S&VP via a hepvO dry trap as manufactured by Hepworth or equivalent.
6. All condensate drainage to include rodding eyes / inspection caps.
7. All condensate drains to be gravity to falls.
8. Minimum of 100mm lighting zone to be maintained above ceiling zone.
9. Refrigerant pipework shown single line for clarity.
10. The final location of all wall mounted controllers is to be agreed with the Client and Architect.
11. Only the containment routed below the downstand beams have been indicated on this layout.

Issue	Date	Description	Drawn	Checked
P5	31 01 22	Planning Issue.	DG	JW
P4	15 12 21	Updated to reflect approx. containment routes.	DG	JW
P3	19 11 21	Updated to comments.	DG	JW
P2	12 11 21	Updated to Architects proposed layouts.	DG	JW
P1	04 11 21	Preliminary issue.	DG	JW

Hannan Associates
MEP Design Solutions

Hannan Associates Ltd
Beta House, Alphagate Drive,
Manchester Road, Denton
M34 3SH
Tel : +44 (0)161 337 2200
Email : info@hannan-uk.com
Web : www.hannan-uk.com

Client
Clearbell UK Strategic Limited Partnership

Project
Freetrade Exchange
Refurbishment

Design Stage
Stage 2 'Concept Design'

Drawing Title
Indicative Comfort Cooling Layout
Typical Upper Floor

Scale	Page Size
1:50	A1L

Status
PLANNING ISSUE

Project : Originator : Volume	Level : File Type : Role : Number
3882 - HAN - ZZ	XX - DR - M - 02 11

This drawing is the property of Hannan Associates. It must not be copied or lent to any third party without the written consent of Hannan Associates, and must be returned upon request.