



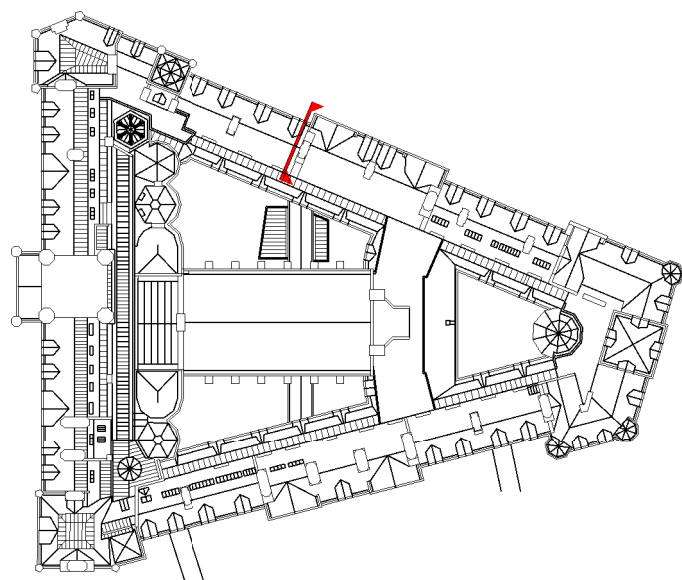

Key plan_Section BK

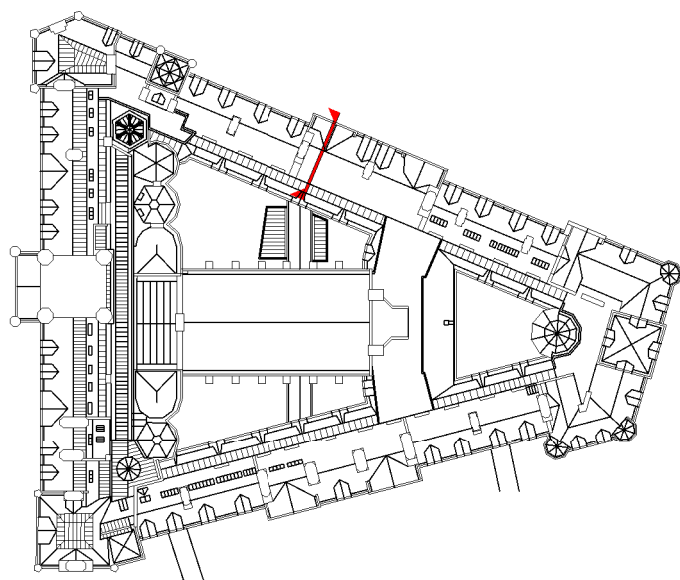

Key plan_Section BL

CS05

CS05

2
4165

4
4165

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out joints to a minimum depth of 35mm, slater to install slate and soakers, and leadworker to install raking abutment flashing as NBS reference H71.471. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.821

See Purcell drawing OTH-PUR-EX-ZZ-DWG-A-4047 for further repair details

Repoint all stonework to chimneys in accordance with NBS reference C41.821

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out bed and perp joints a minimum depth of 35mm, slater to install slate and soakers and leadworker to install stepped abutment flashing as NBS reference H71.475. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.822

Repoint all stone copings in accordance with NBS reference C41.821

Repoint all facing brick to gables in accordance with NBS reference C41.822

Repoint all facing brick to chimneys in accordance with NBS reference C41.822

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out bed and perp joints a minimum depth of 35mm, slater to install slate and soakers and leadworker to install stepped abutment flashing as NBS reference H71.475. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.822

Repoint all stone copings in accordance with NBS reference C41.821

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out joints to a minimum depth of 35mm, slater to install slate and soakers, and leadworker to install raking abutment flashing as NBS reference H71.471. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.821

Section BK
1 : 50

Section BL
1 : 50

Scale Bars to be used as guidance only - refer to sheet size below

1:100 mm	1000	2000	3000	4000	5000	6000	7000	8000
1:200 mm	1500	3000	4500	6000	7500	9000	10500	12000
1:500 M	5	10	15	20	25	30	35	40
1:1250 M	10	20	30	40	50	60	70	80

Notes:

Drawings are based on survey data and may not accurately represent what is physically present.
Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.
All dimensions are in millimeters unless noted otherwise.
Purcell shall be notified in writing of any discrepancies.

Revision 01: Re-issued for construction no change

01	07/05/2020	GR	TK	Re-issued for construction, see note in cloud
-	15/01/2020	GR	TK	First Issue
ISSUE	DATE	APPROVED	DRAWN	DESCRIPTION



OUR
TOWN
HALL
PROJECT



Project Office, Town Hall, MANCHESTER M60 2L1
+44 (0) 7970 097 432
www.purcelluk.com

PROJECT STATUS **Riba Stage 5**

CLIENT **Manchester City Council**

PROJECT **Our Town Hall**

DRAWING TITLE **General Arrangement Roof
Section BK and BL**

SIZE & SCALE **A1:As indicated**

DRAWING STATUS **S4 Construction**

JOB NUMBER **236959**

DRAWING NO. REV

OTH-PUR-TH-RF-DWG-A-4388 01

© PURCELL 2019. PURCELL ® IS THE TRADING NAME OF PURCELL ARCHITECTURE LTD.

04/01/2021 11:19:42