


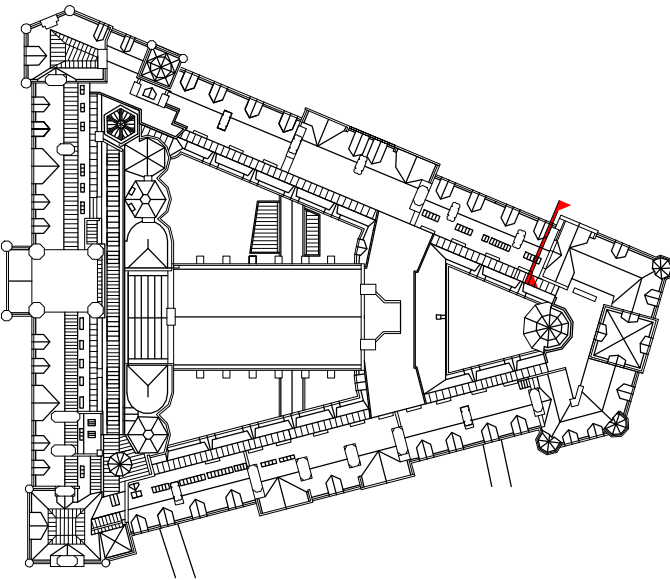


Key plan_Section BE

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out joints to a minimum depth of 35mm, slater to install slate and soakers, and leadworker to install raking abutment flashing as NBS reference H71.471. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.821


Repoint all stone copings in accordance with NBS reference C41.821

Repoint all stonework to gables in accordance with NBS reference C41.821

See Purcell drawing OTH-PUR-EX-ZZ-DWG-A-4039 for further repair details

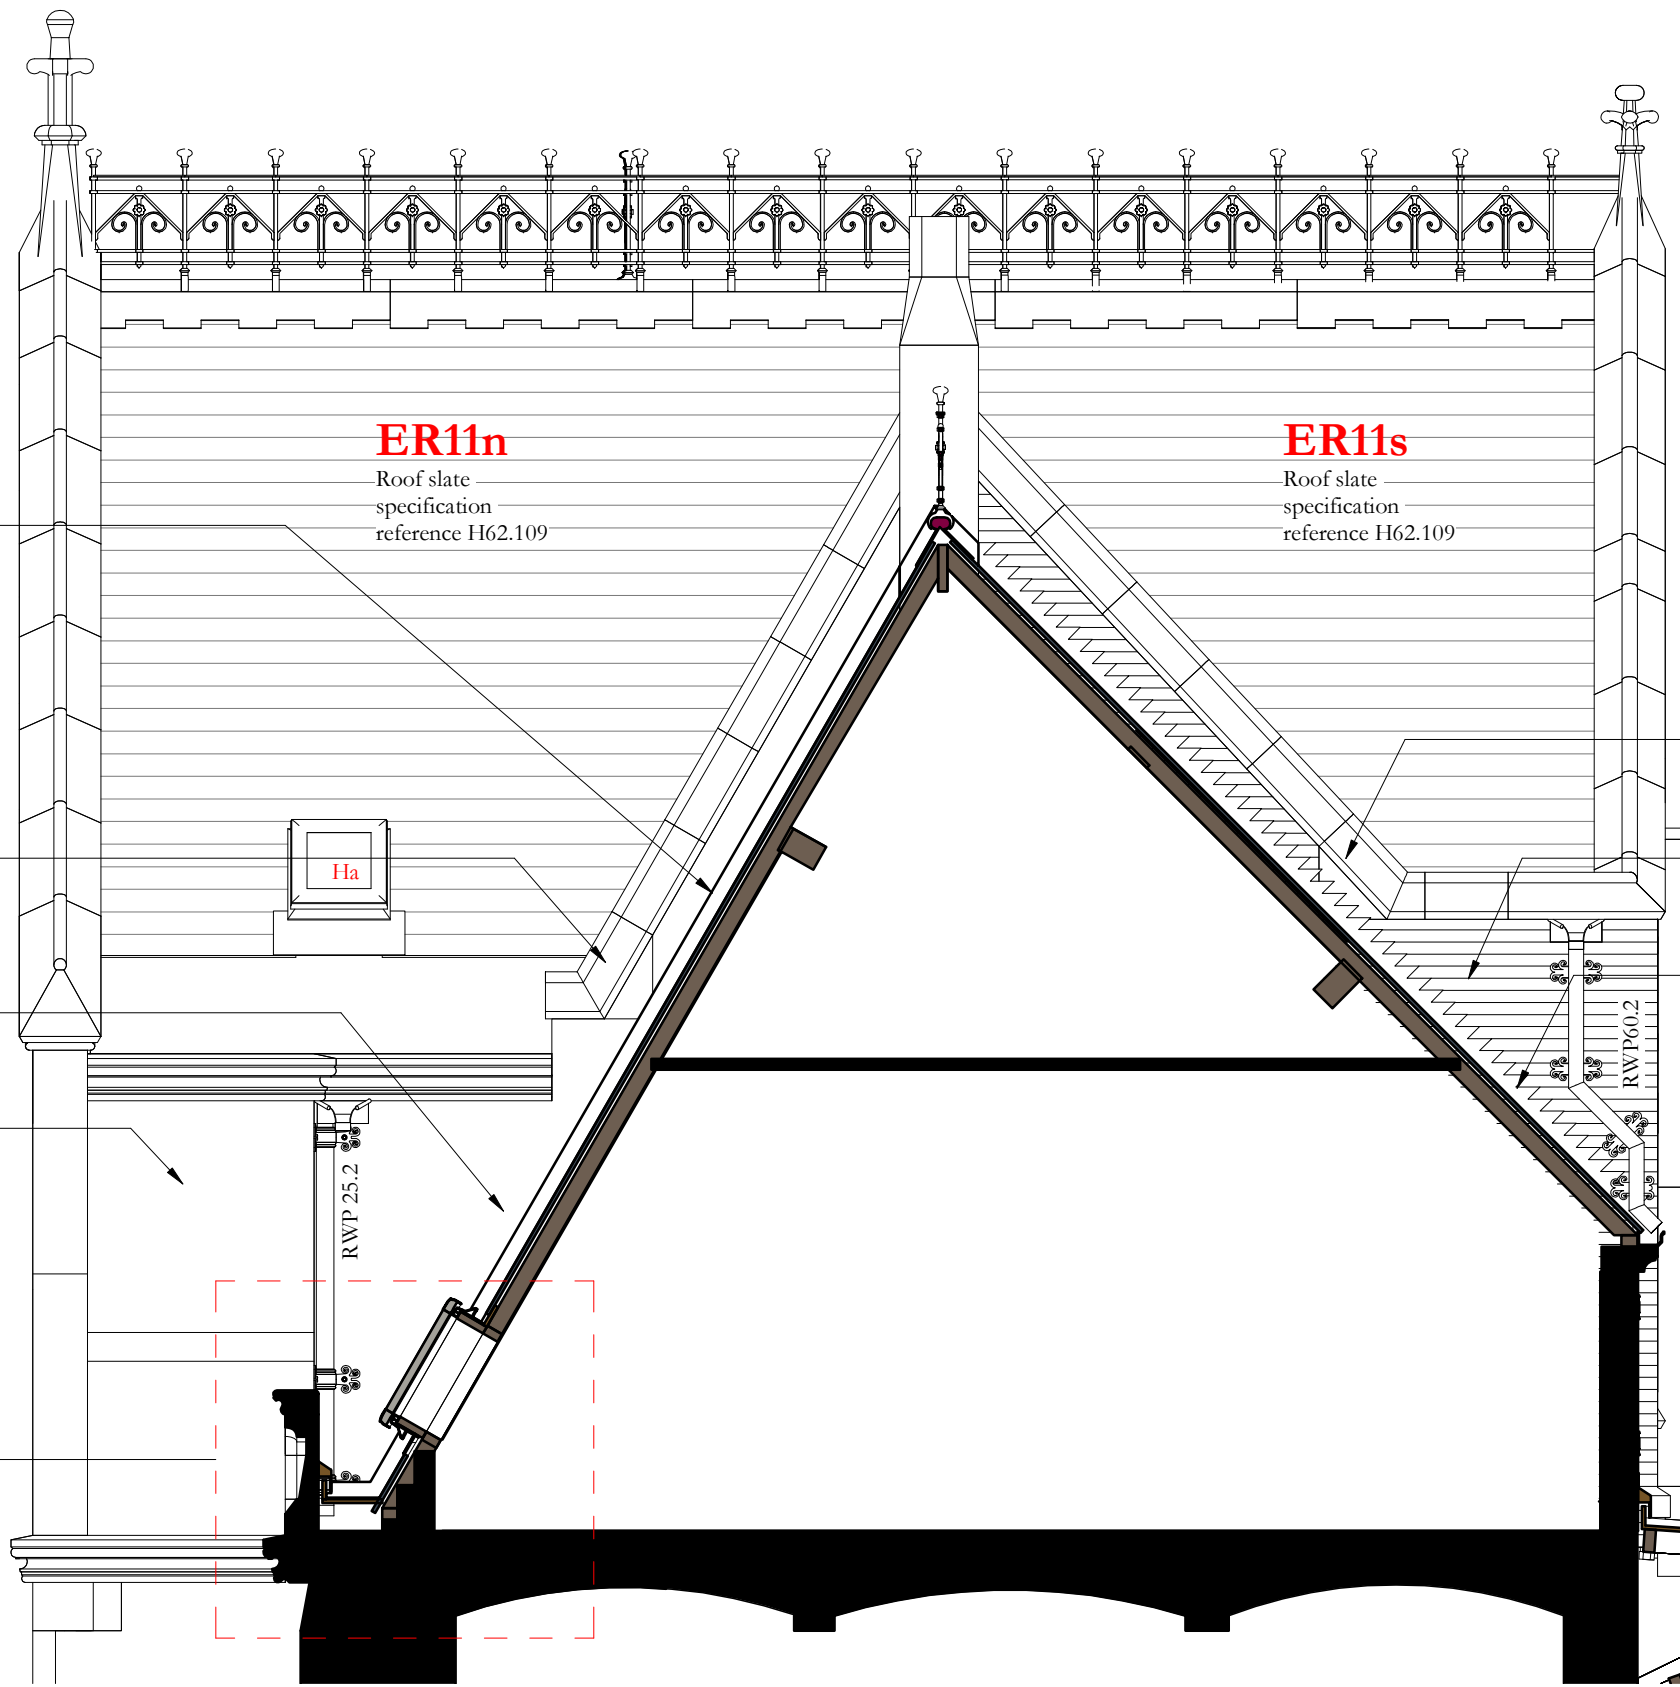

Section BE
1 : 50

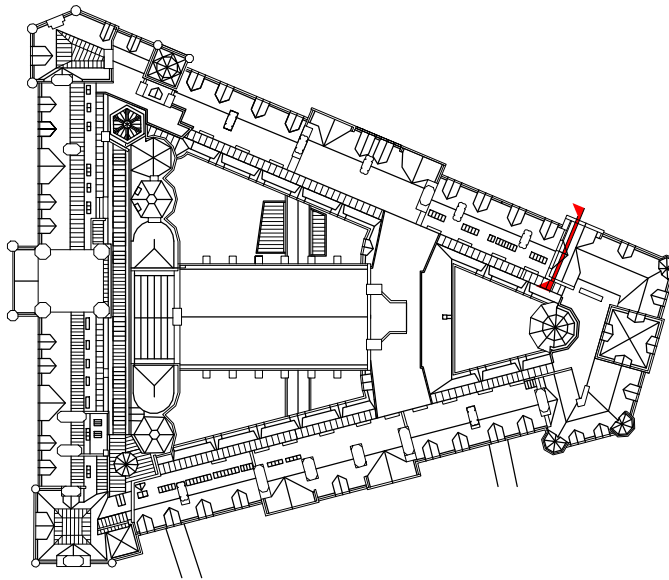

Key plan_Section BF

Repoint all stone copings in accordance with NBS reference C41.821


Repoint all facing brick to gables in accordance with NBS reference C41.822

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out bed and peep joints a minimum depth of 35mm, slater to install slate and soakers and leadworker to install stepped abutment flashing as NBS reference H71.475. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.822


Repoint all stone copings in accordance with NBS reference C41.821

Repoint all facing brick to gables in accordance with NBS reference C41.822

Installation of new abutment flashings to be carefully co-ordinated between stonemason, slater and leadworker. Stonemason to rake out bed and peep joints a minimum depth of 35mm, slater to install slate and soakers and leadworker to install stepped abutment flashing as NBS reference H71.475. Following installation of flashing stonemason to repoint joints in accordance with NBS reference C41.822

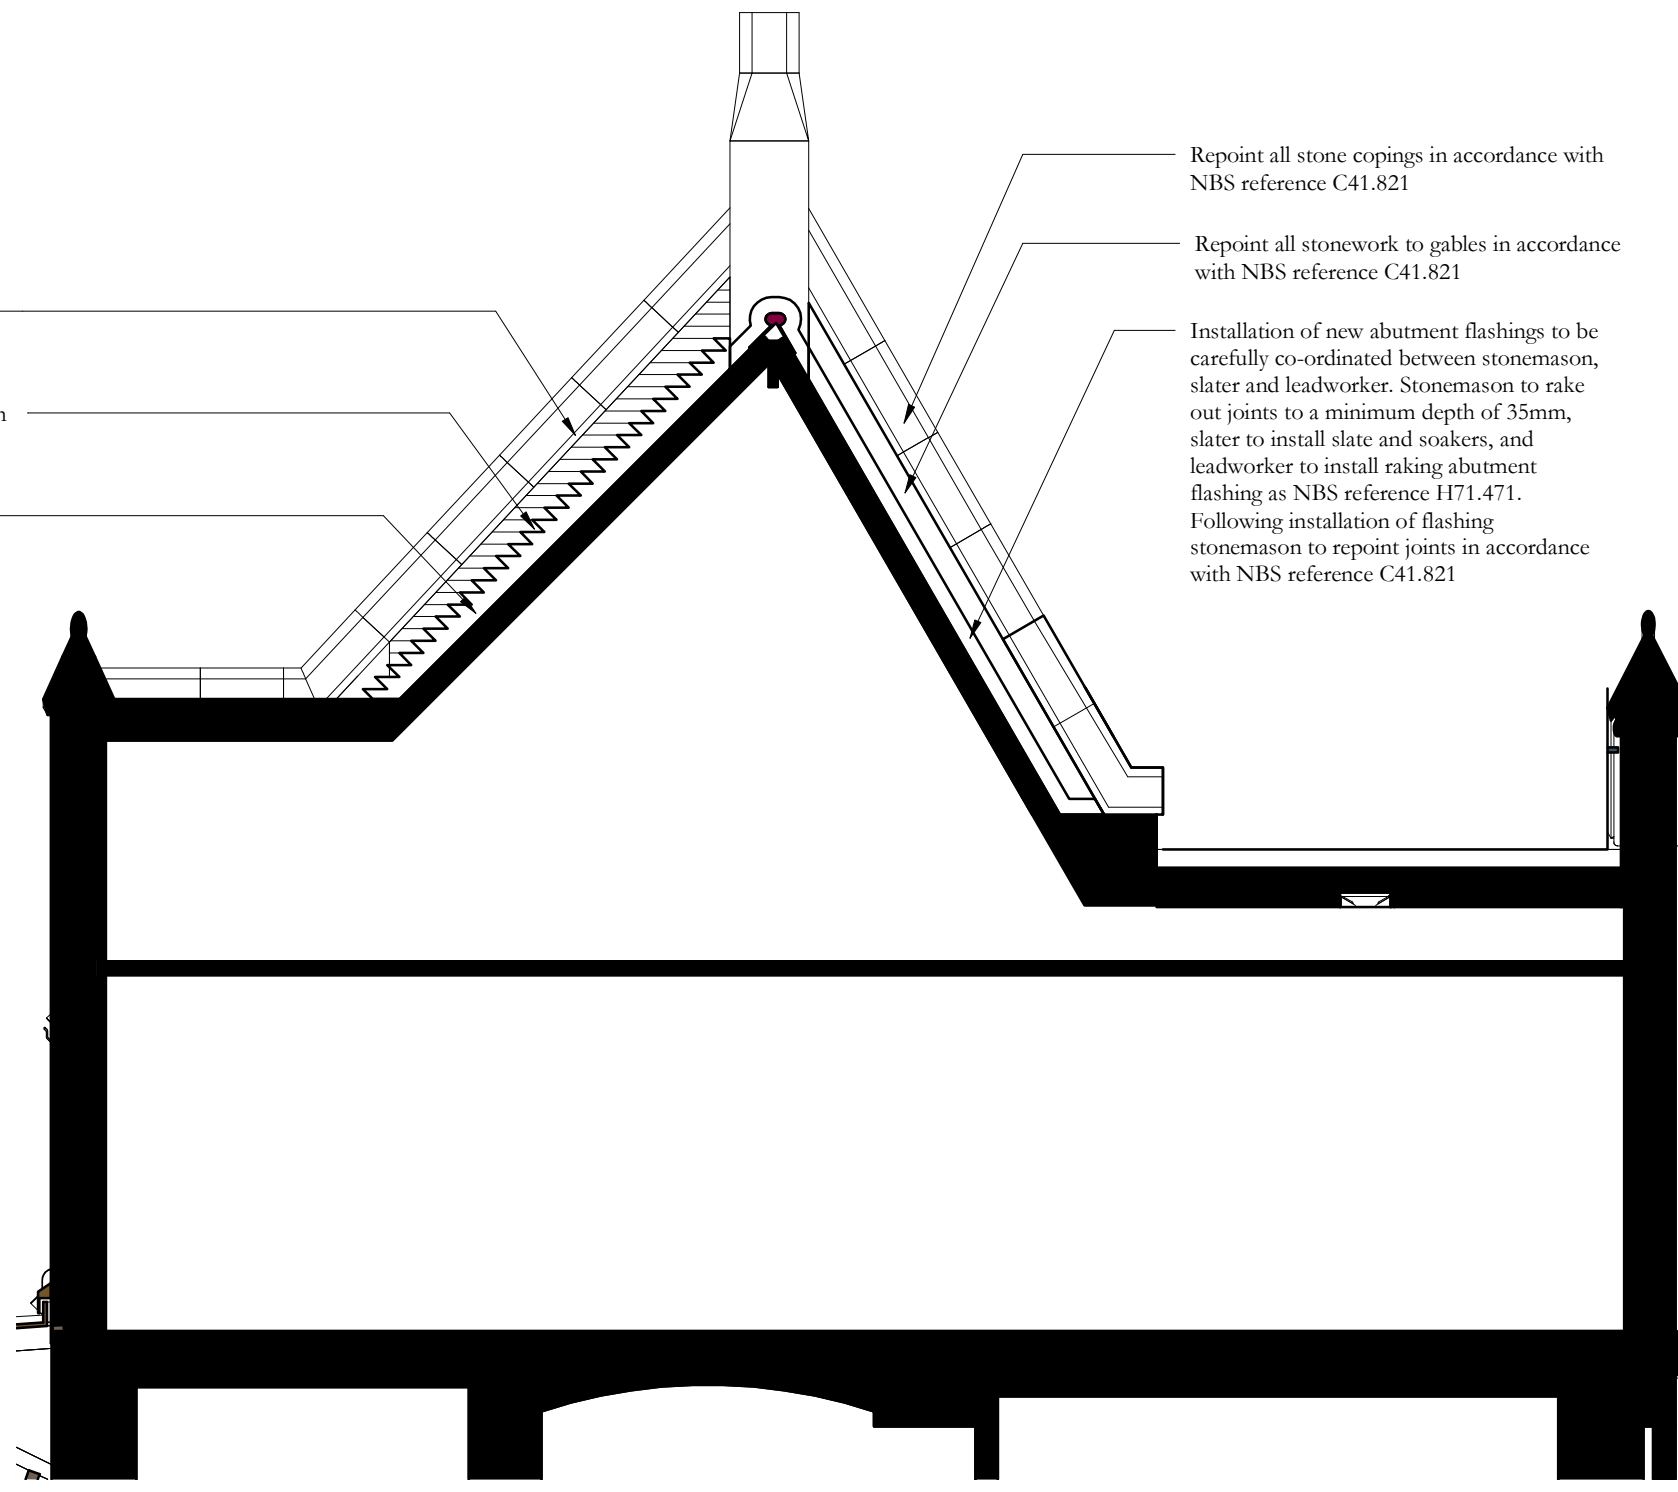


Section BF
1 : 50

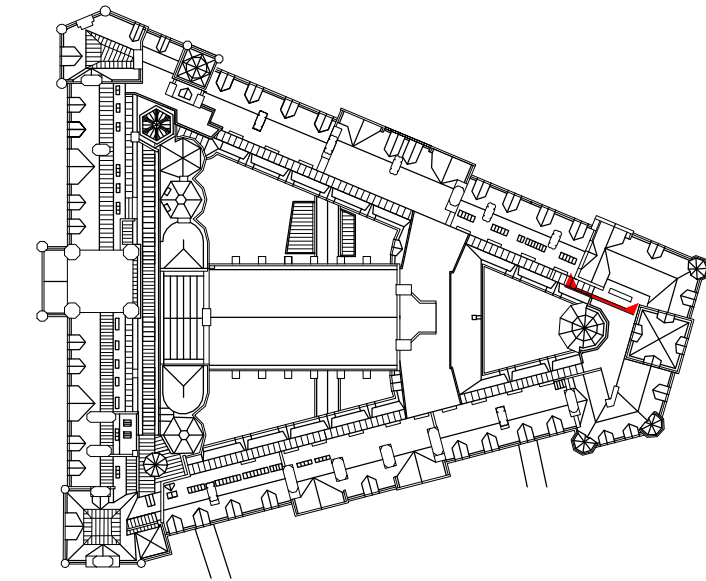


Key plan_Section BG

See Purcell drawing OTH-PUR-EX-ZZ-DWG-A-4101 for details

Ventilated perimeter detail to lead flat roof as NBS reference H71.762

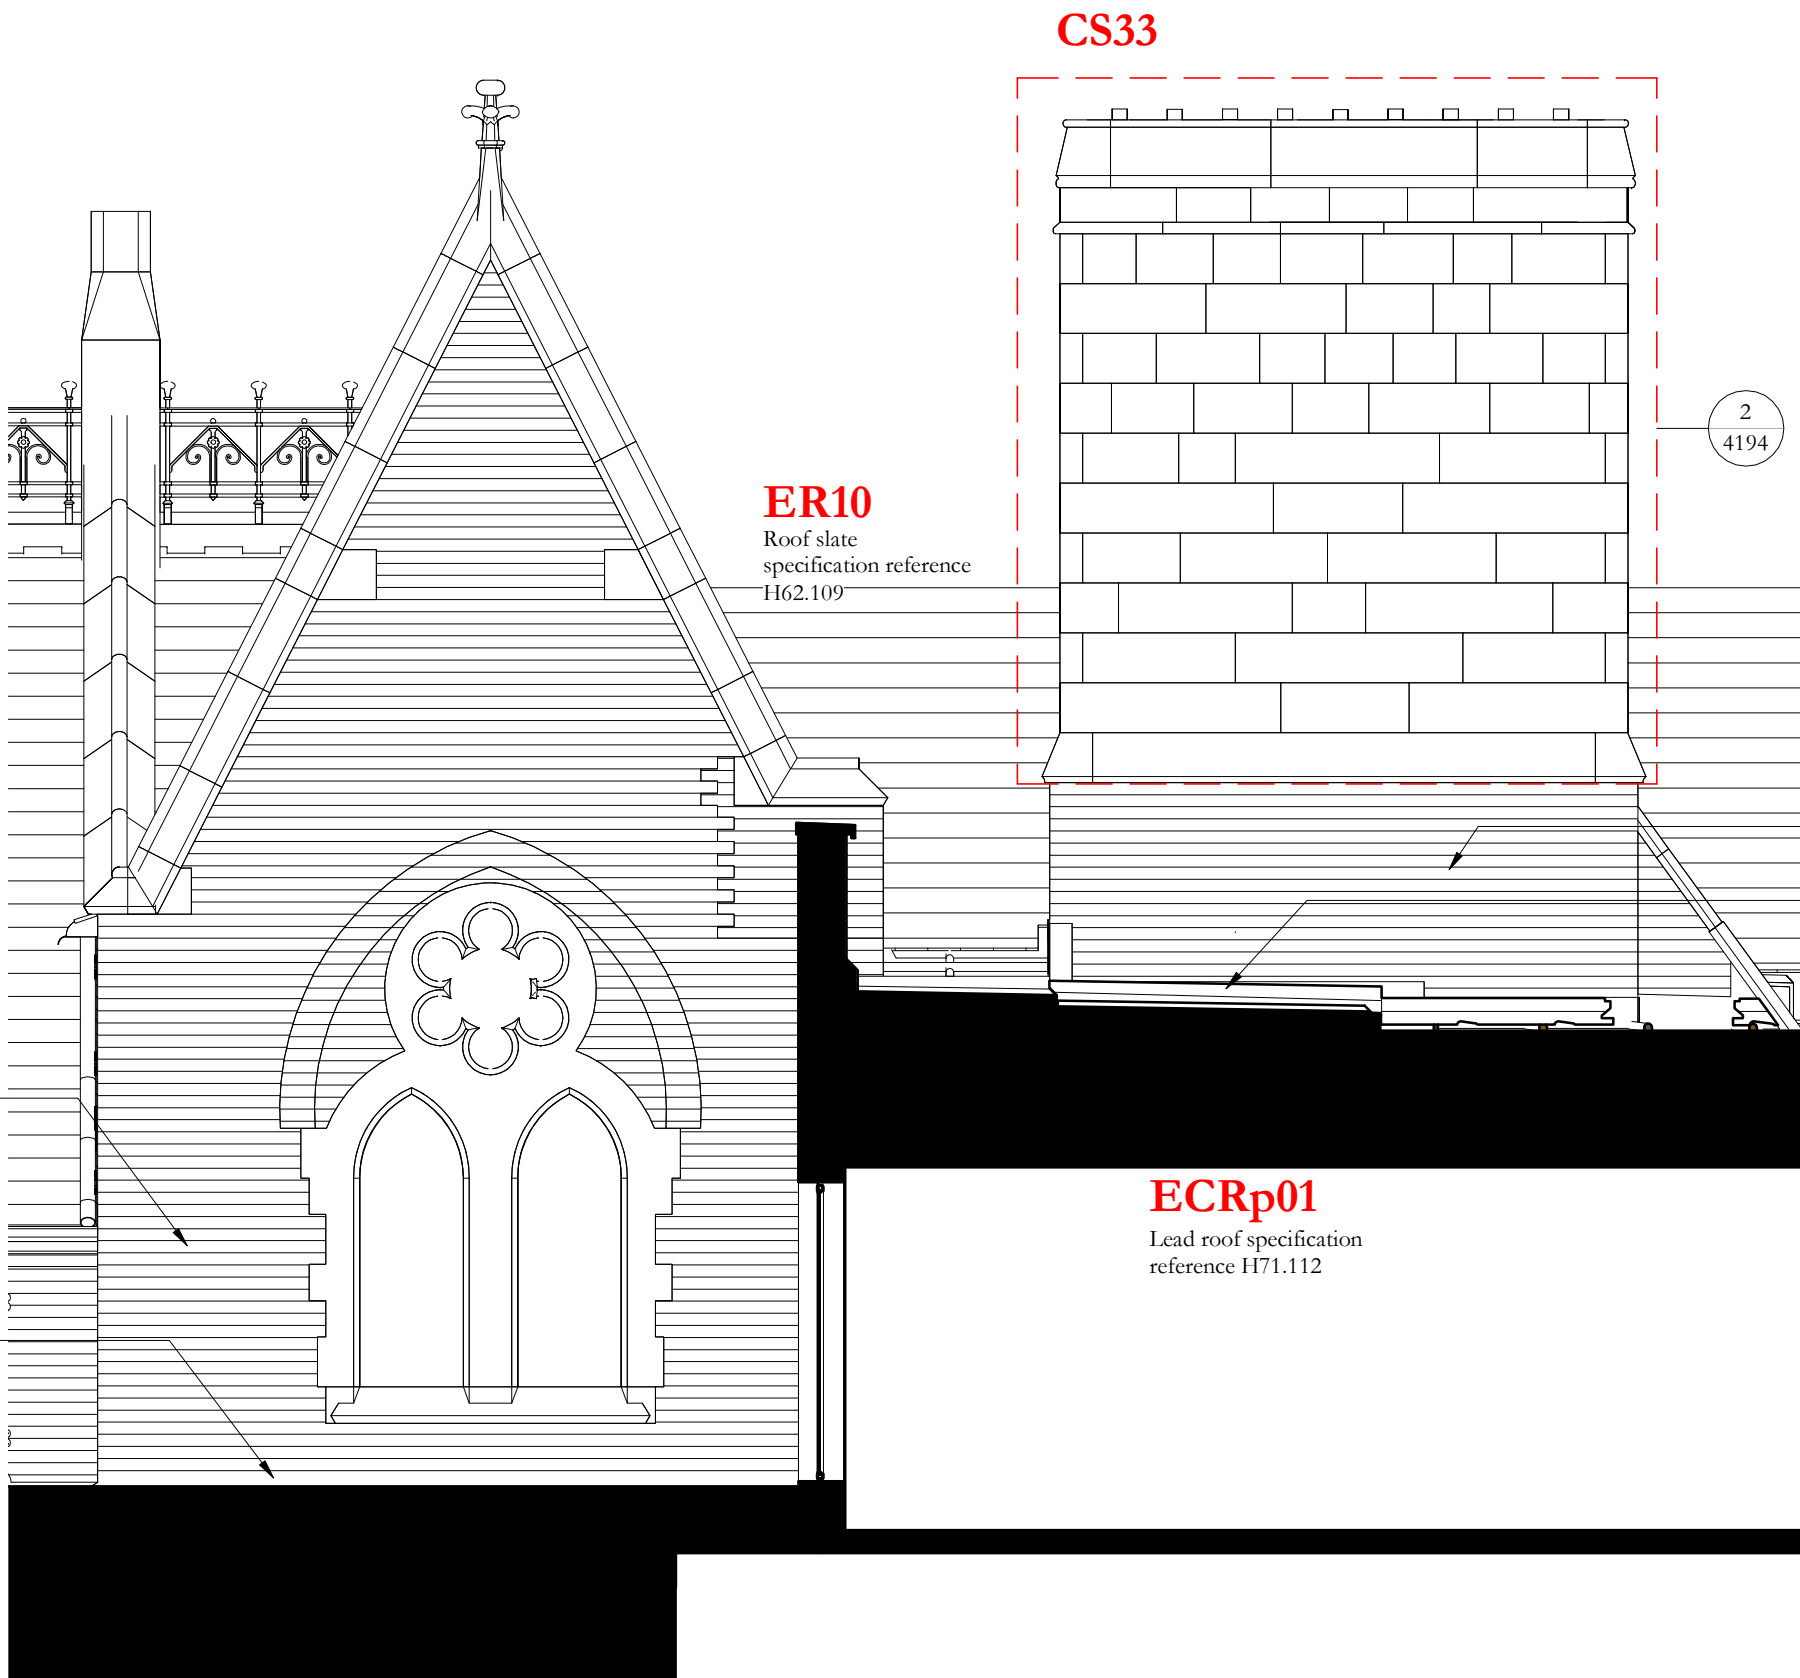


Section BG
1 : 50

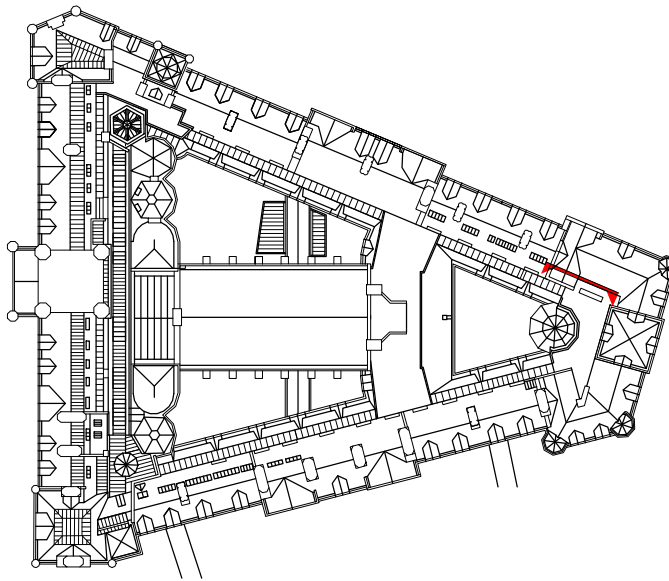

Key plan_Section BH

Repoint all facing brick to gables in accordance with NBS reference C41.822

Ventilated perimeter detail to lead flat roof as NBS reference H71.762

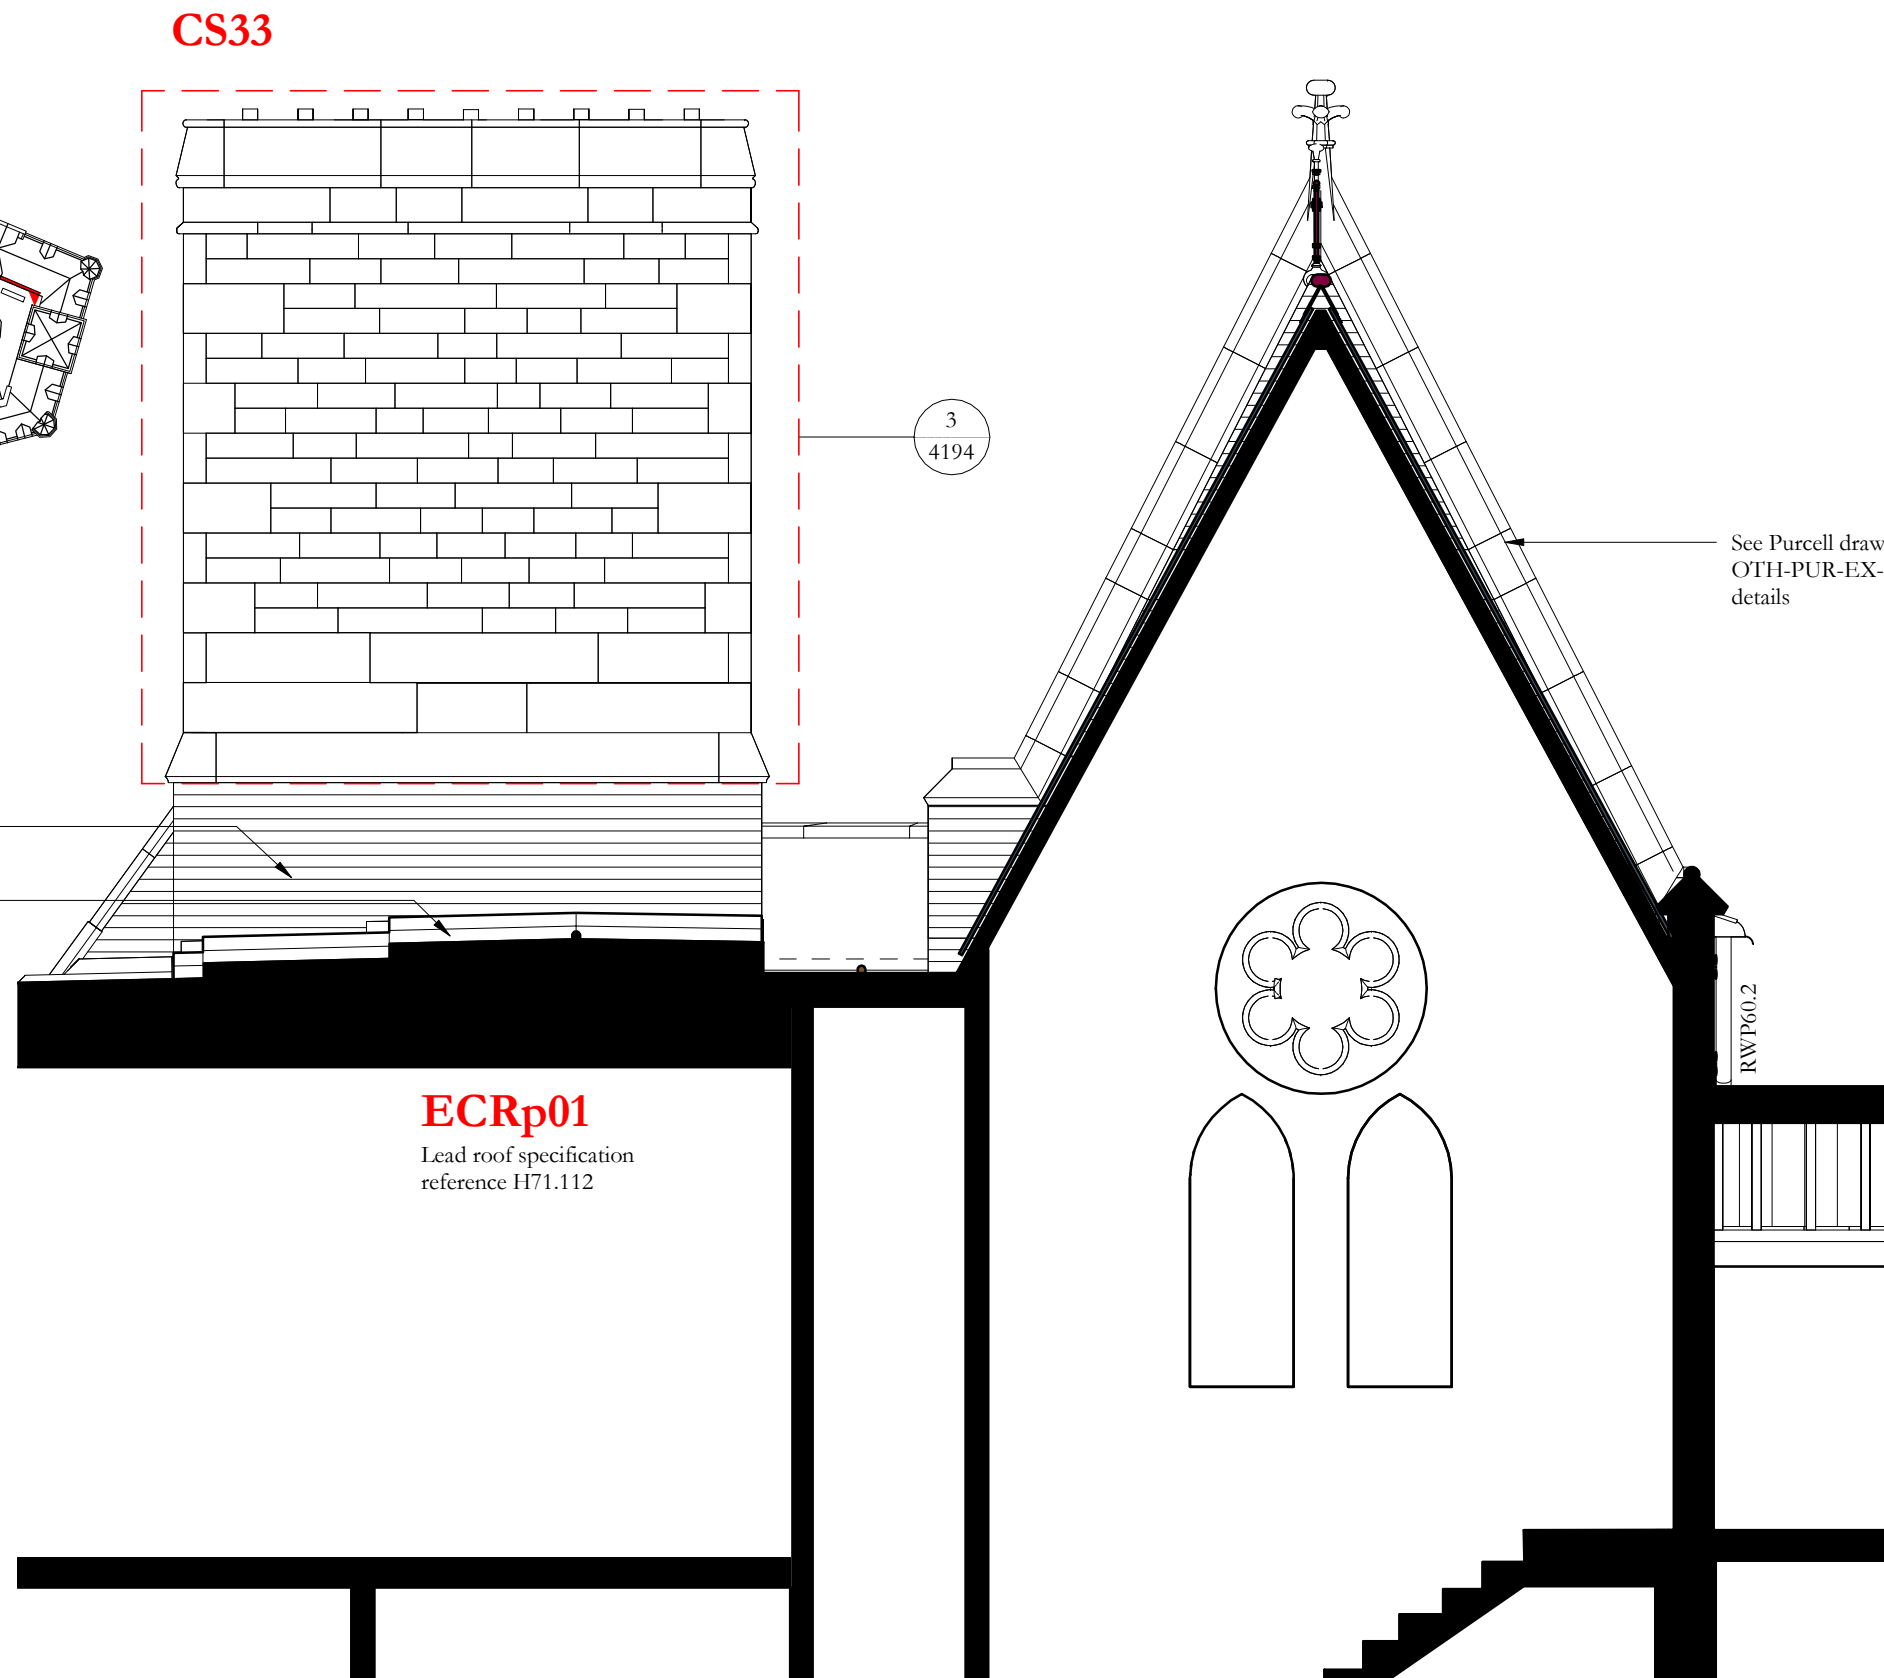

Section BH
1 : 50

Scale Bars to be used as guidance only - refer to sheet size below									
1:100	mm	1000	2000	3000	4000	5000	6000	7000	8000
1:200	mm	1000	2000	3000	4000	5000	6000	7000	8000
1:500	m	5	10	15	20	25	30	35	40
1:1250	m	10	20	30	40	50	60	70	80

Notes:
Drawings are based on survey data and may not accurately represent what is physically present.
Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.
All dimensions are in millimeters unless noted otherwise.
Purcell shall be notified in writing of any discrepancies.

Revision 02:
Access hatch ER11n_Ha added to roof slope ER11n
Access hatch ER12n_Ha added to roof slope ER12n
Minor amendments to lead flat roof ECRp01

Revision 01:
Re-issued for construction no change

ISSUE	DATE	APPROVED	DRAWN	DESCRIPTION
02	12/04/2021	GR	TK	See note in revision cloud
01	07/05/2020	GR	TK	Re-issued for construction, see note in cloud
-	15/01/2020	GR	TK	First Issue



Project Office, Town Hall, MANCHESTER M60 2L1
+44 (0) 7970 097 432
www.purcelluk.com

PROJECT STATUS	Riba Stage 5
CLIENT	Manchester City Council
PROJECT	Our Town Hall
DRAWING TITLE	General Arrangement Roof Section BE, BF, BG, and BH
SIZE & SCALE	A1:As indicated
DRAWING STATUS	S4 Construction

JOB NUMBER 236959

DRAWING NO. REV

OTH-PUR-TH-RF-DWG-A-4386 02

© PURCELL 2019. PURCELL ® IS THE TRADING NAME OF PURCELL ARCHITECTURE LTD.