


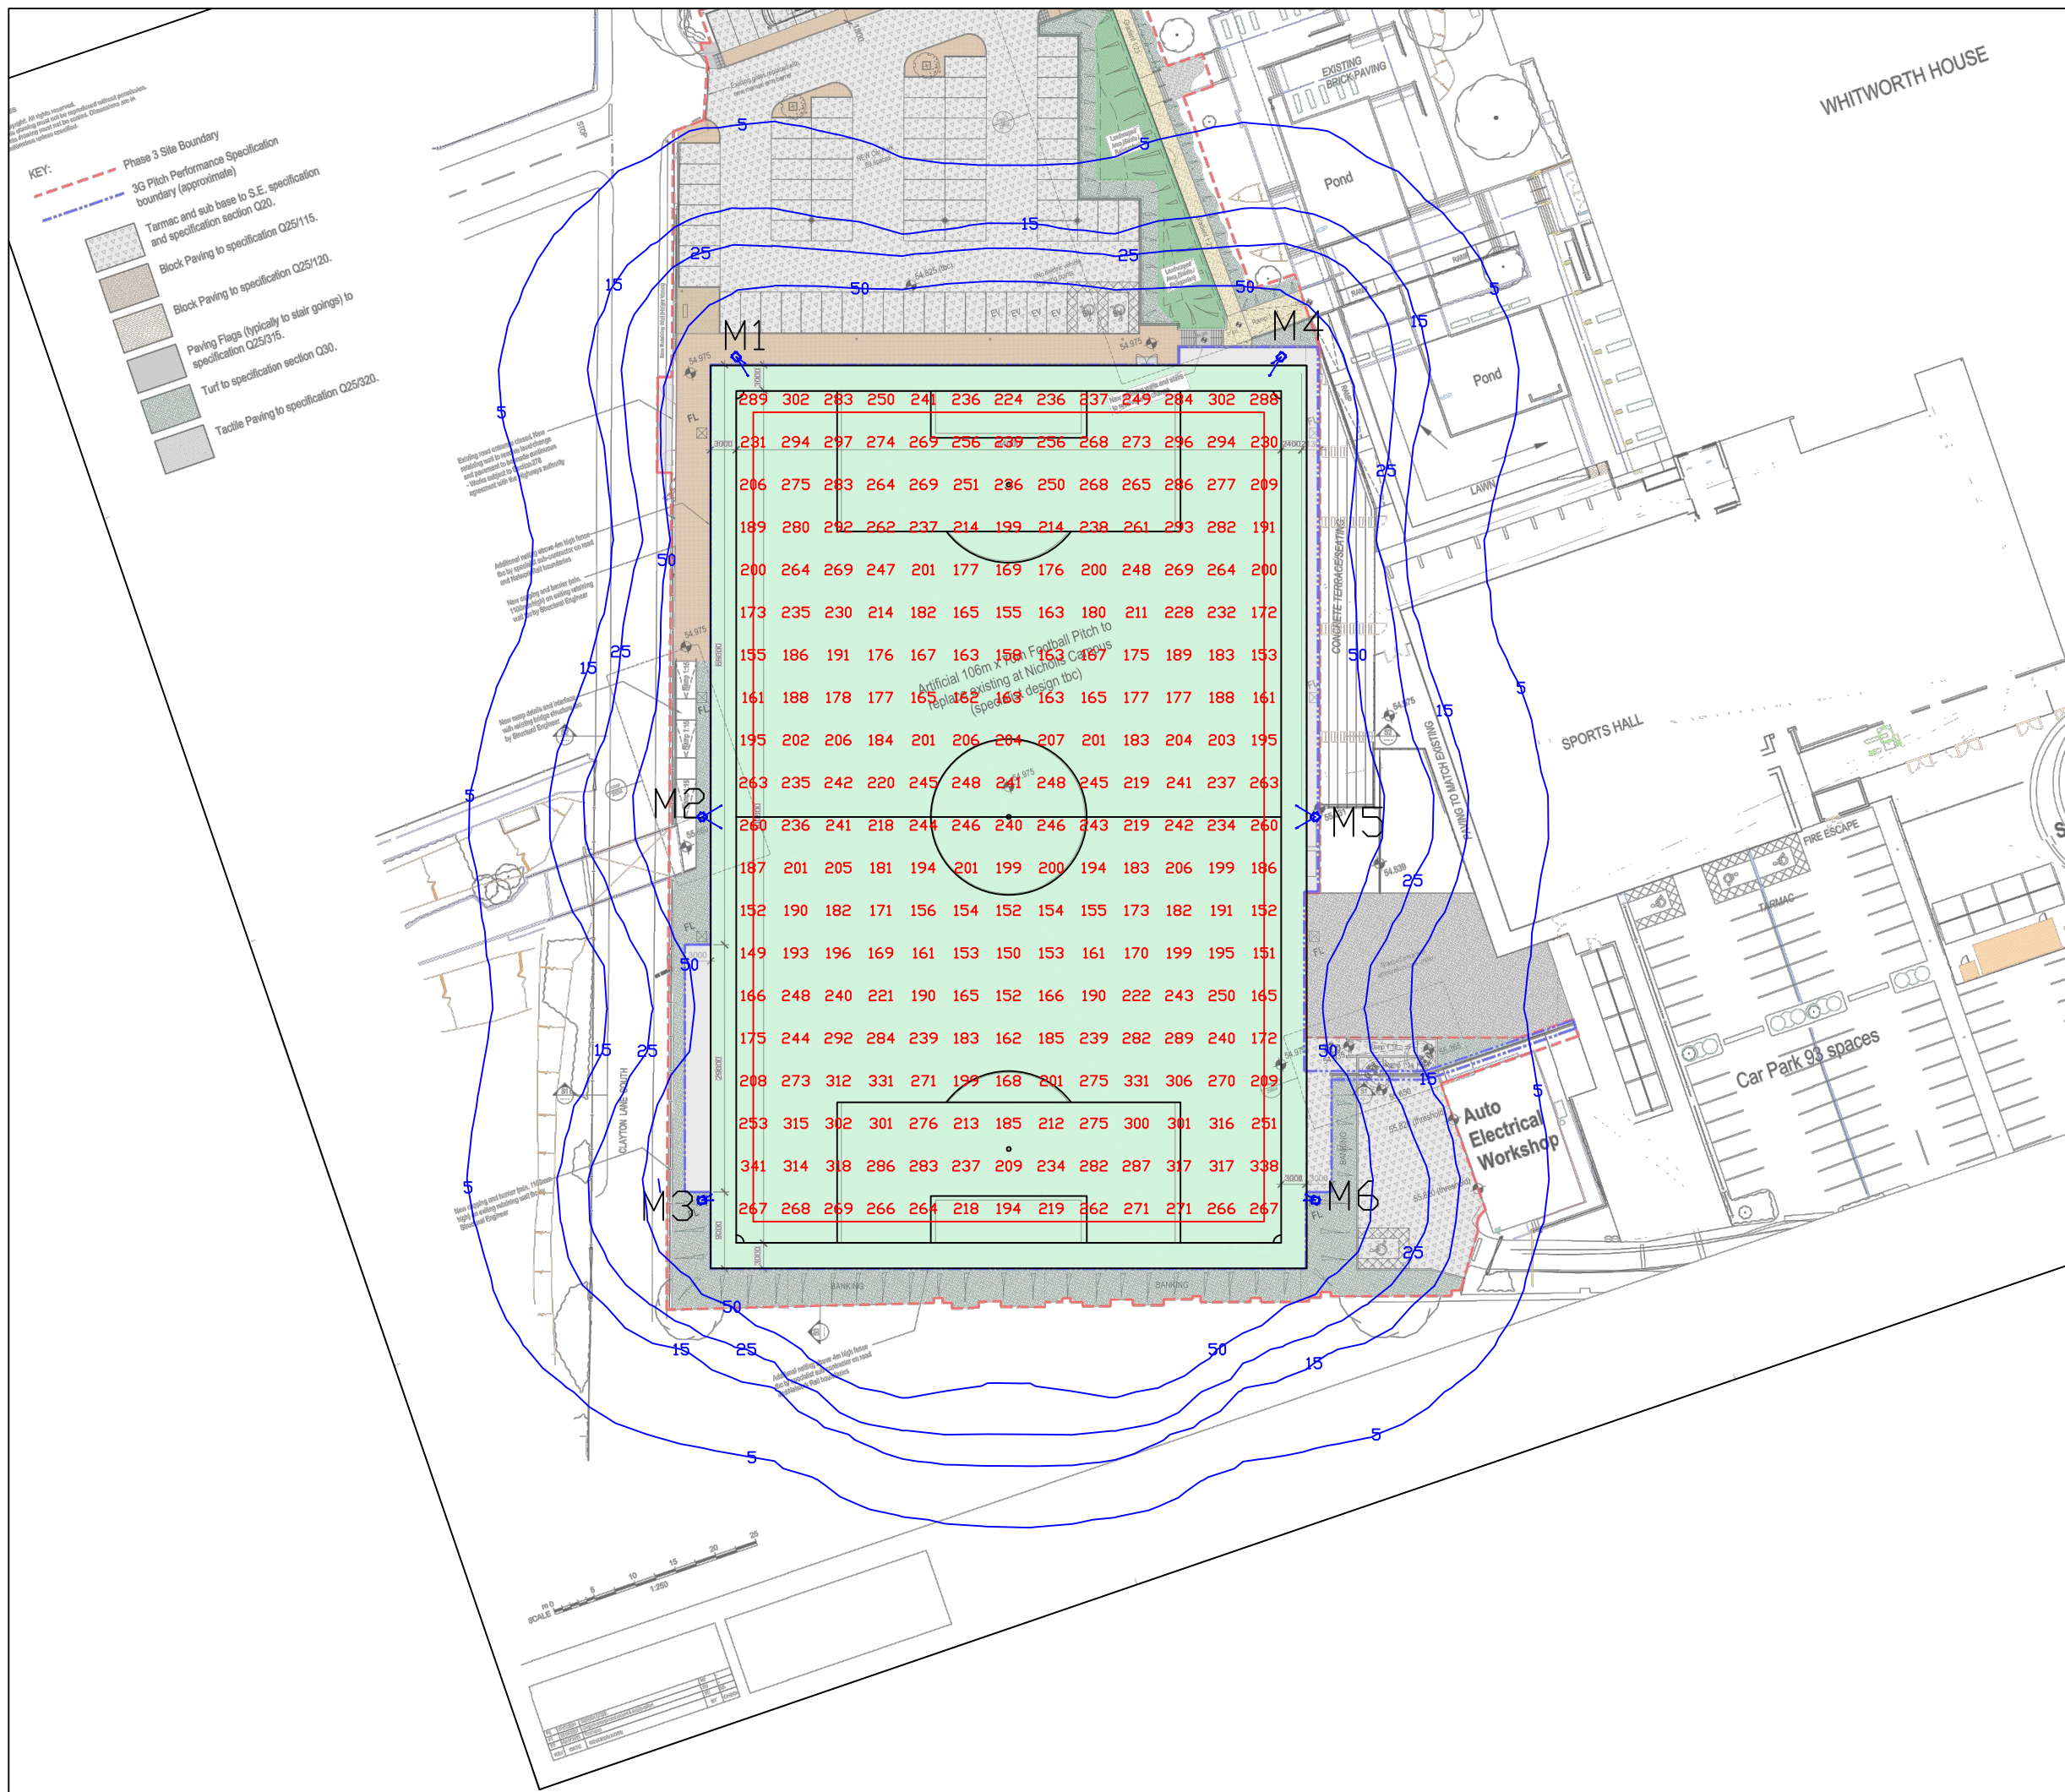

Notes

Floodlighting Equipment
6 x 15m Masts (M1-M6)
Each carrying the following Floodlights :-
M1-M6
.....2 x SITECO FL11 MAXI PL33T

Lamps = SITECO LED - 170,000 Lumen

Illuminance Levels
Initial -
(100hrs) E.i.ave = 225Lux
Maintained -
(4000hrs) E.i.ave = 214Lux
Uniformity
Emin/Eave = 0.66

Grid values in Lux(initial).
Grid interval = 5m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.95

HALLIDAY LIGHTING

www.halliday-lighting.co.uk

Project

Manchester College

Drawing Title

Proposed floodlighting

Drawn By (print)

JM

Date

02/02/2022

Project No

2948

Scale

1:750 @ A3

Drawing No

HLS2948

Status

Proposal