


Health & Safety Notes

- Contractor must ensure that all work on site is carried out in a safe & satisfactory manner, in accordance with Health & Safety At Work Act 1974, COSHH Regulations 2002 & requirements of C.D.M

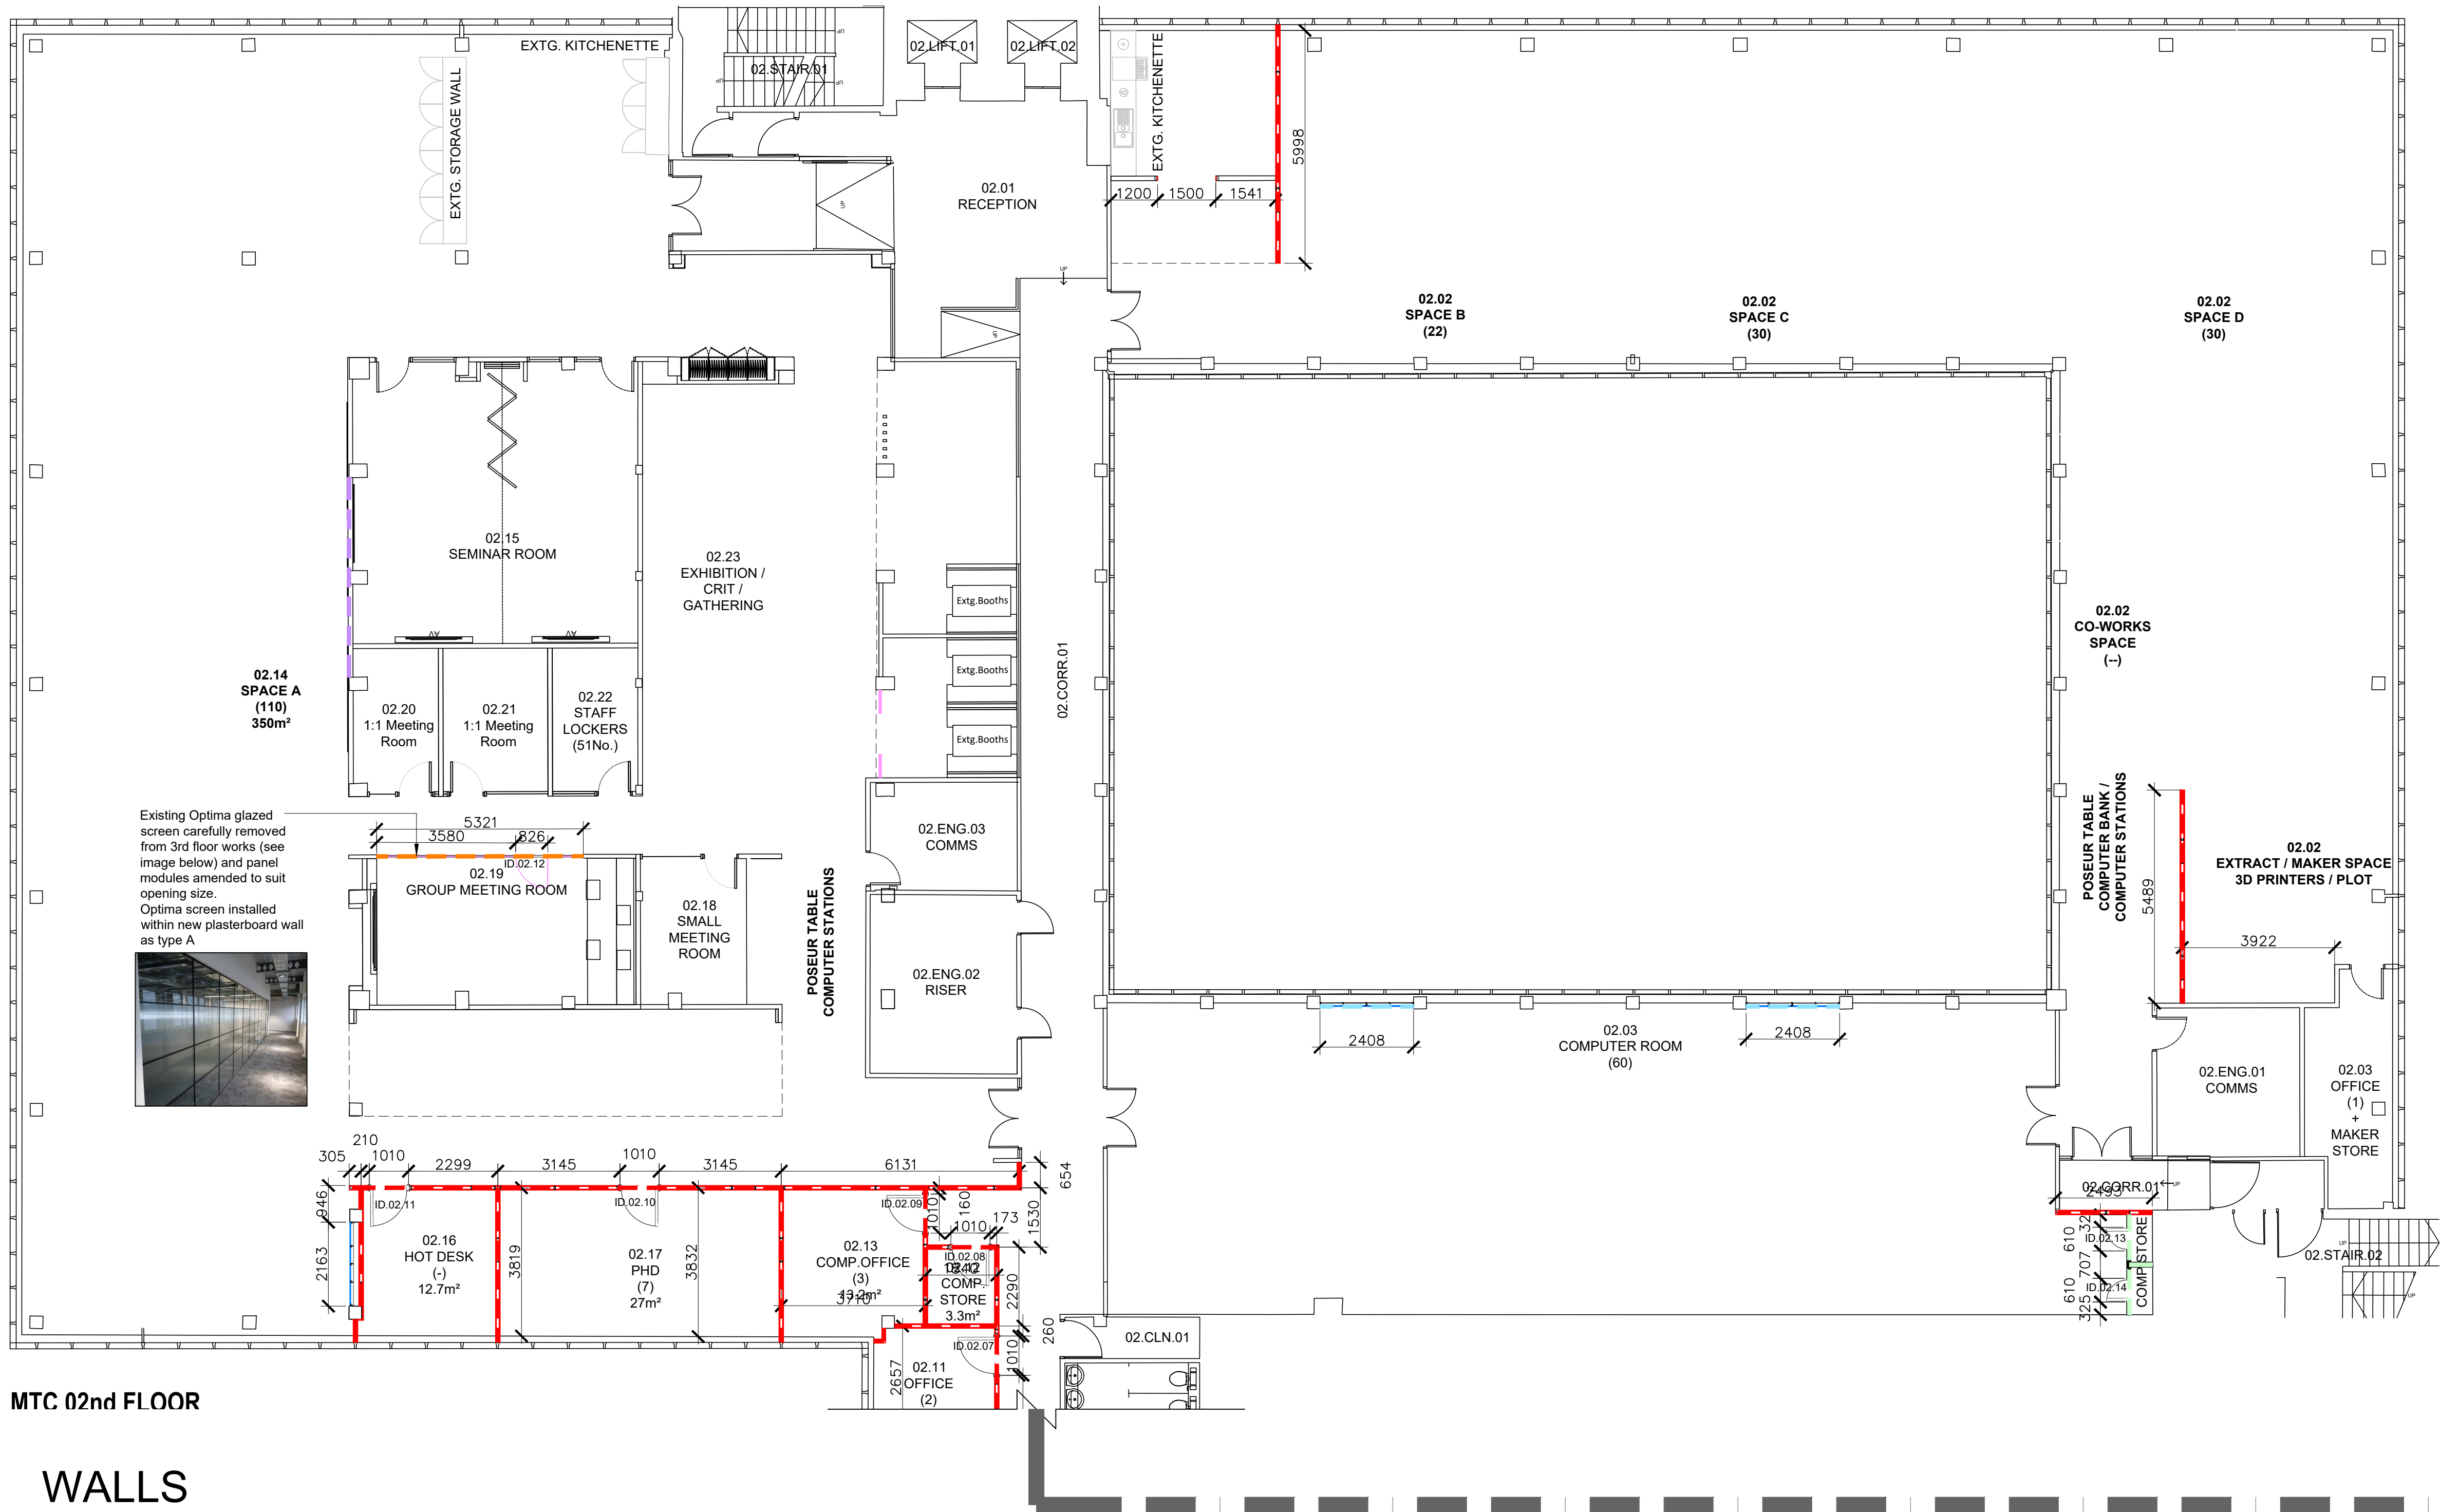

MTC 02nd FLOOR

WALLS


- Wall Type A**
New 122mm wide internal partition wall to be 70mm Gyproframe "C" studs at 600mm centres built off Gyproc Floor Channels, lined with 2no. layers of 12.5mm thk Gyproc SoundBloc to each side, to receive skim finish and painted.
NBS: K10/125
- Wall Type B**
New 95mm wide internal partition wall to be 75x50mm SW timber stud frame at 600mm centres, lined 1 side only with 1no. layer of 12mm Plywood and 1no. outer layer of 12.5mm thk Gyproc Wallboard, to receive skim finish and painted.
NBS: K10/205
- Wall Type C**
New 75x50mm SW timber stud frame lined with single layer 15mm MDF, primed and painted.
NBS: K10/206
- Wall Type D**
Re-used and adapted Optima Shoreditch glass partition system and integral swing door. Wall opening to be adapted with Wall Type A as appropriate to meet structural opening required (Opening to be confirmed on site). Fixings to be in accordance with manufacturers recommendations.
- Wall Type E - Wall Pattressing**
Remove existing lining and provide 15mm MDF pattress lining between studs to accommodate client equipment. Loading requirement and pattressing extent to be confirmed.
- Wall Type F - Secondary Glazing**
Install new secondary glazing within window opening.
NBS: L10/580

General Notes:

- All walls to be taken full height to underside of structural soffit.
- 2nd Floor Concrete Soffit - Approx 3900mm to u/s of soffit. 3300mm to u/s of concrete downstand beams
- 3rd floor Metal Deck soffit - Approx 3500mm to u/s of soffit. 3000mm to u/s of steel beams
- 3rd floor Concrete soffit - Approx 3900mm to u/s of soffit. 3300mm to u/s of concrete downstand beams
- Acoustically sealed deflection heads required to all walls -25mm Deflection allowance. See typical details
- Where walls align with existing, align studding to provide flush wall surfaces.


WALL TYPE :-

Type A:

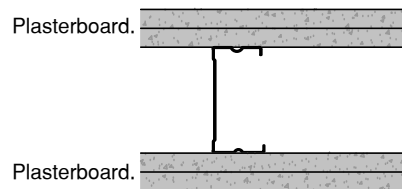



WALL TYPE :-

Type B:

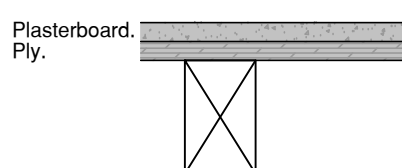

WALL TYPE :-

Type C:

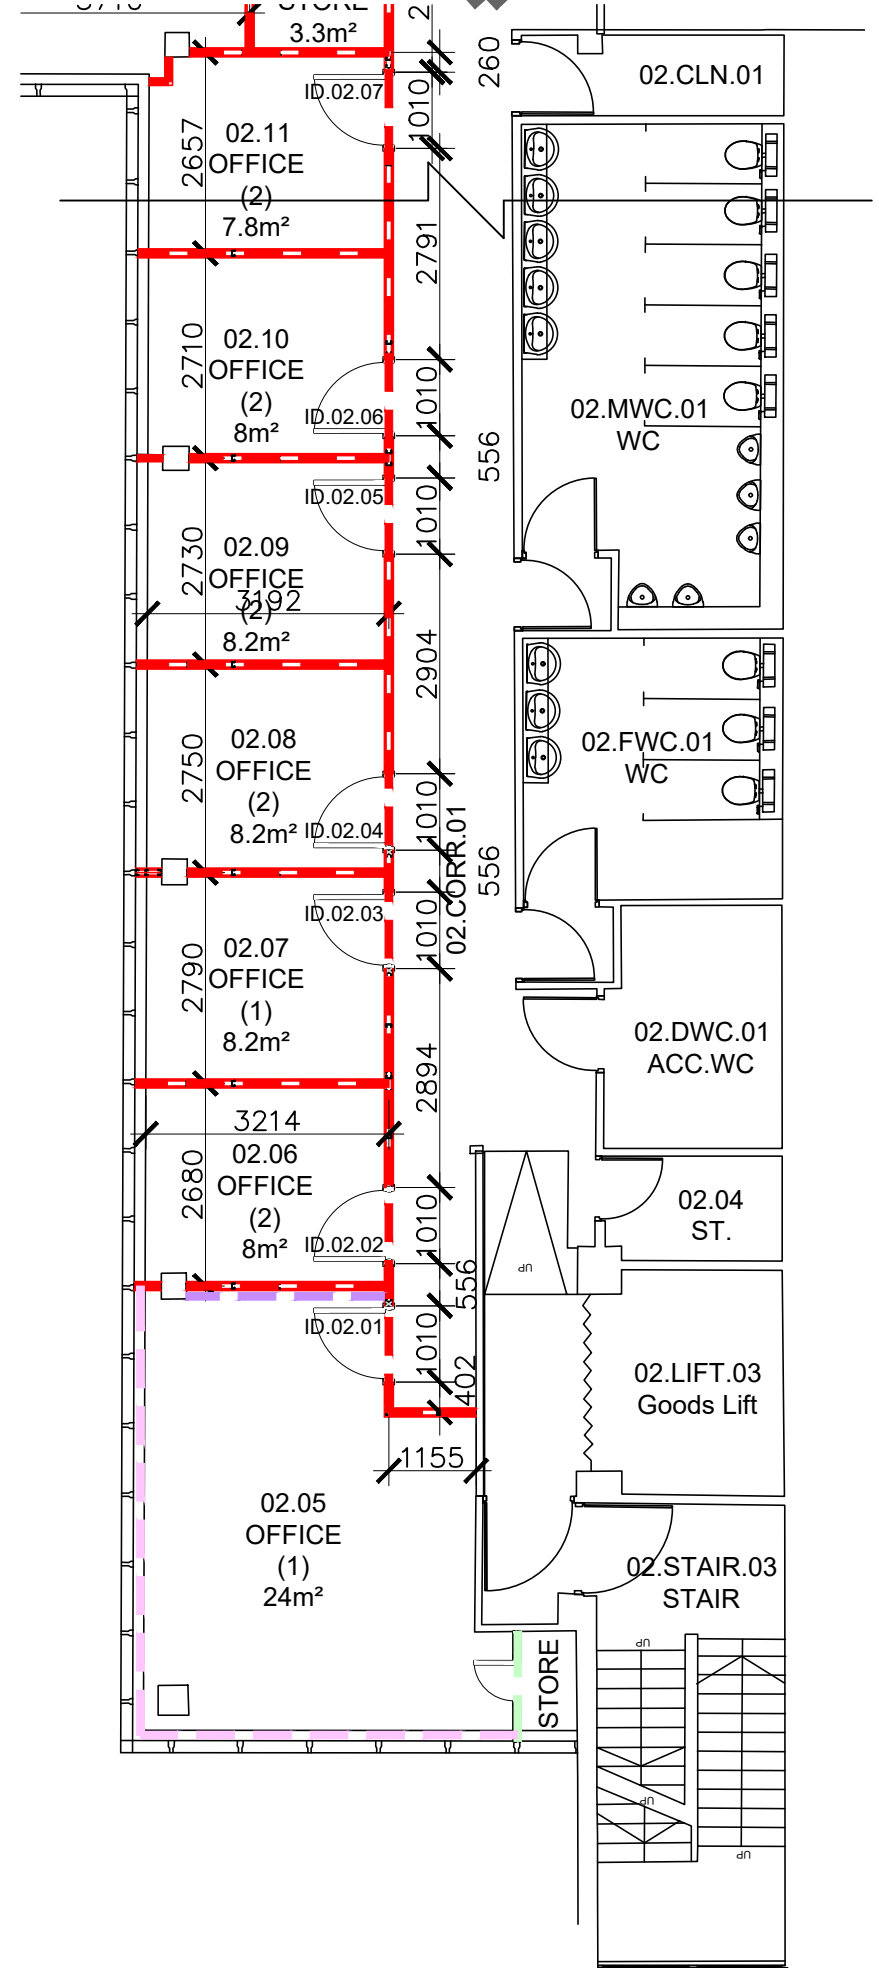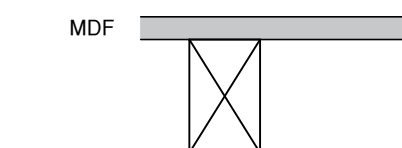

P1	Tender Issue	07.02.2022
Rev.	Description	Date
Client		
Manchester Metropolitan University		
Project		
MSA Decant Appraisal		
Drawing Title		
2nd Floor Wall Types Set Out Plan		
Drawn by	JKB	Checked by SB Date 27.01.2022
Status	D2	Scale @ A1 1:100
Job no.	11264	Dwg. no. CAA-05-02-DR-A-013002 Rev. P1
Cassidy+Ashton		
Architecture + Building Surveying + Town Planning		
7 East Cliff, Preston, Lancashire, PR1 3JE 01772 258 356		
10 Hunters Walk, Canal Street, Chester, CH1 4EB 01244 402 900		