

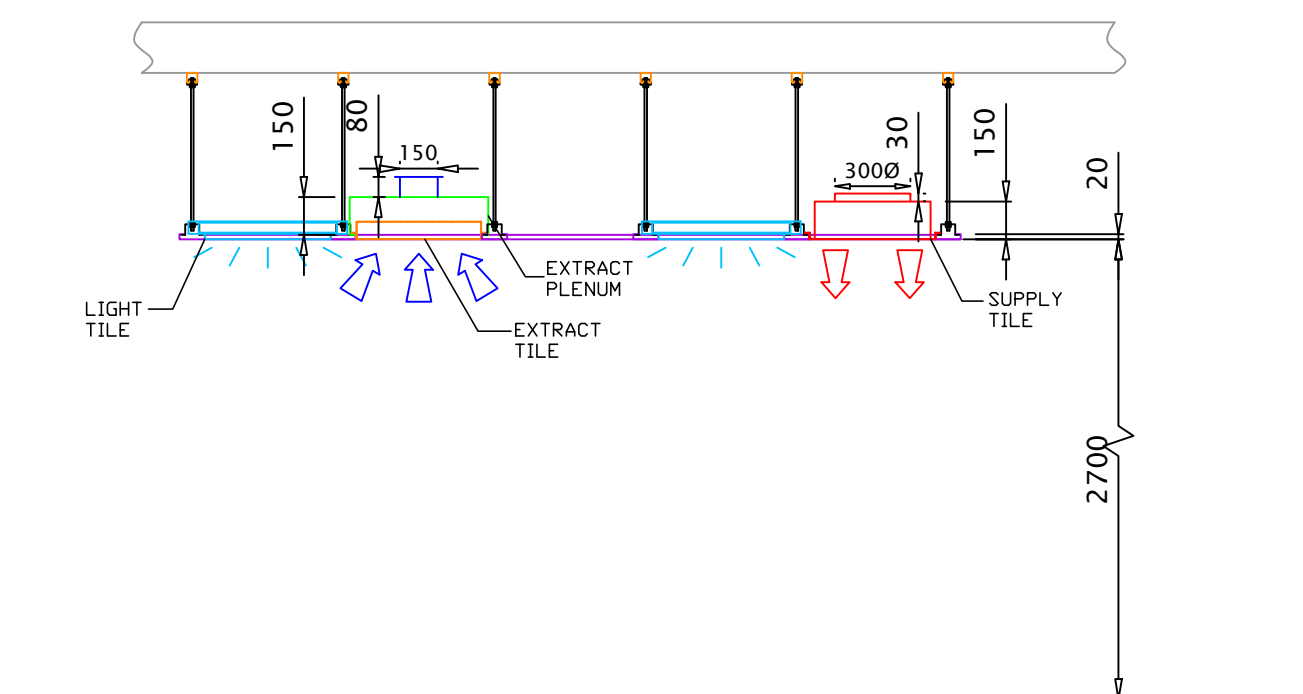
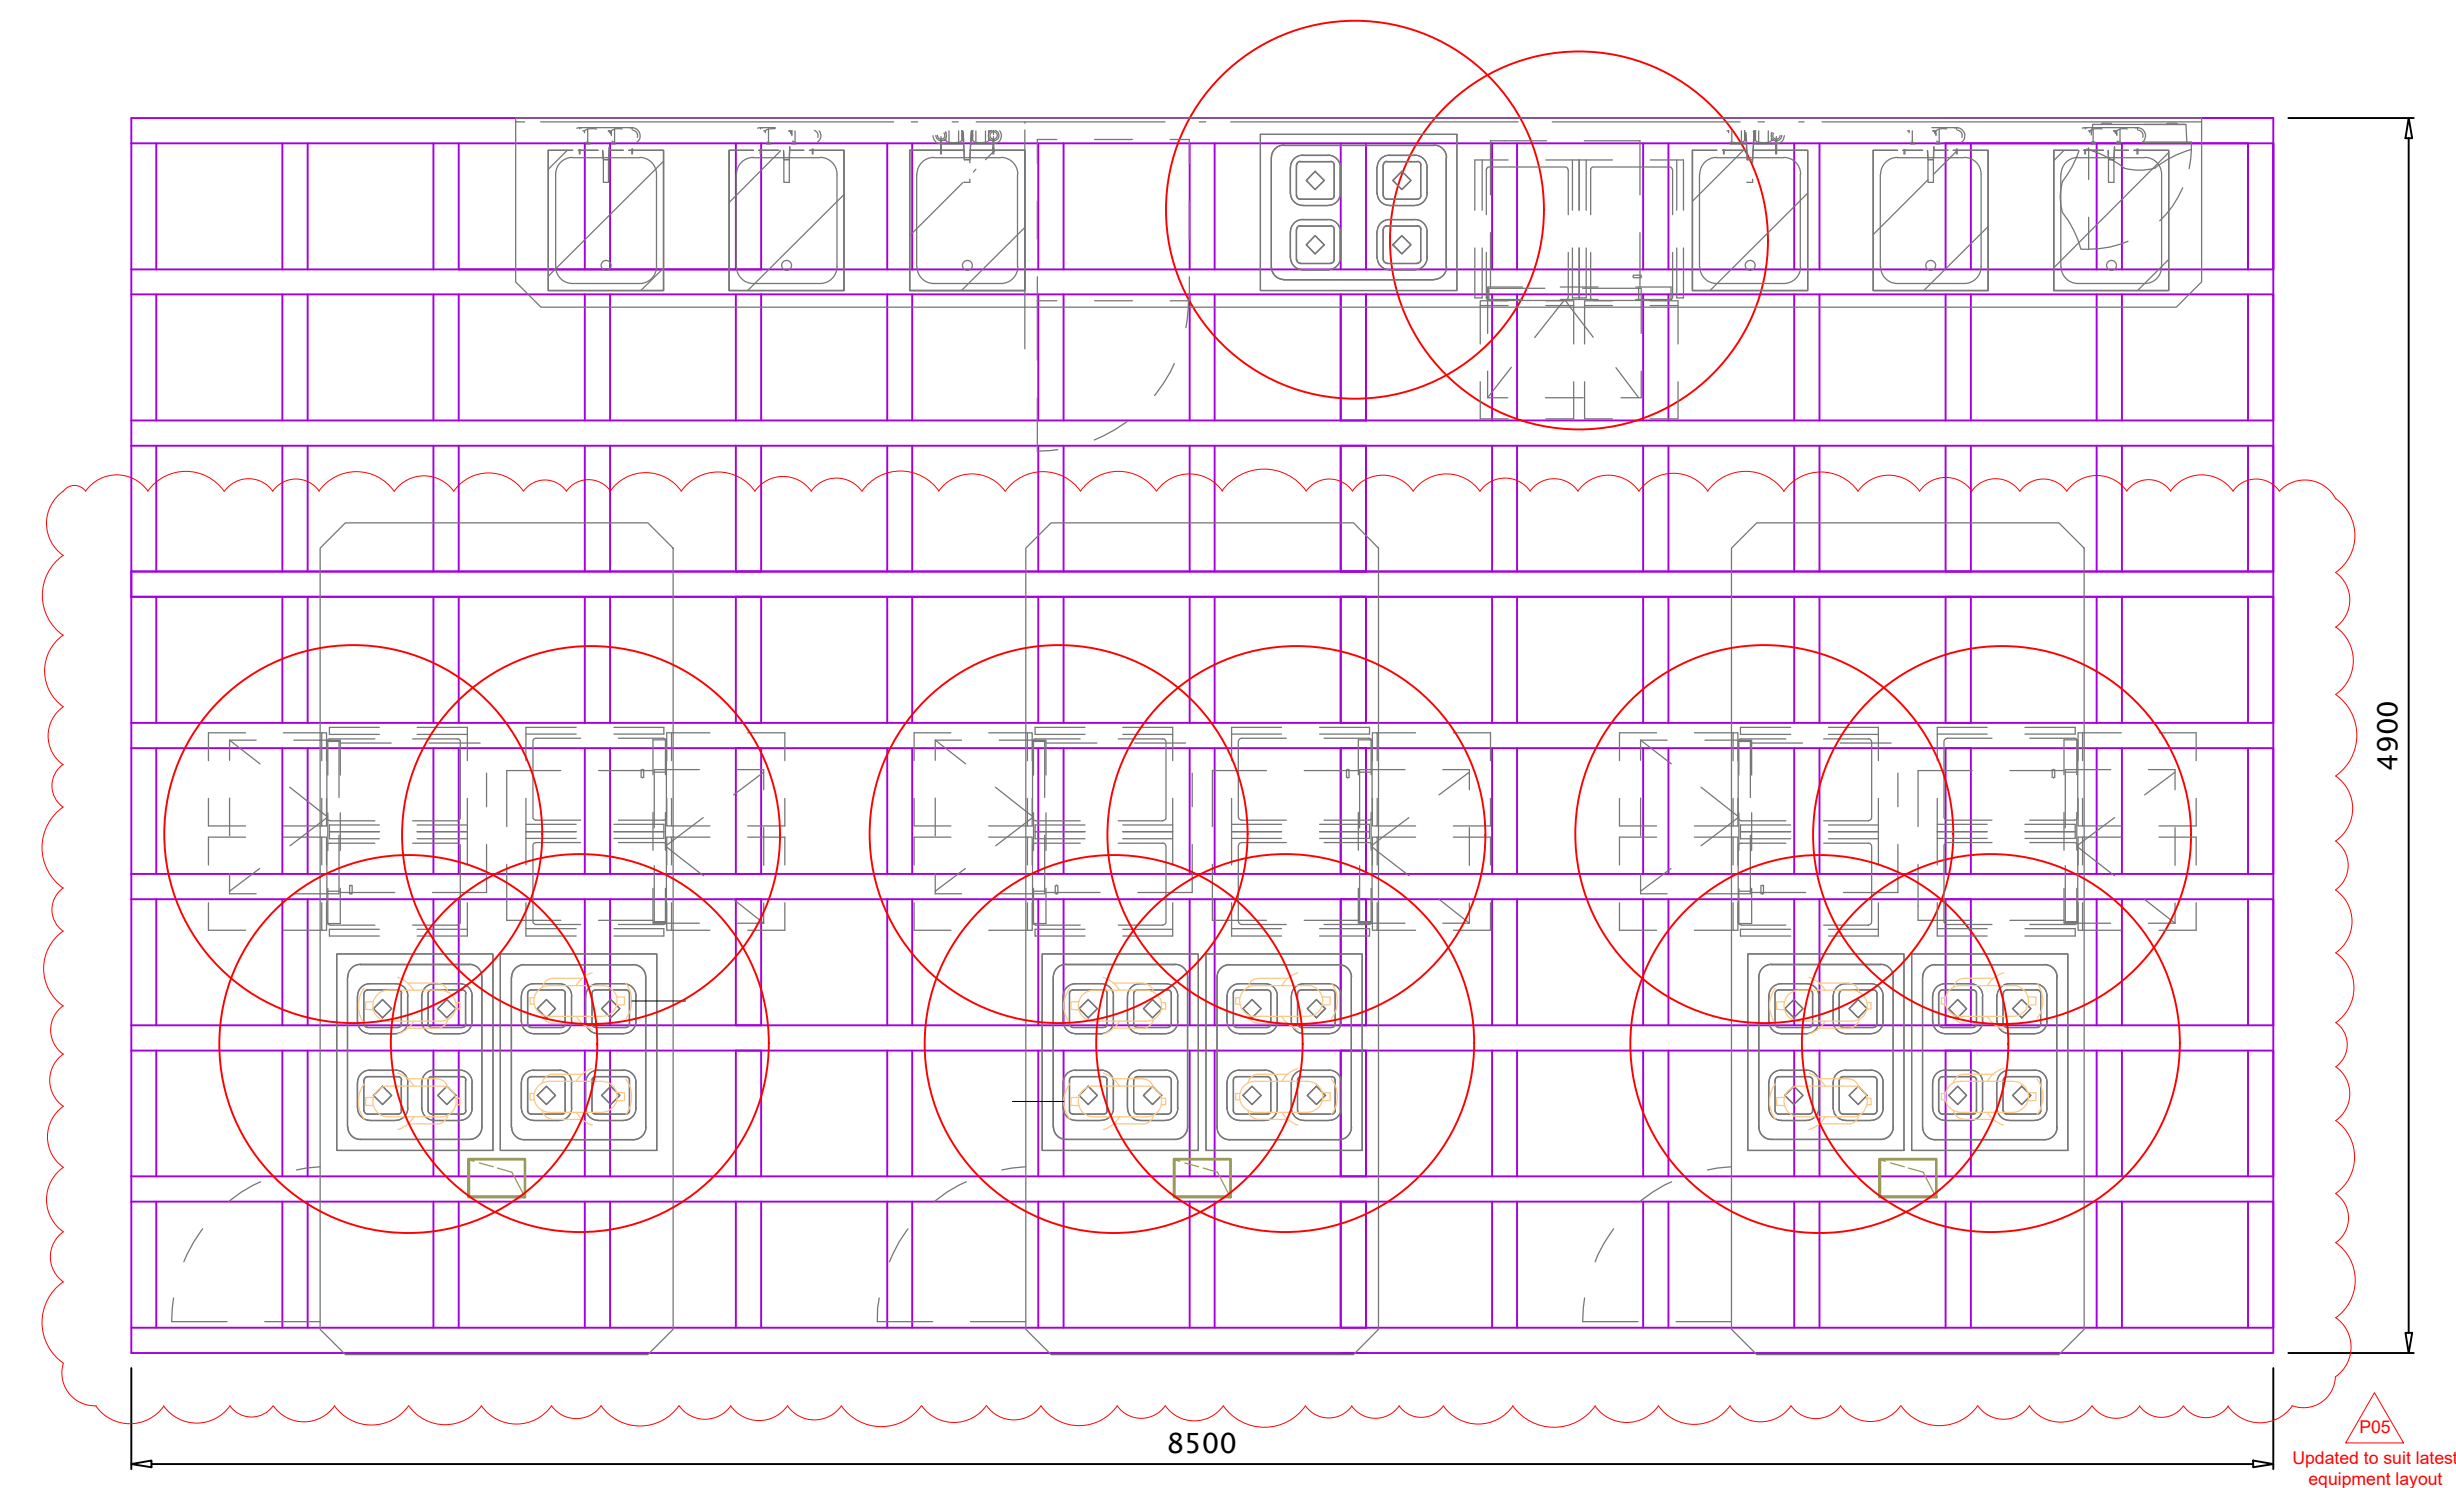






Manchester College

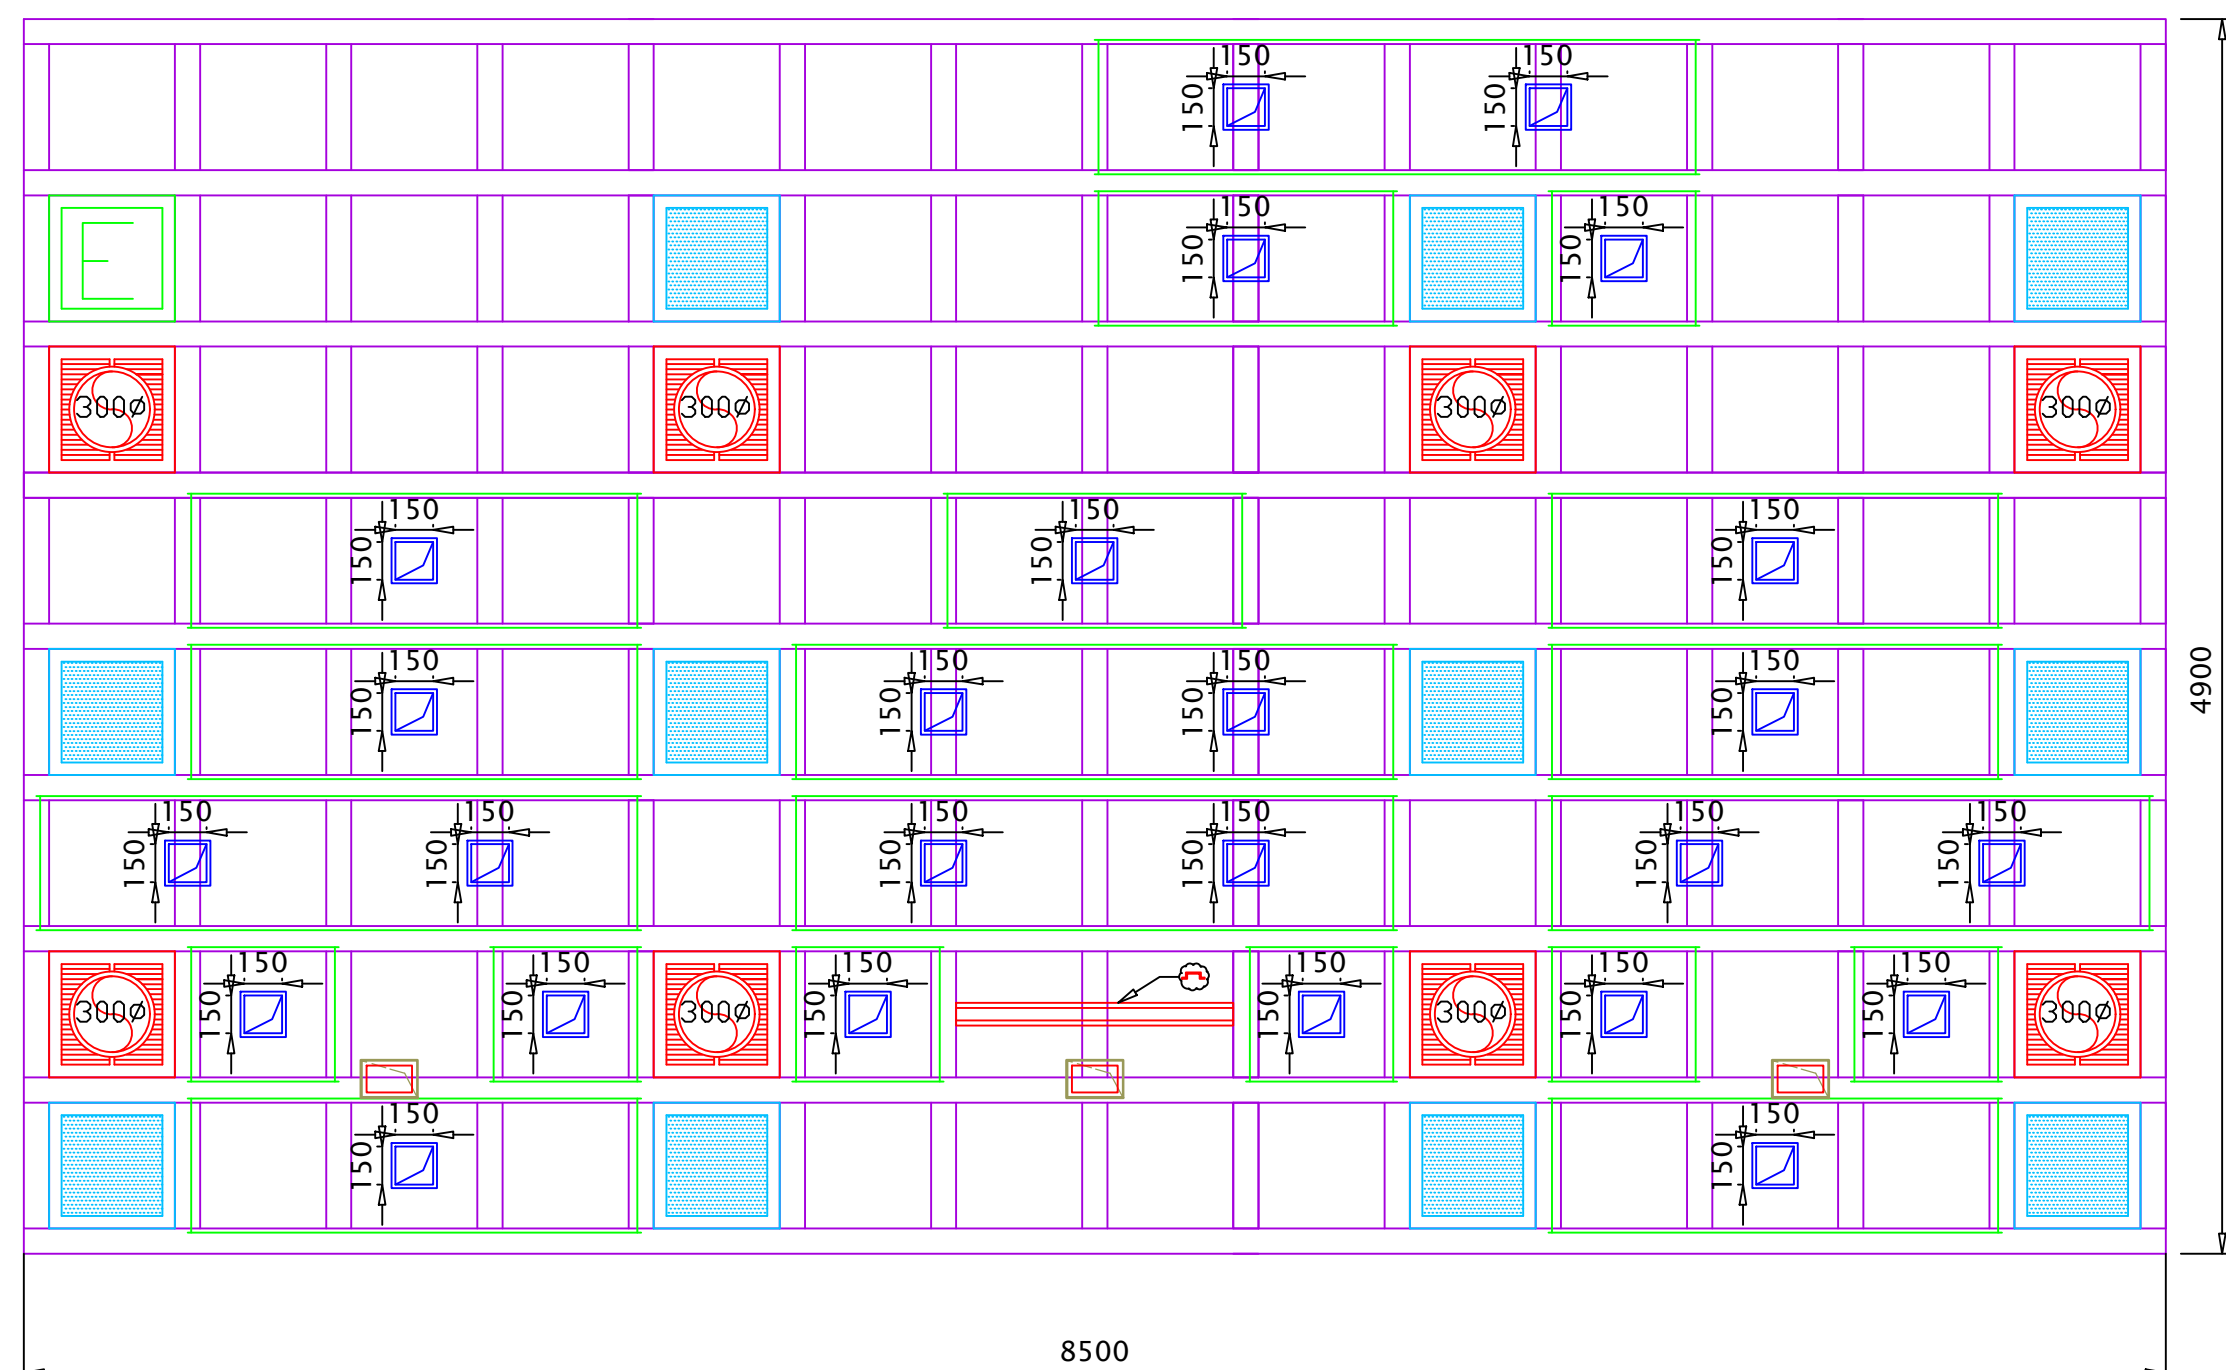

-  SUPPLY AIR TILE.
-  EXTRACT TILE.
-  LIGHTING TILE.
-  EMERGENCY LIGHTING TILE.

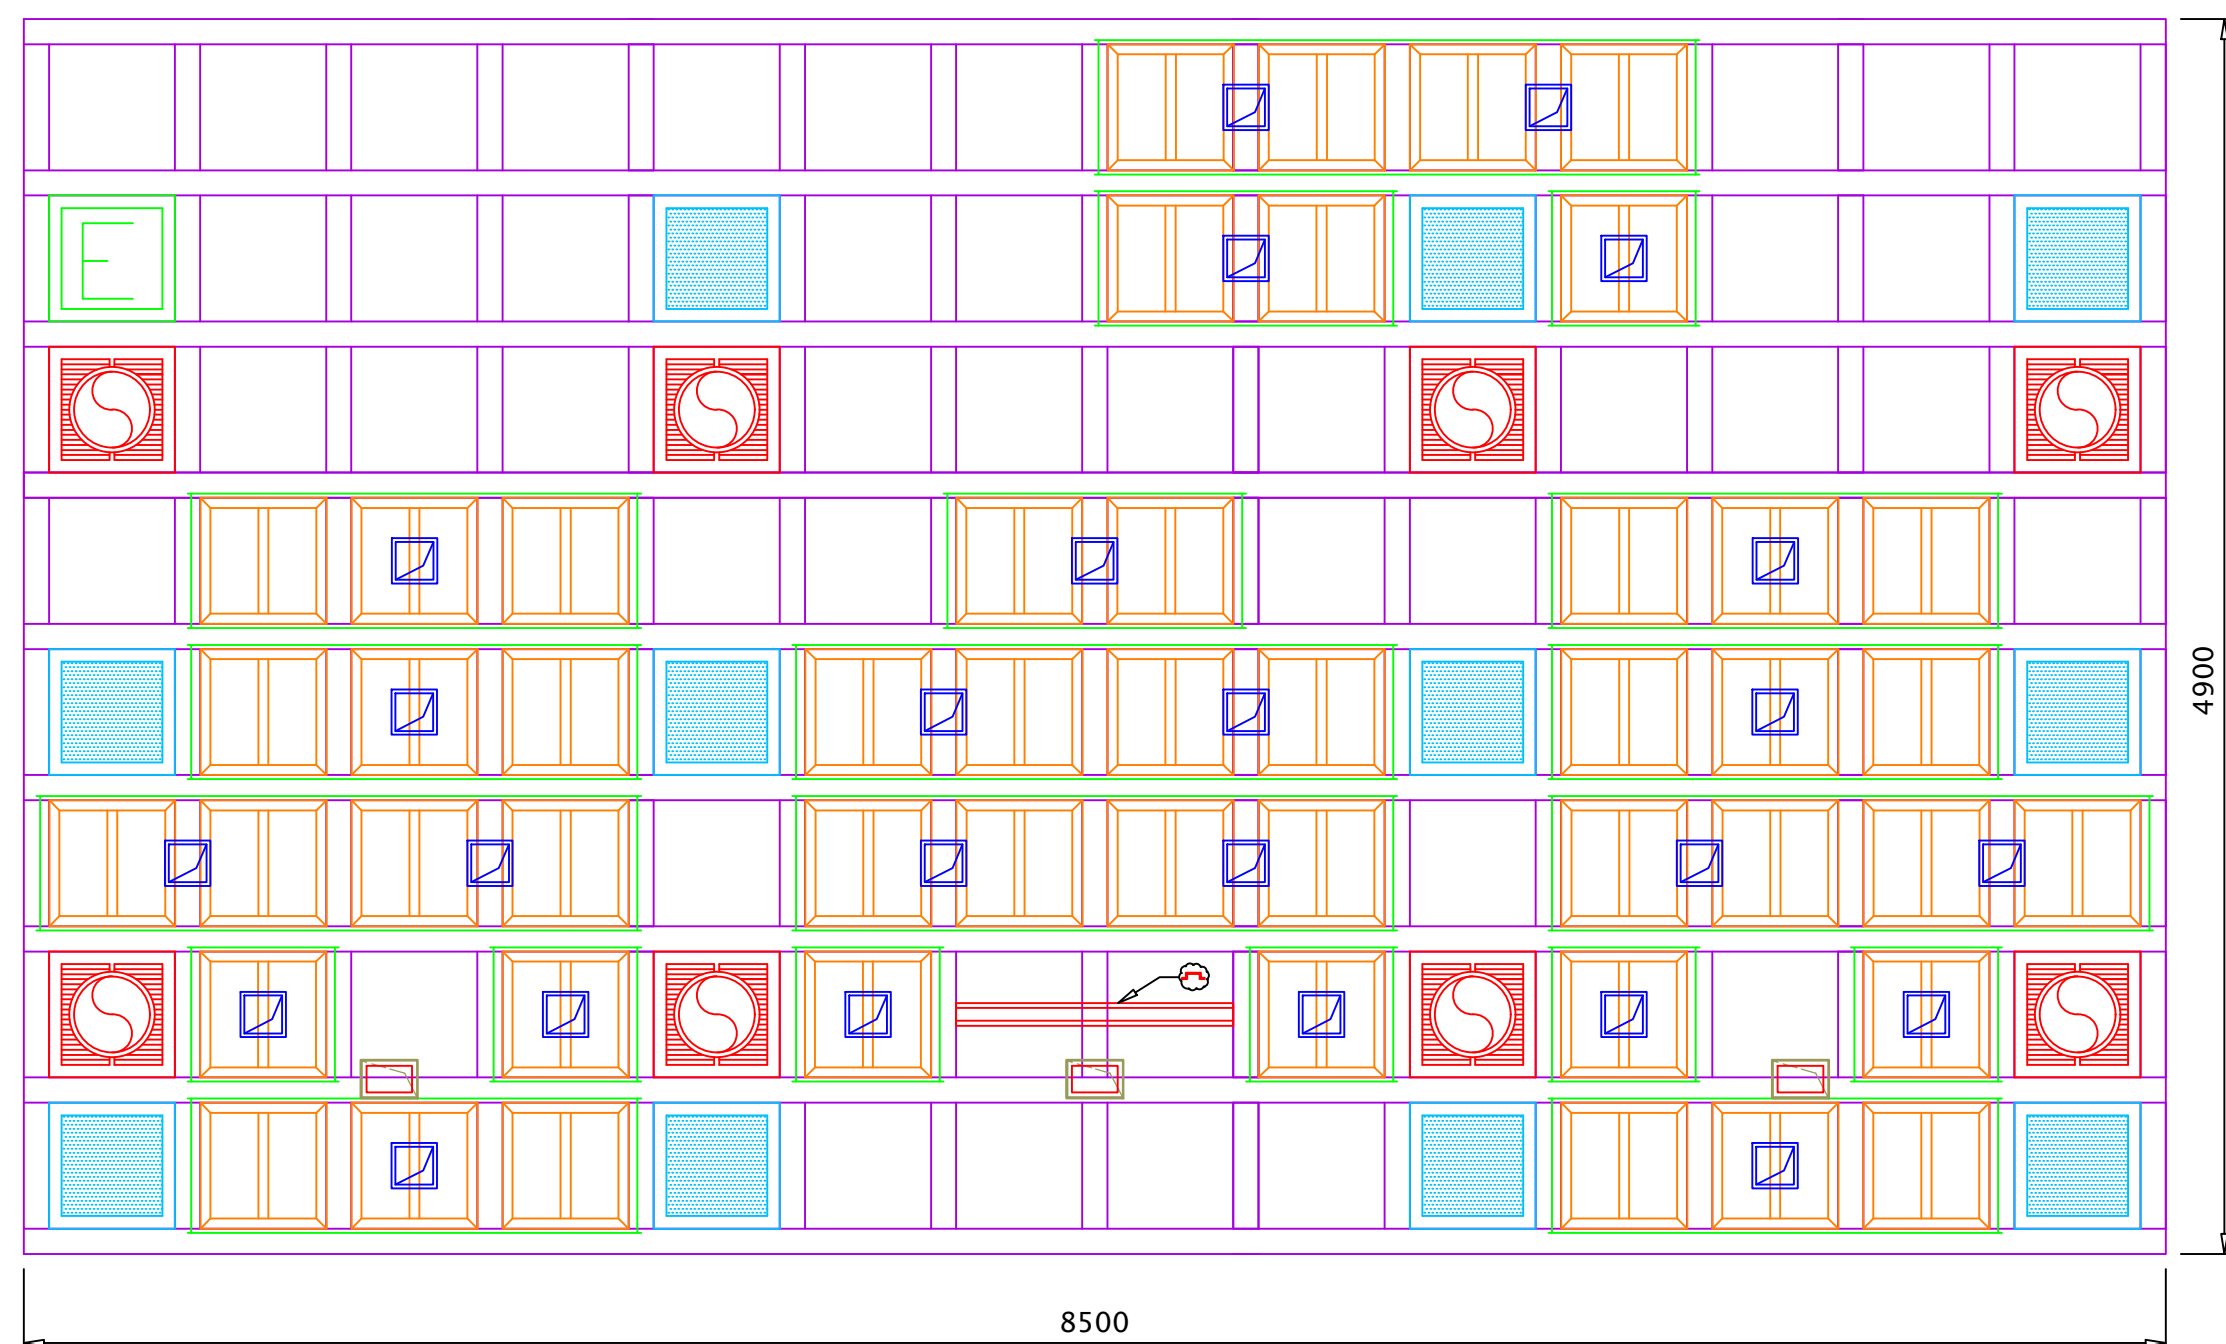

THIS DRAWING AND DESIGN REMAINS THE PROPERTY OF VISION COMMERCIAL KITCHENS LTD. AND MAY NOT BE COPIED, REPRODUCED, LOANED OR DISCLOSED TO ANY UNAUTHORISED THIRD PARTIES WITHOUT WRITTEN PRIOR CONSENT BY VISION COMMERCIAL KITCHENS LTD.
© Vision Commercial Kitchens Ltd 2020. All Rights Reserved.

COPYRIGHT IN THIS DRAWING IS THE PROPERTY OF LEIGHTEC SYSTEMS LTD. IT MUST NOT BE USED NOR AMENDED NOR USED FOR THE EXECUTION OF ANY WORKS WHETHER IN CONNECTION WITH THE PROPOSED WORKS FOR WHICH IT IS PREPARED OR OTHERWISE WITHOUT THE EXPRESS WRITTEN CONSENT OF LEIGHTEC SYSTEMS.
ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED
BS6173 was introduced in May 2001. It is a standard requirement to have the extract and supply fans interlocked with the gas valve where gas appliances are installed within the kitchen.

SUPPLY AIR
IF NOT INCLUDED WITHIN THE KITCHEN VENTILATION PACKAGE, TO BE PROVIDED BY OTHERS, TO ACHIEVE ADEQUATE COMBUSTION AIR IN ACCORDANCE WITH GAS SAFE REQUIREMENTS.
IF THE AIR IS NOT TEMPERED DRAUGHTS AND DISCOMFORT MAY BE CAUSED IN COLD WEATHER
GAS APPLIANCES LIKE HEATING BOILERS LOCATED IN THE KITCHEN VICINITY ARE TO BE ISOLATED FROM THE KITCHENS NEGATIVE AIR PRESSURE BY OTHERS.

CEILING
CEILING CONSTRUCTED FROM 0.9MM 304 GRADE STAINLESS STEEL, COMPLETE WITH COOL WHITE LED LIGHTS RATED AT IP 54 TO UNDERSIDE UNLESS STATED OTHERWISE. CEILING TO BE SEALED WITH FOOD SAFE SILICONE. ALL BUILDERS WORK OPENINGS TO BE FORMED PRIOR TO INSTALLATION. SUSPENDED CEILINGS WHERE FITTED TO BE INSTALLED FOLLOWING CEILING INSTALLATION

ALL OPENINGS TO BE FORMED BY MAIN CONTRACTOR INCLUDING ALL BUILDERS WORKS FOR VENTILATION SYSTEMS
MAIN CONTRACTOR TO ENSURE THE REAR WALL OF THE COOK LINE EQUIPMENT IS CLEAR OF ALL LOOSE PLASTER WORK, TIMBER, TILES AND SERVICES TO ENABLE STAINLESS STEEL WALL CLADDING TO BE FITTED
WALLS TO THE REAR OF COOK LINES TO BE OF A NON-COMBUSTIBLE/FIRE RATED MATERIAL, PRIOR TO STAINLESS STEEL WALL CLADDING BEING FITTED.
ALL EXISTING CANOPIES AND DUCTING NOT TO BE REUSED ARE TO BE STRIPPED OUT BY OTHERS OR LTS CAN PROVIDE THIS SERVICE
MAIN CONTRACTOR TO PROVIDE & FIT ALL FLASHING & SEALING MATERIALS FOR DUCTING THROUGH ROOF
WHERE ANY APPLIANCE IS SHOWN THAT IS NOT UNDERNEATH A CANOPY, ROOM VENTILATION IS TO BE CALCULATED AND INSTALLED TO THESE AREAS

P05	01/02/21	Canopy drawings - As Noted	LGR	
P04	21/12/20	Canopy drawings - As Noted	LGR	
P03	10/12/20	Canopy drawings - As Noted	LGR	
P02	01/12/20	Canopy drawings - revised to suit latest equipment layout	LGR	
P01	24/09/20	Canopy drawings first issue	LGR	MPS
rev	date	revision description	by	ch'd



Unit A1, Axis Point, Hill Top Road, Heywood, Lancashire, OL10 2BQ
Tel: 0844 811 7210 Email: sales@visionck.co.uk
Website: www.visionck.co.uk Shop: www.visionckshop.co.uk

PRIOR TO THE APPOINTMENT OF THE OFFICIAL CO-ORDINATOR AND PRINCIPAL CONTRACTOR, THIS DRAWING IS ISSUED STRICTLY AS DESIGN INTENT ONLY

Project Name	Manchester College
Sheet Name	GF Ground Floor - FE Training Kitchens - Ventilated Ceiling Details
Architects / Clients drawing reference	None
Originator	WJH
Rev	01/02/21
Design number	0413VCK00
Scale	G
VCK project no.	220110
Designed by	LGR
Scale	NTS
Sheet size	A1
Drawing number	CC-VCK-XX-00-DR-Y-4002
Sheet	S2
Revision	P05
Availability description	SUITABLE FOR INFORMATION
Revision description	PRELIMINARY

