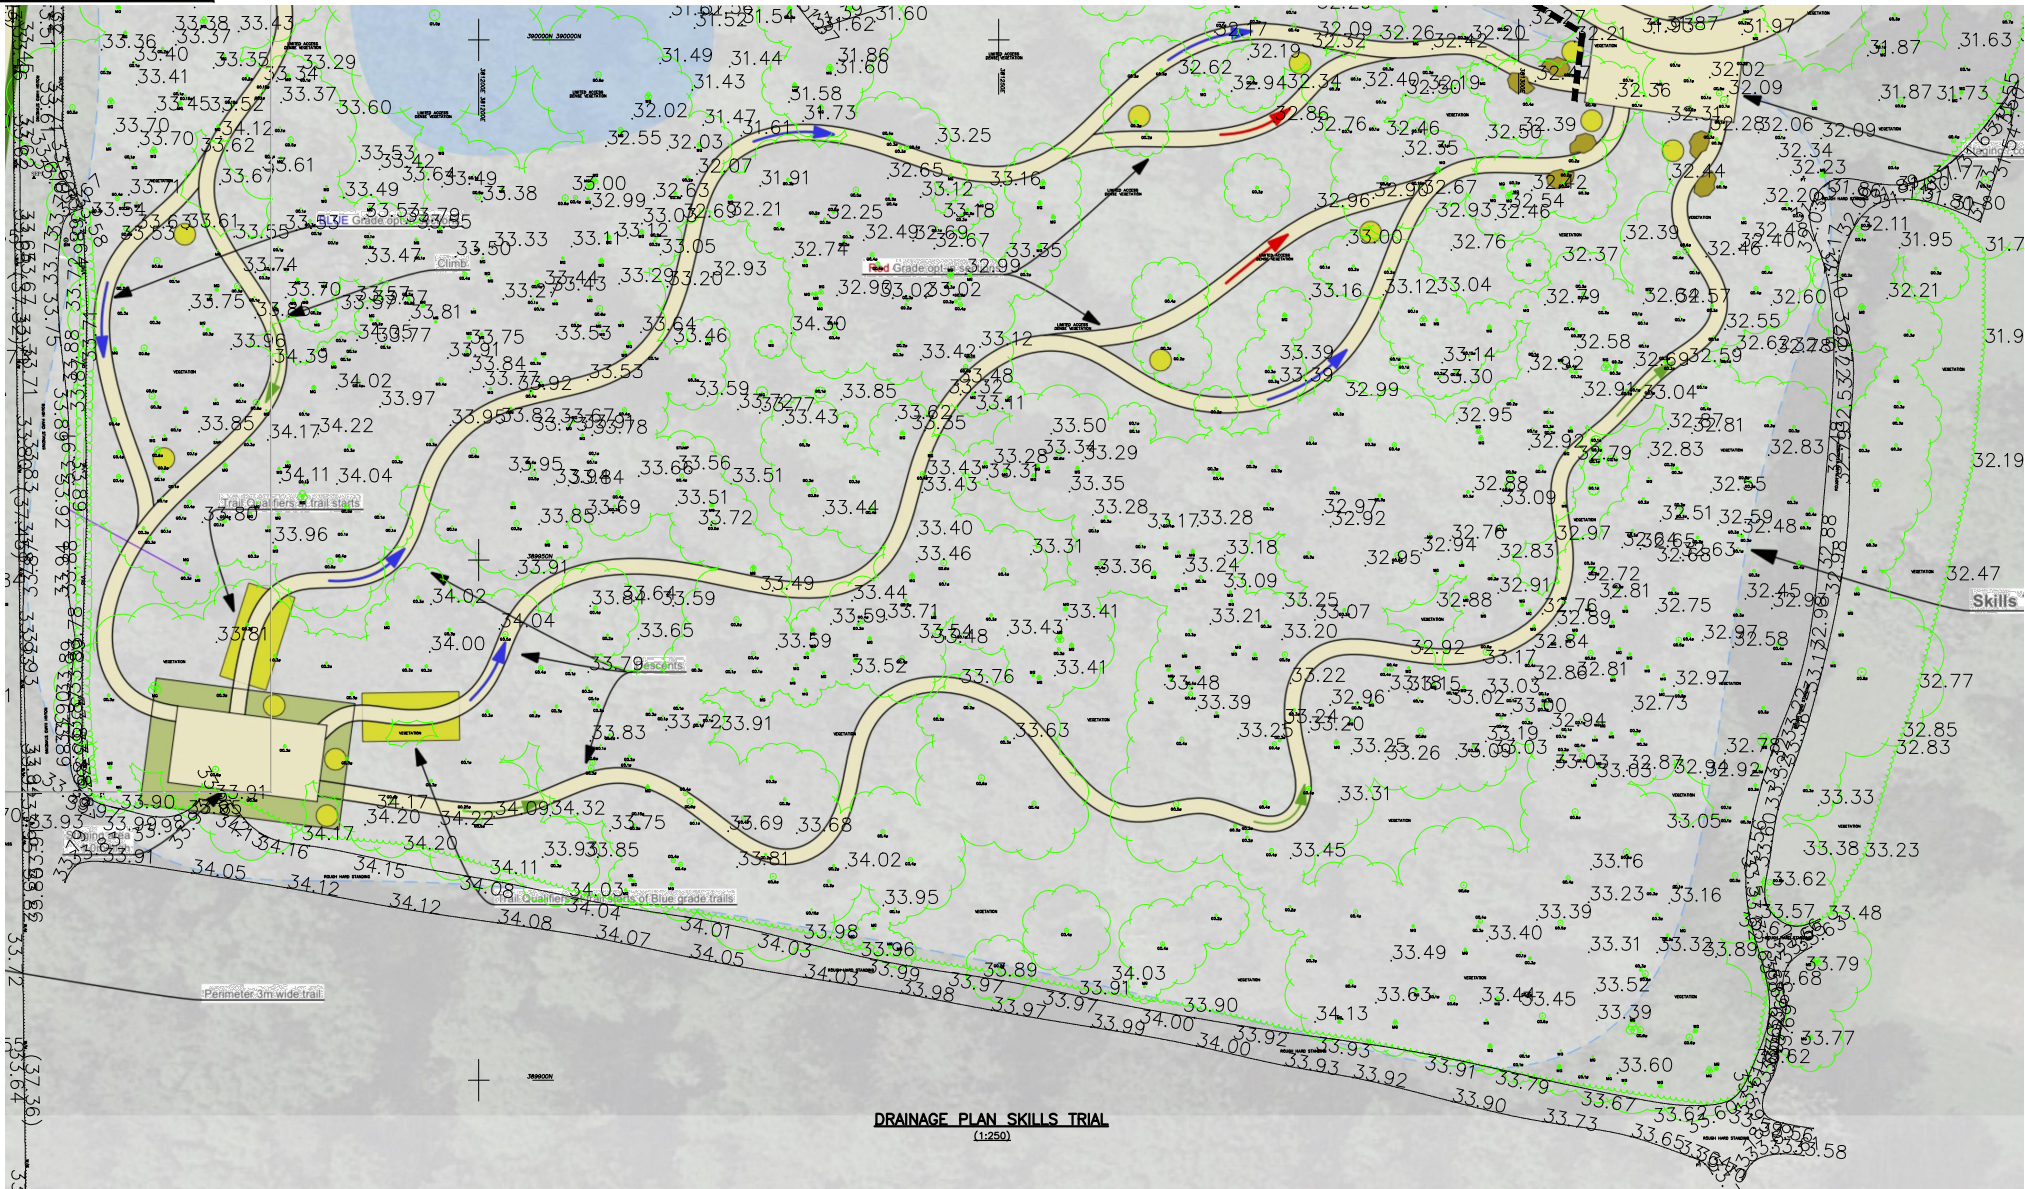


SKILLS TRAILS

Green, blue and red trails

No Topsoil to be stripped on trail line.

If required remove loose leaf matter and other debris by hand only. Load spreading mats to be laid where access is required for plant and machinery within tree root protection areas to enable construction of the trail.


Cover any exposed roots using topsoil gained from itail strip elsewhere onsite or import additional certified topsoil prior to application of non-woven geotextile membrane across entire trail line including underneath feature areas such as berms and rock armouring.

Install trail features such as berms and rock armouring.

Install 100mm compacted depth of 75mm dust gritstone. Cover this with 50mm compacted depth of 40mm dust gritstone prior to sealing the track line with 30mm compacted depth of 4mm dust gritstone. These materials will be compacted using whacker plates as works progress.

Where conditions dictate a capping layer of 150mm compacted depth of 75mm dust gritstone may be required prior to the base layer as detailed above. Requirements for this may include an excessively wet ground area, high usage area, ground stability issues etc. This will be carried out in agreement with the project lead.

**SKILLS TRAIL SECTION EXTRACTED
FROM DRAWING 20-011(09)001
BY BIKE TRACK**

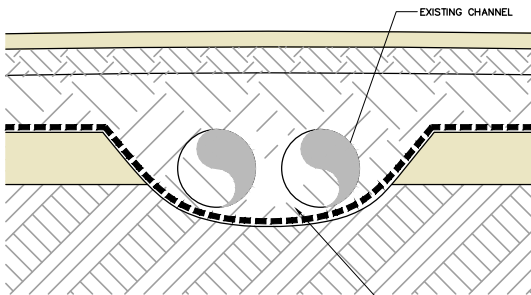

**PATH CULVERT INSTALLED WHERE
THERE ARE EXISTING CHANNELS
(1:5)**

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
3. ALL CONCRETE WORK AND MATERIALS TO BE IN ACCORDANCE WITH BS EN 12620, OR BS 8119-1:1987, BS 8500:2006 PTF 1 & 2, BS EN206-1:2000.
4. PRIOR TO CASTING CHECK WITH ARCHITECT'S DRAWING.
5. CONCRETE COMPRESSIVE STRENGTH C30/37.
6. ANY AMBIGUITIES, OMISSIONS AND ERRORS ON DRAWINGS, SHALL BE BROUGHT TO THE ENGINEERS ATTENTION IMMEDIATELY.
7. THE CONTRACTOR SHALL CONFIRM THE LOCATION AND LEVEL OF EXISTING DRAINAGE PRIOR TO COMMENCEMENT OF THE DRAINAGE WORKS.
8. EXACT LOCATIONS OF PROPOSED MANHOLES AND INSPECTION CHAMBERS TO BE DETERMINED ON SITE.
9. THE CONTRACTOR SHALL CONFIRM THE LOCATION AND LEVEL OF EXISTING STATUTORY UNDERTAKERS APPARATUS AND SERVICE CONNECTIONS BY TRIAL PITS PRIOR TO OPENING UP FOR THE WORKS.
10. ALL WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH SEWERS FOR ADOPTION 7TH EDITION.

KEY:

- NEW SURFACE WATER DRAIN
S1 ● SURFACE WATER MAN-HOLE

P2	ISSUED FOR INFORMATION	JW	PKD	JAN22
P1	ISSUED FOR INFORMATION	JKT	PKD	DEC21
Rev	Description	Drawn	Chkd	Date

Sir Frederick Snow & Partners Ltd
Consulting Engineers



211 - 213 Higher Hillgate
Stockport
Cheshire
SK1 0RB
Tel: 0161 477 3365
e-mail: northwest@fsnow.co.uk

Client
MANCHESTER CITY COUNCIL

Project Title
WYTHENSHAW PARK - BIKE PARK

Drawing Title
SKILLS TRAILS AREA DRAINAGE DETAILS

Scale(s)
1:500 (Do not scale off this drawing work to figured dimensions)

Scalebar
0 10 50 100mm
Original Drawing Size A0