


Ground floor slab beneath hot tub to be min 150mm thick with two layers A14 mesh reinforcement top and bottom on insulation on 1200 gauge visqueen on 50mm sand blinding on min 300 hardcore placed in 2 x 150mm well compacted layers. Any soft spots in load bearing ground to be dug out and filled with weak mix concrete fill.

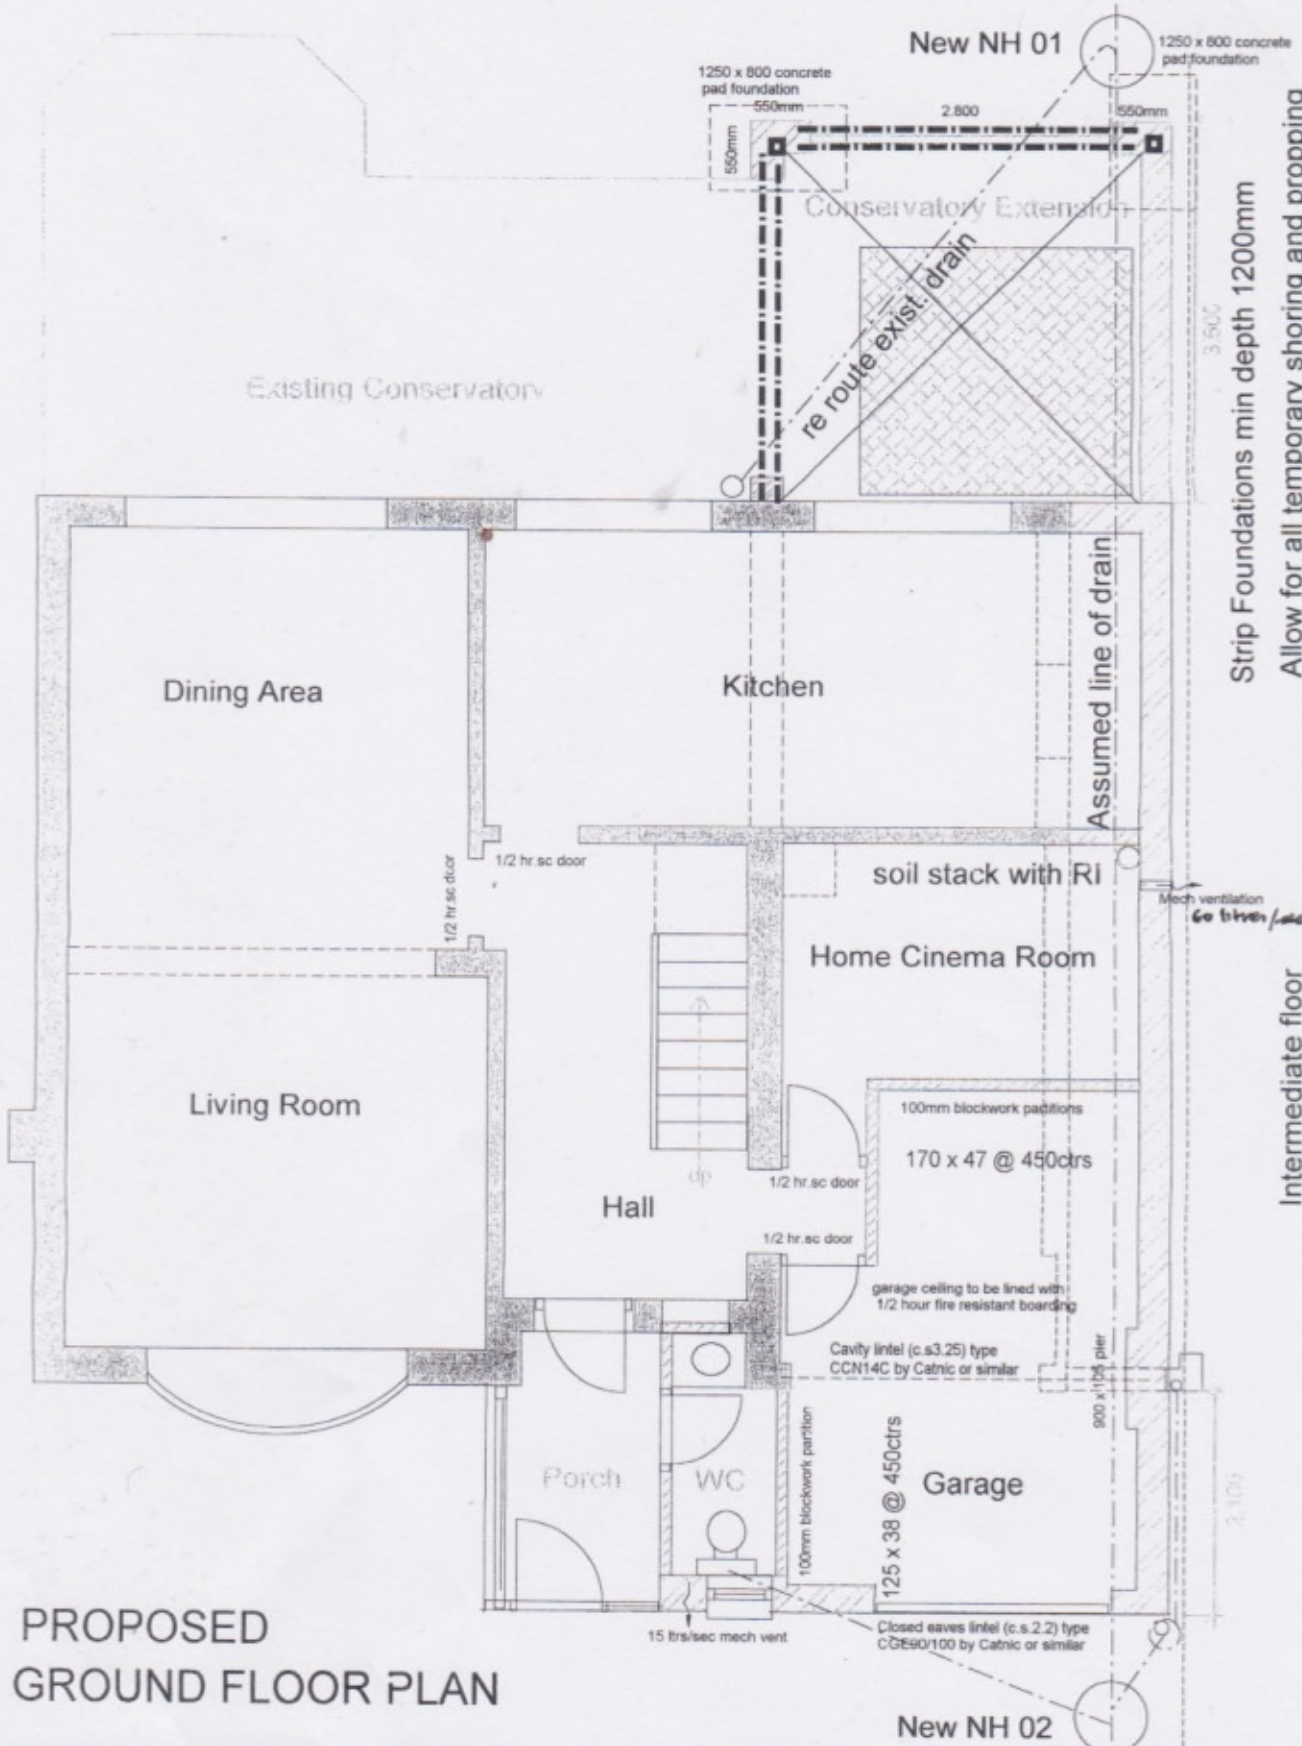

PROPOSED EXTENSION TO 34 CHERRY TREE RD M23 9BX

2283 P 03

scale 1:50