


WITHINGTON
BASEMENT
VENTILATION

TOILET VENTILATION SYSTEM
BASED ON 10 AIR CHANGES / HR
SUPPLY AIR & EXTRACT SYSTEM

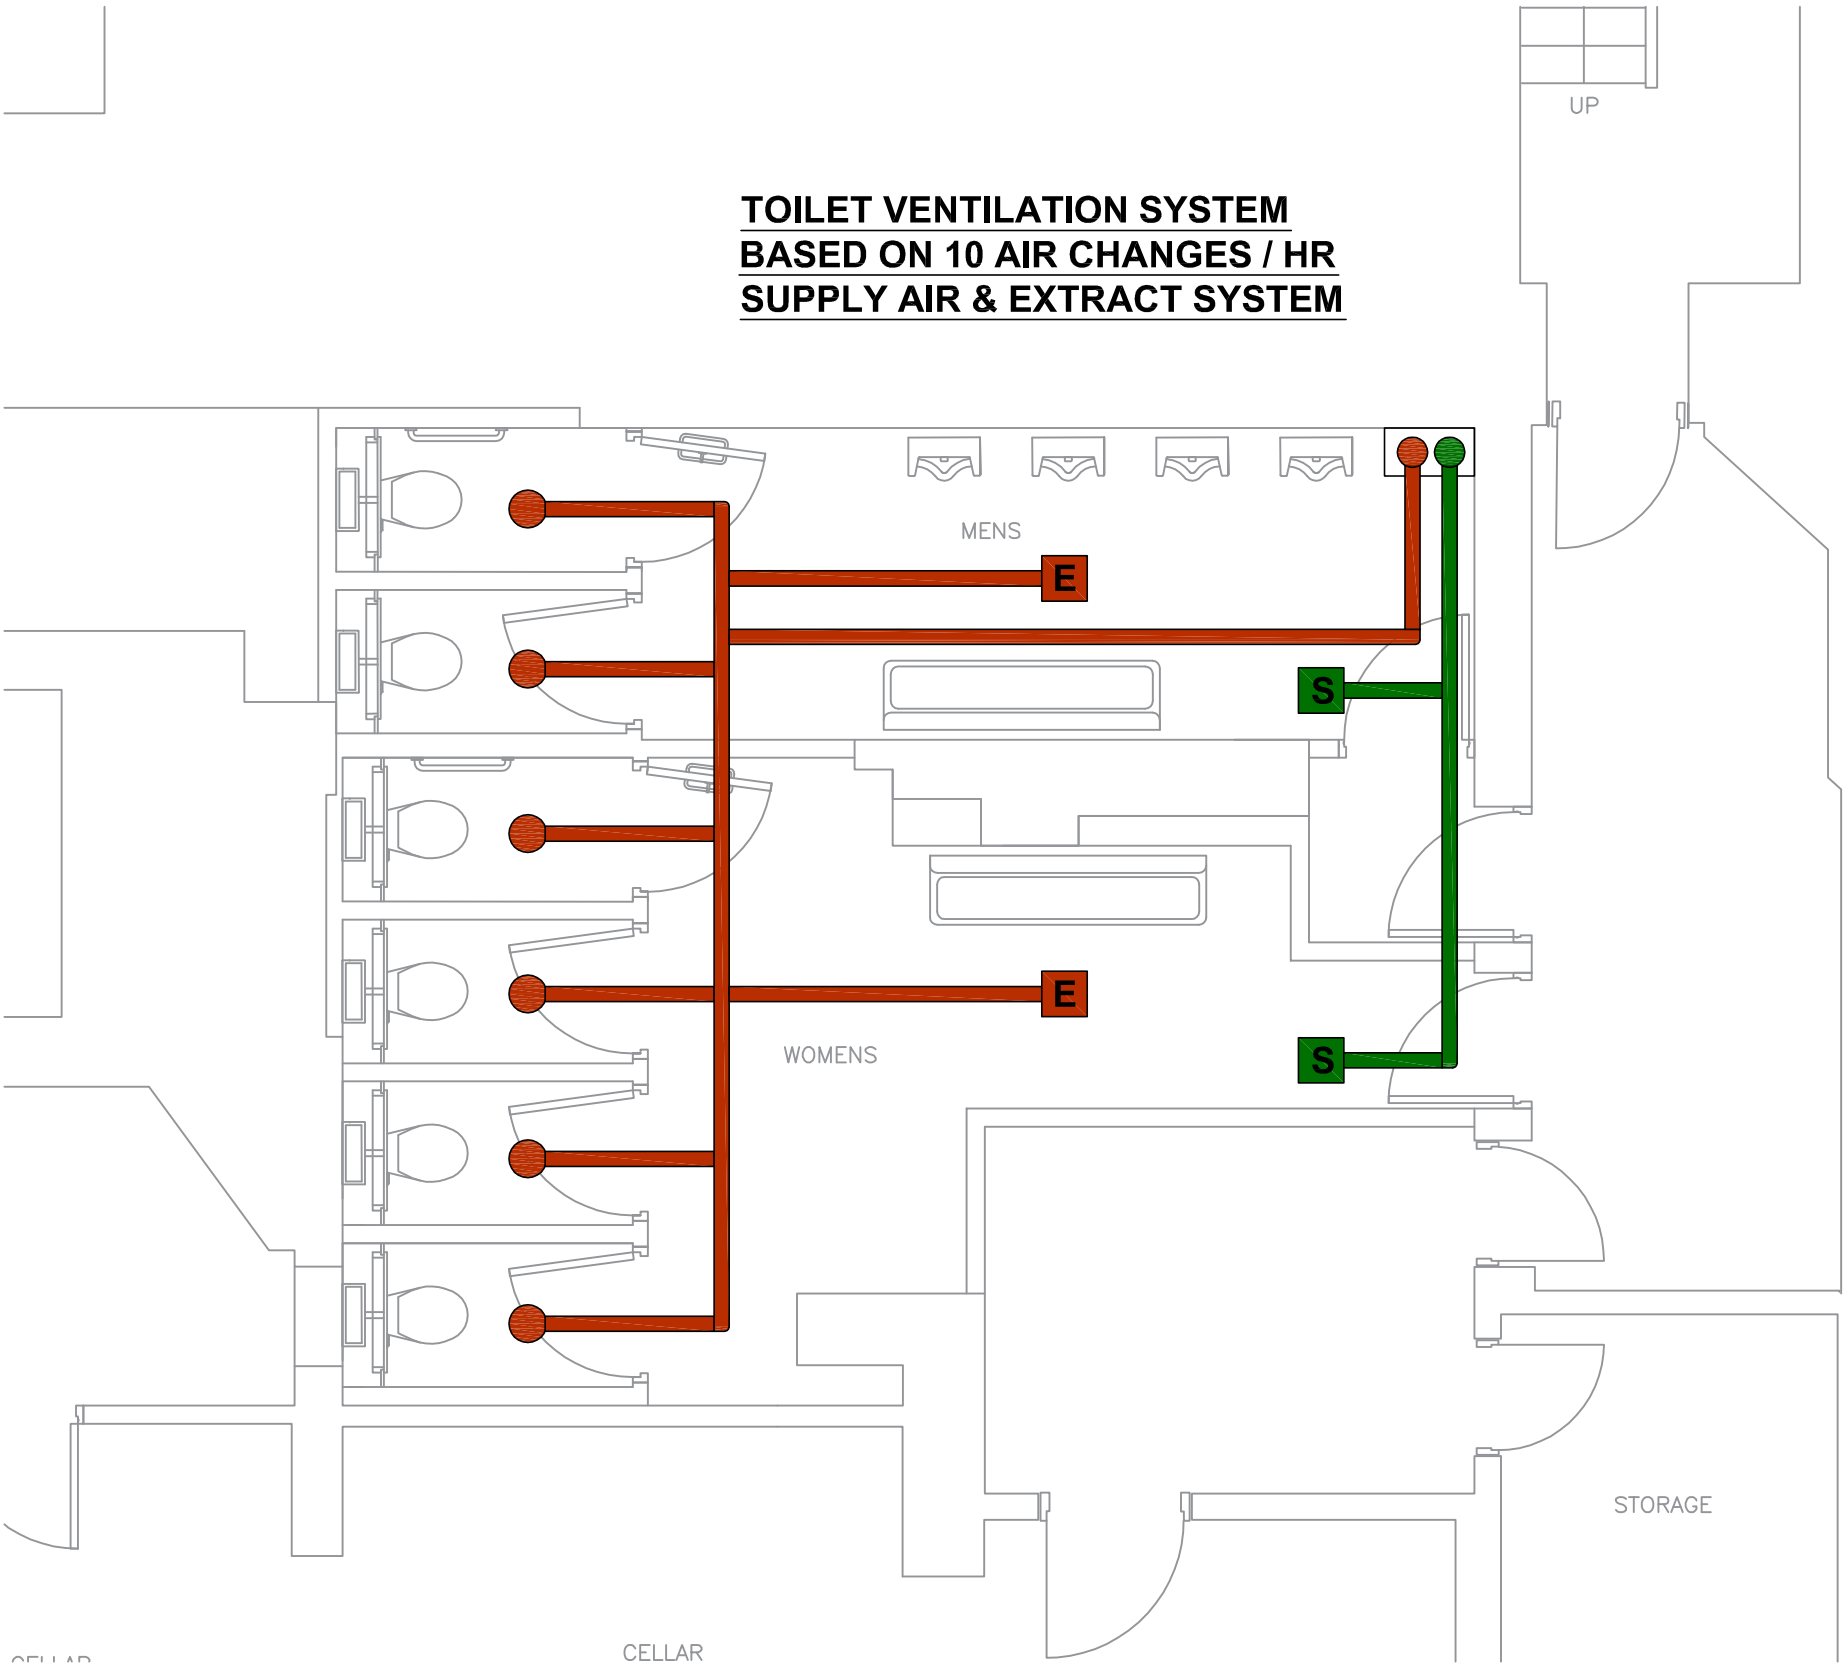

General Notes

A 1000mm opening is required giving a 900mm clear door opening to at least one external access door to the kitchen to enable equipment access at point of on installation and for general servicing during life of the kitchen.

All mechanical service pipework run by the main contractor is to drop down from ceiling or to follow agreed pipework runs so as not to hinder equipment pushing hard to walls. All service runs / drops to be agreed prior to first fix runs.

All heights of electrical boxes refer to the underside of the Isolator boxes/socket boxes.

All services provided by main contractors, mechanical contractors and electrical contractors are to be run to the position shown on the equipment drawing or to within one (1) metre of the equipment connection points.

Copyright 2021

This drawing and all the information contained within it is the property of Ace Mechanical Ltd and shall not be copied in whole or in part or used for any purpose without the written permission of Ace Mechanical Ltd

Dimensions

All wall dimensions indicated on this drawing are the minimum finished wall dimensions as required by Ace Mechanical Ltd and any differences or variations on site or on contract drawings are to be brought to the attention of Ace Mechanical Ltd immediately. All dimensions are to be checked on site and are not to be scaled from the drawing.



Unit 4, Cuncilffe Court, Petre Road, Clayton Business Park, Accrington, BB5 5JB
T: 01254 447576
E-Mail: info@acemechanical.co.uk
Web: acemechanical.co.uk

Client/Project

WITHINGTON
BASEMENT
VENTILATION 4

-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
-	-	-	-
B	LAYOUT UPDATED	22.03.21	MPS
A	LAYOUT UPDATED	12.03.21	MPS
Rev.	Brief Description	Date	Drawn
Designed By MPS		Date 11.03.21	
Scale/Size 1:50 @ A3 1:25 @ A1			
Drawing Number ACE018_003		Revision B	