




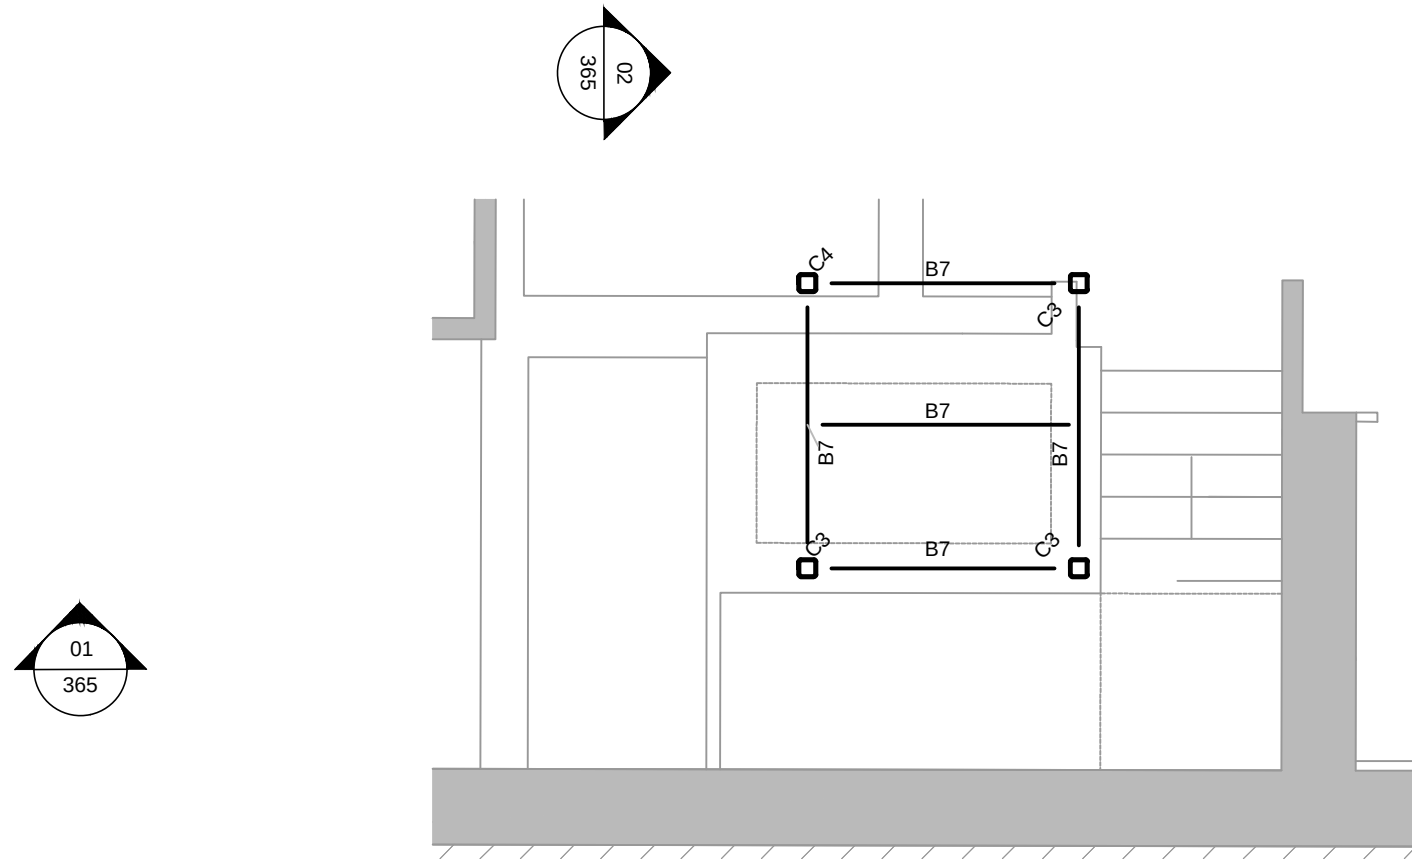


LOWER GROUND FLOOR
SCALE 1:50

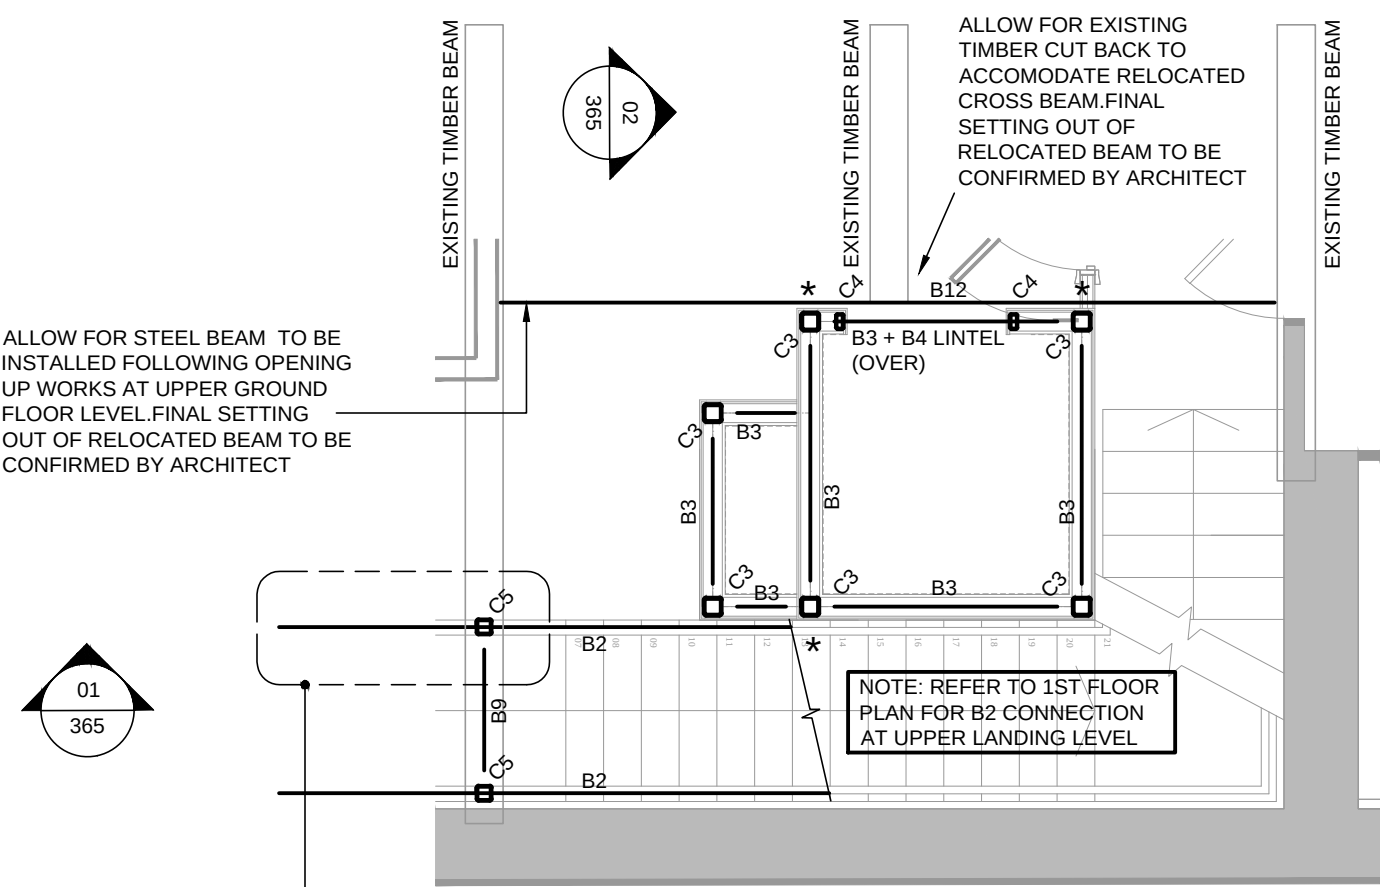


GROUND FLOOR
SCALE 1:50

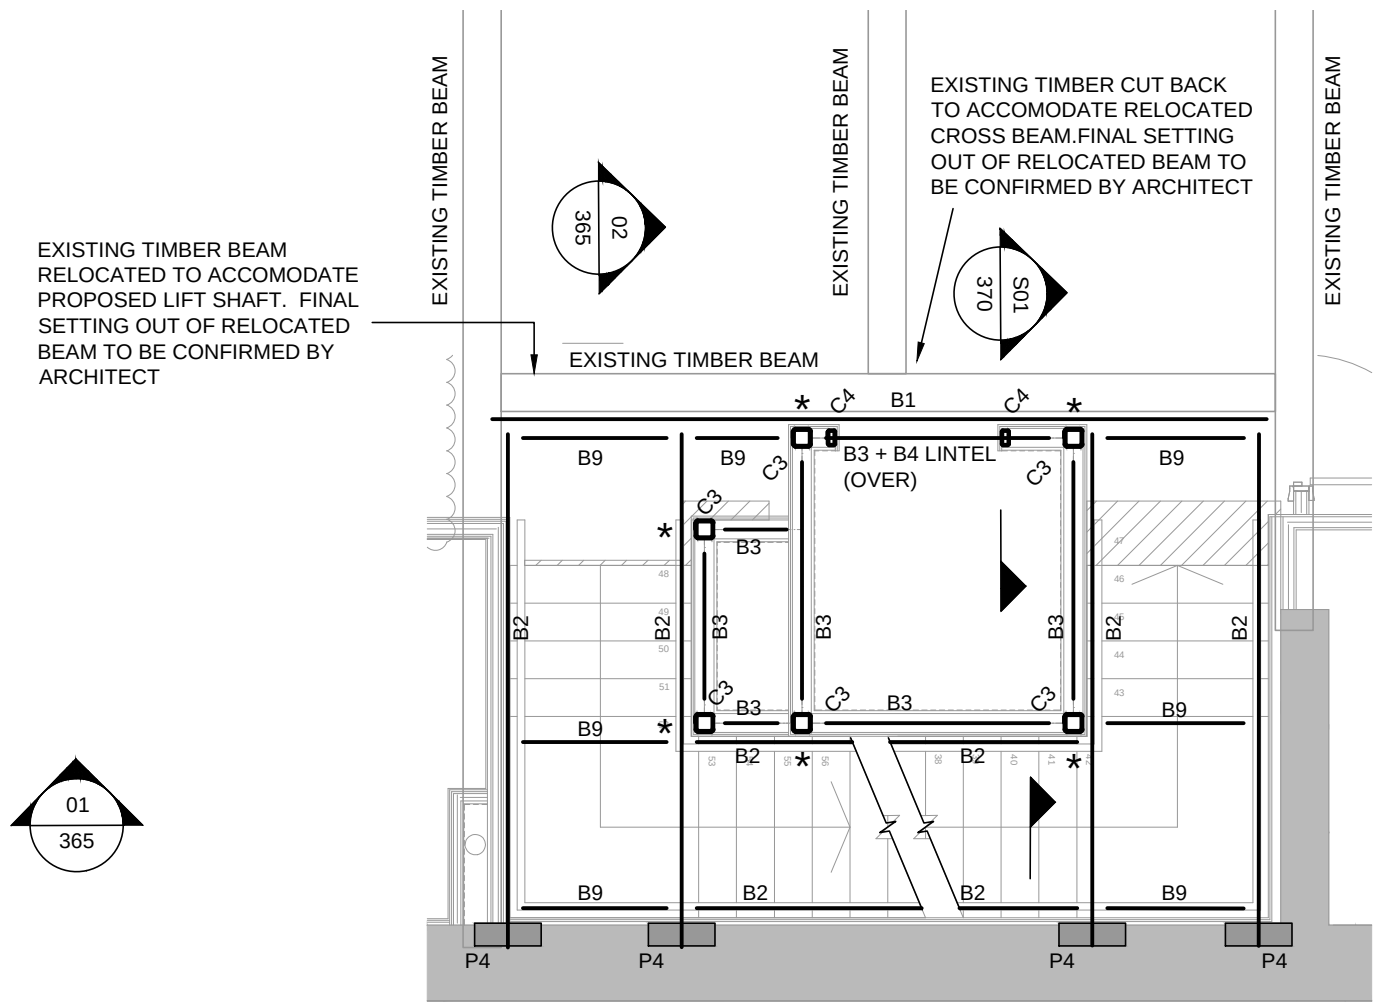

2ND FLOOR
SCALE 1:50

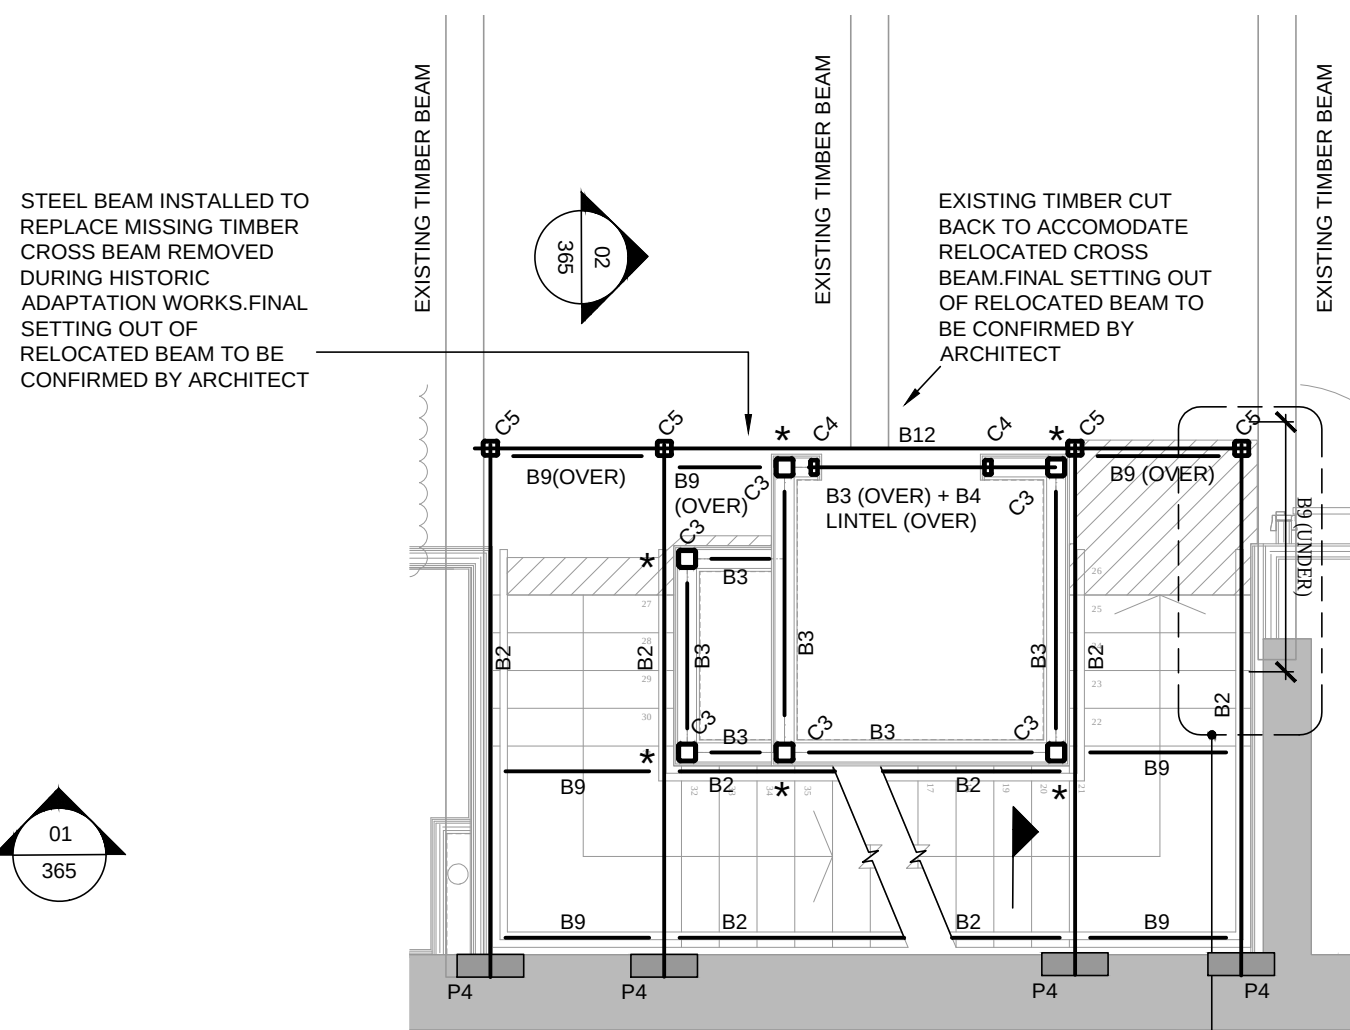

1ST FLOOR
SCALE 1:50

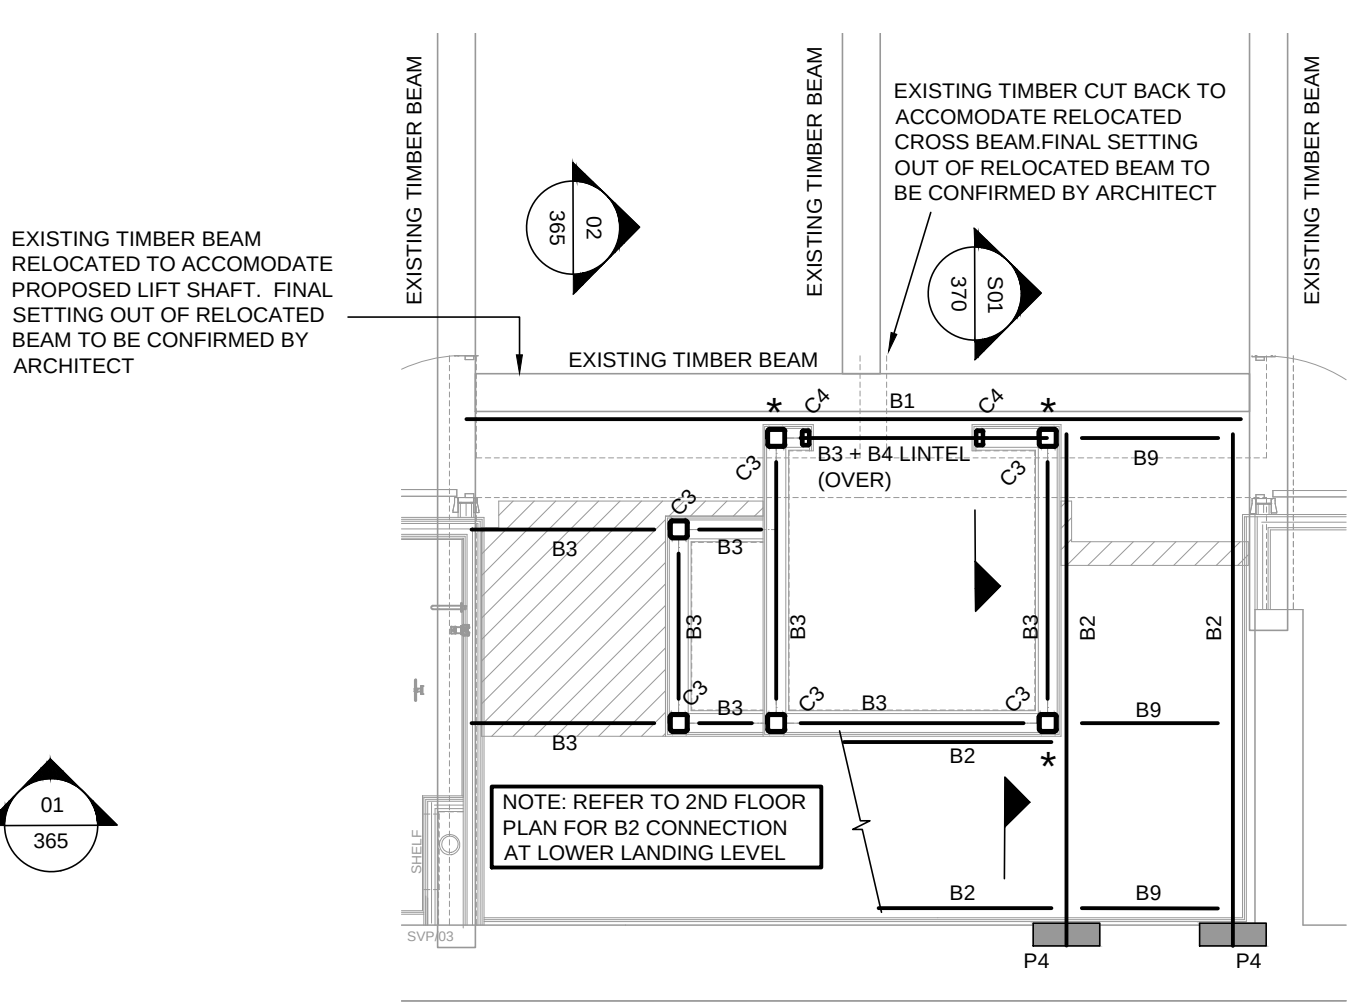

3RD FLOOR
SCALE 1:50

NOTES:

1. REFER TO DRAWING S-00-10 FOR GENERAL NOTES.
2. DO NOT SCALE FROM THIS DRAWING.
3. ALL STEELWORK TO BE GRADE S355 JR UNO.
4. FOR FIRE PROTECTION REQUIREMENTS REFER TO ARCHITECT'S DETAILS.
5. STEELWORK TO RECEIVE PAINT PROTECTION SYSTEM TO SUIT 50 YEAR DESIGN LIFE IN C2 (UNHEATED INTERIOR LOCATION) EXPOSURE CONDITIONS. STEEL FABRICATOR TO PROPOSE ONE OF THE FOLLOWING PAINT PROTECTION SYSTEMS FOR REVIEW BY ENGINEER PRIOR TO FABRICATION.

CORROSION PROTECTION FOR STEELWORK

THE STEELWORK FABRICATOR IS TO ENSURE ALL NEW STEELWORK EMBEDDED WITHIN OR IN CONTACT WITH THE BUILDING MASONRY FAÇADE IS CORROSION PROTECTED USING ONE OF THE SYSTEMS BELOW

SYSTEM NUMBER	PW-C2-A	PW-C2-B
STRUCTURE LIFE	50+	50+
COATING LIFE	N/A	N/A
NEAREST EQUIVALENT BS EN ISO 12944-5 ⁽¹⁾	-	-
SURFACE PREPARATION TO BS EN ISO 8501-1 9	BLAST CLEAN TO SA 2½	-
FACTORY APPLIED COATINGS	ONE COAT SOLVENT FREEEPOXY 450µm	i) HOT DIP GALVANISE TO BS EN ISO 1461(5) 85µm ii) TWO COATS HEAVY DUTY BITUMEN, 200µm TOTAL
SITE APPLIED COATINGS	-	-

NOTE: REFER TO ARCHITECT'S DRAWINGS FOR ALL SETTING OUT OF NEW STRUCTURE

T02	UPDATED TO SUIT REVISED ARCHITECT'S LAYOUT	06.01.22	MOH	NP
T01	TENDER ISSUE	22.12.20	MOH	NP
Rev:	Description:	Date:	By:	Chkd:



Project:
**47 PETER STREET,
MANCHESTER**

Drawing Title:
**STEEL STAIRCASE AND
LIFT FRAME PLANS**

Status:
STAGE 4

Size:	Date:	Drawn by:	Designed by:	Checked by:
A1	OCT 20	MOH	NP	HG

Scale:	1:50	Project No:	1809-1
--------	------	-------------	--------

Project:	Originator:	Volume:	Level:	Type:	Role:	Category/Number:	Rev:
----------	-------------	---------	--------	-------	-------	------------------	------

PSM-REN-ZZ-ZZ-DR-S-0360-T02