
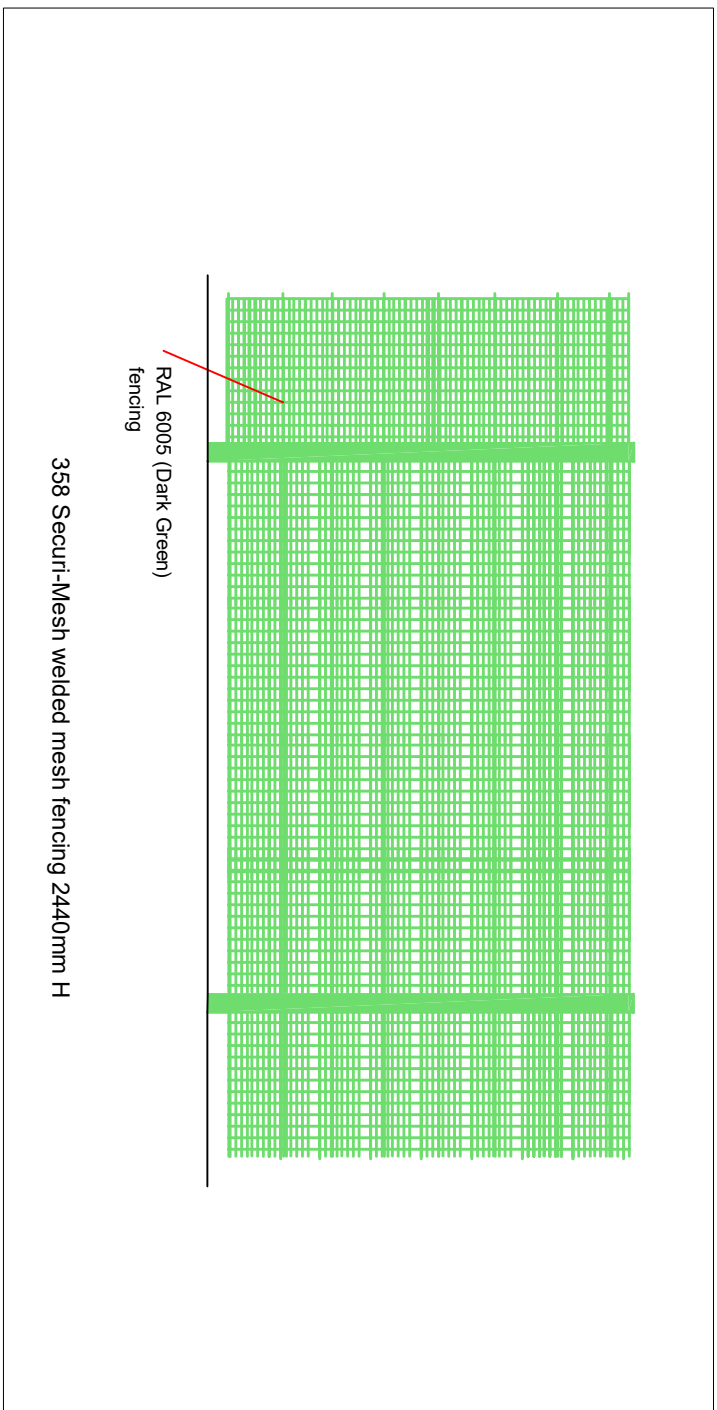
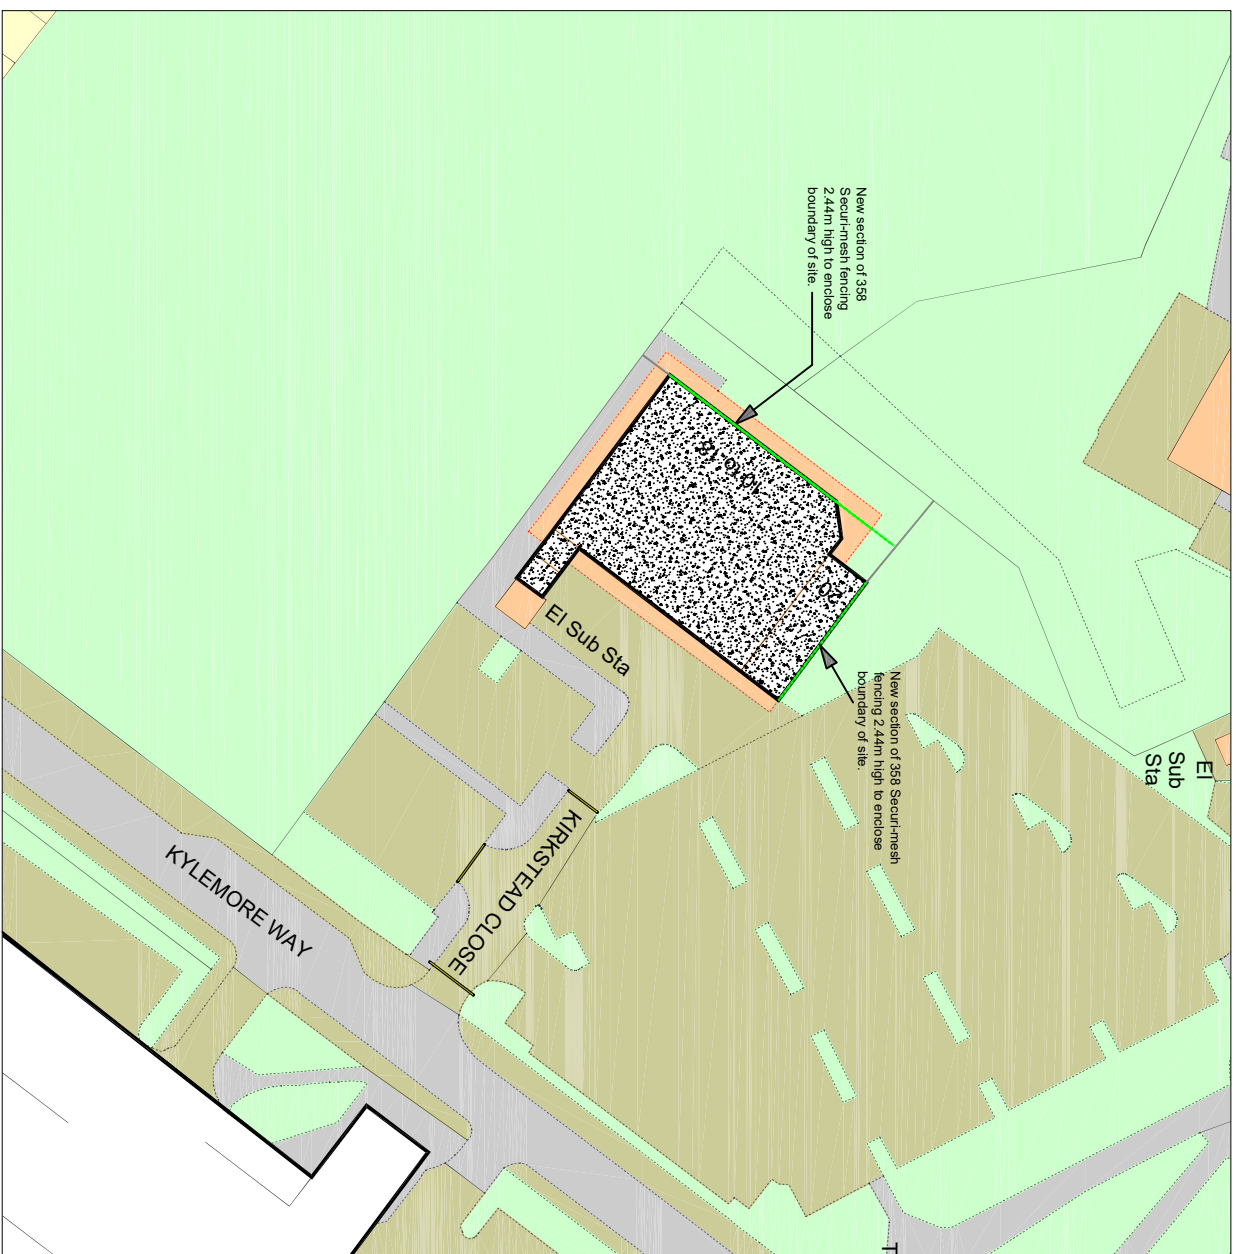


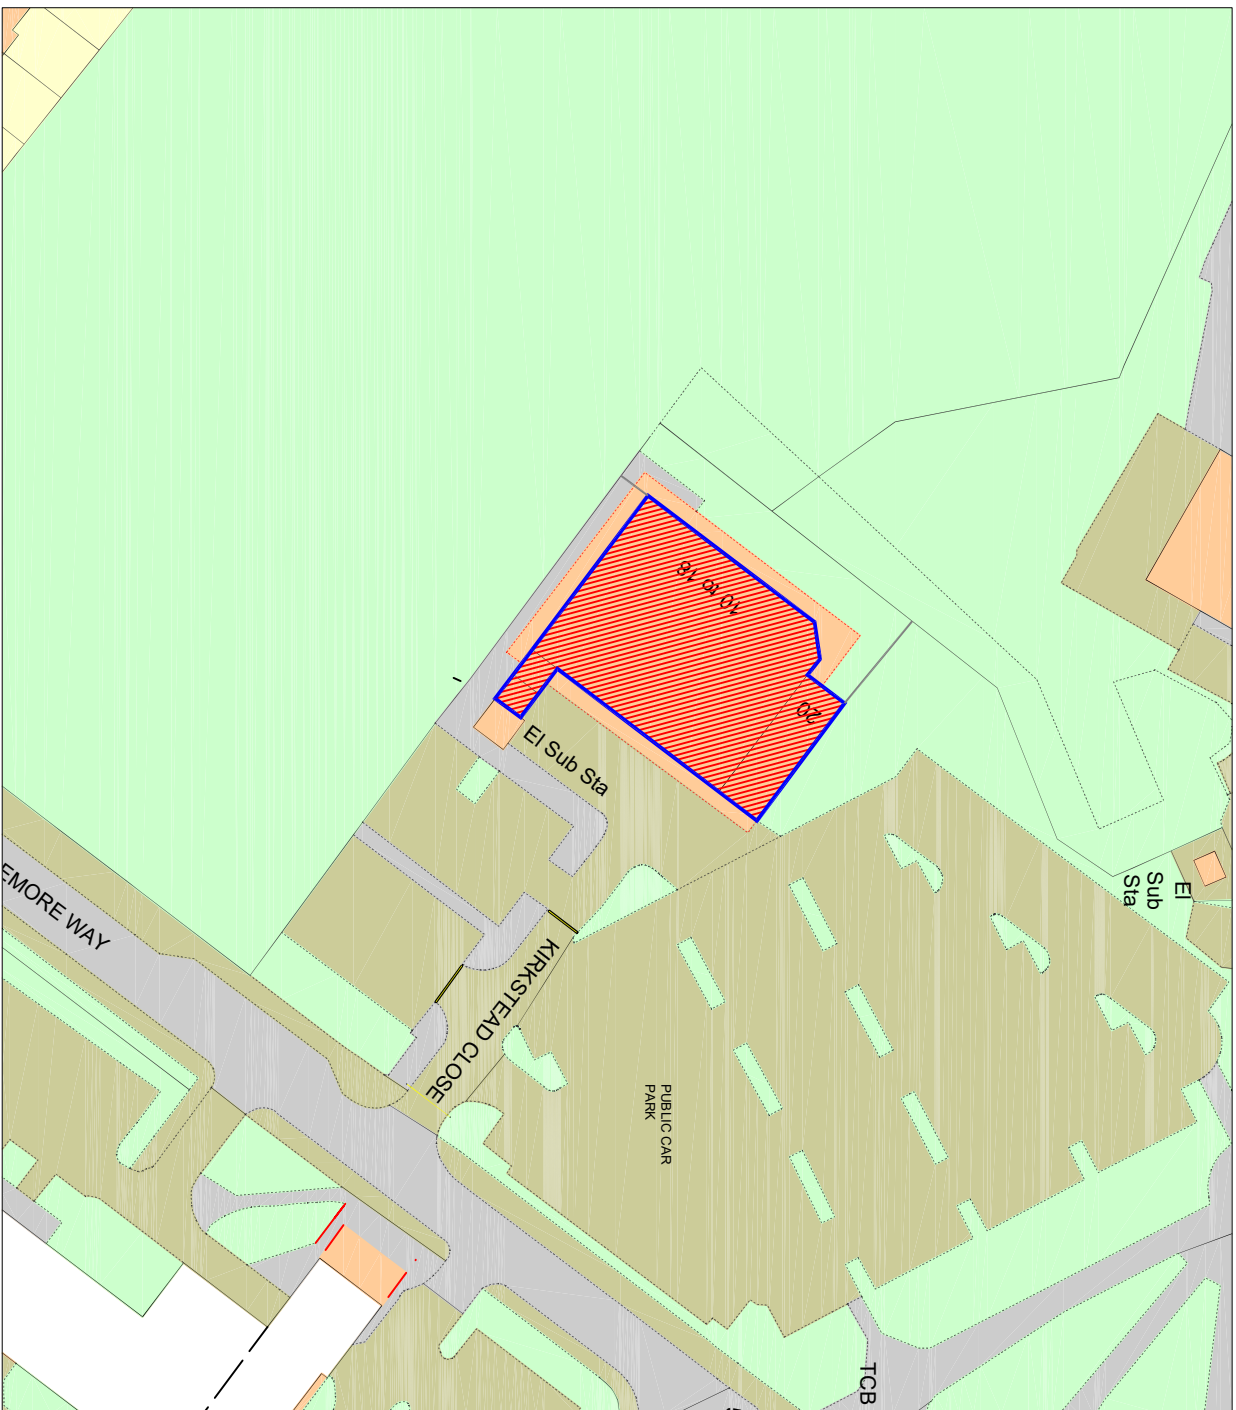

Specification for Proposed New Boundary Fencing

Following the demolition of the former shop building, two sections of the boundary will be left exposed without any fencing to part of the North West and North East Elevations. To supply and erect 55.50m of 2.44m (8') high mesh fencing. The new fencing shall be 358 Secur-Mesh welded mesh panels (to match existing).

To be constructed from 76.2 x 12.7mm (3"x1 1/2") with 4mm wire. Panel widths to be 2515mm and posts to be 80 x 60mm erected at 2440mm centres. Overall post length to be 3300mm.

Set posts in holes 300mm diameter x 800mm deep, filled not less than half the depth with concrete. Mix to BS5328 designated mix not less than Gen1. Excavate holes neatly and with vertical sides. Position posts and fill holes with concrete, well rammed as filling proceeds and consolidated. Holes not completely filled with concrete to be backfilled with excavated material, well rammed and consolidated.

Panels and posts to be zinc alloy coated and to receive a powder coated finish to BS EN 13438 - Colour Green RAL 6005 (to match existing).

