

Site construction sequencing should be assessed before the appropriate Visqueen Standard Detail is selected & approved by the Designer

Detail Issued For Guidance Only,
Designer's Approval Required


All laps must be fully sealed.

The design of a Sub-floor Ventilation Layer should be considered to dilute & disperse ground gases

KEY TO MATERIALS :

(Refer to Visqueen Technical Data for full detailed material specification).

- 1) VISQUEEN ZEDEX CPT DPC.
- 2) VISQUEEN GR DPC.
- 3) VISQUEEN GAS BARRIER.
- 4) VISQUEEN GR LAP TAPE.
- 5) VISQUEEN JOINTING TAPE (50mm x 10m).
- 6) RIGID POLYSTYRENE INSULATION.

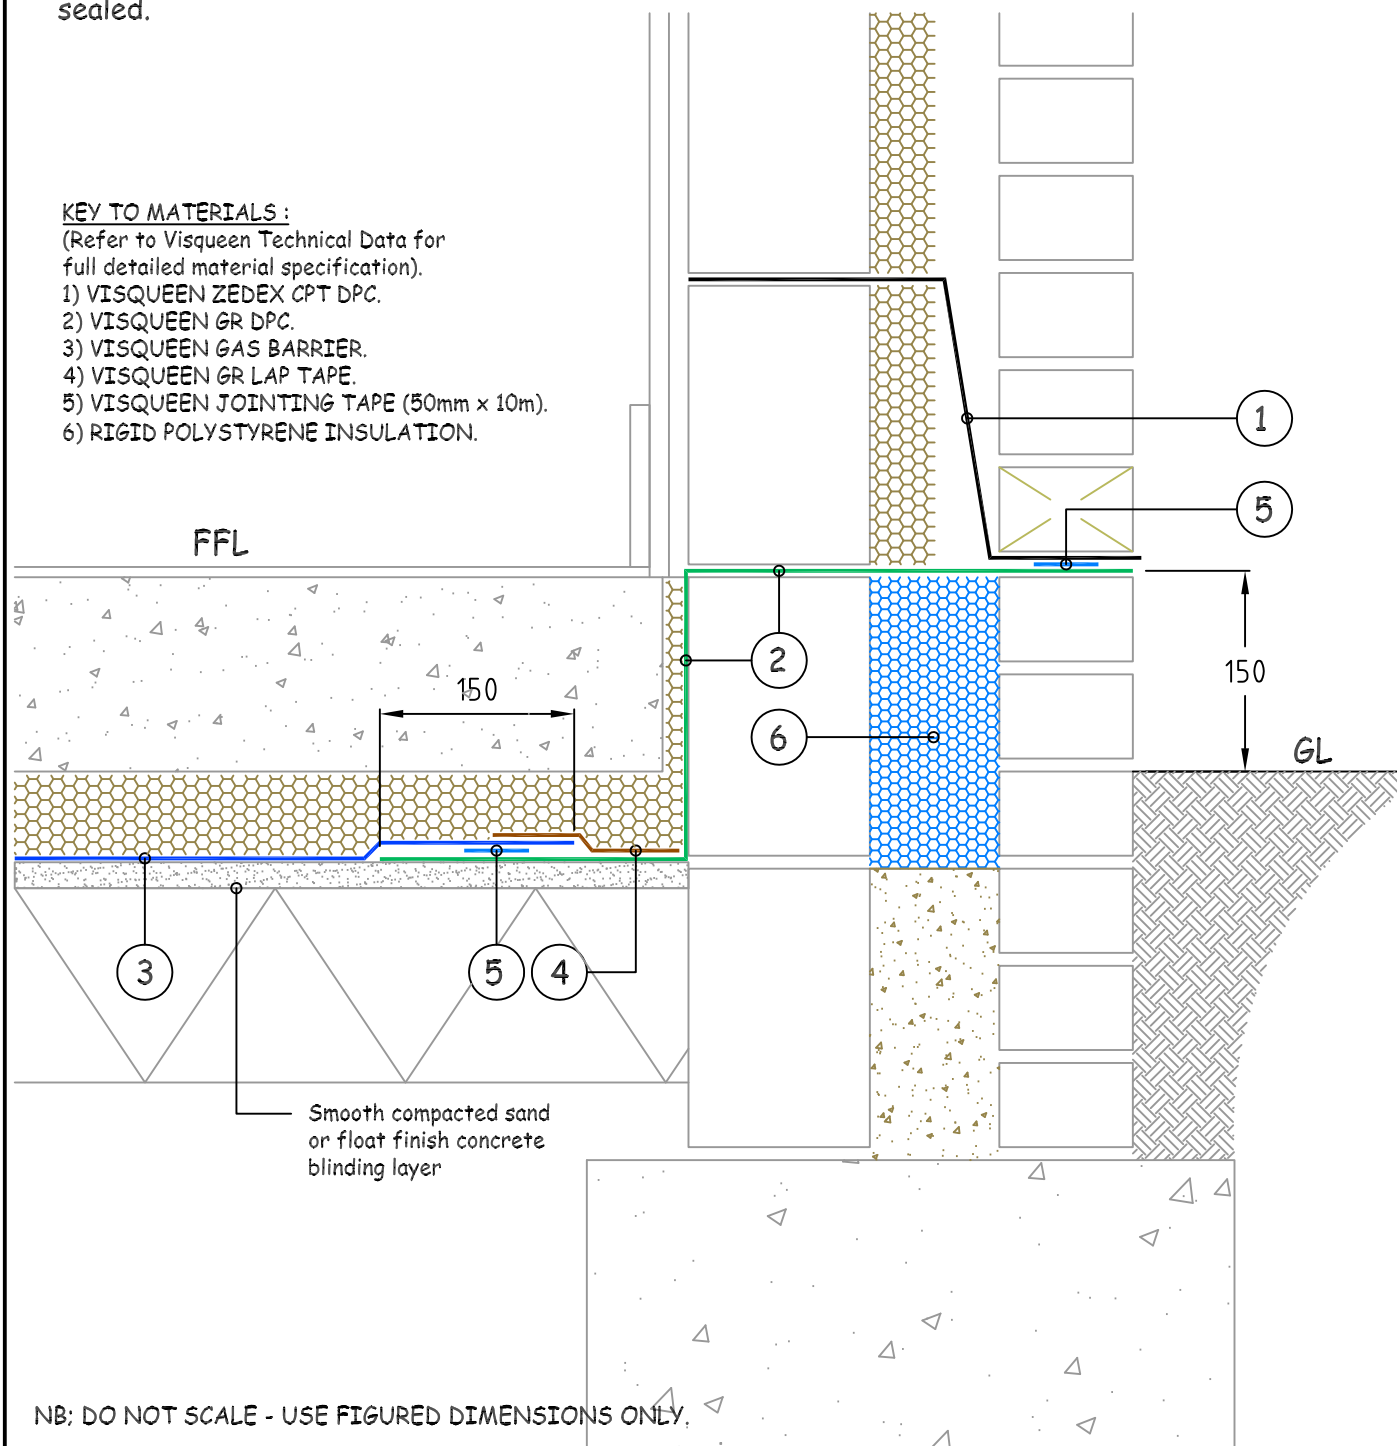

VISQUEEN

GAS BARRIER

Visqueen Building Products

Contact Technical Support :

t : 0870 6092084

f : 0870 8508169

e : enquiries@visqueenbuilding.co.uk

www.visqueenbuilding.co.uk

Project: Standard Detail : Ground Bearing Slab - Typical Edge Detail.

Drawing No.- GB-07.

Date.- 12/09.

Scale.- NTS.

© COPYRIGHT
RESERVED.