

Job No. PA1484	Drawing No. TCE-XX-XX-DR-E-47001	Rev C1
-------------------	-------------------------------------	-----------

COPYRIGHT:
The copyright of this drawing is vested in TACE. It shall not be used or reproduced without permission for any purpose.

Do NOT scale from this drawing, work only to figured dimensions.
All dimensions in millimetres unless otherwise stated.

This drawing has been created electronically, do not modify by hand.

Notes

1. It is recommended that all devices are wired on a dedicated life safety power supply.
2. Standard network rules must be adhered to.
3. This is not an 'as-wired' schematic.
4. Mode 5 - 24v Supply to SFDI.
5. Mode 6 - 230v Supply to SFDI.



Network Cable Spec

Non Fire Rated Cable:

1. Beldon 9841NH, 2 Core, 0.51mm² conductor size

Fire Rated Cable Options:

1. Pyrmsian (Pirelli) FP200 Gold, 2 Core, 1.5mm²
2. Pyrmsian (Pirelli) FP200 Plus, 2 Core, 1.5mm²
3. Firetuf FT30, 2 Core, 1.5mm² conductor size
4. Firetuf FT120, 2 Core, 1.5mm² conductor size

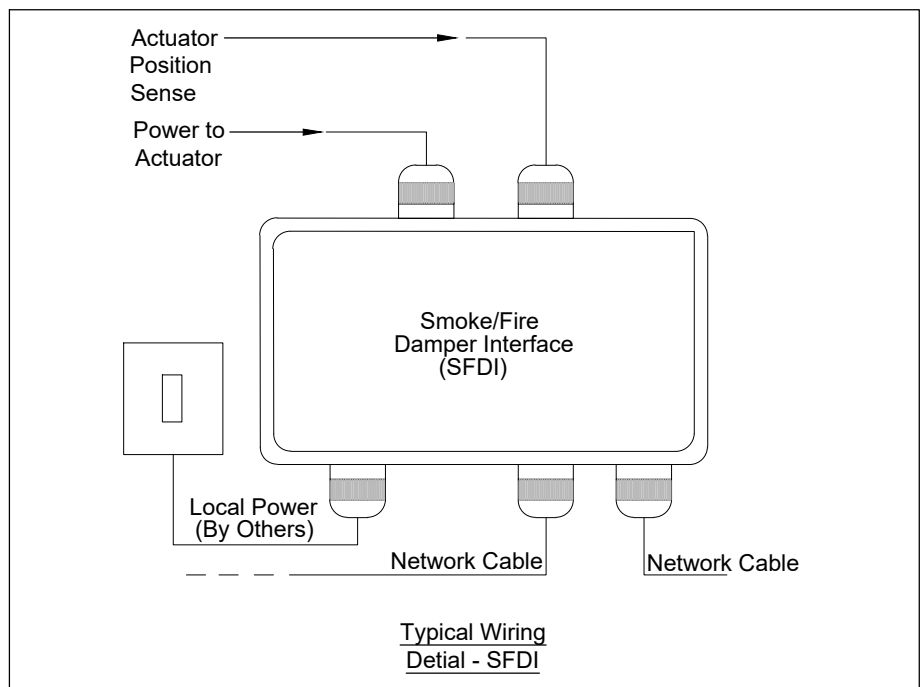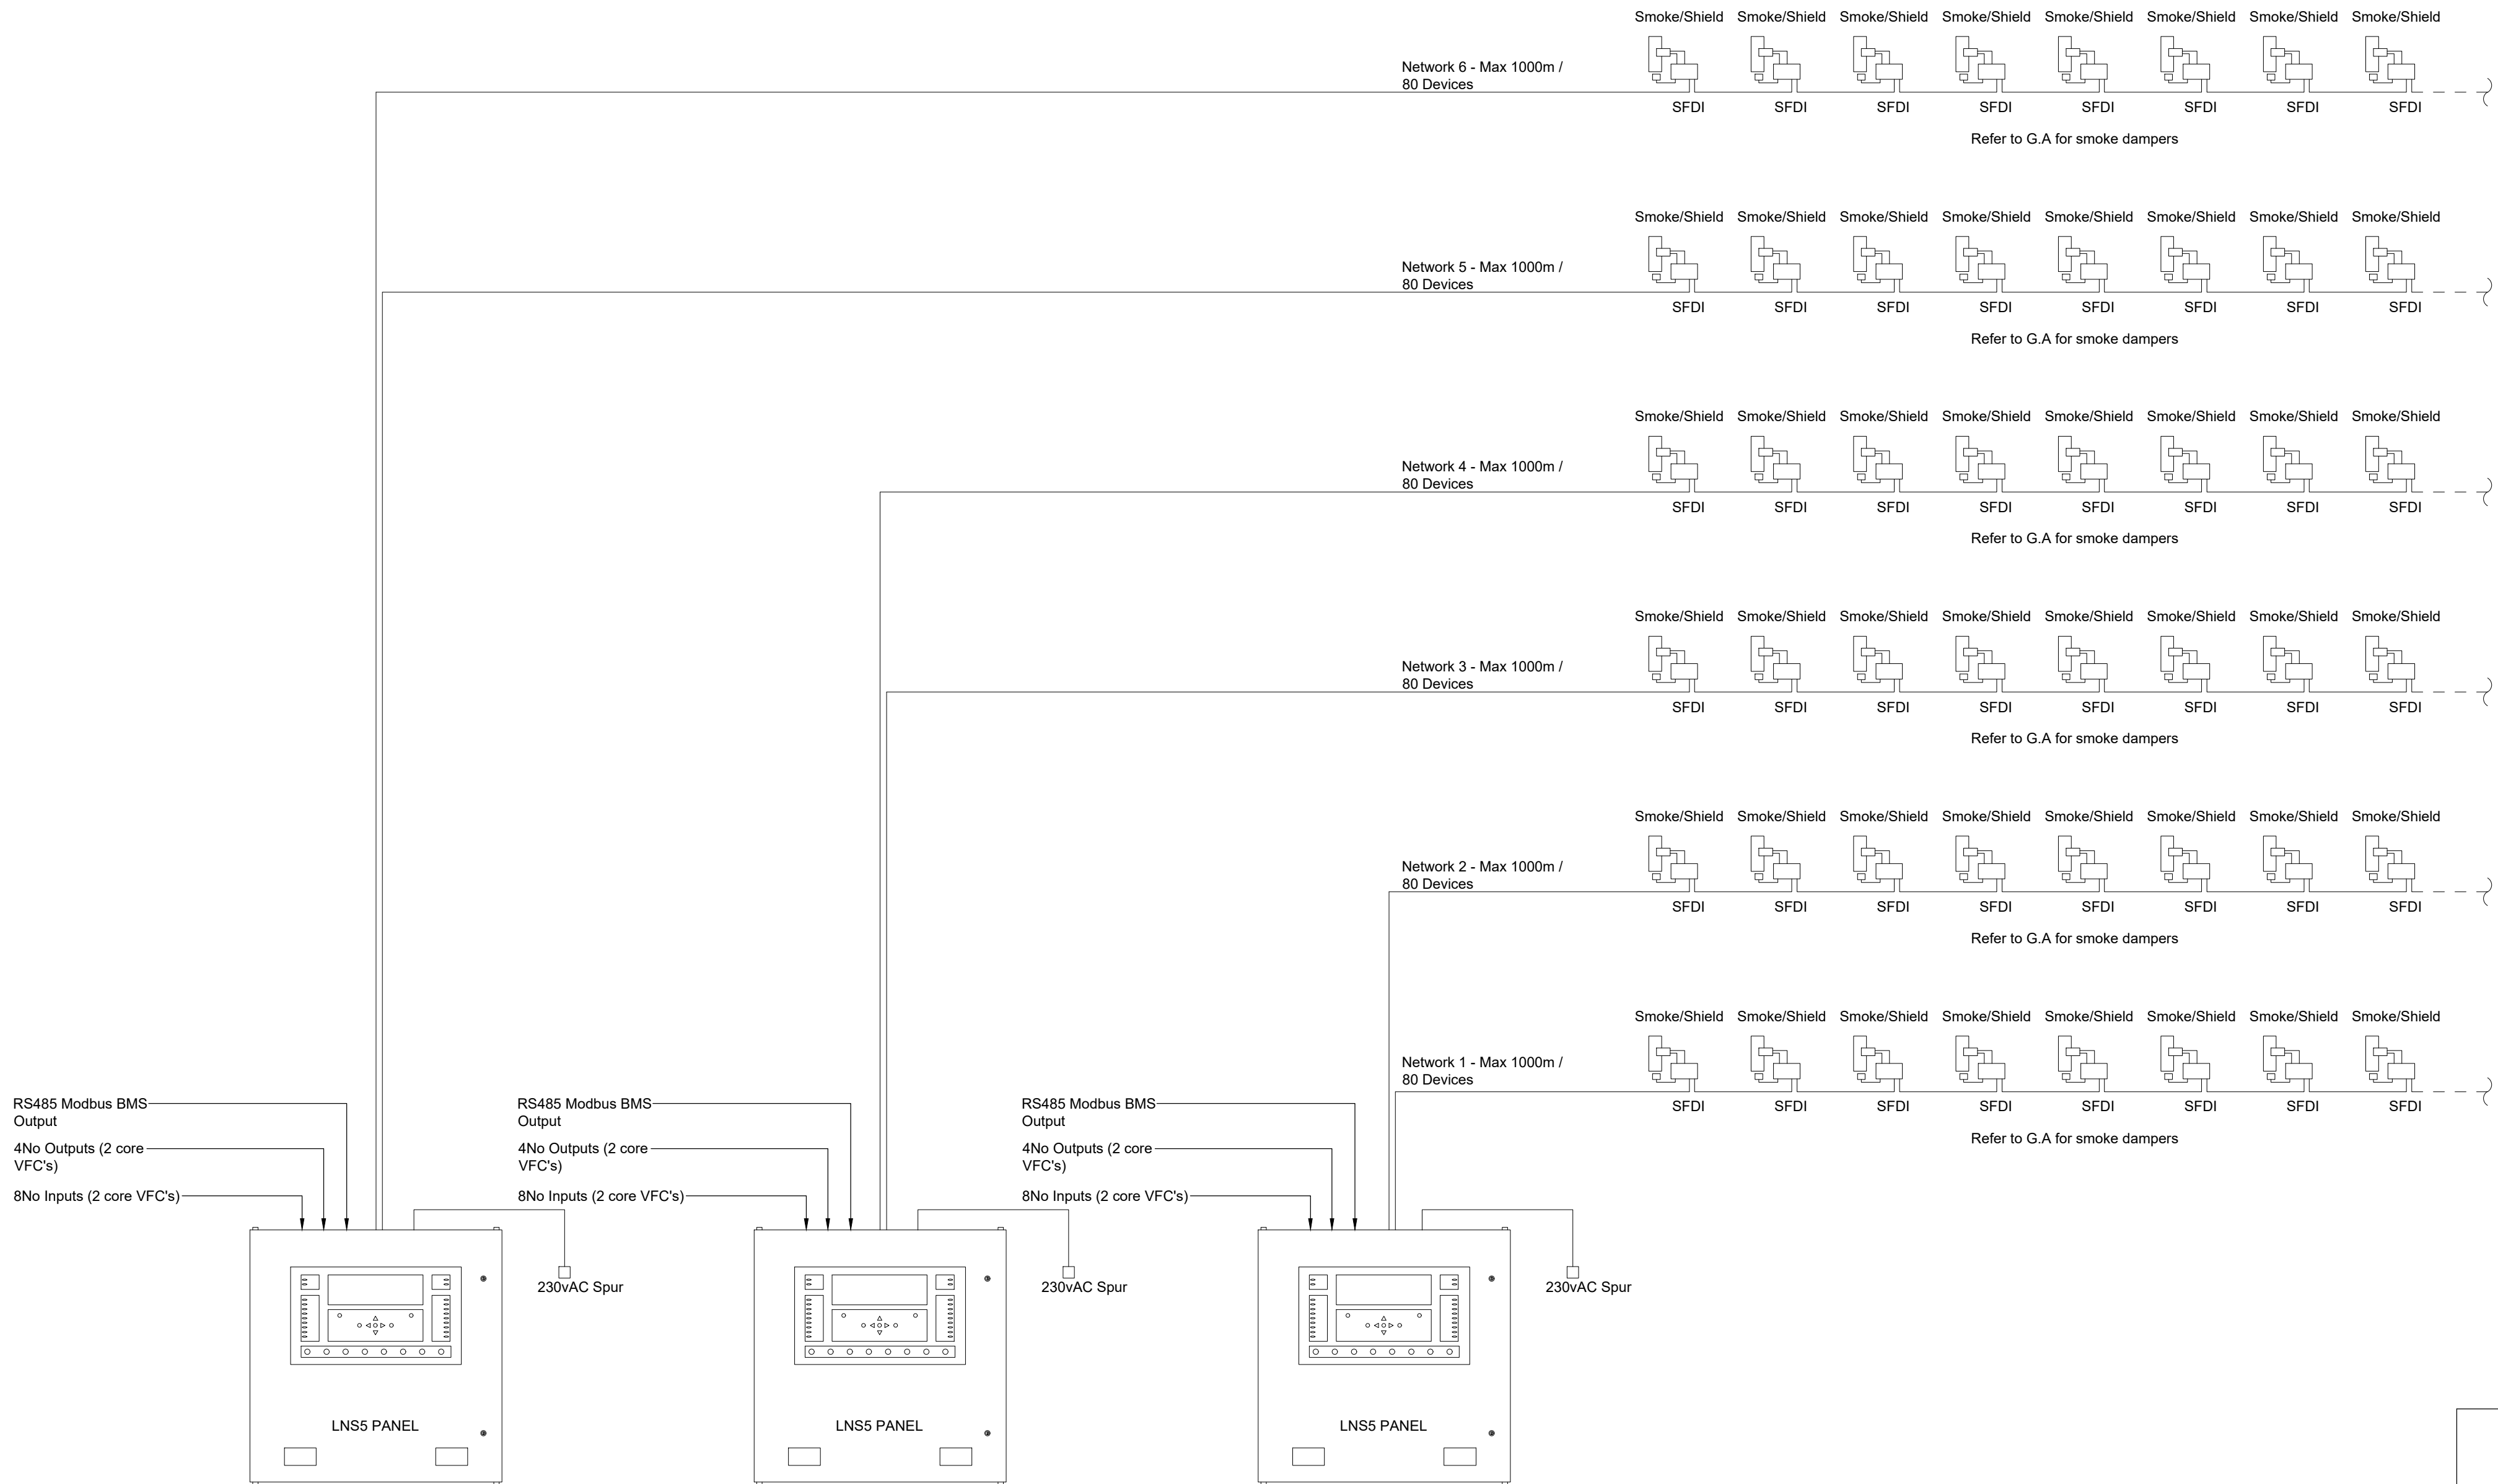

C1	NG	19.03.21	Contract Issue.
P1	NG	26.02.21	Preliminary Issue.
Rev	By	Date	Description



TACE®

THE ASSOCIATES CONSULTING ENGINEERS
Portland House
Stanley Green Business Park
Oak Green
Cheshire
SK8 6QL
T. 0161 486 0429
F. 0161 486 0488
E. info@tace.co.uk
W. www.tace.co.uk

Client

FRP Advisory

Project

Victoria Mill

Drawing Title

Smoke Shield Schematic

Drawn EI	Date 24.02.21	Cad File PA1484-TCE-XX-XX-DR-E-4700	
Checked NG	Date 26.02.21	External Ref. -	
Approved NG	Date 26.02.21	Scale NTS at A1	Issue Status --
Job No. PA1484	Drawing No. TCE-XX-XX-DR-E-47001	Rev C1	