



PAIR OF UC'S TO "WALL 1" MUST BE INSTALLED BEFORE THOSE TO "WALL 2"

THE OUTLINE SEQUENCE OF INSTALLATION OF BEAMS TO WALL 1 AND WALL 2 IS AS FOLLOWS TO BE DEVELOPED WITH CONTRACTOR:


1. NEEDLE THROUGH WALL ABOVE PROPOSED BEAM LEVEL
2. PREPARE, SHUTTER AND CAST PADSTONES TO BEAMS ENDS
3. INSTALL BEAMS, AND INSTALL ALL BOLT SLEEVES BETWEEN BEAMS
4. DRY PACK TO TOP OF BEAMS TIGHT TO UNDERSIDE OF EXISTING WALL,
5. REMOVE NEEDLES ON COMPLETION

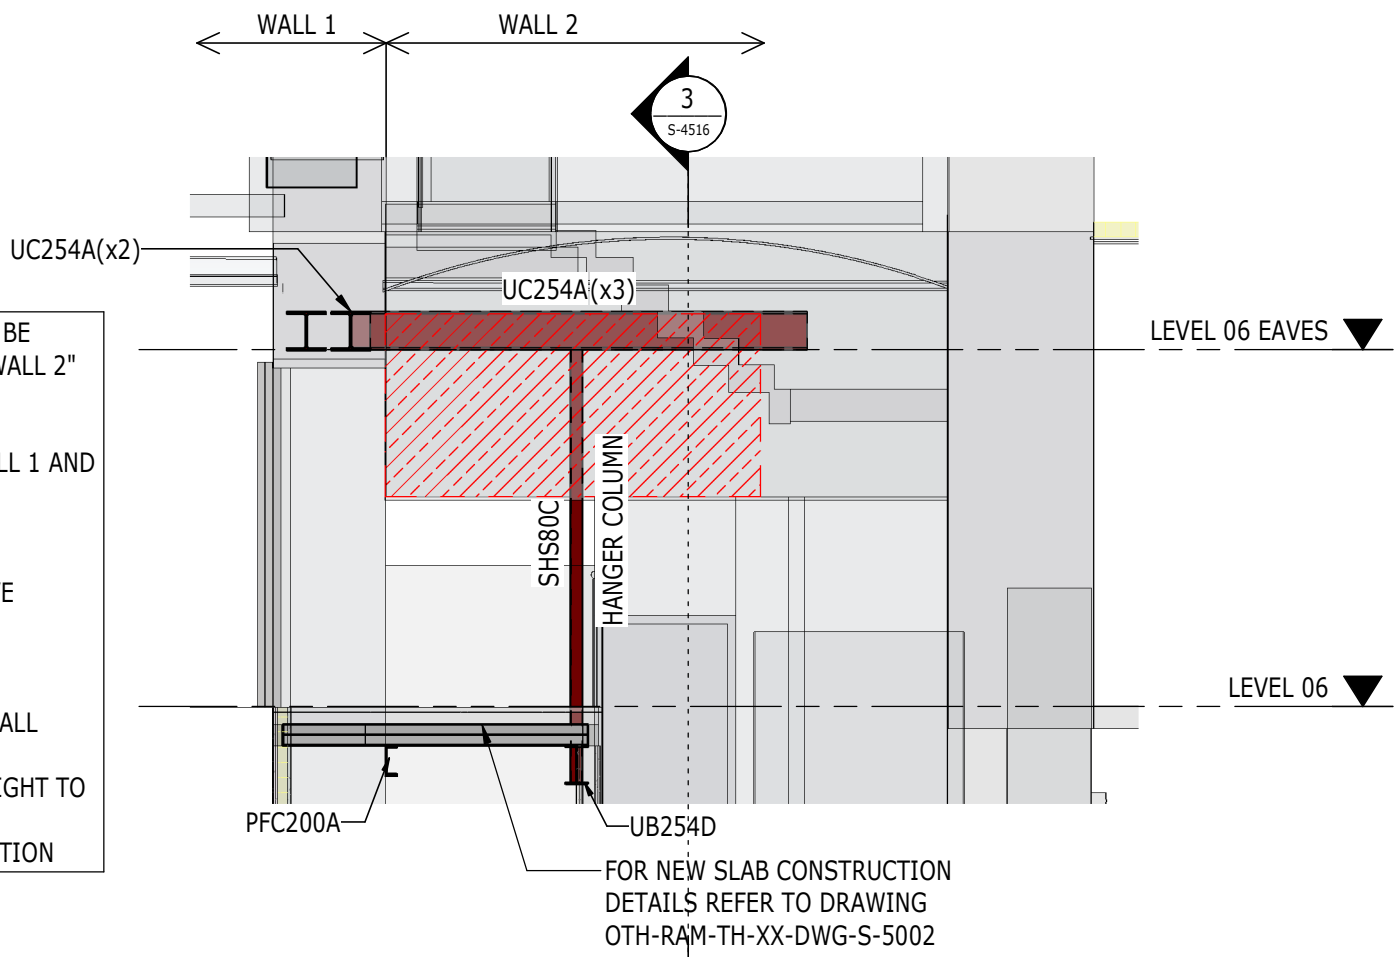

SECTION 1
1 : 50
PRINCESS ST LEVEL 06 SECTION 1

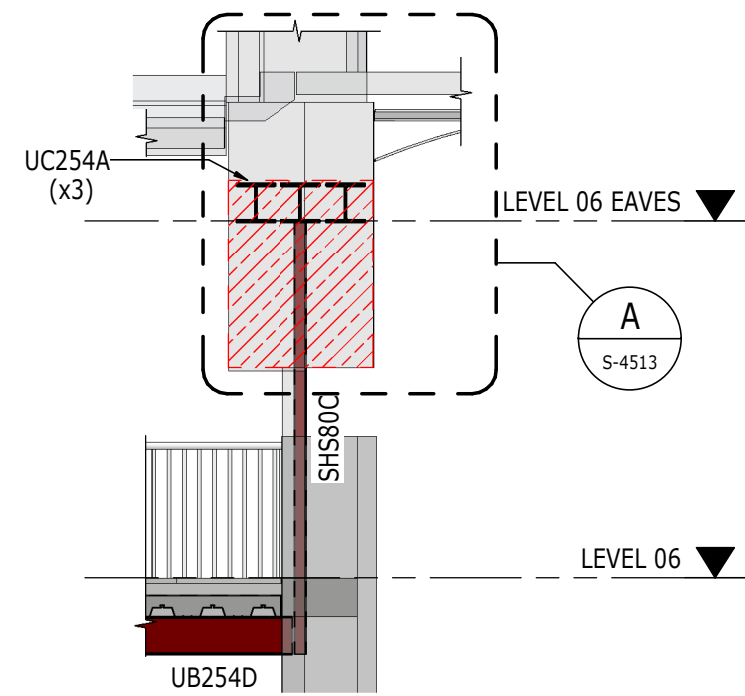


SECTION 2
1 : 50
PRINCESS ST LEVEL 06 SECTION 2

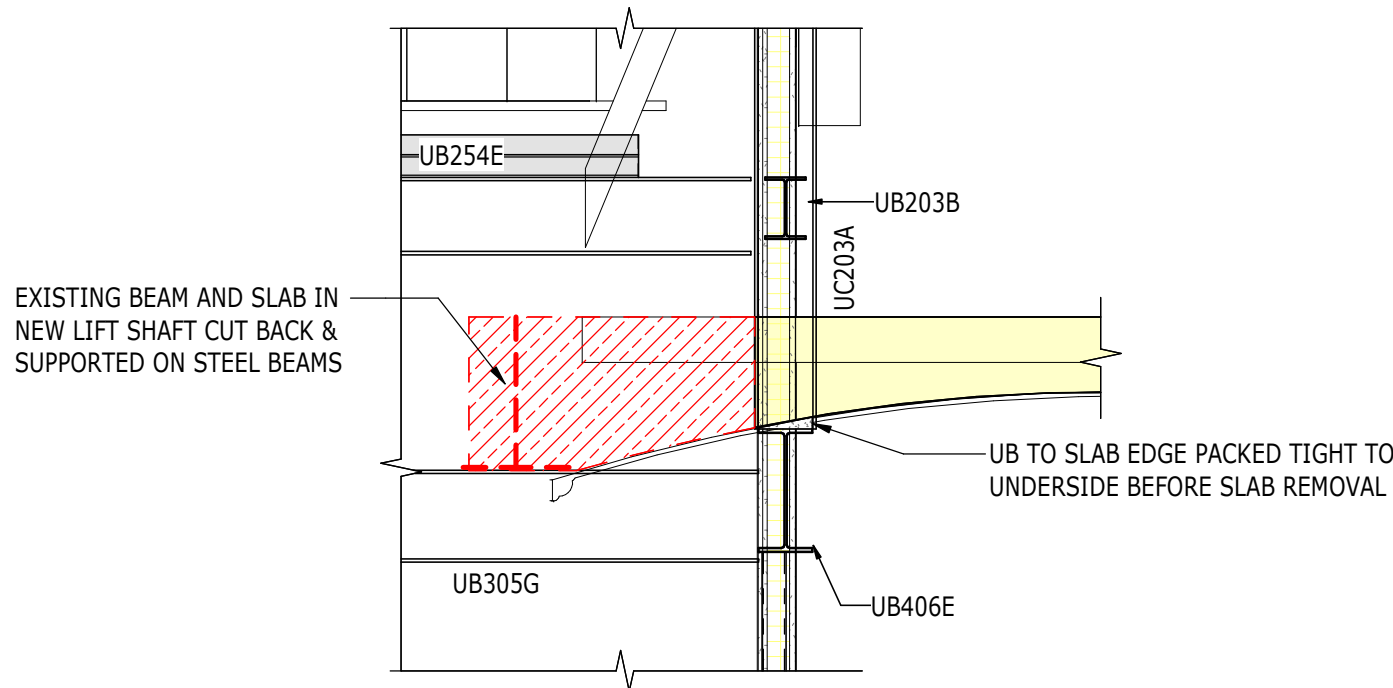


SECTION 3
1 : 25
PRINCESS ST LEVEL 06 SECTION 3

THE OUTLINE SEQUENCE OF INSTALLATION OF BEAMS TO WALL 1 AND WALL 2 IS AS FOLLOWS TO BE DEVELOPED WITH CONTRACTOR:

1. NEEDLE THROUGH WALL ABOVE PROPOSED BEAM LEVEL
2. PREPARE, SHUTTER AND CAST PADSTONES TO BEAMS ENDS
3. INSTALL BEAMS, AND INSTALL ALL BOLT SLEEVES BETWEEN BEAMS
4. DRY PACK TO TOP OF BEAMS TIGHT TO UNDERSIDE OF EXISTING WALL,
5. REMOVE NEEDLES ON COMPLETION

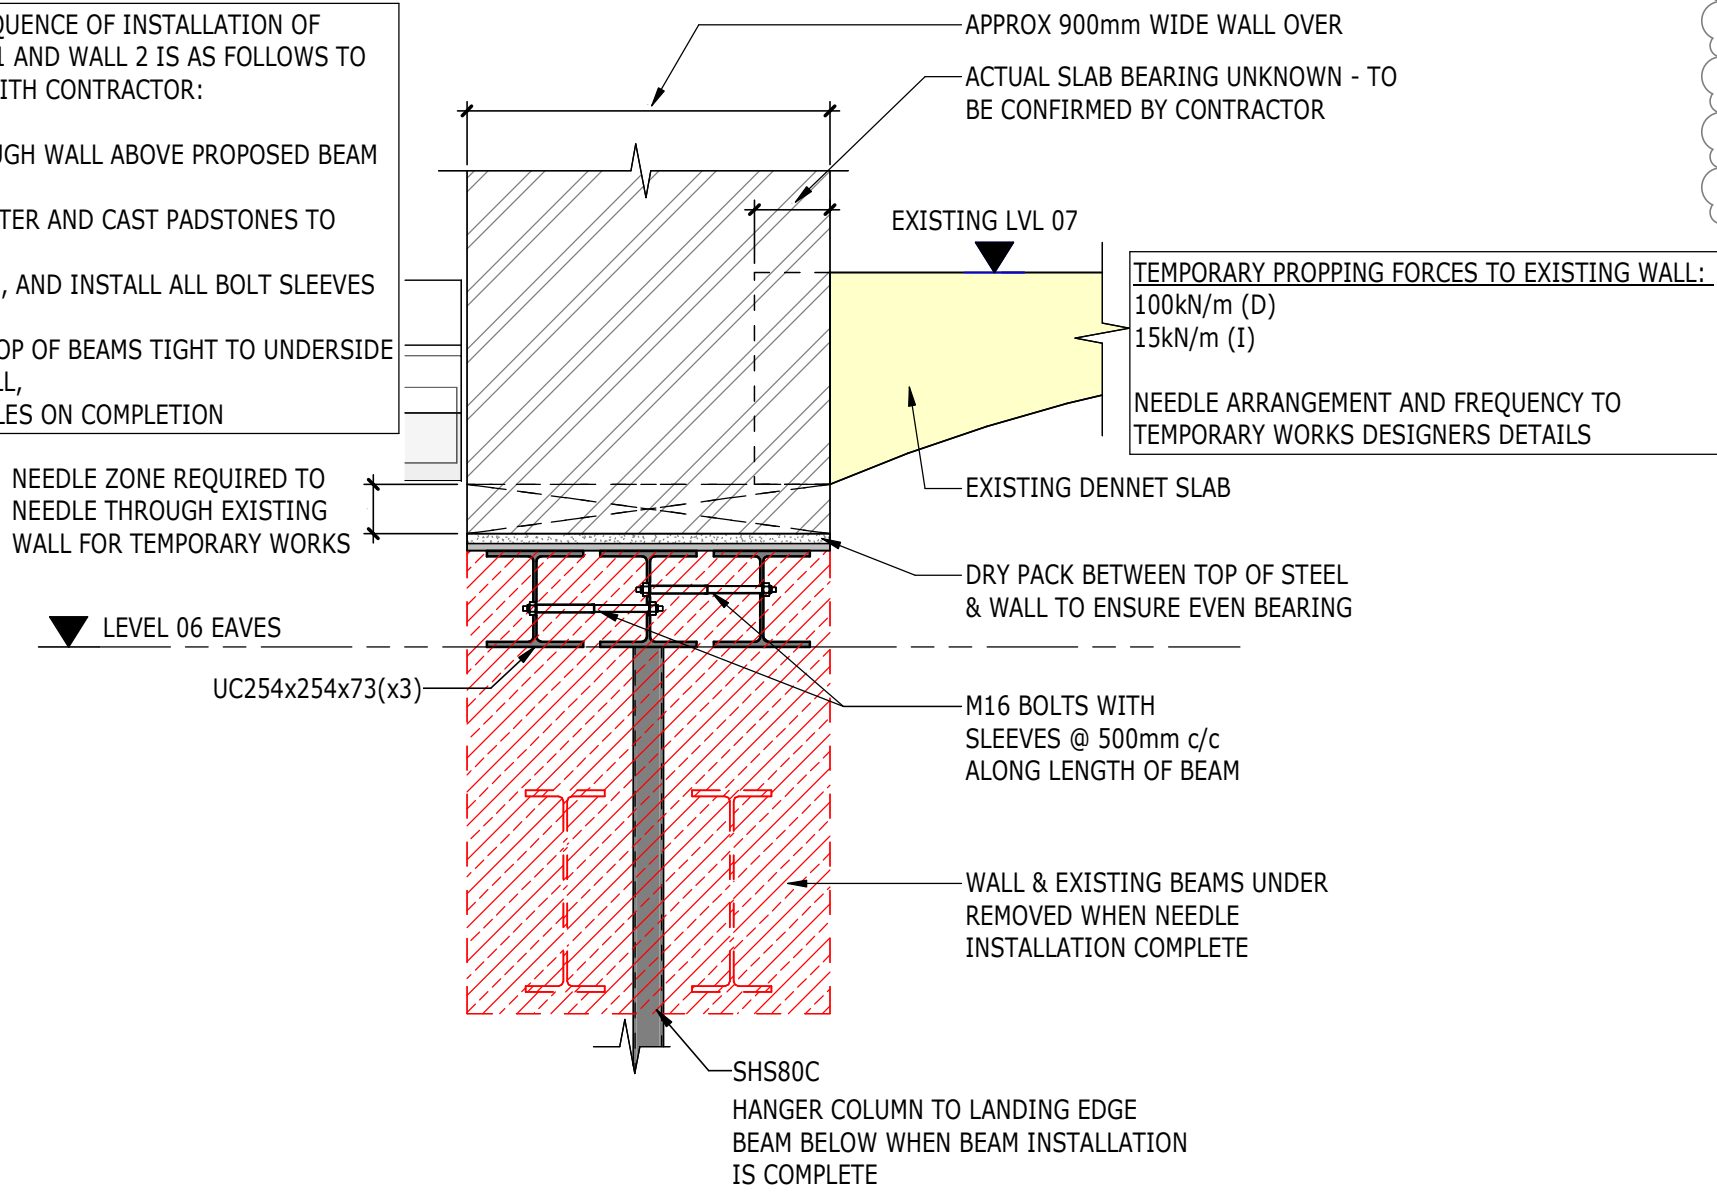

DETAIL A
1 : 20
PRINCESS ST LEVEL 06 DETAIL A

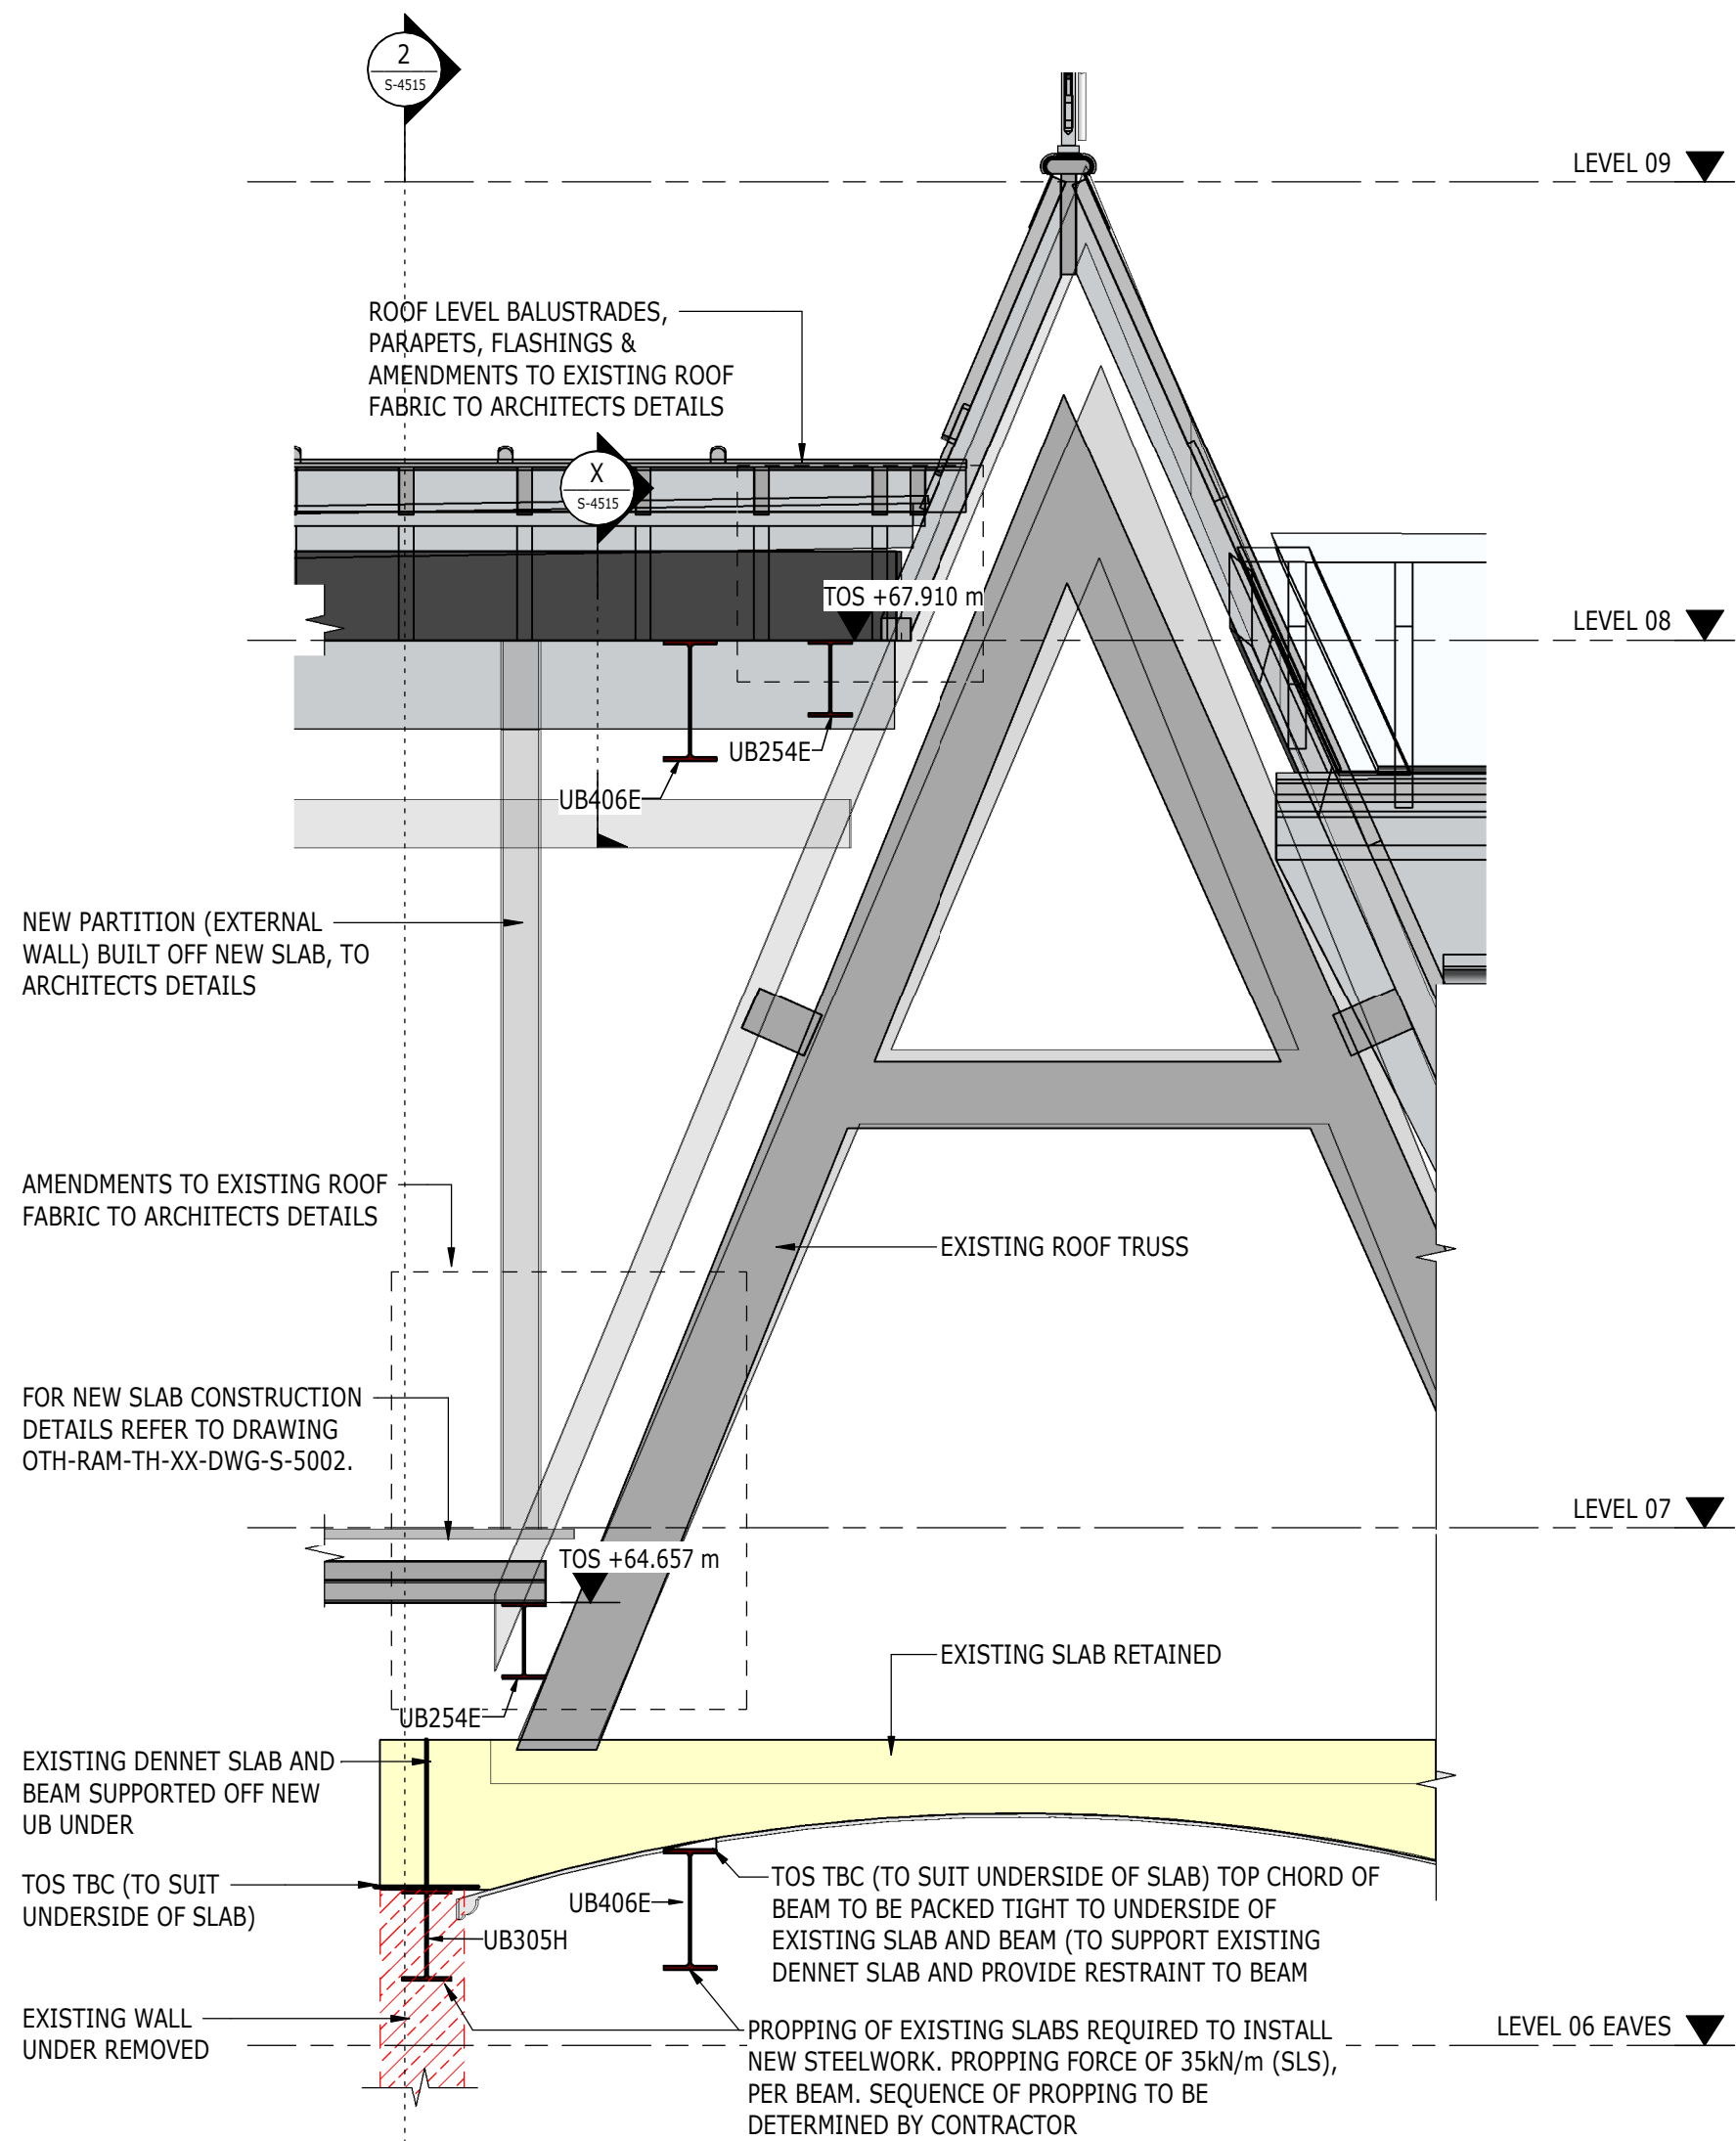

SECTION 4
1 : 25
PRINCESS ST LEVEL 07 SECTION 4

THIS DRAWING HAS SIGNIFICANTLY CHANGED FROM THE TENDER ISSUE, REFER TO PREVIOUS REVISION AND CHANGE TRACKER FOR THE LIST OF CHANGES.

THE STAIR PRESSURISATION DESIGN BY COLT HAS NOT YET BEEN CONCLUDED. AREAS OF THIS CORE ARE TO BE REVIEWED FOLLOWING THE OUTCOME OF THE DESIGN OPTIONS. THIS INCLUDES THE RISERS SHOWN IN ABEYANCE, THE STEEL & SLAB DESIGN AT UPPER LEVELS AND THE ROOF.

NOTE:
ALL DIMENSIONS/EXTENTS ARE TO BE CONFIRMED ON SITE. NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN DRAWINGS AND ONSITE CONDITIONS AND ALLOW TIME FOR ENGINEER TO REVIEW.

MEMBER CONNECTION FORCES

MEMBER REFERENCE	V	F
254UB	250kN	75kN
SHS80	-	+/-100kN

V - DENOTES VERTICAL SHEAR FORCE (END REACTION)
F - DENOTES AXIAL FORCE IN MEMBER (TIE FORCE)

Scale Bars to be used as guidance only - refer to sheet size below

1:100	1:200	1:500	1:1000	1:2000	1:5000	1:10000	1:20000
1:100	1:200	1:500	1:1000	1:2000	1:5000	1:10000	1:20000
1:1250	1:2500	1:5000	1:10000	1:20000	1:50000	1:100000	1:200000

- NOTES
1. FOR GENERAL NOTES, SEE DRAWING S-00010
 2. FOR STEEL AND PADSTONE REFERENCES, SEE SCHEDULES ON DRAWINGS S-00015/S-00016
 3. DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECTS DRAWINGS AND M&E ENGINEERS DRAWINGS
 4. DRAWING TO BE READ IN CONJUNCTION WITH STRUCTURAL SPECIFICATION
 5. ALL LEVELS AND SETTING OUT TO BE CONFIRMED BY ARCHITECT
 6. ALL REINFORCED CONCRETE TO BE C30/37 UNO.
 7. ALL CONCRETE BLINDING TO BE GEN 1 AND BULK MASS FILL TO BE GEN 3 UNO
 8. ALL REINFORCEMENT TO BE GRADE 500 TO BS4449
 9. STEELWORK:
INTERNAL: GENERAL SECTIONS AND PLATES S275JR, HOLLOW SECTIONS S355JRH
EXTERNAL: GENERAL SECTIONS AND PLATES S275JO, HOLLOW SECTIONS S355JOH
ALL EXTERNAL STEELWORK TO BE GALVANISED. ALL INTERNAL STEELWORK TO BE PAINTED, AND SUITABLE FOR ENVIRONMENT CATEGORY C2, UNO (SEE STRUCTURAL SPECIFICATION)
 10. REFER TO RAMBOLL BWIC SCHEDULE OTH-RAM-TH-ZZ-SCH-S-1000 & S-1001 FOR WHERE BWIC ARE APPLIED.
 11. FOR MASONRY NOTES, SEE DRAWING S-0010
 12. FOR NEW LINTEL DETAILS, REFER TO LINTEL SCHEDULE OTH-RAM-TH-ZZ-SCH-S-1000 & 1001

- KEY
- DENOTES EXTENT OF NEW SLAB. REFER TO DRAWING OTH-RAM-TH-XX-DWG-S-5002 FOR NEW SLAB CONSTRUCTION DETAILS
 - DENOTES EXISTING DENNET SLAB ABOVE TO BE RETAINED, AND ASSUMED SPAN DIRECTION. DASHED LINE INDICATES APPROXIMATE LOCATION OF EXISTING BEAMS BASED UPON ARCHIVE INFORMATION, VISUAL & INTRUSIVE INVESTIGATIONS.
 - NOTE:** BOTH TO BE CONFIRMED ON SITE BY CONTRACTOR PRIOR TO CONSTRUCTION
 - DENOTES AREA OF DEMOLITION
 - DENOTES LOCATION OF PADSTONE. REFER TO DRAWING S-0015 FOR SIZES, UNLESS NOTED OTHERWISE. FOR PADSTONE DETAILS SEE DRAWING S-5001
 - DENOTES NEW LIFT SHAFT WALLS. REFER TO SECTION DRAWINGS FOR LINTEL REQUIREMENTS
 - DENOTES CUT / DEMOLISHED LINE AND EXTENT OF TEMPORARY PROPPING. ALL PROPPING FORCES FOR MIN 15kN/m (SLS) AT SLAB EDGES UNO ON GA DRAWINGS
 - DENOTES EXISTING BEAMS WITHIN FLOOR CONSTRUCTION. WHERE BEAMS ARE TO BE CUT / PARTIALLY REMOVED, CONTRACTOR TO REVIEW TEMPORARY PROPPING PROPOSALS. ALL PROPPING FORCES FOR MIN 50kN (SLS) AT BEAM LOCATIONS UNO ON GA DRAWINGS

C01	24/06/ 2021	PM	JP	CONSTRUCTION ISSUE
T02	14/02/ 2020	PM	JP	GENERAL NOTES UPDATE, AS CLOUDED
T01	20/09/ 2019	PM	JC	STAGE 4 ISSUE
ISSUE	DATE	APPROVED	DRAWN	DESCRIPTION



OUR
TOWN
HALL
PROJECT



www.ramboll.co.uk

Arkwright House, Parsonage, Manchester M3 2LF
+44 (0) 161 827 1890
www.Ramboll.com

PROJECT STATUS	STAGE 5
CLIENT	MANCHESTER CITY COUNCIL
PROJECT	OUR TOWN HALL PROJECT
DRAWING TITLE	PRINCESS STREET SECTIONS & DETAILS SHEET 3
SIZE & SCALE	A1: AS SHOWN
DRAWING STATUS	S4 - CONSTRUCTION
JOB NUMBER	1620003165
DRAWING NO.	REV
OTH-RAM-TH-ZZ-DWG-S-4513 C01	