



THIS DRAWING IS TO BE READ IN CONJUNCTION WITH
21-MSD-4166-1, 2 AND 4


PLATFORM DESIGN LOAD 2.00 .kN/m²

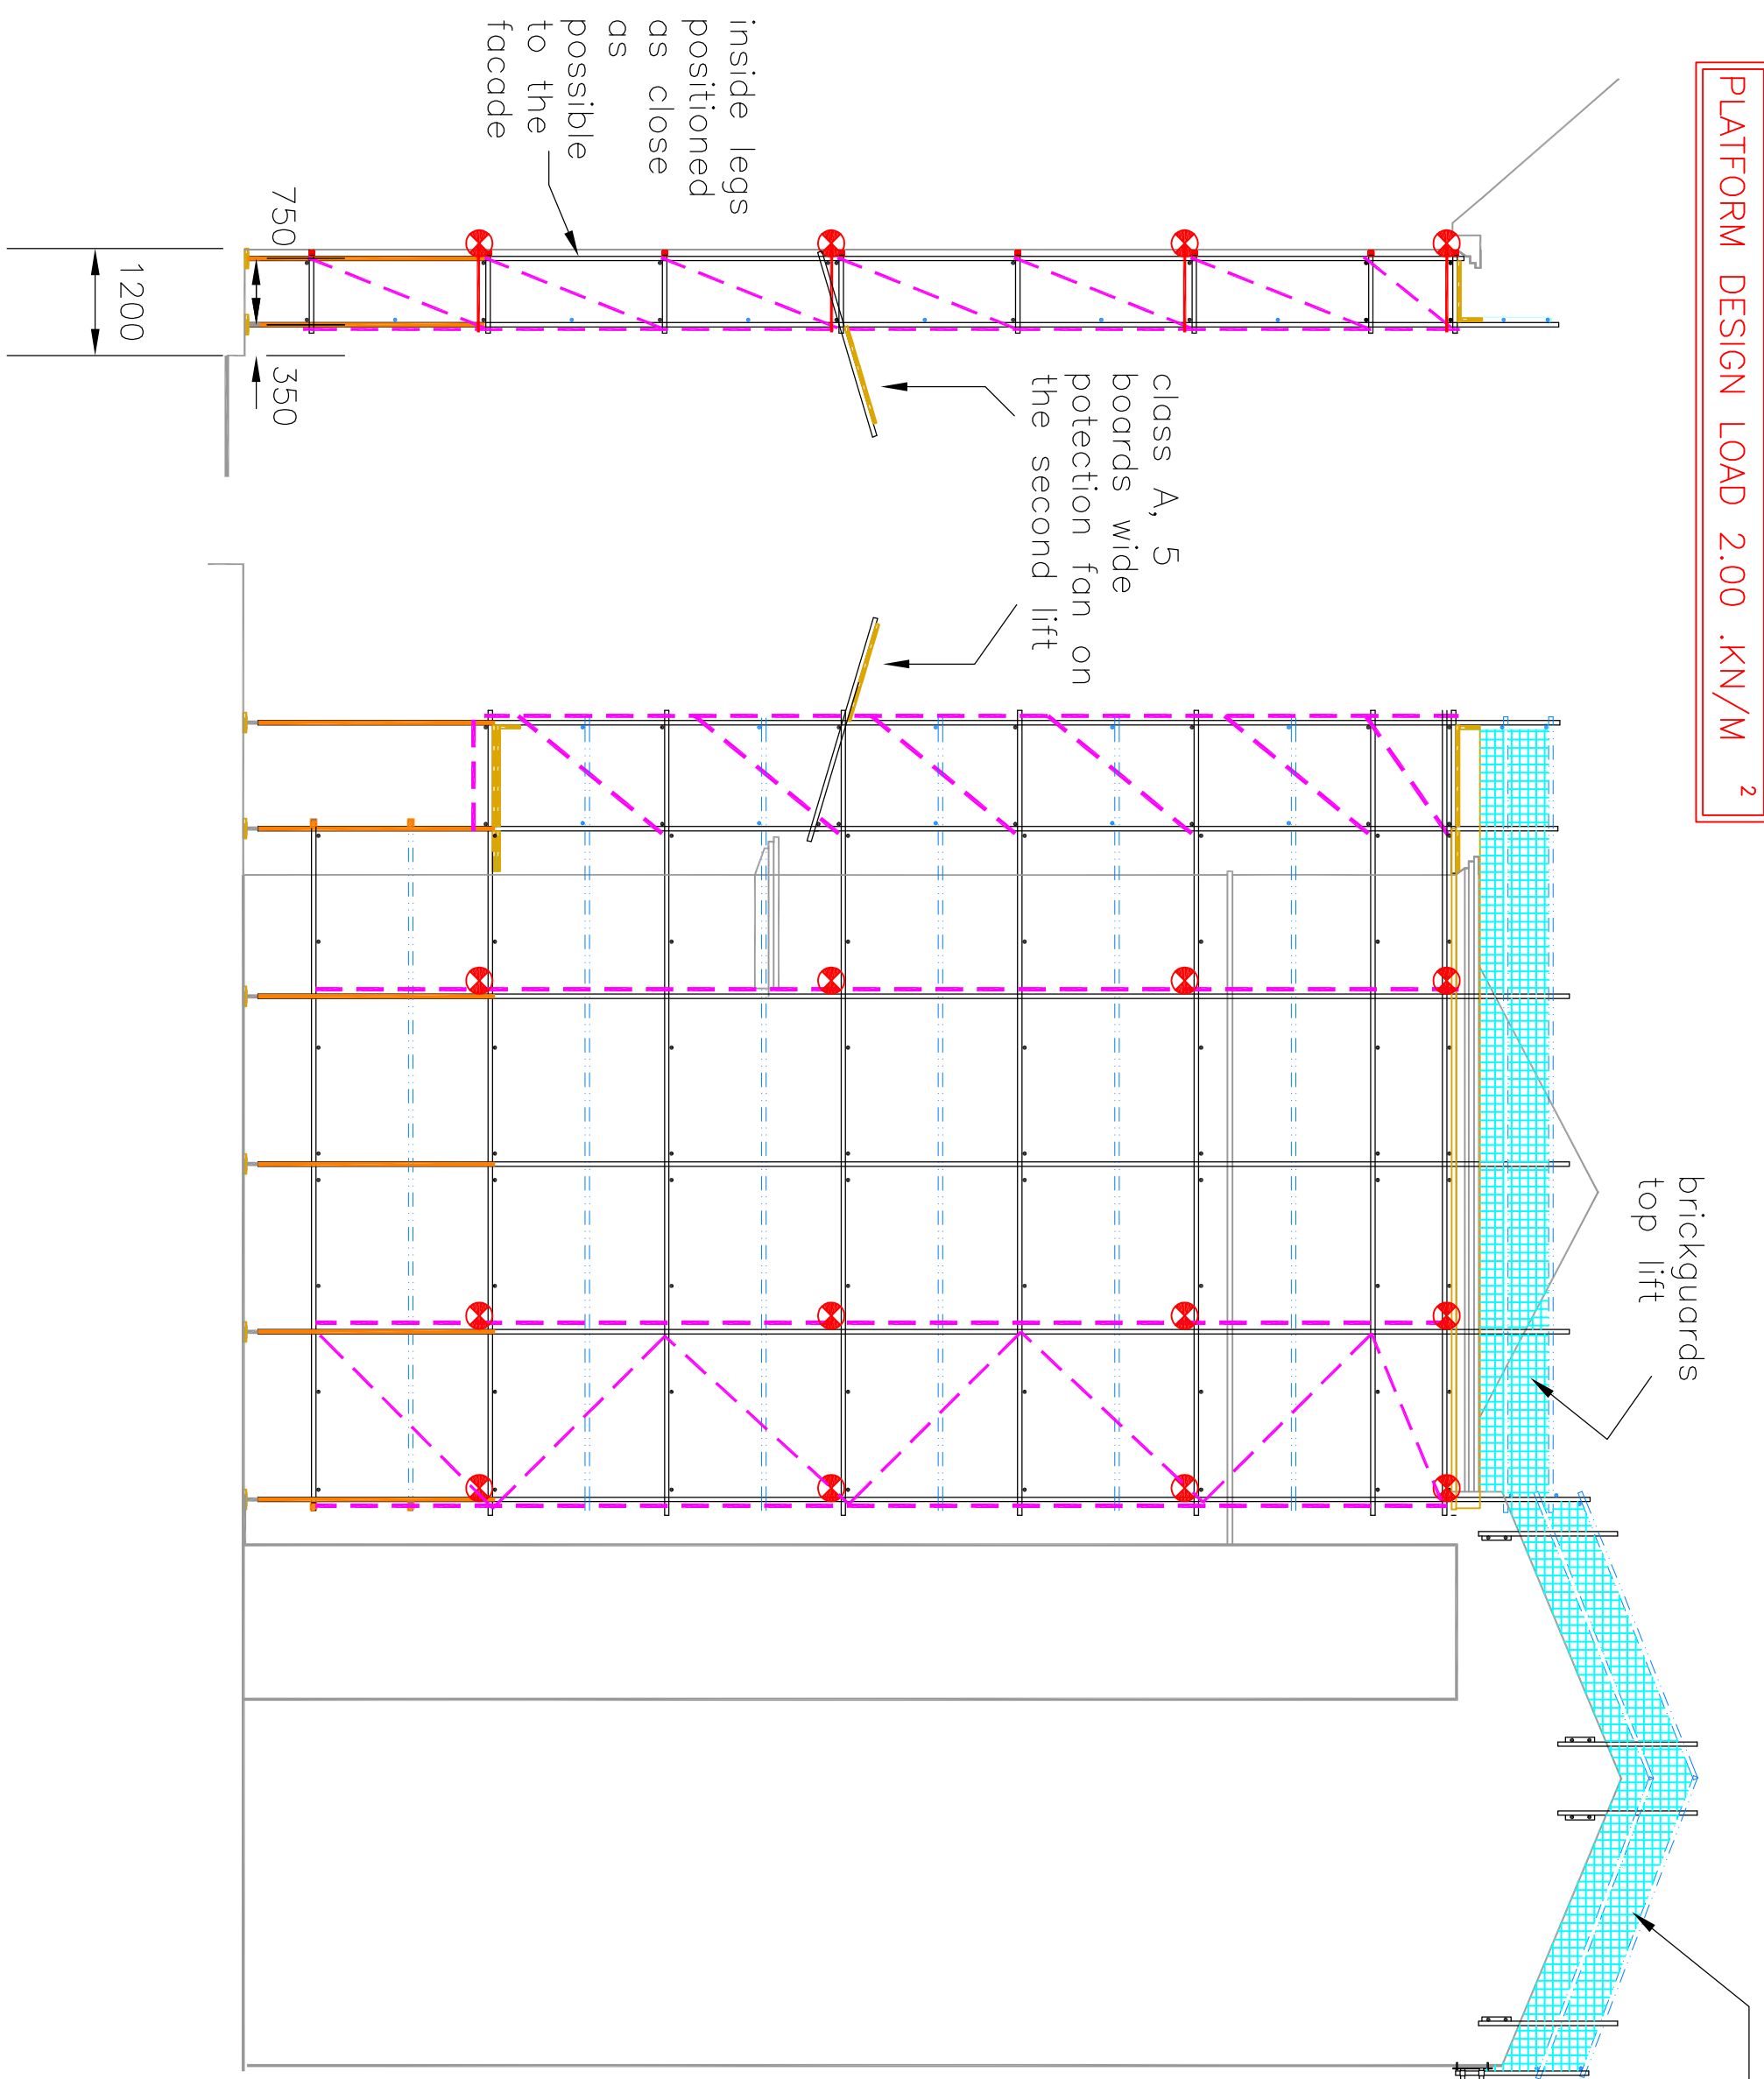

TYPICAL BOLTED HANDRAIL TO
PERIMETER OF PITCHED ROOFS
MAX C/C 2.7M

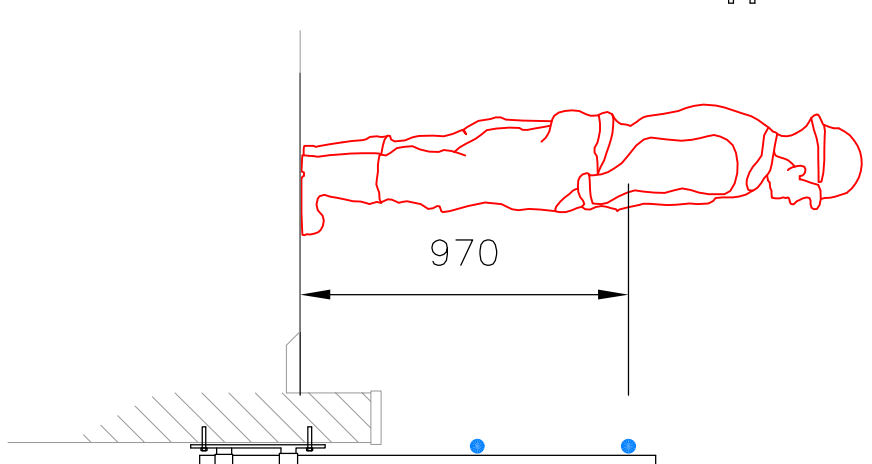

TEST TIES TO 3KN

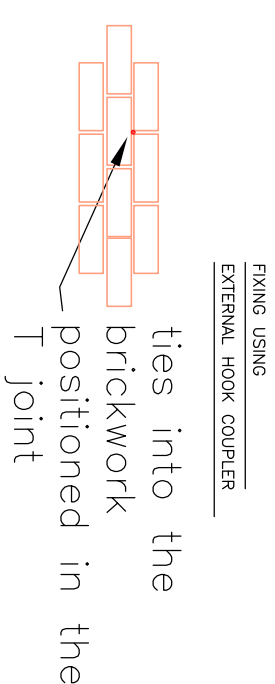

Structure/ground must be adequate to support all the imposed loads from the scaffold

Main contractor to be responsible for all traffic management and security, including protective barriers, hoarding, site lighting, warning signs, and lighting protection etc as and where required

SCAFFOLD NOT SHEETED OR NETTED

NO WORK ON SCAFFOLD IS PERMITTED WHEN WIND EXCEEDS 40mph

SECTION E-E

PART ELEVATION F-F

DESIGN BASED RESIDUAL HAZARD


Design Based Hazards actively eliminated where possible in the Design Process. Where Hazards cannot be eliminated, this symbol on the drawing with an attached note means:

1. Design Based Hazards Exists within this proposal
2. Action is required by the person supervising the work to manage the design Hazards during construction

all scaffold tubes shall be type steel to BS EN 39:2001 or BS 1139-1-1:1990 (as new) all couplers in accordance with EN 12811-1

all timber boards shall be 225x38, C24

scaffold to be erected in accordance with TG20:21, the work at height regulations and SG4

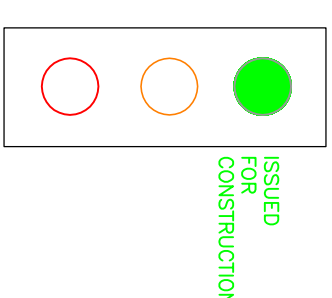[illegible]