

Do not scale from this drawing. All information should be checked by the contractor on site before commencing work. Any discrepancies should be reported to the architect immediately. All rights are reserved and are not transferable. Unauthorised reproductions of this drawing are not permitted.

GENERAL NOTES

- (1) THE CONTRACTOR IS TO CHECK AND VERIFY ALL BUILDING AND SITE DIMENSIONS, LEVELS AND STEEP INVERT LEVELS AT CONNECTION POINTS BEFORE WORK COMMENCES.
- (2) THE CONTRACTOR IS TO COMPLY IN ALL RESPECTS WITH THE REQUIREMENTS OF THE BUILDING REGULATIONS AND NOT SPECIFICALLY STATED ON RELATION TO EITHER OR NOT.
- (3) BEFORE WORK COMMENCES – ENSURE ALL PLANNING CONDITIONS AND BUILDING REGULATION CONDITIONS HAVE BEEN RESOLVED TO THE SATISFACTION OF THE LOCAL AUTHORITY.
- (4) ALL WORKS TO COMPLY WITH THE WORKMANSHIP CLAUSES IN BS8000 SERIES AND TO BE IN FULL COMPLIANCE WITH THE BUILDING REGULATIONS.
- (5) CONTRACTOR IS TO NOTIFY BUILDING CONTROL AT THE APPROPRIATE STAGES IN CONSTRUCTION – NECESSARY FOR THE DETERMINING THE WORST CASES COMPLIANCE.
- (6) THE CONTRACTOR IS TO BE RESPONSIBLE FOR THEMSELVES TO UNDERSTAND THE PLANS AND ANY APPROPRIATE STRUCTURAL DETAILS BEFORE ANY WORK COMMENCES ON SITE.
- (7) THE PLANS RELATING TO THE PROPOSED PROJECT TO BE READ IN CONJUNCTION WITH ALL APPROPRIATE STRUCTURAL ENGINEERS DETAILS.
- (8) DO NOT SCALE FROM PLANS, USE FIGURED AND ON SITE DIMENSIONS ONLY. IF QUERIES ARISE ON SITE CONTACT SITE AGENT.
- (9) THE CONTRACTOR IS TO CHECK ALL DIMENSIONS ON SITE PRIOR TO COMMENCEMENT OF WORK ON SITE AND ANY DEFICIENCIES BE BROUGHT TO THE ATTENTION OF THE SITE AGENT.
- (10) ALL SITE WORK TO BE CARRIED OUT TO THE BUILDING REGULATIONS 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (11) ALL STATUTORY SITE INSPECTIONS ARE TO BE SEEN AND APPROVED BY LAB.C.O. PRIOR TO ANY COVERING UP OF WORK.

(12) NO WORK IS TO BE CARRIED OUT FROM THIS PLAN UNTIL IT HAS BEEN STAMPED APPROVED BY COUNCIL BUILDING CONTROL AND PLANNING DEPARTMENTS.

(13) ALL DRAINAGE AND FOUNDATION IS PROVISIONAL AND SUBJECT TO THE CONDITIONS ENCOUNTERED ON SITE.

(14) ALL CONCRETE WORK TO BE CARRIED OUT TO BS5328:1981 AND BS1282:1985.

(10) ALL BRICKWORK TO BE CARRIED OUT TO BS5528:PT3: 1965.

(15) ALL LIMBER TO BE TREATED WITH A SUITABLE PRESERVATIVE TO BS1262:1975.

(16) ALL WORK REGARDING THIS PROJECT IS SUBJECT TO THE BCO'S APPROVAL AND SATISFACTION.

(17) ALL STRUCTURAL WORK MUST BE INSPECTED AT THE RELEVANT STAGES BY THE STRUCTURAL ENGINEER AND/OR

THE BUILDING CONTROL OFFICER, AND COMPLY WITH THEIR REQUIREMENTS.

(18) ALL ELECTRICAL WORK IS TO COMPLY WITH ALL THE RELEVANT REQUIREMENTS OF PART P. COMPLETION CERTIFICATE TO BE PROVIDED ON COMPLETION OF WORK

(19) SITE TO BE LEFT CLEAN BY CONTRACTOR AFTER COMPLETION OF PROJECT

CODE 4 LEAD FLASHINGS (MIN HURSTAND 150mm & MIN

CODE LEAD 1 DIMENSIONS (MIN OF STAND 150MMIT & MIN 150MM SPREAD ON TILE) AND CAVITY TRAYS ARE TO BE USED WHERE INDICATED.

- DOUBLE GLAZING TO BE PROVIDED TO ALL WINDOWS TO NEW STRUCTURE, THEREFORE U-VALUE OF WALLS TO BE

0.28w/m² K AND U-VALUE OF WINDOWS TO BE 1.6w/m² K, & EXTERNAL DOOR 1.8w/m² K (I.E.. CONSTRUCTED AS

INDICATED). SAFETY GLAZING TO CRITICAL LOCATIONS.
- WHERE EXISTING GROUND FLOOR IS OF THE SUSPENDED

TIMBER TYPE, VENTILATION IS TO BE MAINTAINED BY DUCTING FROM EXISTING VENTS WITH 100mm EARTHENWARE PIPES LAID

IN HARDWARE TO NEW EXTERNAL VENTS, GIVING A MIN VENTILATION AREA EQUIVALENT TO 3000sqmm PER METER RUN

- THE NEW CAVILLES SHOULD BE CONTINUOUS WITH THOSE OF THE EXISTING PROPERTY.

- INSULATED CAVITY CLOSERS TO BE PROVIDED AT ALL WINDOWS & DOOR OPENINGS.

NEW GROUND FLOOR

ALL VEGGIES, SOIL, AND DELETERIOUS MATTER STRIPPED OFF SITE. LAY MIN. 150mm OF CLEAN, CRUSHED STONE. HARDWARE AND COMPACT. LAY 120 GAUGE DPM AND FULLY LAP WITH DPC. ANY JOINTS IN DPM TO BE LAPPED MIN 300mm. PROVIDE 100mm KINGSPLY/EXTRAHEAVY/CELOTEX[®] INSULATION AS SHOWN ON SECTION. LAY MIN. 100mm EXISTING (112x42mm) AGGREGATED SLAB FINISH SURFACE. PROVIDE 25mm POLYURETHANE FOAM INSULATION. EXISTING WOOD FLOOR LAY 100MM DIA PVC PIPE IN NEW EXISTING FLOOR.

1

PROJECT

73, Dennison Avenue, 025

Wilmington

CLIENT

Mr. Johnny Poulse

DRAWING TITLE

Floor Plan (QD)

Se

JOB NO. NA-B01

INA-B01 ☐ ☐

SCALE	DATE	REVISION
1:50@A2	May 2021	(9)

4:0783 805 3405

U
L: 0162 693 3403
e: niamat@hotmail.co.uk

EXISTING REAR ELEVATION


EXISTING FRONT ELEVATION

EXISTING SIDE ELEVATION

EXISTING SIDE ELEVATION

GARDEN

- New 102mm facing brick work to match existing.
- 100mm Cavity to be fully filled with Knaut's Ditherm 37 Cavity batts, 100mm Thermalite block work to internal skin dot dab plasterboard taped and skim finished.
- Proposed external walls incorporating appropriate cavity wall ties, at max. 750mm horizontal and 450mm vertical centers (300mm at wall reveals).
- All stud work to be 12.5mm plasterboard (12.5mm moisture resistant in bathrooms) either side of 75x50mm softwood framework @ max. 400mm c/cs, head and sole plate to be provided. With gypsum skim finish to plasterboard and 75mm 'crown frametherm' insulation between framework.
- All new windows to use double glazed units with a 'low-e' soft coating with an emissivity of 0.05. The double glazed panels are to be separated by a 16mm gap to provide a U-value of 1.6w/m²k.
- Trickle vents to windows. Safety glazing to critical locations as per approved document 'K'. Windows to open 1/10 th of the floor area. All new first floor habitable room windows to be fire escape, windows to be 800-1100mm above FFL.
- Ceiling to be 12.5mm Gyproc Wallboard Duplex taped and skimmed. Include 100mm rock wool insulation between joists and 170mm above joists. NOTE - Special precautions may be required when electric cables are covered by insulating materials.
- All internal SVPs to be boxed in with 2 No. layers of 12.5mm plasterboard, outer layer to be moisture resistant, on 75x50mm softwood framework @ max. 400mm c/cs with 30mm 'QuietZone Acoustic Blanket' fixed to manufacturers specification and an access panel to enable rodding of the Soil Pipe. All pipework to be wrapped in 'QuietZone Partition Roll'.
- Mid span strutting should be provided to floor joists.
- Where new brickwork abuts existing walls cavities should be continuous.
- A cavity tray (300mm wide DPC) to be provided over the brickwork on all door and windows opening and single storey roof abutment.
- All internal and external lintels to have 150mm minimum bearing.
- 30x5mmx1.2m galvanized steel straps to be used for lateral restraint at wall plate and top with gable wall and roof rafters @ 2m c/c.
- Steel work to Structure Engineer's design and specifications. Boxed in 2 layers of plasterboard or single layer of Fireline.
- Sockets and switches between 450mm and 1200mm.
- All drainage to the satisfaction of the LABC Inspector on site.
- All new gas and heating works to be carried out by a Gas Safe Registered Installer and certificate to be provided on completion.
- All new Electrical work to be carried out by a qualified and competent person and certificate to be issued on completion of work.
- All smoke & heat detectors to be battery packed, mains powered, hardwired interlinked to all storey landings.

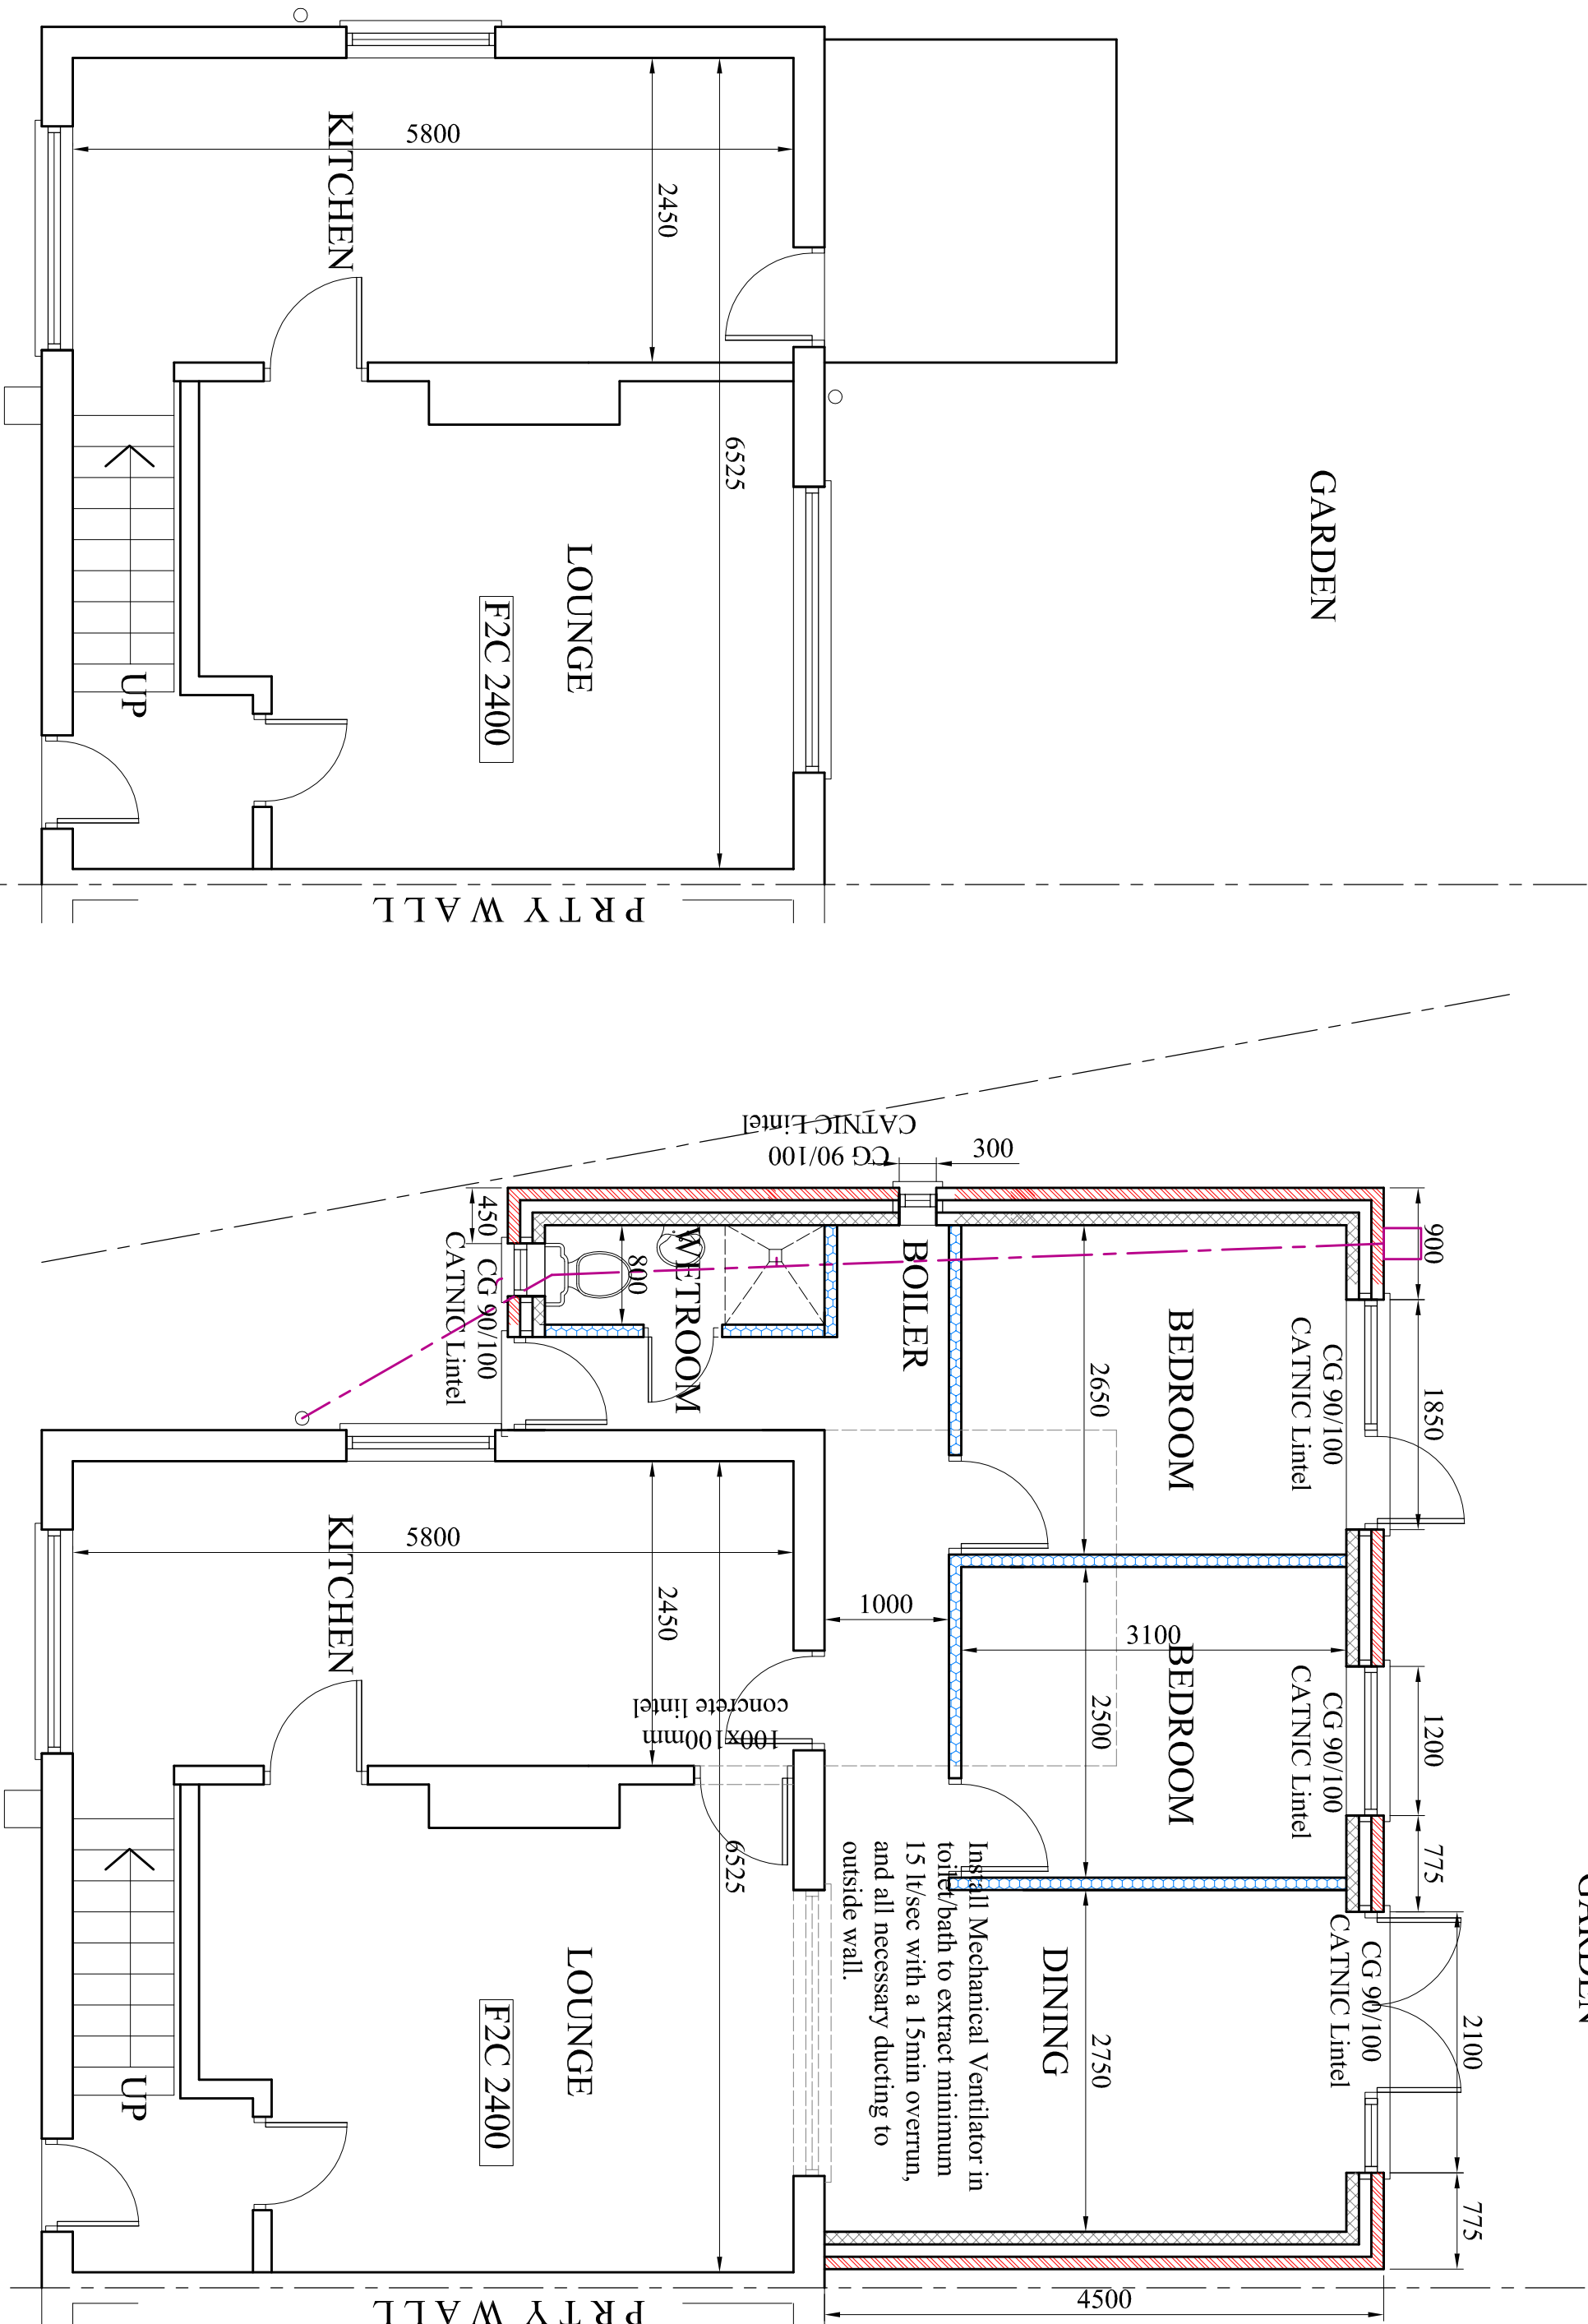

EXISTING GROUND FLOOR PLAN

PROPOSED GROUND FLOOR PLAN

Job No. _____ Drawing No. **NA-B01**
 Scale **1:50@A2** Date **May 2021** Revision _____
 Tel: **0782 895 3405**
 Email: **miamat@hotmail.co.uk**