



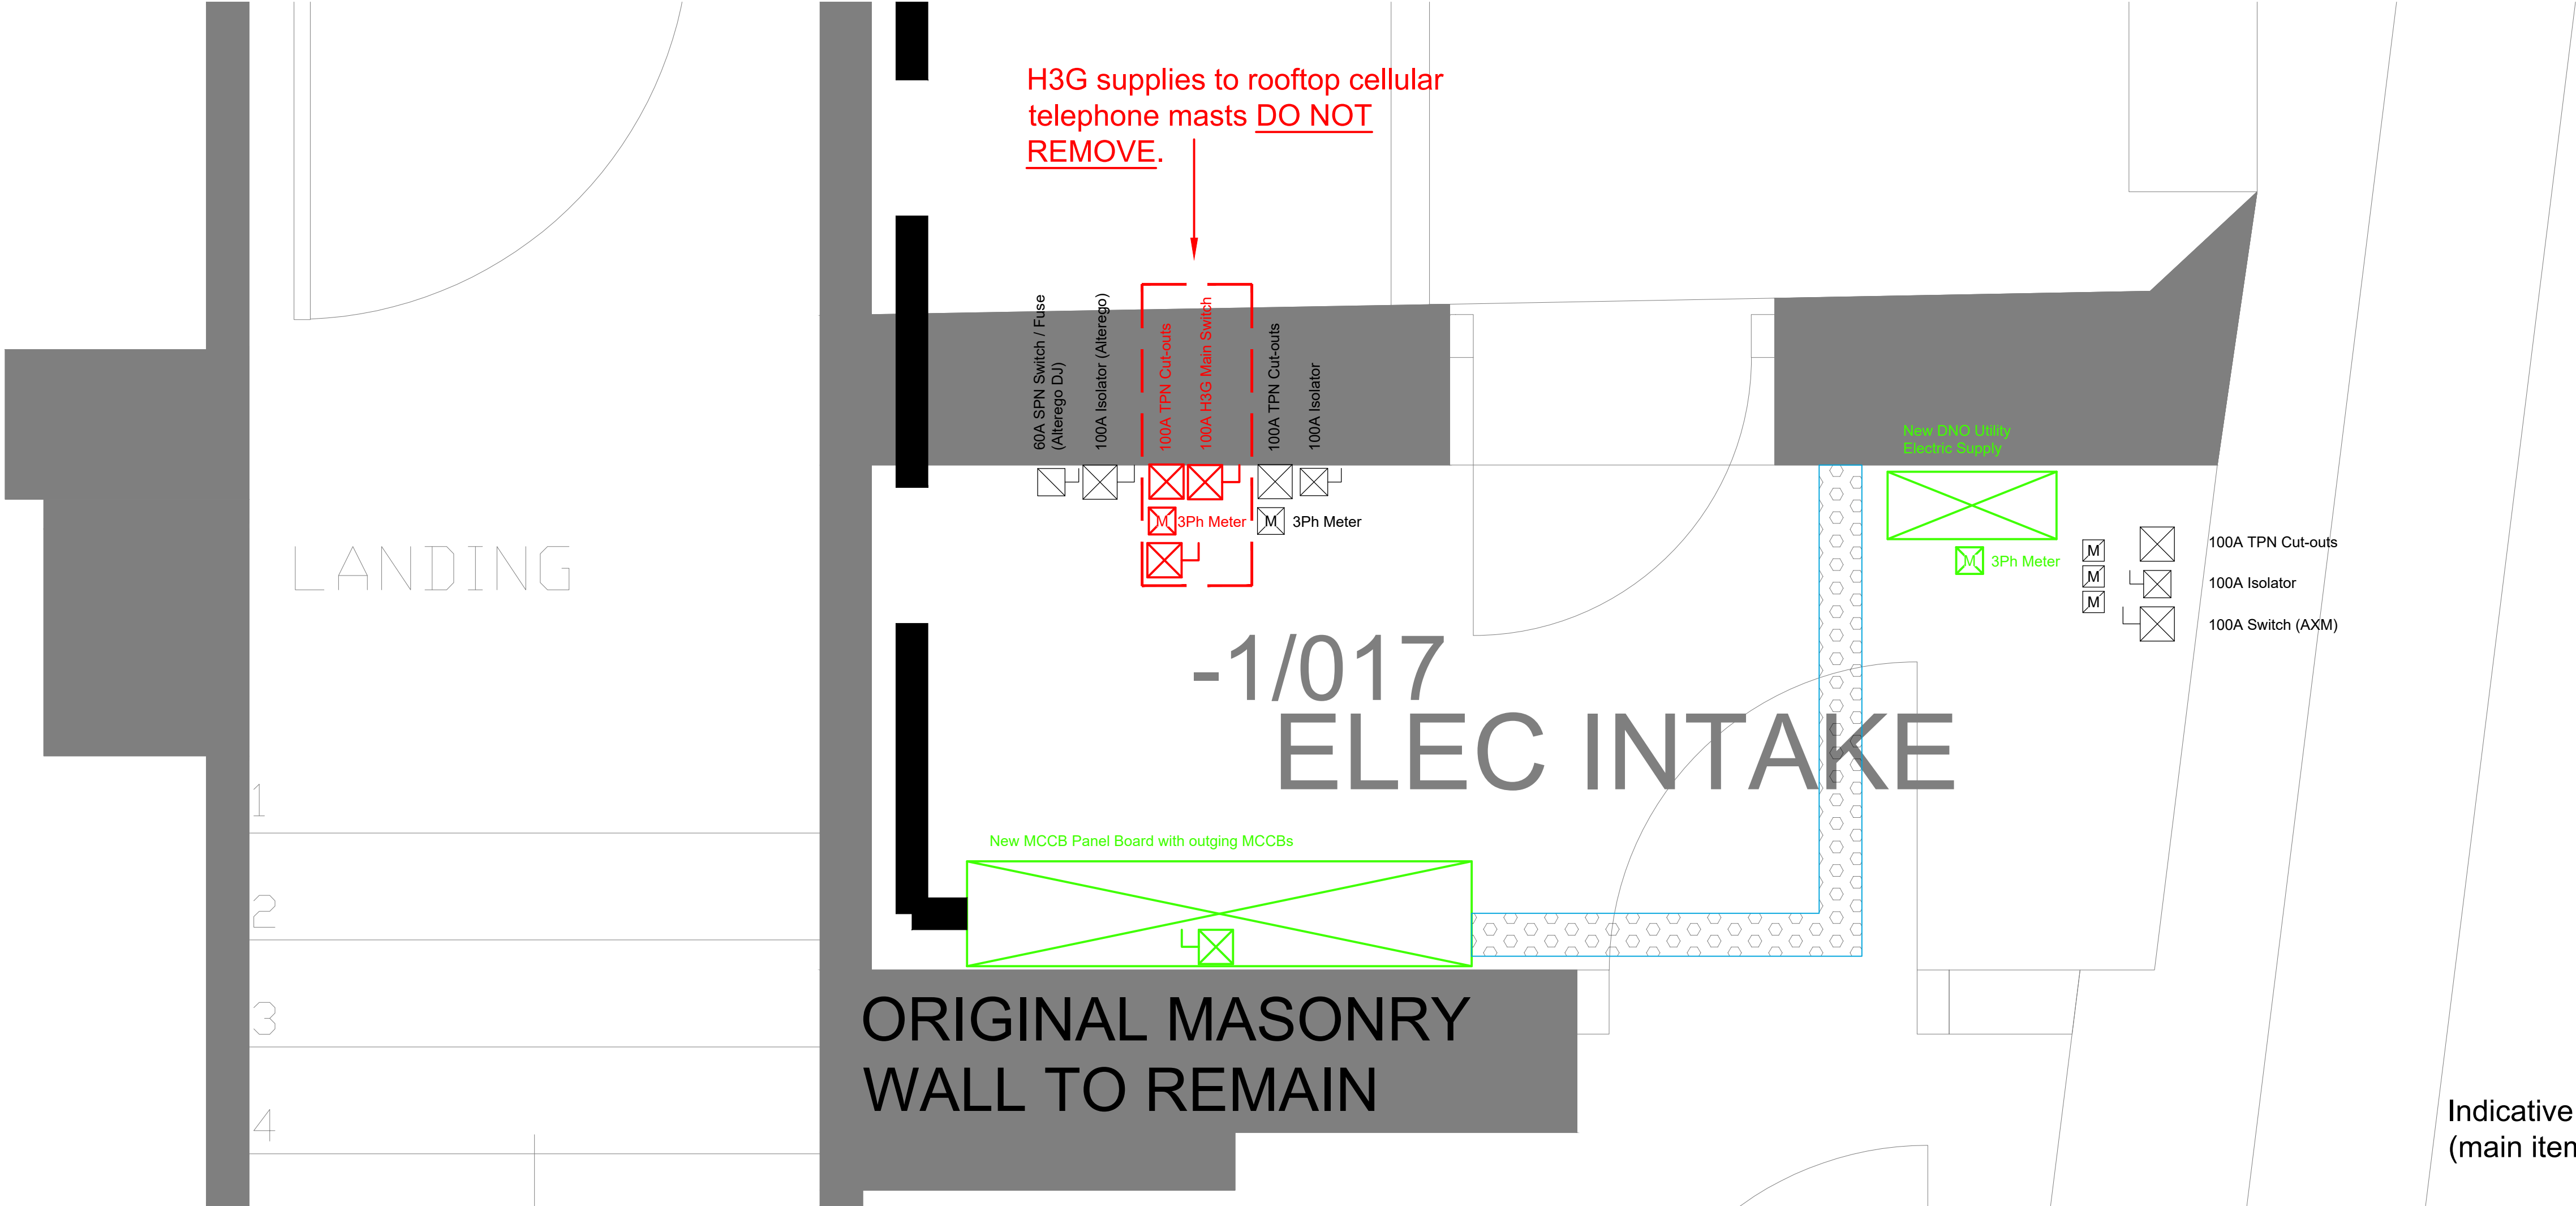

Indicative Proposed Switchgear
(main items only)

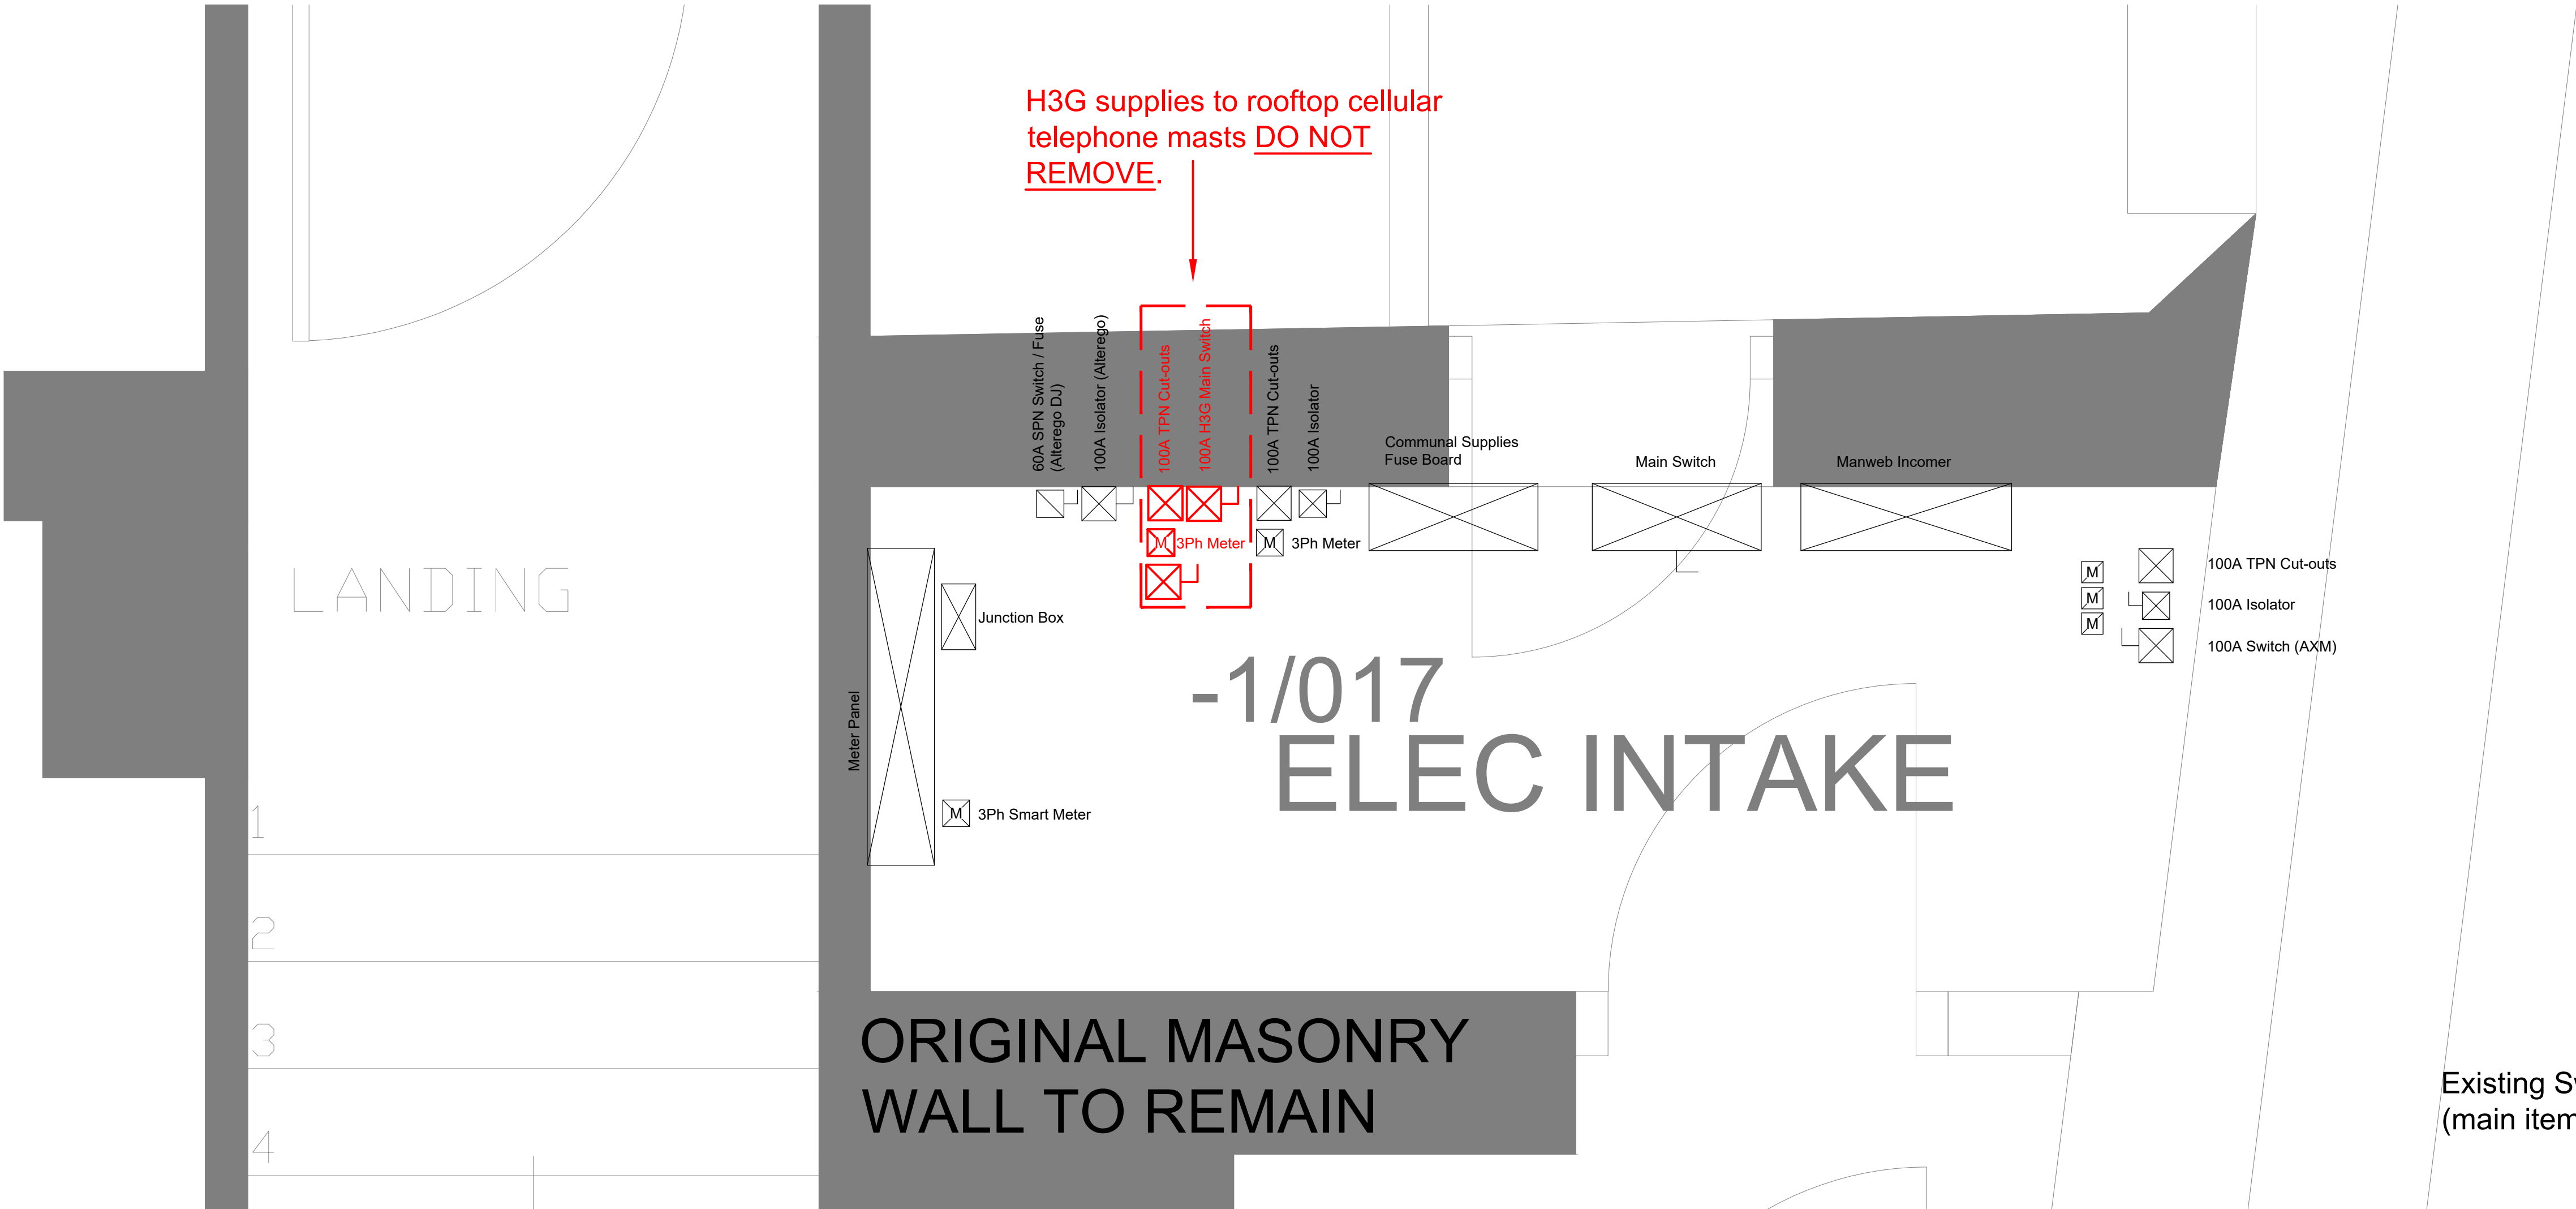

Existing Switchgear
(main items only)

- Notes:
1. This drawing shall be read in conjunction with all other drawings and specifications.
 2. All electrical installation works shall be carried out in accordance with BS7671 incorporating all current amendments

P1	21.09.21	Preliminary Issue	GC	PW	PW
Rev	Date	Description	By	Check	App.

COPYRIGHT: THE COPYRIGHT OF THIS DRAWING IS VESTED IN CLANCY CONSULTING.
IT SHALL NOT BE USED WITHOUT PERMISSION BY ANYONE FOR ANY PURPOSE.
DO NOT SCALE THIS DRAWING ELECTRONICALLY OR MANUALLY.
WORK TO FIGURED DIMENSIONS ONLY.
ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
DO NOT TURN ON LAYERS THAT HAVE BEEN TURNED OFF.
DO NOT THAW LAYERS THAT HAVE BEEN FROZEN.
DRAWING MUST BE PRINTED IN BLACK AND WHITE ONLY.

Client	Lapwine Ltd
Project	105 Princess Street Manchester
Office	Altrincham
Discipline	Electrical
Title	Electrical Switch Room Existing and Proposed Layouts
Scale @ A1	1:10
Status	Preliminary



www.clancy.co.uk

Project No.	Originator	Building/Zone	Level
7_7478	CCL	XX	LG
Type	Discipline	Drawing No.	Revision
DR	E	300110	P1

Birmingham 0121 200 7800, Glasgow 0141 222 1700, Liverpool 0151 227 2300, London 020 3077 0970, Manchester 0161 616 0000, Newcastle 0191 221 0702, Norwich 01603 300100, Plymouth 01202 420370, Reading 01184 1788