



○ MAST CLIMBERS REQUIRE A 415V, 3 PHASE, NEUTRAL & EARTH SUPPLY (MOTOR RATED)
FLC OF TWIN MAST CLIMBER = 32AMPS PER PHASE, FLC FOR SINGLE = 16AMPS PER PHASE

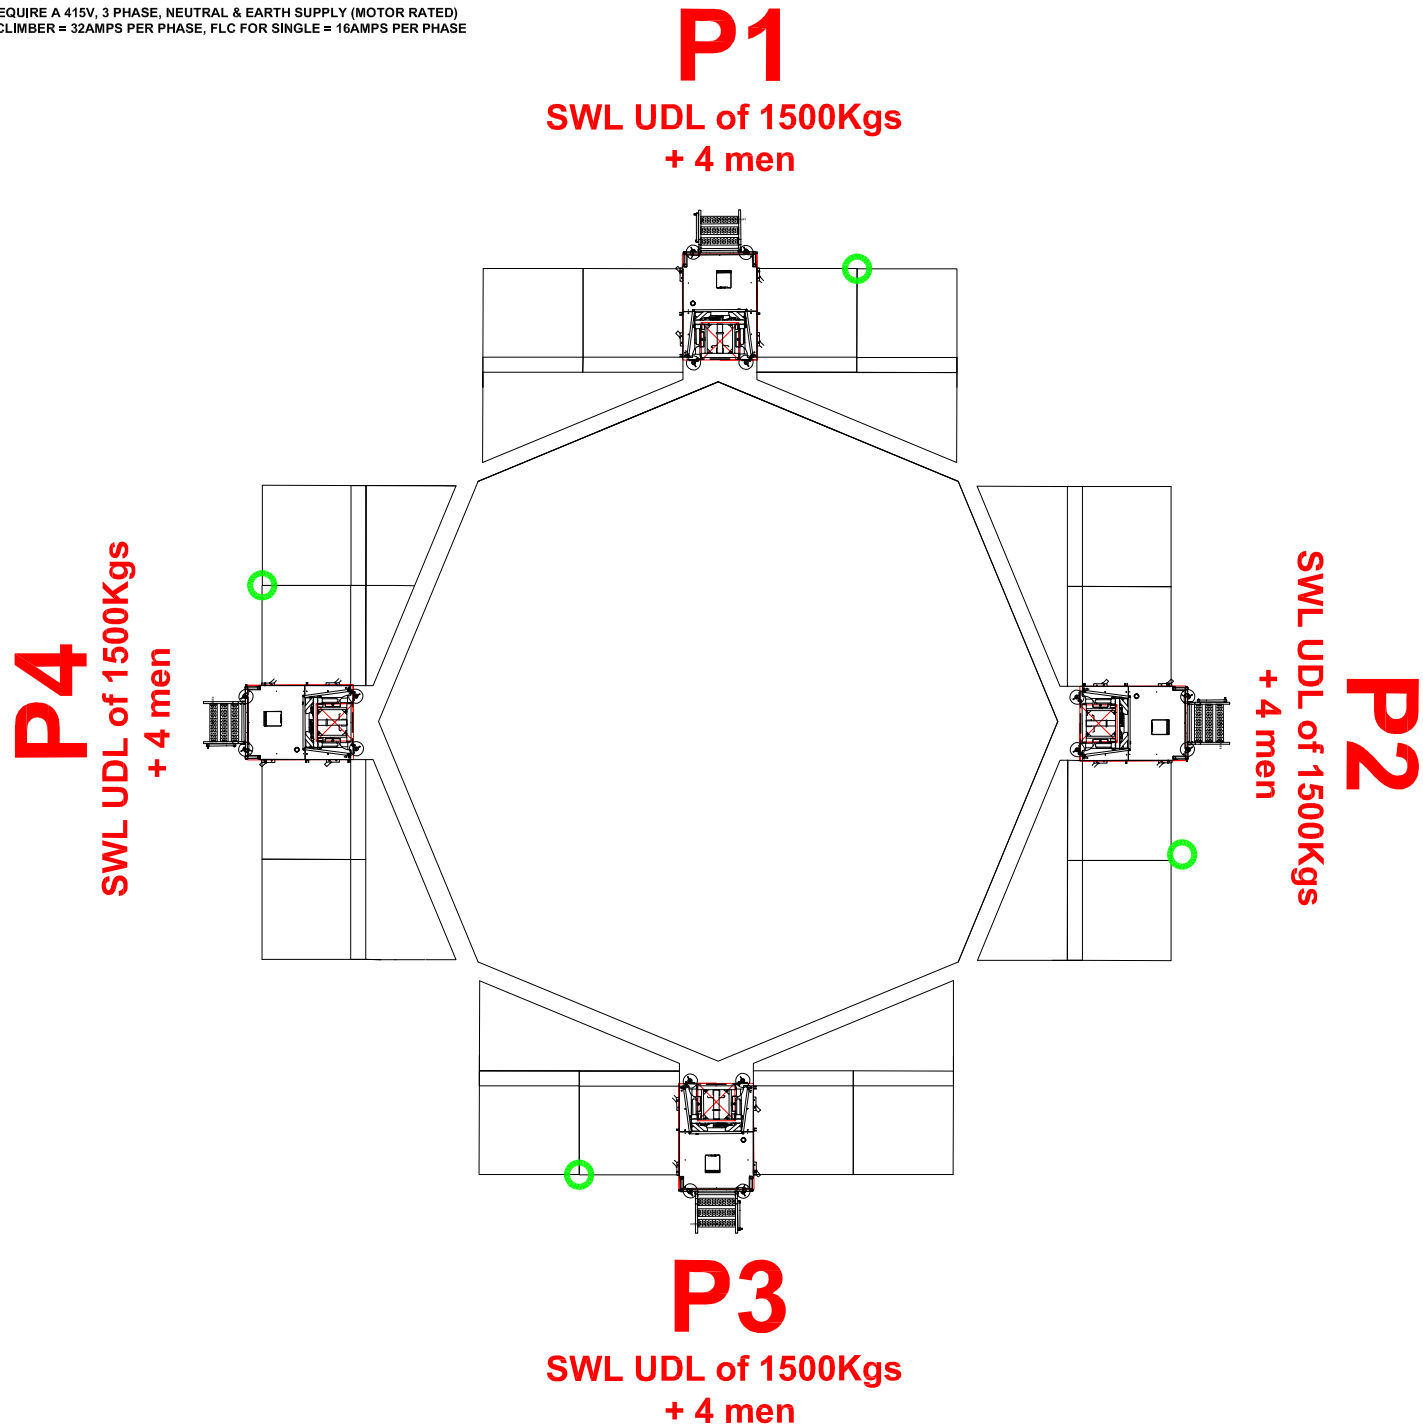

As owner of design right in the design depicted by this document, Apollo Cradles Ltd has the exclusive right to reproduce the design for commercial purposes and to make or enable to be made articles of the design.
(Copyright Designs and Patents Act 1988)



NOTES

MATERIAL LIST

NO	QTY	DESCRIPTION
----	-----	-------------

Apollo Mast Climber Layout

NO	DATE	DESCRIPTION	CHKD
----	------	-------------	------

REVISIONS

CUSTOMER

Horizon

TITLE

**Strangeways
Prison**

Manchester

**Apollo Cradles
LTD**

SPECIALIST ACCESS SYSTEMS

TEL 01226 700 079
FAX 01226 727 108

DRN		SCALE
MW		
CHKD	DATE	
DB		
MW	16/03/21	001