

Proposed erection of a 2 storey extension at the side and part single part 2 storey extension at the rear of house at 234 Brantingham Road, Chorlton-Cum-Hardy, Manchester	
Drawg No: 01	REVISION: 0
Floor Plans & Elevations	
Scale: 1:100 (A1 drwg size)	Date: Sep 2021
FP Architecture & Planning email: fparchitecture@gmail.com tel: 07763680011	

234 Brantingham Road, Chorlton-Cum-Hardy, Manchester



Extension construction details

ROOF: Concrete interlocking tiles lagged on treated battens on approved breasable roofing felt onto 200 x 50mm rafters at 400 c/c. Insulation to be 272mm deep rockwool quilt insulation or other equal and approved between rafters. 12mm plaster board and skim to underside of 175 x 50mm ceiling rafters at 400 c/c. Roofspace ventilation system (min 25mm gap) with purpose-made eaves-fitting to ensure eaves are not blocked. Gutter to be 100mm half-round gutter with 75mm dia PVC rainwater pipe to roadable gully.

FLOOR: 100mm thick concrete (1346) on 1200 gauge viapaven on 100mm thick Kingspan Thermaflow insulation T770 to give U value of 0.22w/m2K with 25mm upstand at perimeter on 50mm sand bedding on 150mm well compacted hardcore.

WALLS: Outer skin to be 110mm approved brick facings to match existing. 100mm cavity with rockwool insulation to give U Value of 0.3w/m2K, inner skin to be 100mm thermalite blocks. 12mm plasterboard and skim to internal.

Butterfly type wall ties to be fixed 700mm c/c horizontally and 450mm centres vertically. Cavity to be continuous bonded to existing and sealed at eaves level with brick or black on edge. DPC to be 150mm above ground level, and insulated horizontal and vertical DPC to be around all openings and reveals. Stepped lead cavity tray and flashing at abutments. 50mm x 5mm galvanised MS straps to fix to walls and structural timbers of roof at max 1800mm c/c. Weak mix concrete cavity fill in cavity wall below ground level.

FOUNDATIONS: Strip foundation 600 x 150mm min concrete (1346) min depth 750mm below ground level to approval of Building Control Officer.

DRAINS: 100mm dia PVC drains to connect to existing and fall 1:40 to approval of Building Control Officer. PVC approved inspection chambers to be fitted at junction with main drain.

WASTES: 32mm dia PVC waste with anti vac traps to washbasin and 50mm dia to sink connected direct to gully to new drain as above.

VENTILATION: Opening lights not to be less than 1/20th of floor area of room served. Glazing to be SAFETY glazing to BS 6206 is FENSA approved and have K glass. Any boiler vent to be ducted to external air 200mm clear of opening light. Mechanical fan to be ducted to external air and have extract rate of 60 litres per sec in kitchen and 15 litres per second in bathrooms.

FIRE: All elements of structure and new ceilings to have 12mm fireline board and skim. 30 minute fire doors with frames to be installed at all relevant openings.

OPENINGS: To have standard canics over with min end venting 150mm each end.


SKY LIGHTS: Double up rafters on either side of velux windows.

INTERNAL WALL: Stud walls c/o 50x100. Single boarded each side. 100mm acoustic fibre glass or rockwool. Walls taken to underside of ceiling.


ELECTRICS & GENERAL

All electrical installations to comply to BS 7671, 16th Edition of IEE Regs and Part P of Building Regs by a NICEIC electrician with a test certificate forwarded to Building Control within 30 days of completion. New radiators to have TRV are if a new boiler is installed, it should be of condensing type and have min SEDBUK rating of 86%. If not, adequacy of existing boiler should be checked to determine that it is capable of handling the proposed increased loads. Service pipes to be insulated and boiler control interlocks together with zone timing and temperature controls are required. In addition, the heating and hot water system should be commissioned so that at completion the system and their controls are left in working order and can operate efficiently. A copy of the Corgi Certificate is to be given to the Local Authority on completion.


NOTES:
Copyright in all documents and drawings prepared by the designer and any works executed from these documents and drawings shall, unless otherwise agreed, remain the property of the designer and must not be reproduced by, lent or disclosed to, a third party without the written consent of the designer.
Do not SCALE off these drawings.
All dimensions to be checked on site and any discrepancies to be referred to the architectural designer before proceeding.
All works to be carried out in accordance with the information in the specification to be referred to the architectural designer prior to proceeding.
All component sizes and references to be checked prior to ordering of materials.
Positions and designations (i.e. corridors, surface water or foul) of existing drain runs on site are to be checked / confirmed by the building contractor prior to commencement of any drainage works. Any existing drains to which additional connections are to be made, are also to be checked as necessary to ensure that they are suitable to accommodate additional capacity and the type of effluent being connected.
All relevant boundary positions to be checked prior to proceeding.

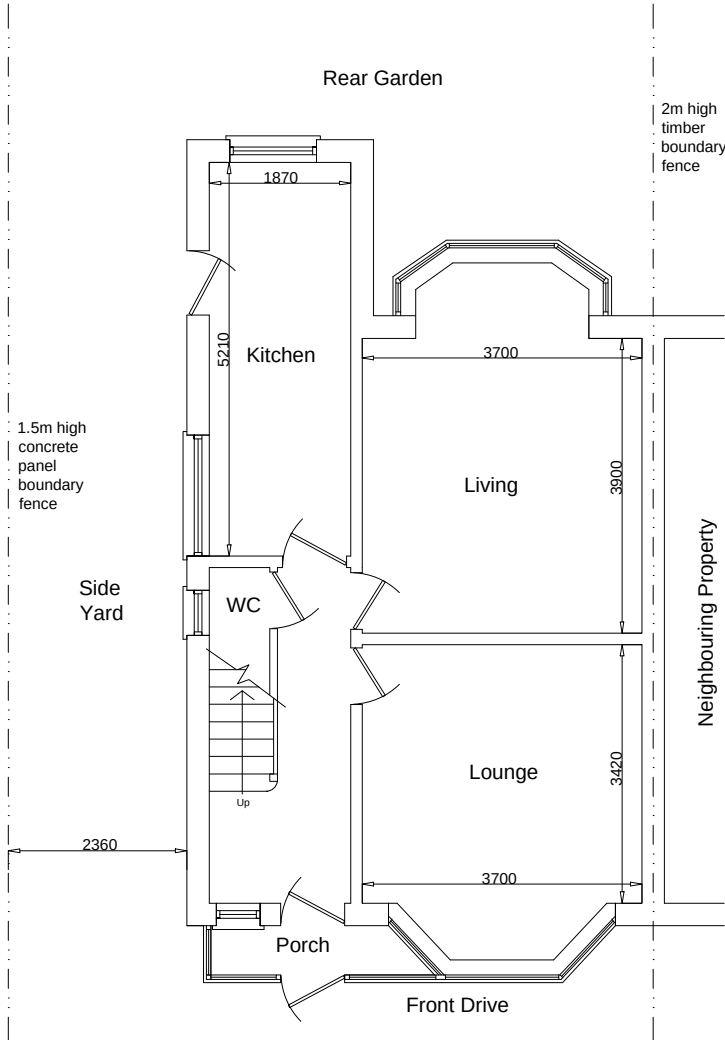


Existing Ground Floor Plan

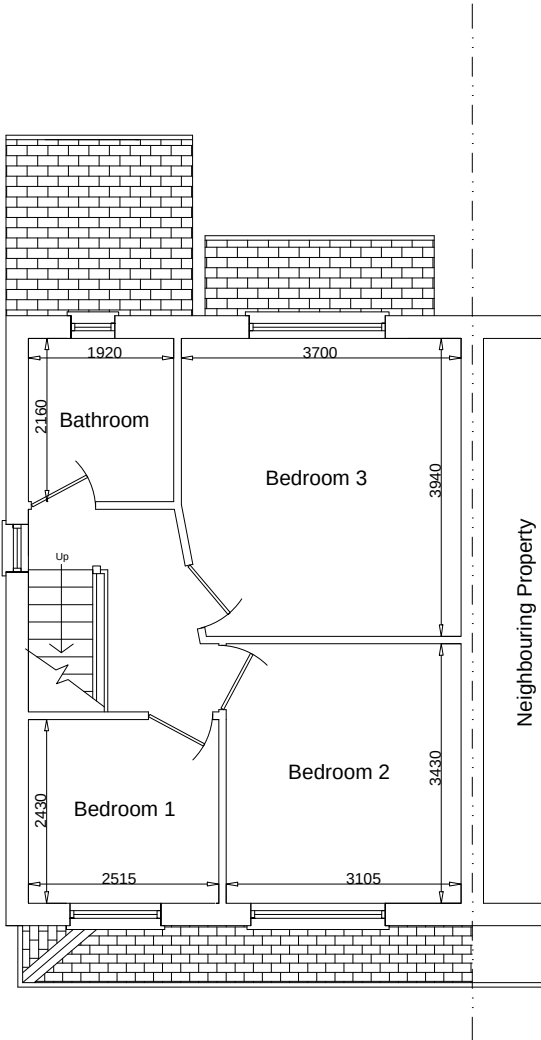


Existing First Floor Plan

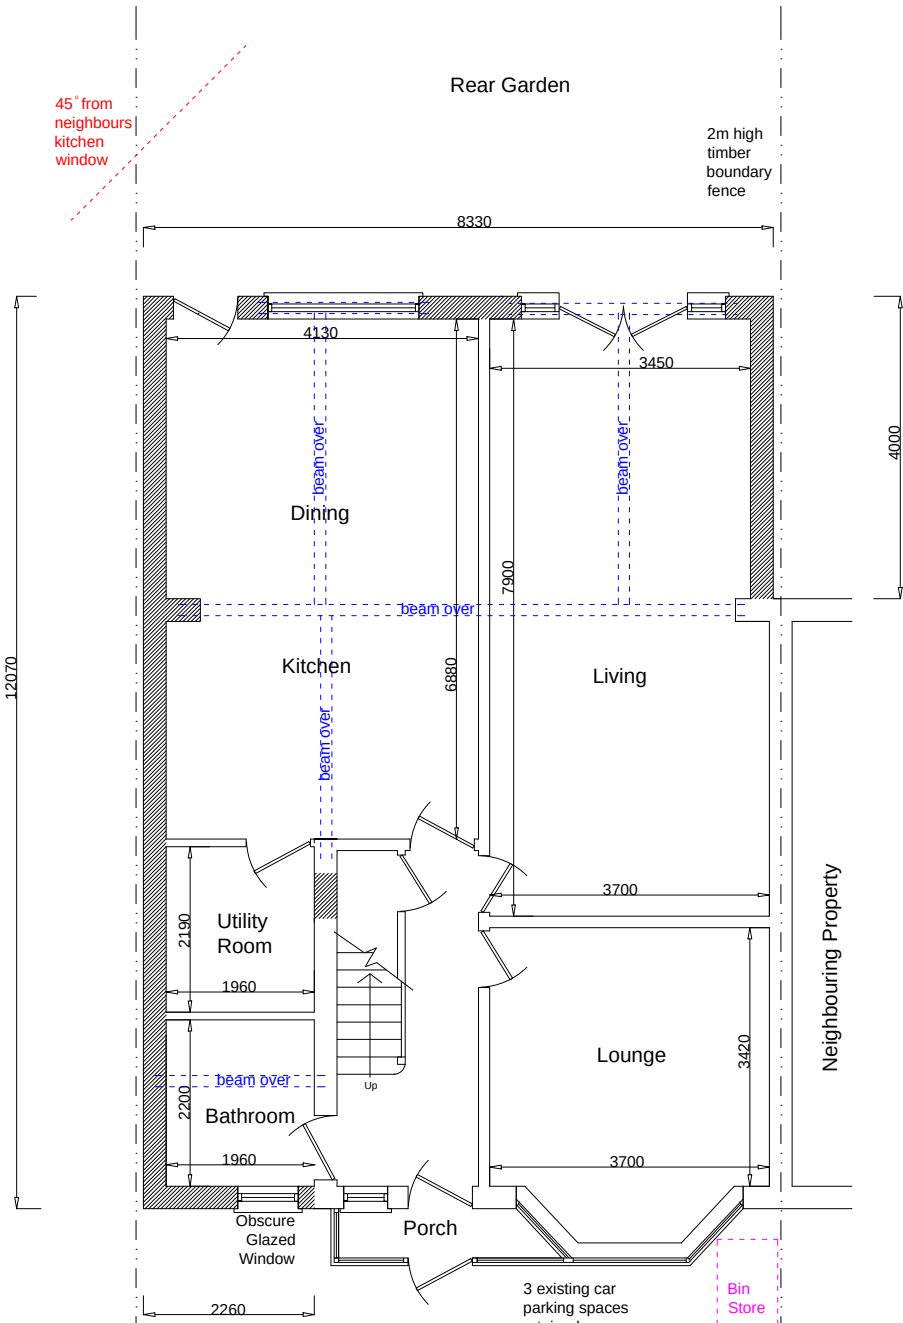

Proposed Ground Floor Plan

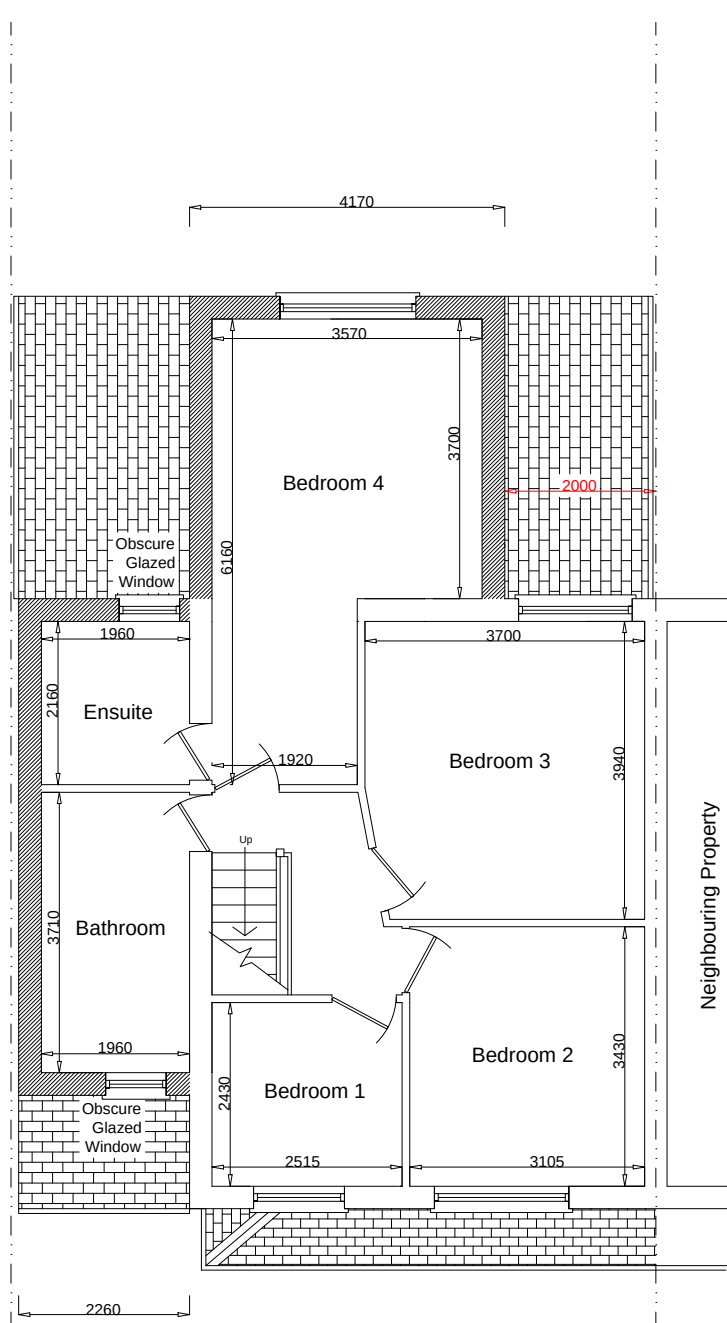


Proposed First Floor Plan

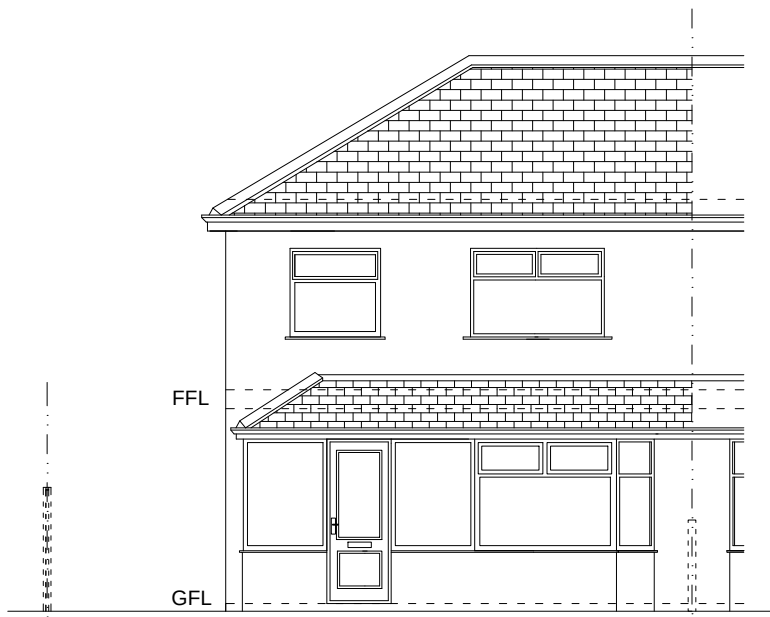


Existing Front Elevation



Existing LHS Elevation

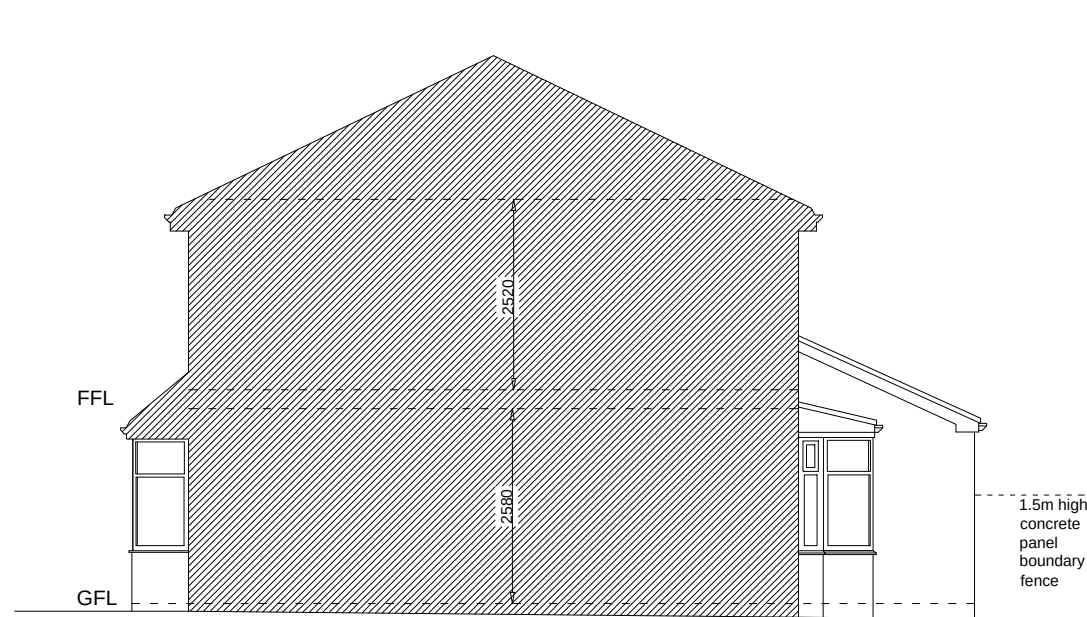


Existing RHS Elevation

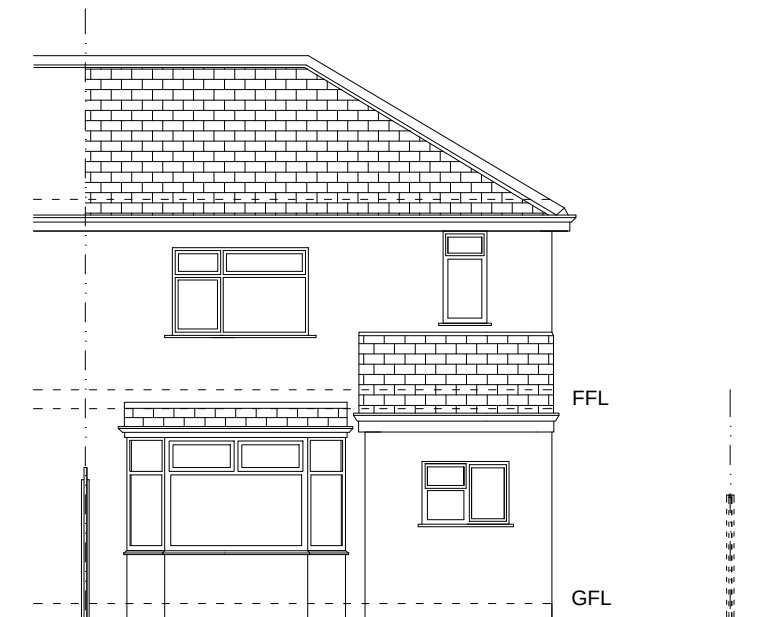


Existing Rear Elevation



Proposed Front Elevation

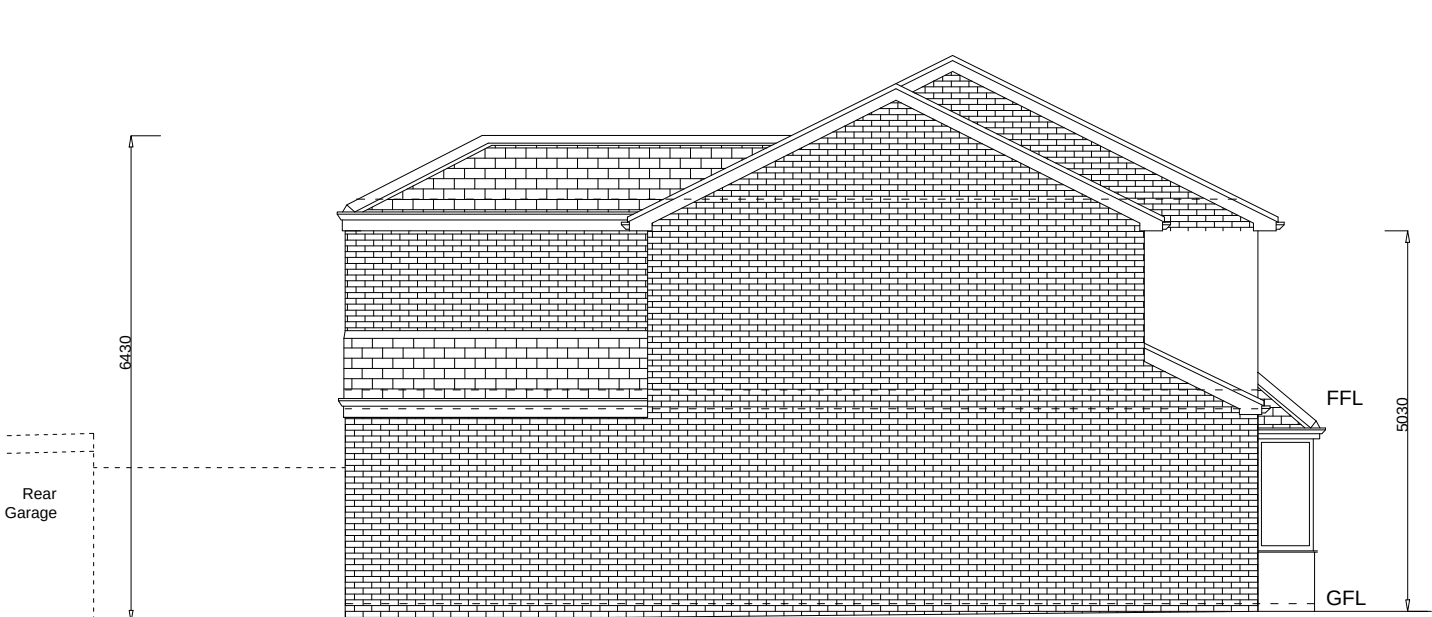

Proposed LHS Elevation

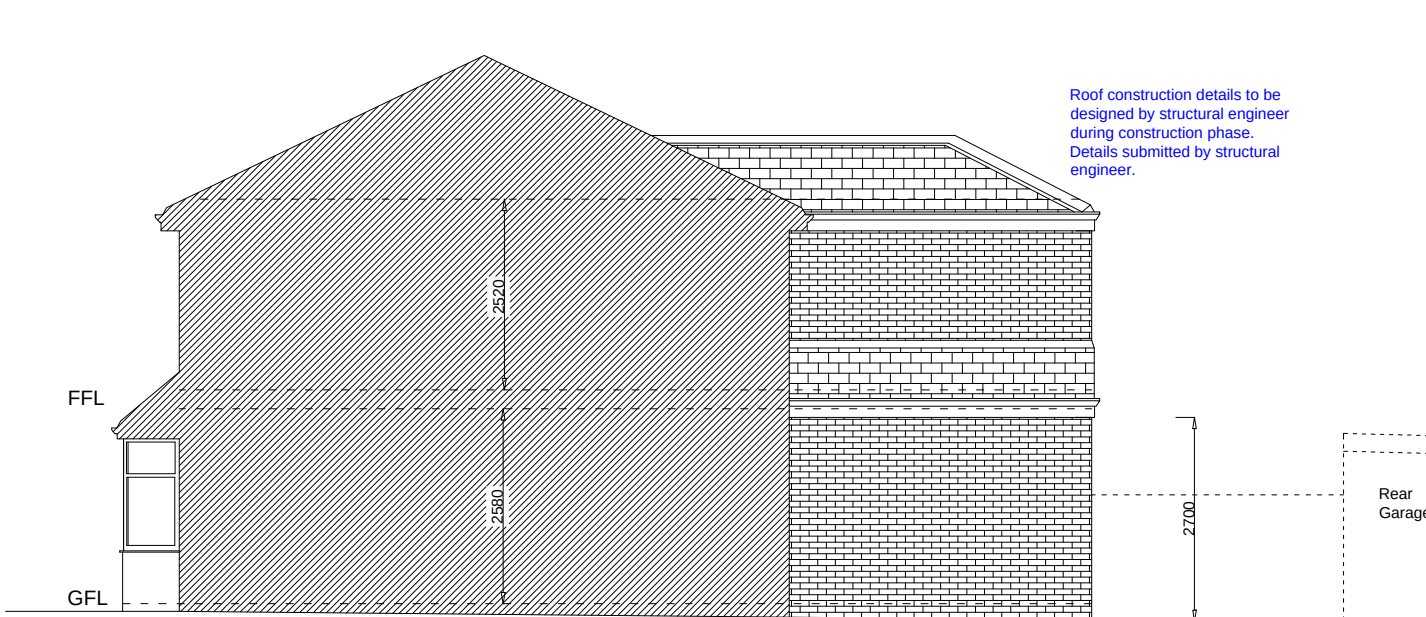

Proposed RHS Elevation



Proposed Rear Elevation