
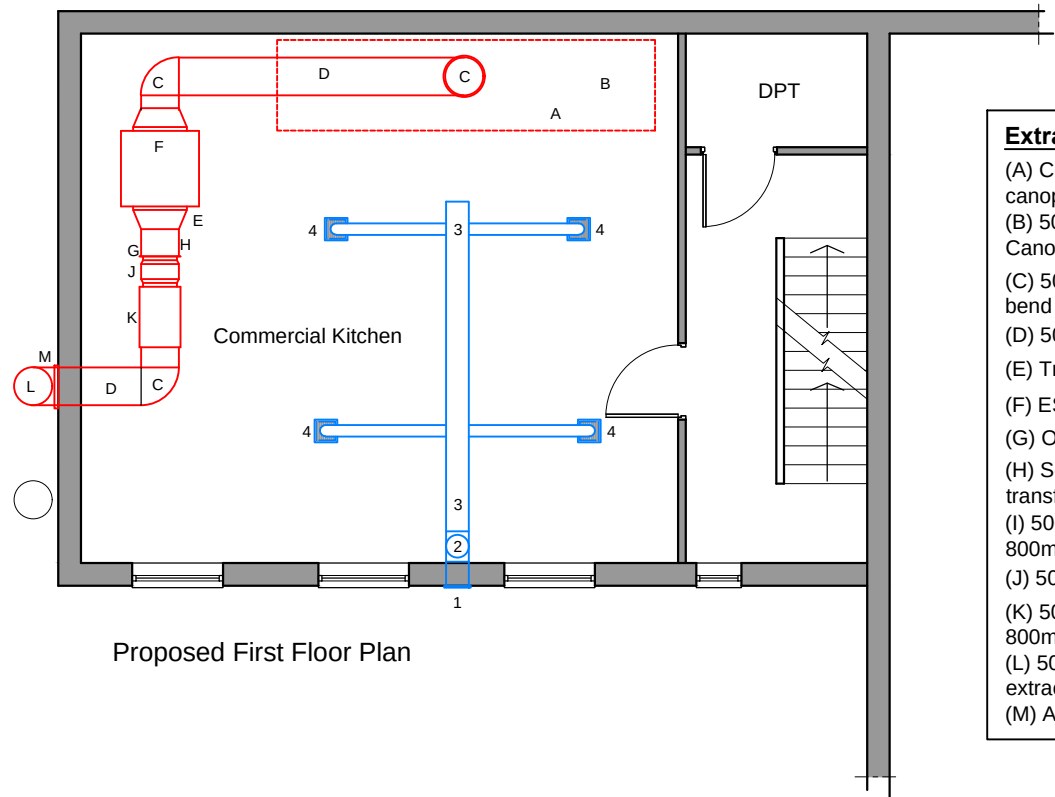


DESIGN INTENT DRAWING ONLY.
ANY CONSTRUCTION MUST COMPLY
WITH ALL APPLICABLE BUILDING
REGULATIONS.

ALL DIMENSIONS IN MM.

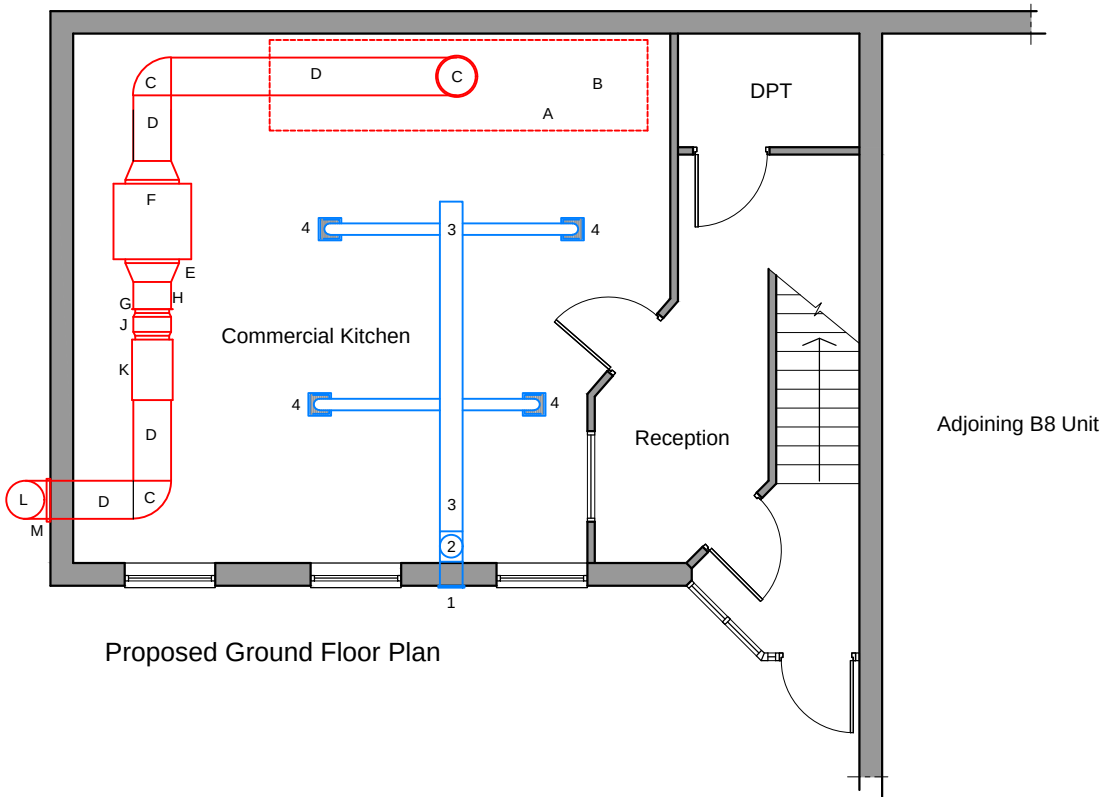

Extraction System Key

- (A) Cooking Area under canopy
- (B) 5000mm X 1200mm Canopy with baffle filters
- (C) 500x500mm 90 degree bend duct
- (D) 500mm circular duct
- (E) Transformer to/from ESP
- (F) ESP 3000
- (G) O.N.100
- (H) Square to round transformer
- (I) 500mm Dia Silencer 800mm long
- (J) 500 Max Fan 2/16/4/5
- (K) 500mm Dia Silencer II 800mm long
- (L) 500mm horizontal extract duct with Jet cowel
- (M) Anti-vibration bracket

Incoming Air


- (1) 350X350 Wall grille
- (2) 300mm Dia Plate Fan
- (3) 300x300 square duct
- (4) Air distribution using ceiling grilles 300x300

Annex B - Information

1. Number of meals prepared a day will be between 50-150.


11. Maintenance

The grease filter on the cooker hood will be cleaned weekly, and the extraction duct will be cleaned every 3 months. The air inlet duct will be cleaned every 6 months.

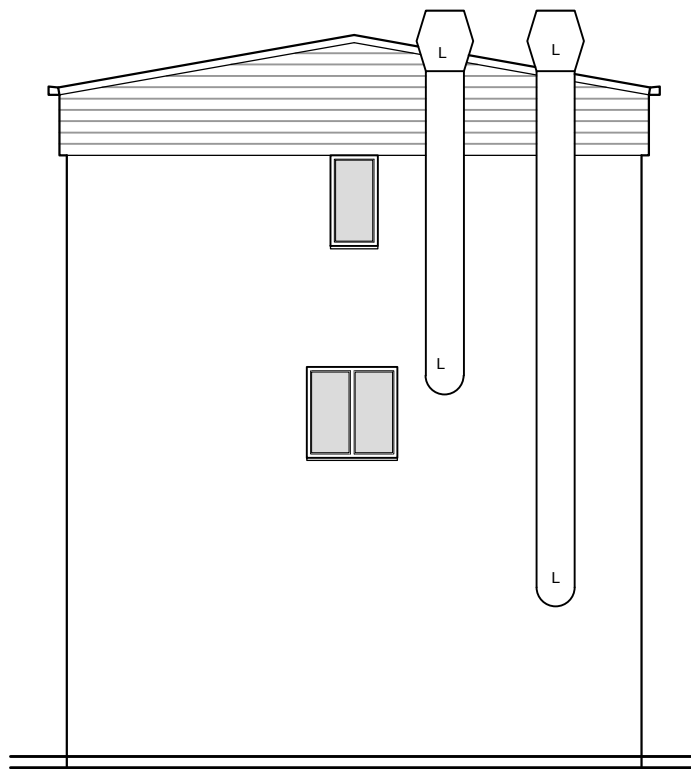

Proposed Side Elevation

(Please note the front and rear elevations are not impacted by the proposed change of use)

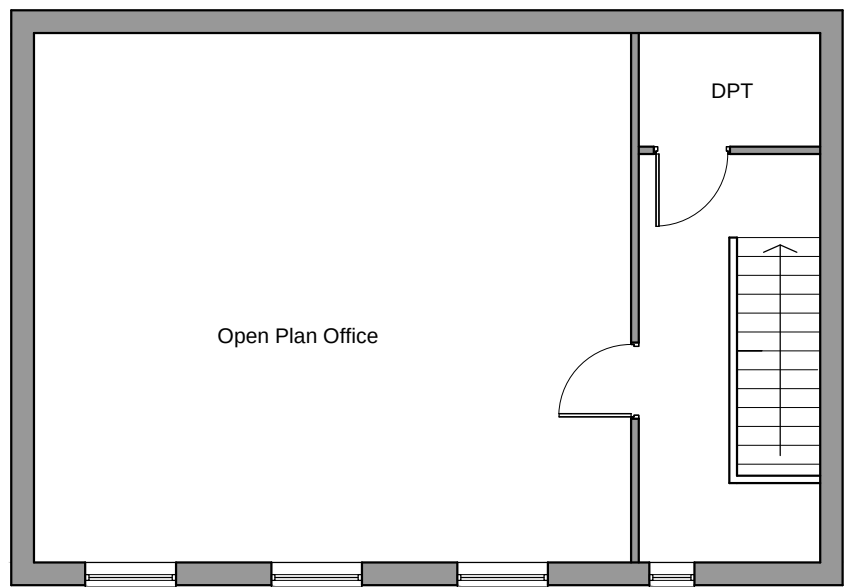

Proposed Second Floor Plan

A	Extraction duct finished 1m above the eaves level.	11.08.21
Rev	Amendment	Date



t 0161 8501045
m 07814 024033
e info@nk-architects.com
w www.nk-architects.com
a Sovereign House
Stockport Road
Cheadle, SK8 2EA

PROJECT:
CHANGE OF USE FROM OFFICE
BUILDING TO COMMERCIAL KITCHEN

ADDRESS:
648 ASHTON OLD ROAD,
MANCHESTER, M11 2DW

DRG:
PROPOSED PLANS AND ELEVATION

DRG STATUS:
PLANNING SUBMISSION

DATE: April 2021 DRAWN: ANK
SCALE: 1:100 CHECKED: ANK
SIZE: A3 DRG NO: 600.02A

COPYRIGHT © 2007 NK ARCHITECTS (MCR) LIMITED. ALL RIGHTS RESERVED.
REFER TO DIMENSIONS AND DO NOT SCALE.