




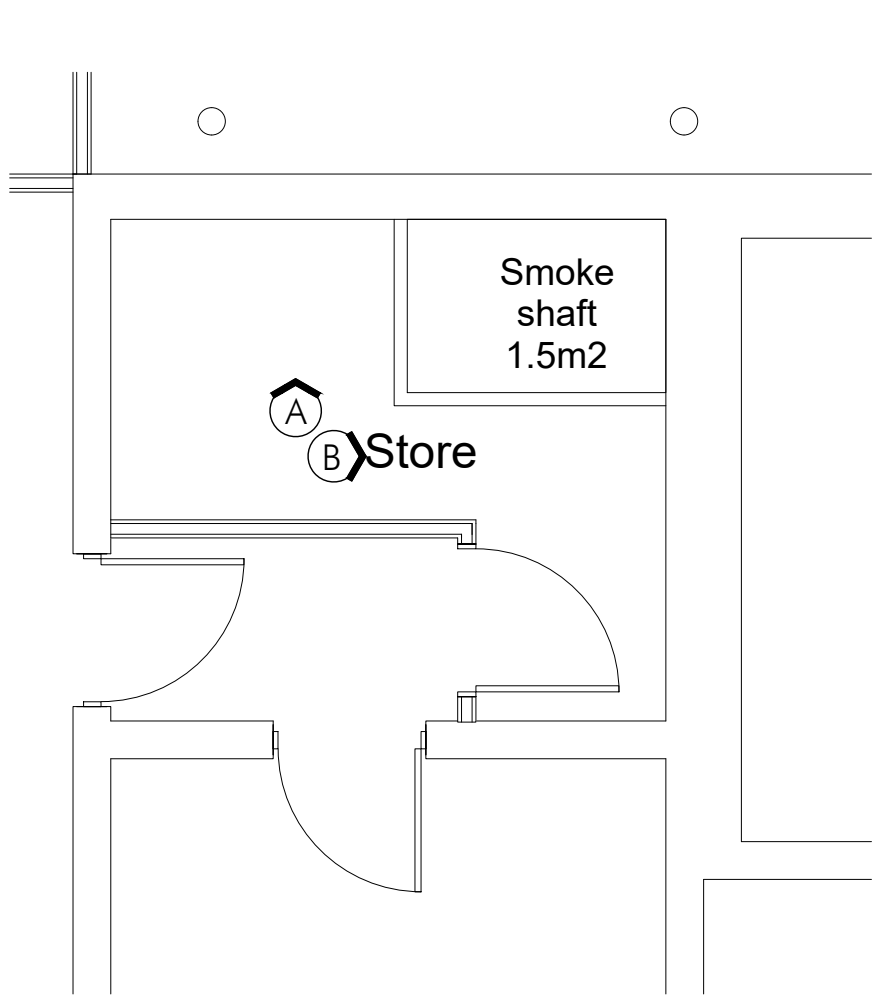


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FIFTH FLOOR PLAN
SCALE 1:50

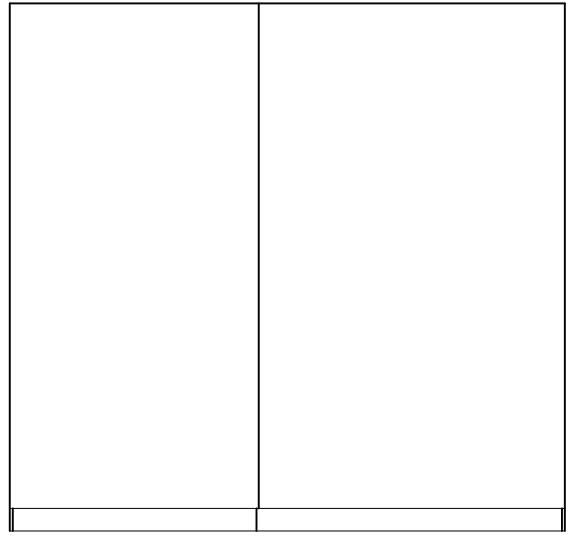

PROPOSED ELEVATION A
FIFTH FLOOR
SCALE 1:50

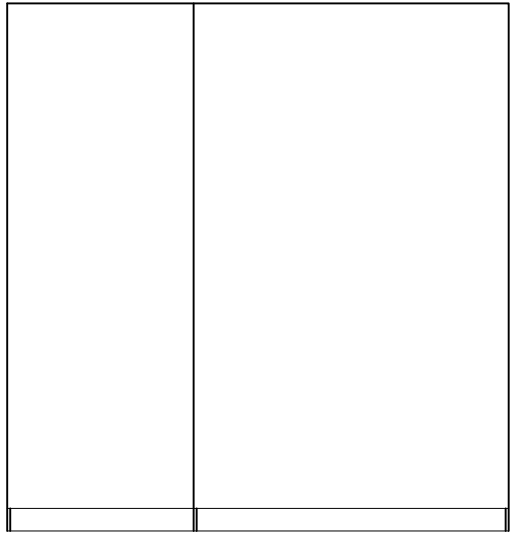


PROPOSED ELEVATION B
FIFTH FLOOR
SCALE 1:50

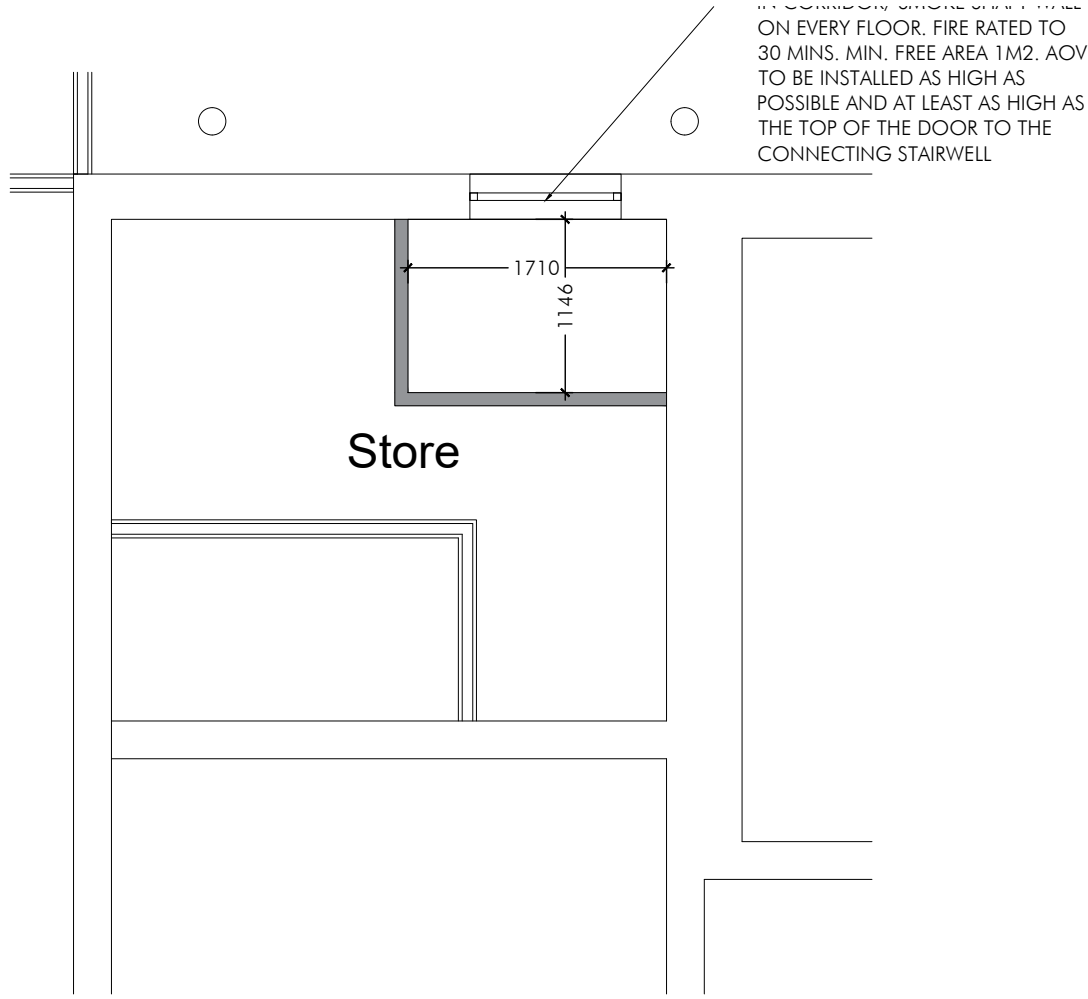


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FIFTH FLOOR REFLECTED CEILING PLAN
SCALE 1:50


ON EVERY FLOOR, FIRE RATED TO 30 MINS, MIN. FREE AREA 1M2. AOV TO BE INSTALLED AS HIGH AS POSSIBLE AND AT LEAST AS HIGH AS THE TOP OF THE DOOR TO THE CONNECTING STAIRWELL

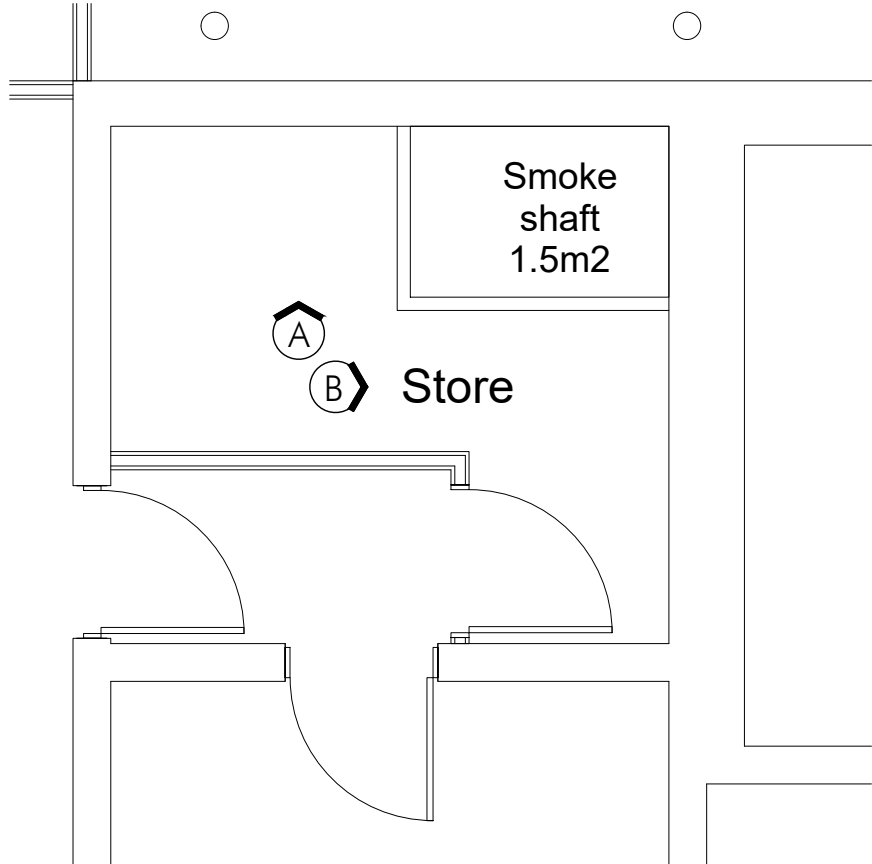


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FOURTH FLOOR PLAN
SCALE 1:50

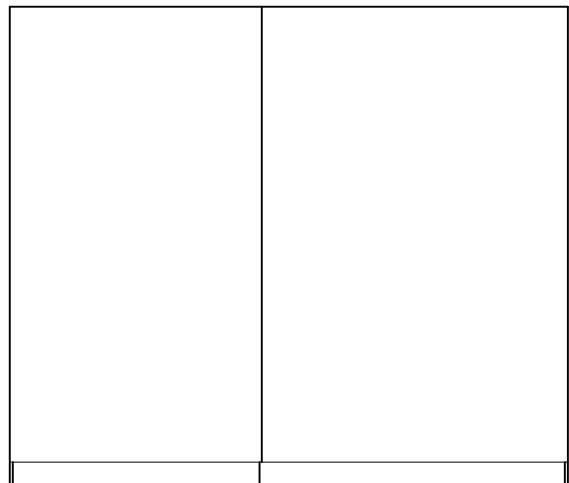

PROPOSED ELEVATION A
FOURTH FLOOR
SCALE 1:50

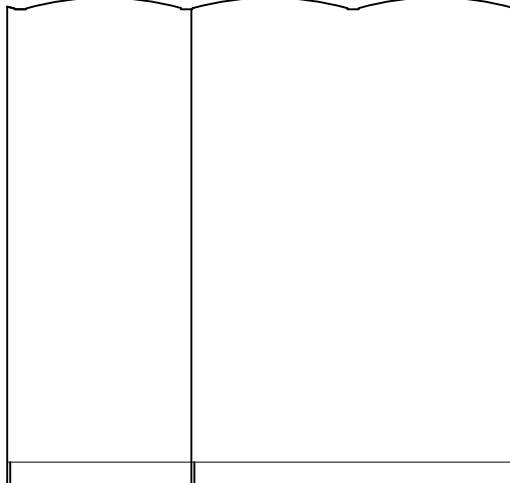


PROPOSED ELEVATION B
FOURTH FLOOR
SCALE 1:50

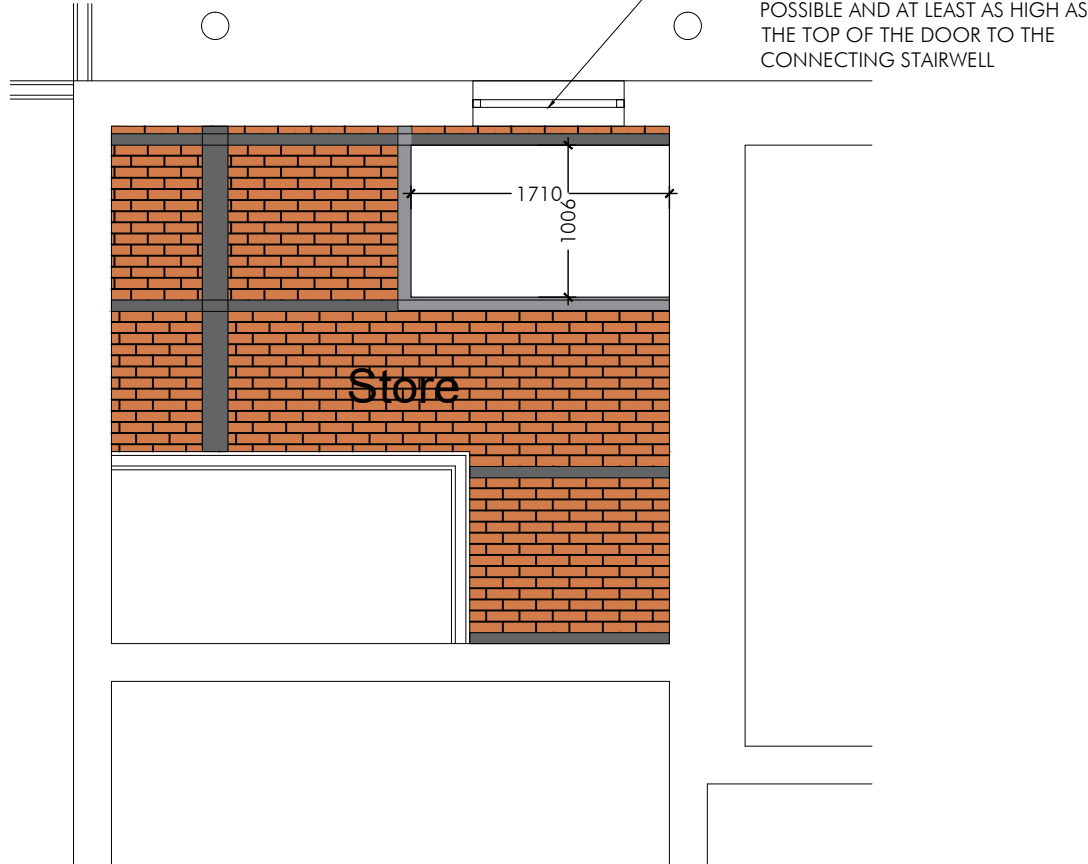


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FOURTH FLOOR REFLECTED CEILING PLAN
SCALE 1:50


AUTOMATIC OPENING VENT (AOV) IN CORRIDOR/ SMOKE SHAFT WALL ON EVERY FLOOR. FIRE RATED TO 30 MINS, MIN. FREE AREA 1M2. AOV TO BE INSTALLED AS HIGH AS POSSIBLE AND AT LEAST AS HIGH AS THE TOP OF THE DOOR TO THE CONNECTING STAIRWELL

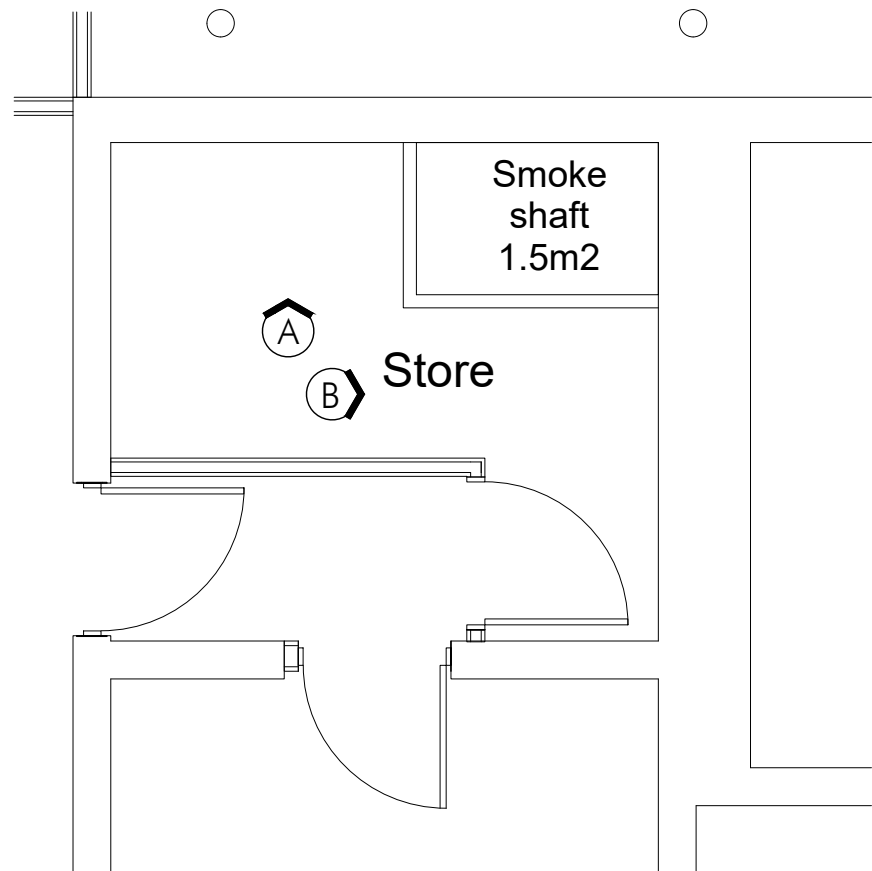


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED THIRD FLOOR PLAN
SCALE 1:50

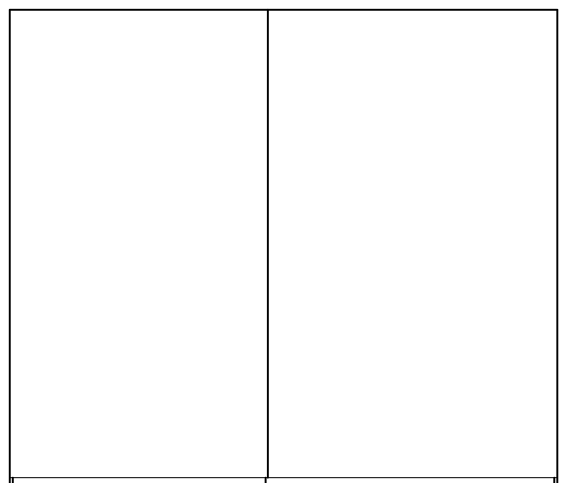

PROPOSED ELEVATION A
THIRD FLOOR
SCALE 1:50

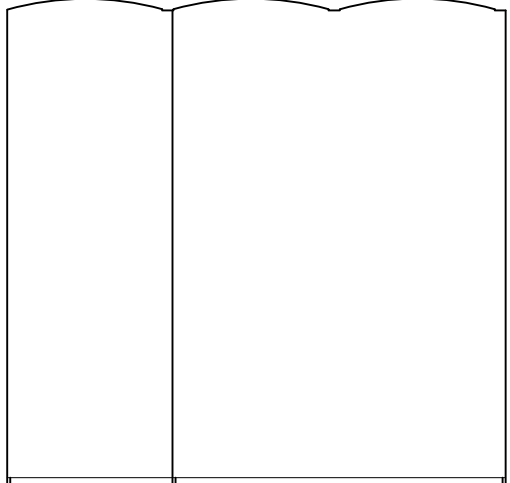


PROPOSED ELEVATION B
THIRD FLOOR
SCALE 1:50

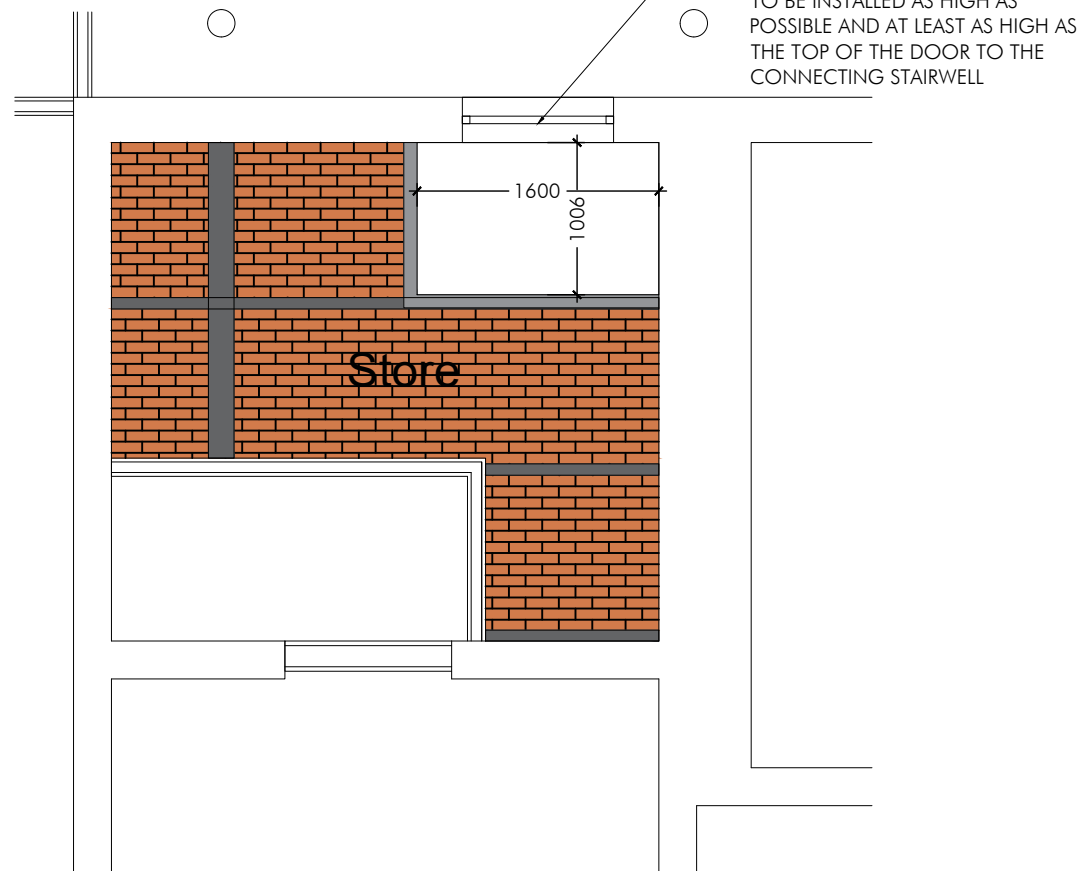


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED THIRD FLOOR REFLECTED CEILING PLAN
SCALE 1:50


AUTOMATIC OPENING VENT (AOV) IN CORRIDOR/ SMOKE SHAFT WALL ON EVERY FLOOR. FIRE RATED TO 30 MINS, MIN. FREE AREA 1M2. AOV TO BE INSTALLED AS HIGH AS POSSIBLE AND AT LEAST AS HIGH AS THE TOP OF THE DOOR TO THE CONNECTING STAIRWELL

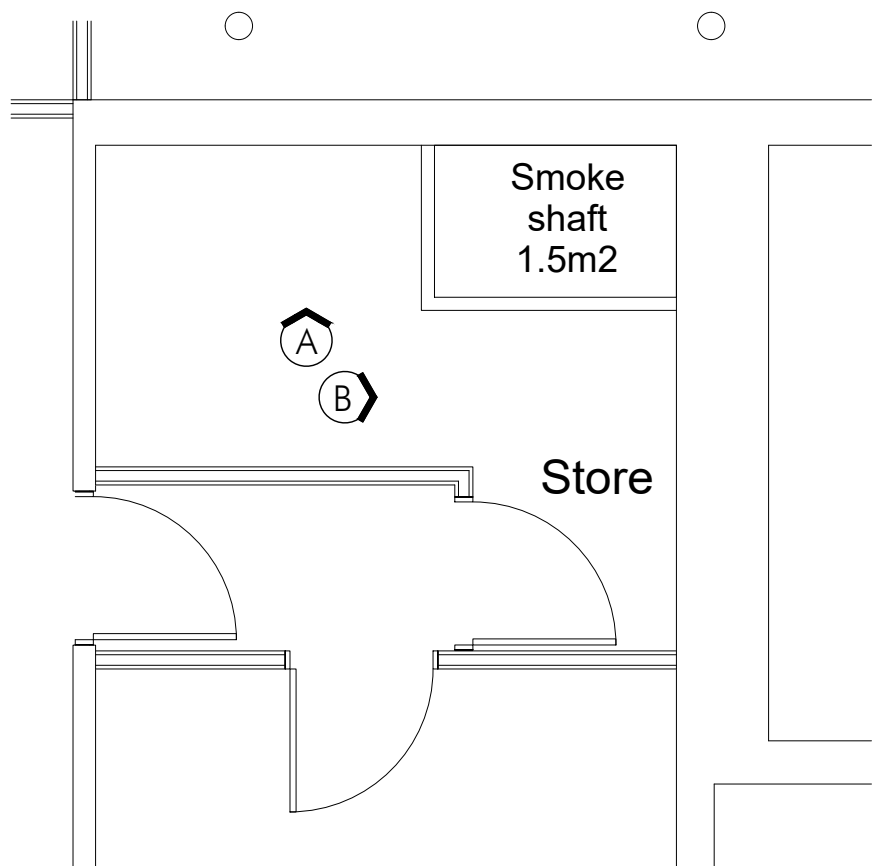


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED SECOND FLOOR PLAN
SCALE 1:50



PROPOSED ELEVATION A
SECOND FLOOR
SCALE 1:50

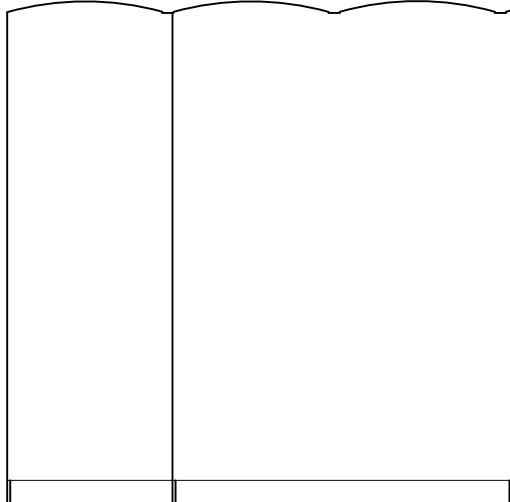


PROPOSED ELEVATION B
SECOND FLOOR
SCALE 1:50

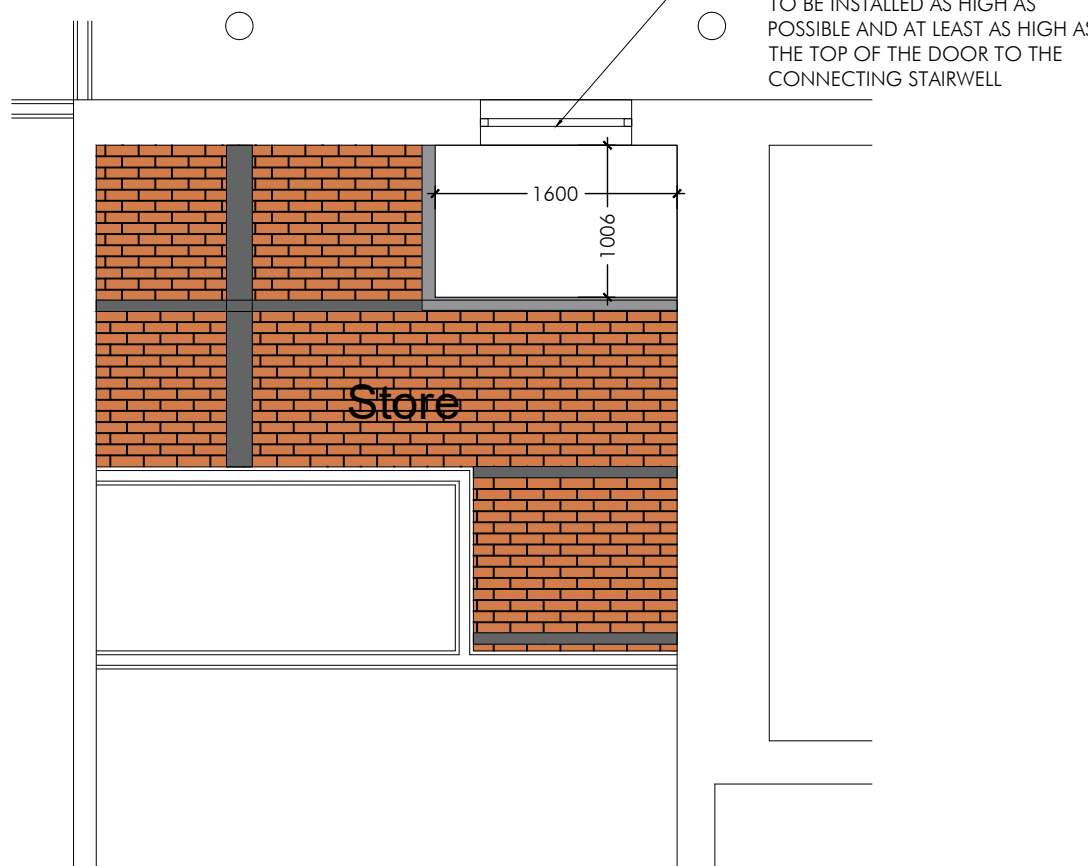


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED SECOND FLOOR REFLECTED CEILING PLAN
SCALE 1:50


AUTOMATIC OPENING VENT (AOV) IN CORRIDOR/ SMOKE SHAFT WALL ON EVERY FLOOR. FIRE RATED TO 30 MINS, MIN. FREE AREA 1M2. AOV TO BE INSTALLED AS HIGH AS POSSIBLE AND AT LEAST AS HIGH AS THE TOP OF THE DOOR TO THE CONNECTING STAIRWELL

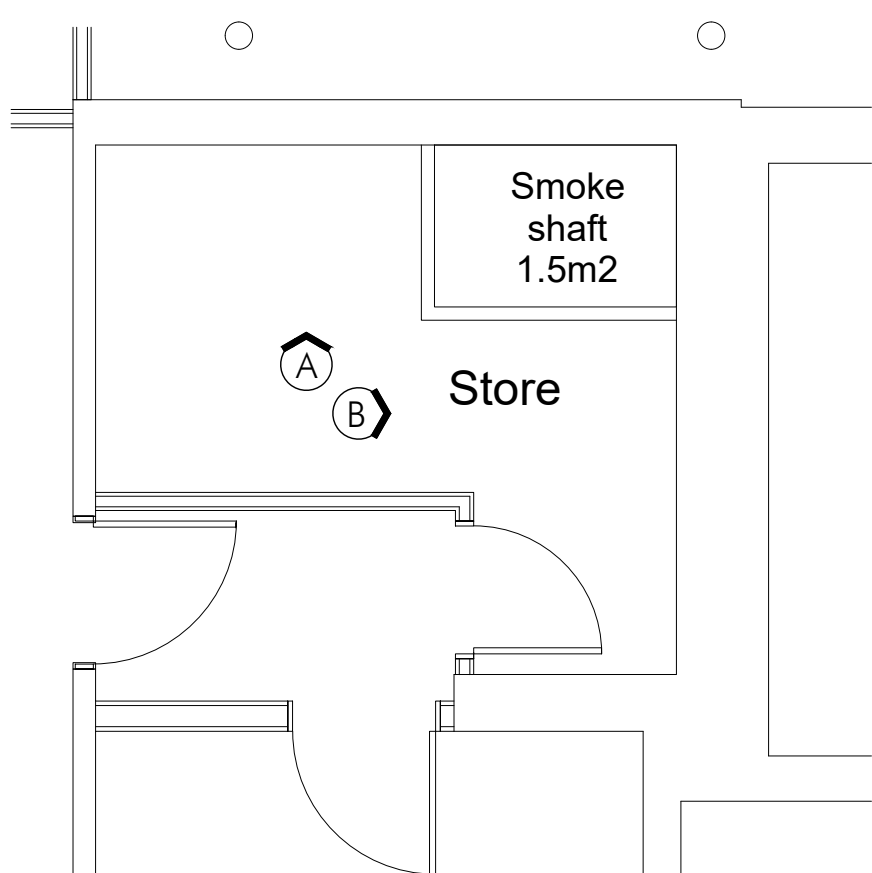


60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FIRST FLOOR PLAN
SCALE 1:50



PROPOSED ELEVATION A
FIRST FLOOR
SCALE 1:50

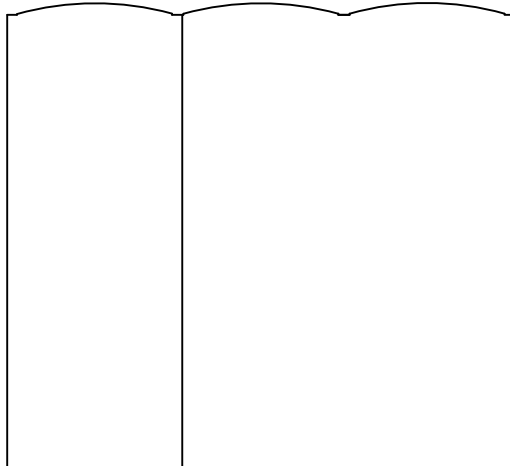

PROPOSED ELEVATION B
FIRST FLOOR
SCALE 1:50

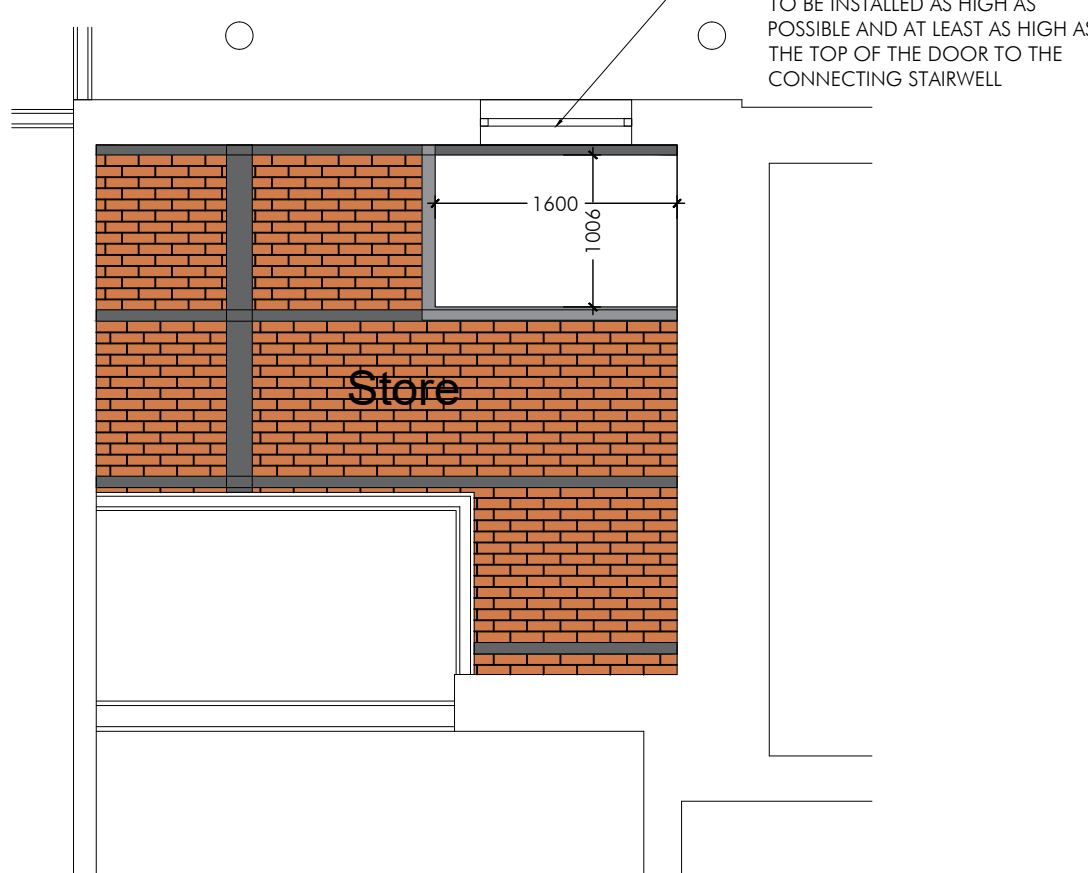

60 MINUTE SMOKE SHAFT STAIR B
PROPOSED FIRST FLOOR REFLECTED CEILING PLAN
SCALE 1:50

AUTOMATIC OPENING VENT (AOV) IN CORRIDOR/ SMOKE SHAFT WALL ON EVERY FLOOR. FIRE RATED TO 30 MINS, MIN. FREE AREA 1M2. AOV TO BE INSTALLED AS HIGH AS POSSIBLE AND AT LEAST AS HIGH AS THE TOP OF THE DOOR TO THE CONNECTING STAIRWELL

DMG DRAWN	DRAWN REVISION	24.05.21 DATE	VER
AP Architects and Designers AllisonPike			
7 Buxton Road West, Disley, Stockport, Cheshire, SK12 2AE. Website: www.allisonpike.com			
Telephone: 01663 763000 Facsimile: 01663 766772 Email: studio@allisonpike.com			
© Allison Pike Partnership Limited.			
PROJECT MEDLOCK VICTORIA MILL MILES PLATTING			
TITLE PROPOSED SMOKE SHAFT TO STAIRCASE B PROPOSED PLANS AND ELEVATIONS			
SCALE 1:50 @ A1			
JOB No MED02	DRAWING No AP401	REV -	