
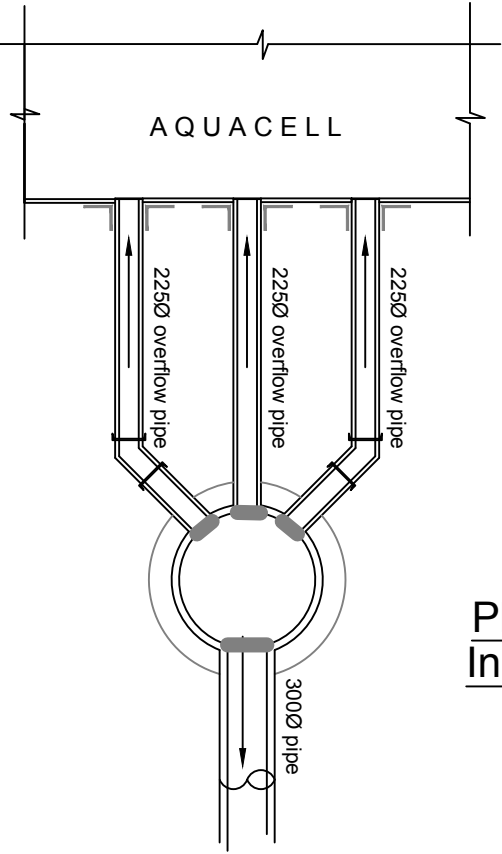


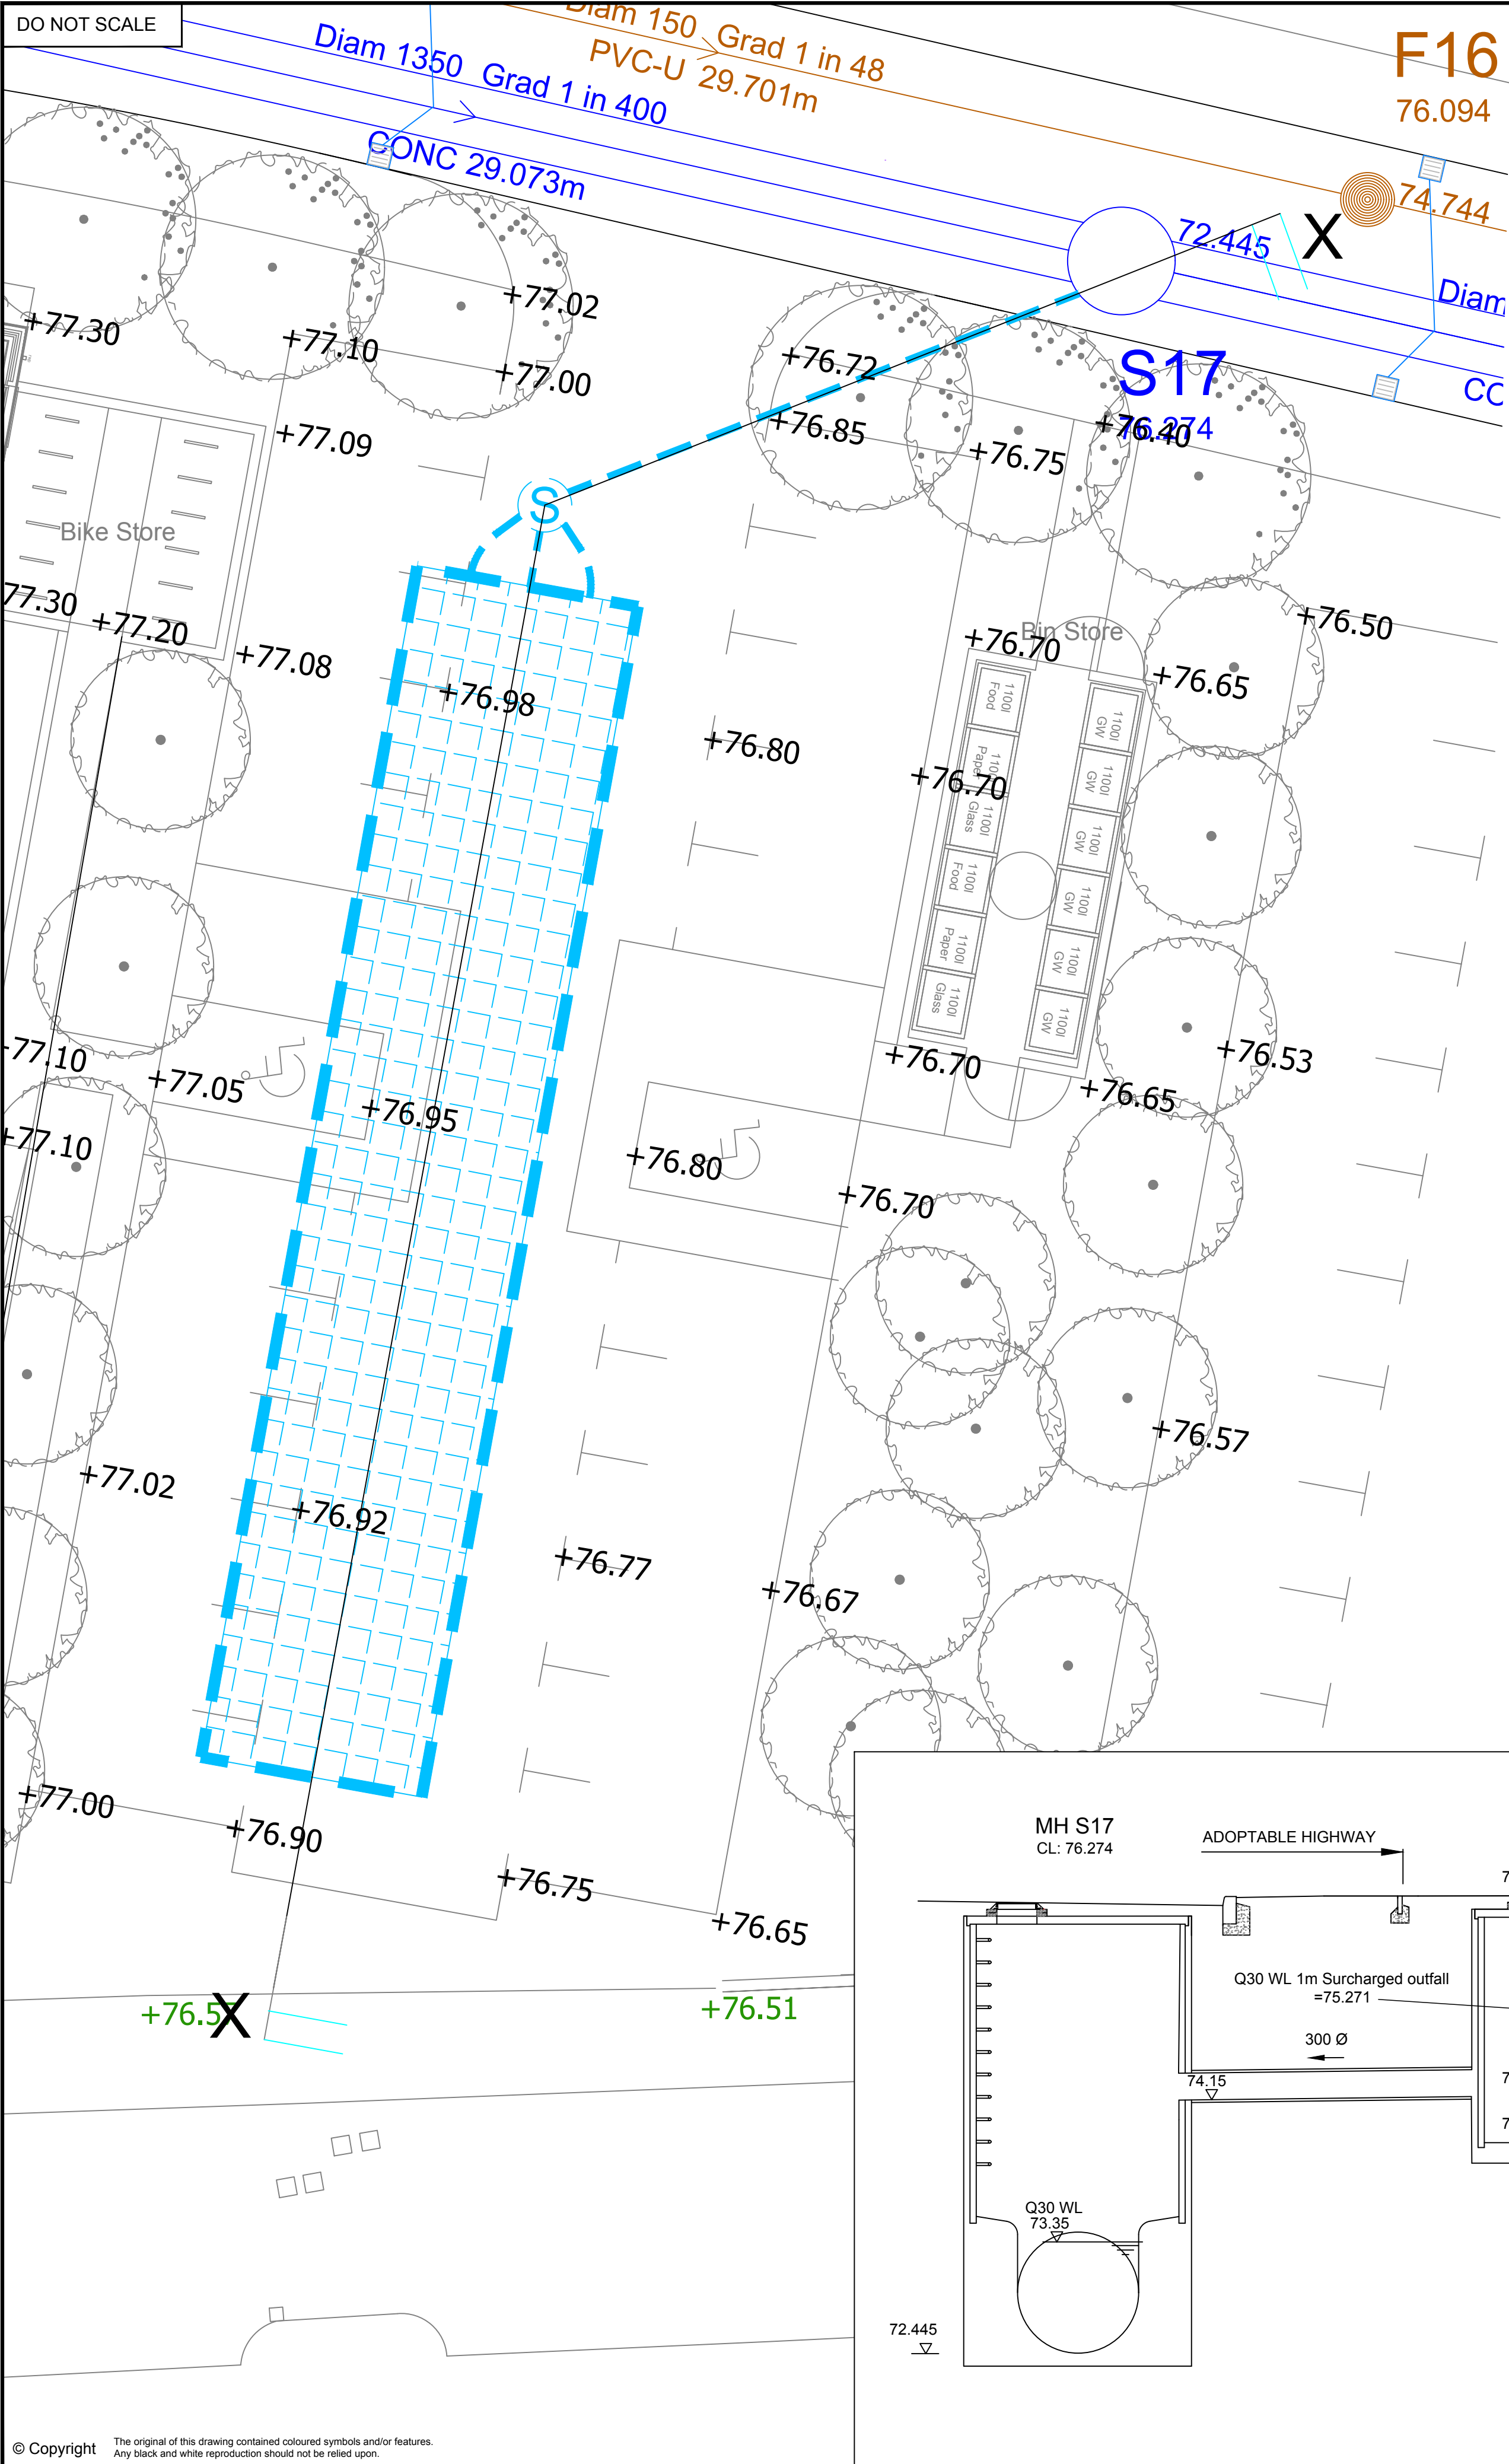

Plan View of Tank Showing
Inspection Chambers (NTS)

NOTE:
Refer to manufacturers details for
installation / construction details

Notes

Geocellular Attenuation Tank providing storage for a 100yr + 40 CC storm event (154 cu.m)
Base Level = 74.300
Top WL = 75.57
135m² x 1.2m deep
Aquacell 'Core' or similiar approved.

Refer to manufacturers details for construction / installation / maintenance details.

APPROVAL

E	30.06.21	Updated to suit revised design	PW	AJ
D	09.06.21	Updated to suit revised design	PW	AJ
C	07.06.21	Updated to suit revised design	PW	AJ
B	27.01.21	Updated To suit UU comments	LW	AJ
A	04.01.21	Updated To suit revised design	LW	AJ
Rev.	Date	Revision	By	Appd.

**coopers**
chartered consulting engineers

Tel: 01244 684910
Fax: 01244 684911
Email: admin@coopers.co.uk
Web: http://coopers.co.uk

Park House
Sandpiper Court
Chester Business Park
Chester
CH4 9QU

Client	BRANLEY HOMES LTD		
Project	White House Club, Middleton Road, Manchester		
Title	100 Year Storm Event Attenuation Details		
DRAWING NUMBER	7424 / 14		
SCALE at A1	1:20	REVISION	
DATE	02.11.20	E	
DRAWN	LW		
CHECKED	AJ		

