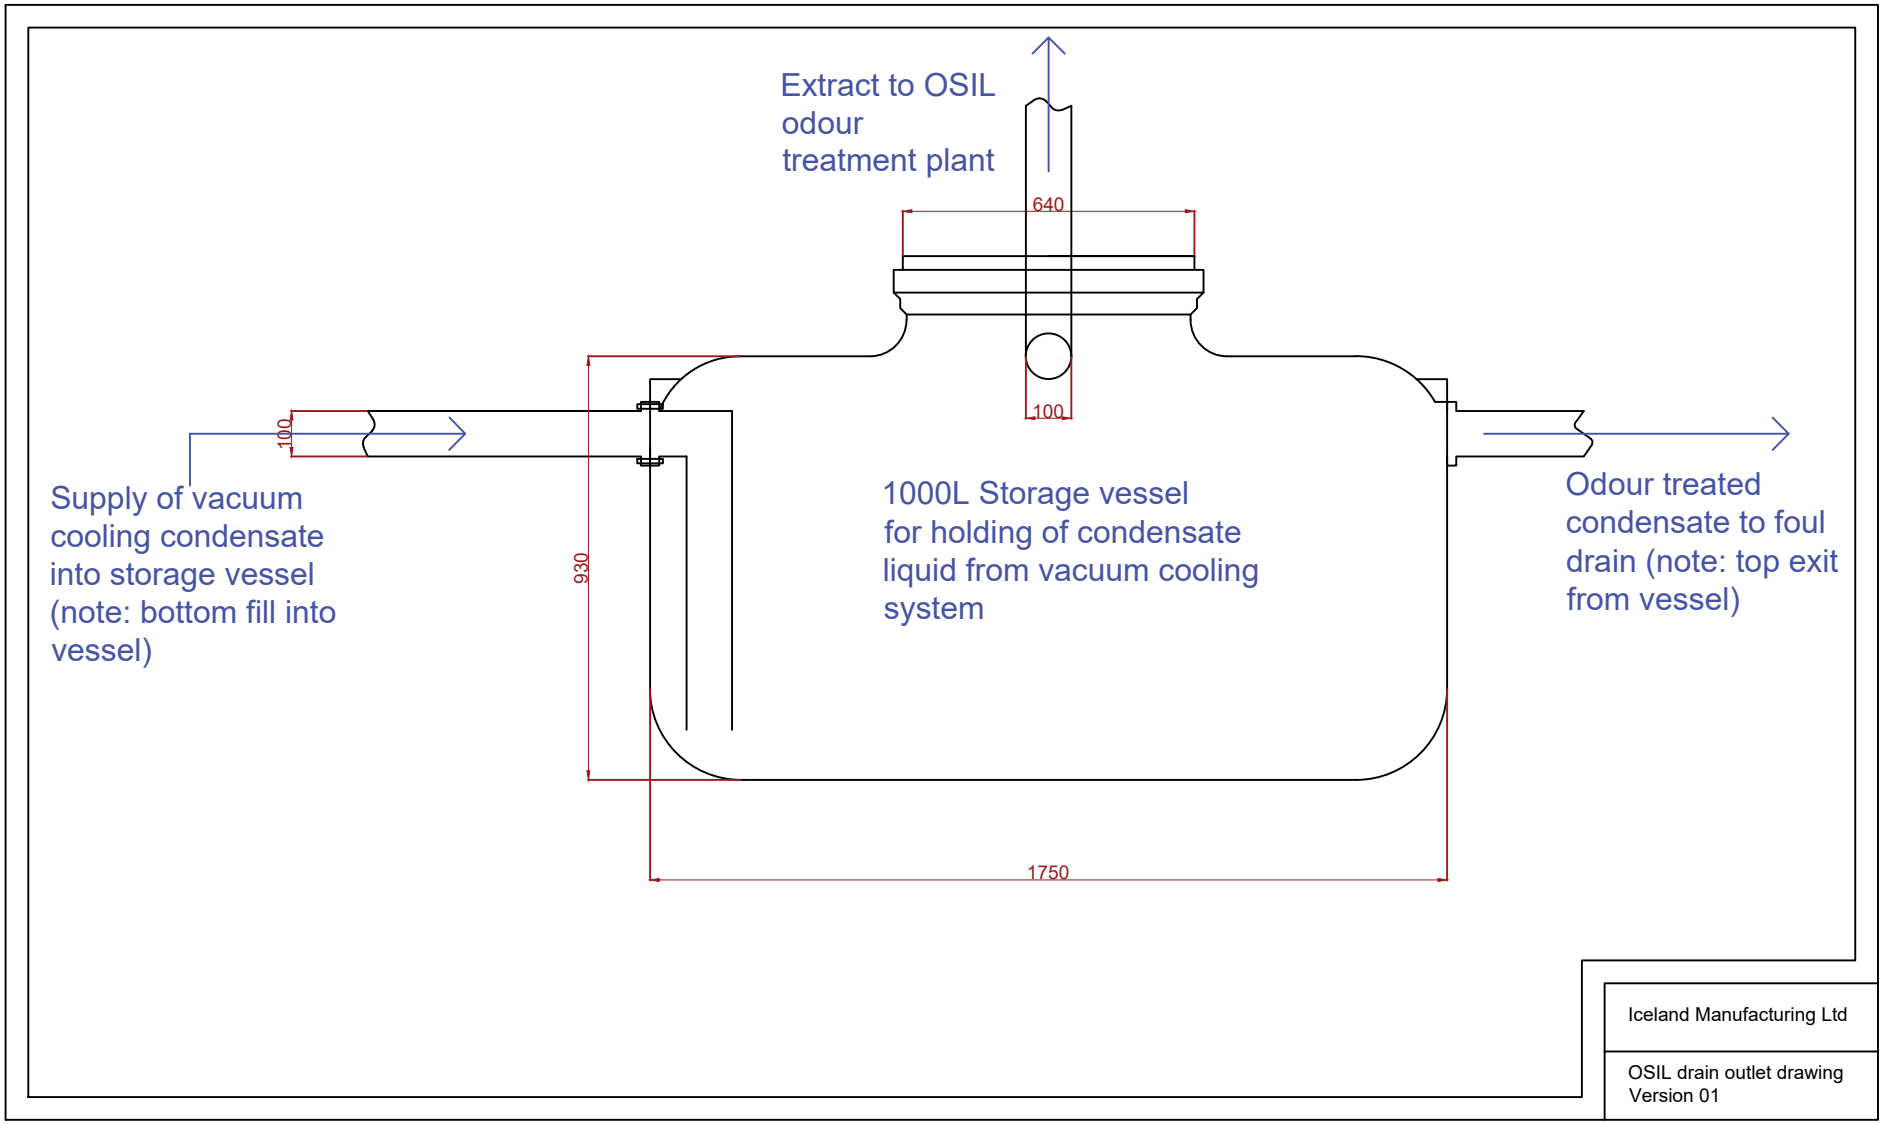
Extract to OSIL odour treatment plant
640
100
100
930
1750
Supply of vacuum cooling condensate into storage vessel (note: bottom fill into vessel)
1000L Storage vessel for holding of condensate liquid from vacuum cooling system
Odour treated condensate to foul drain (note: top exit from vessel)
Iceland Manufacturing Ltd
OSIL drain outlet drawing
Version 01