
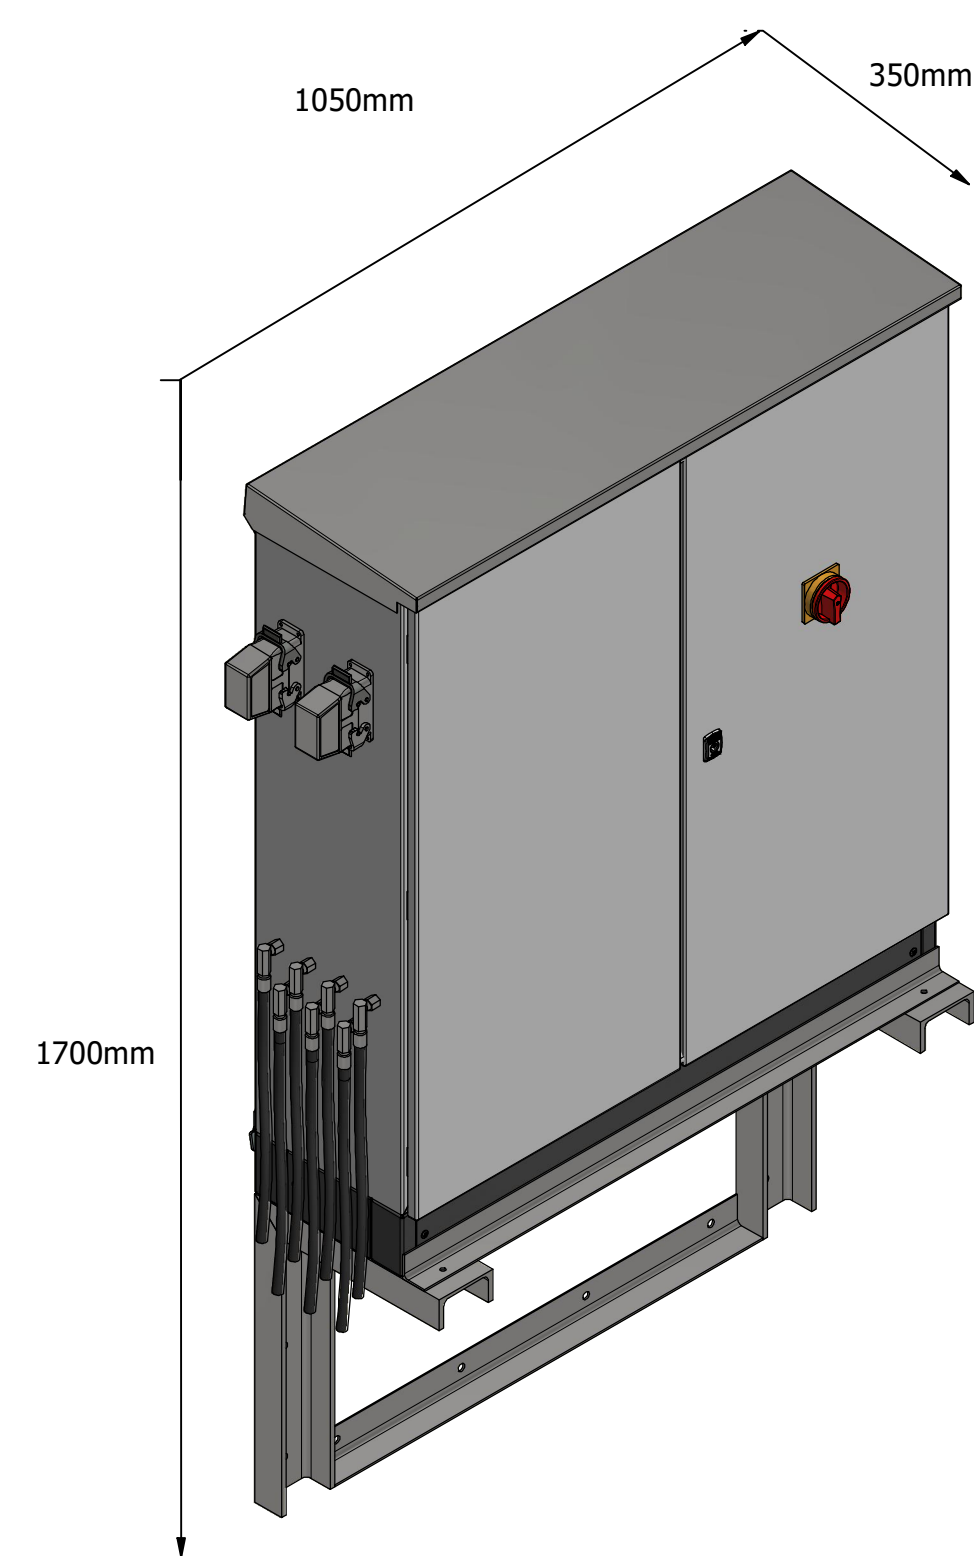


On Lift Button Post incorporated to Handrail

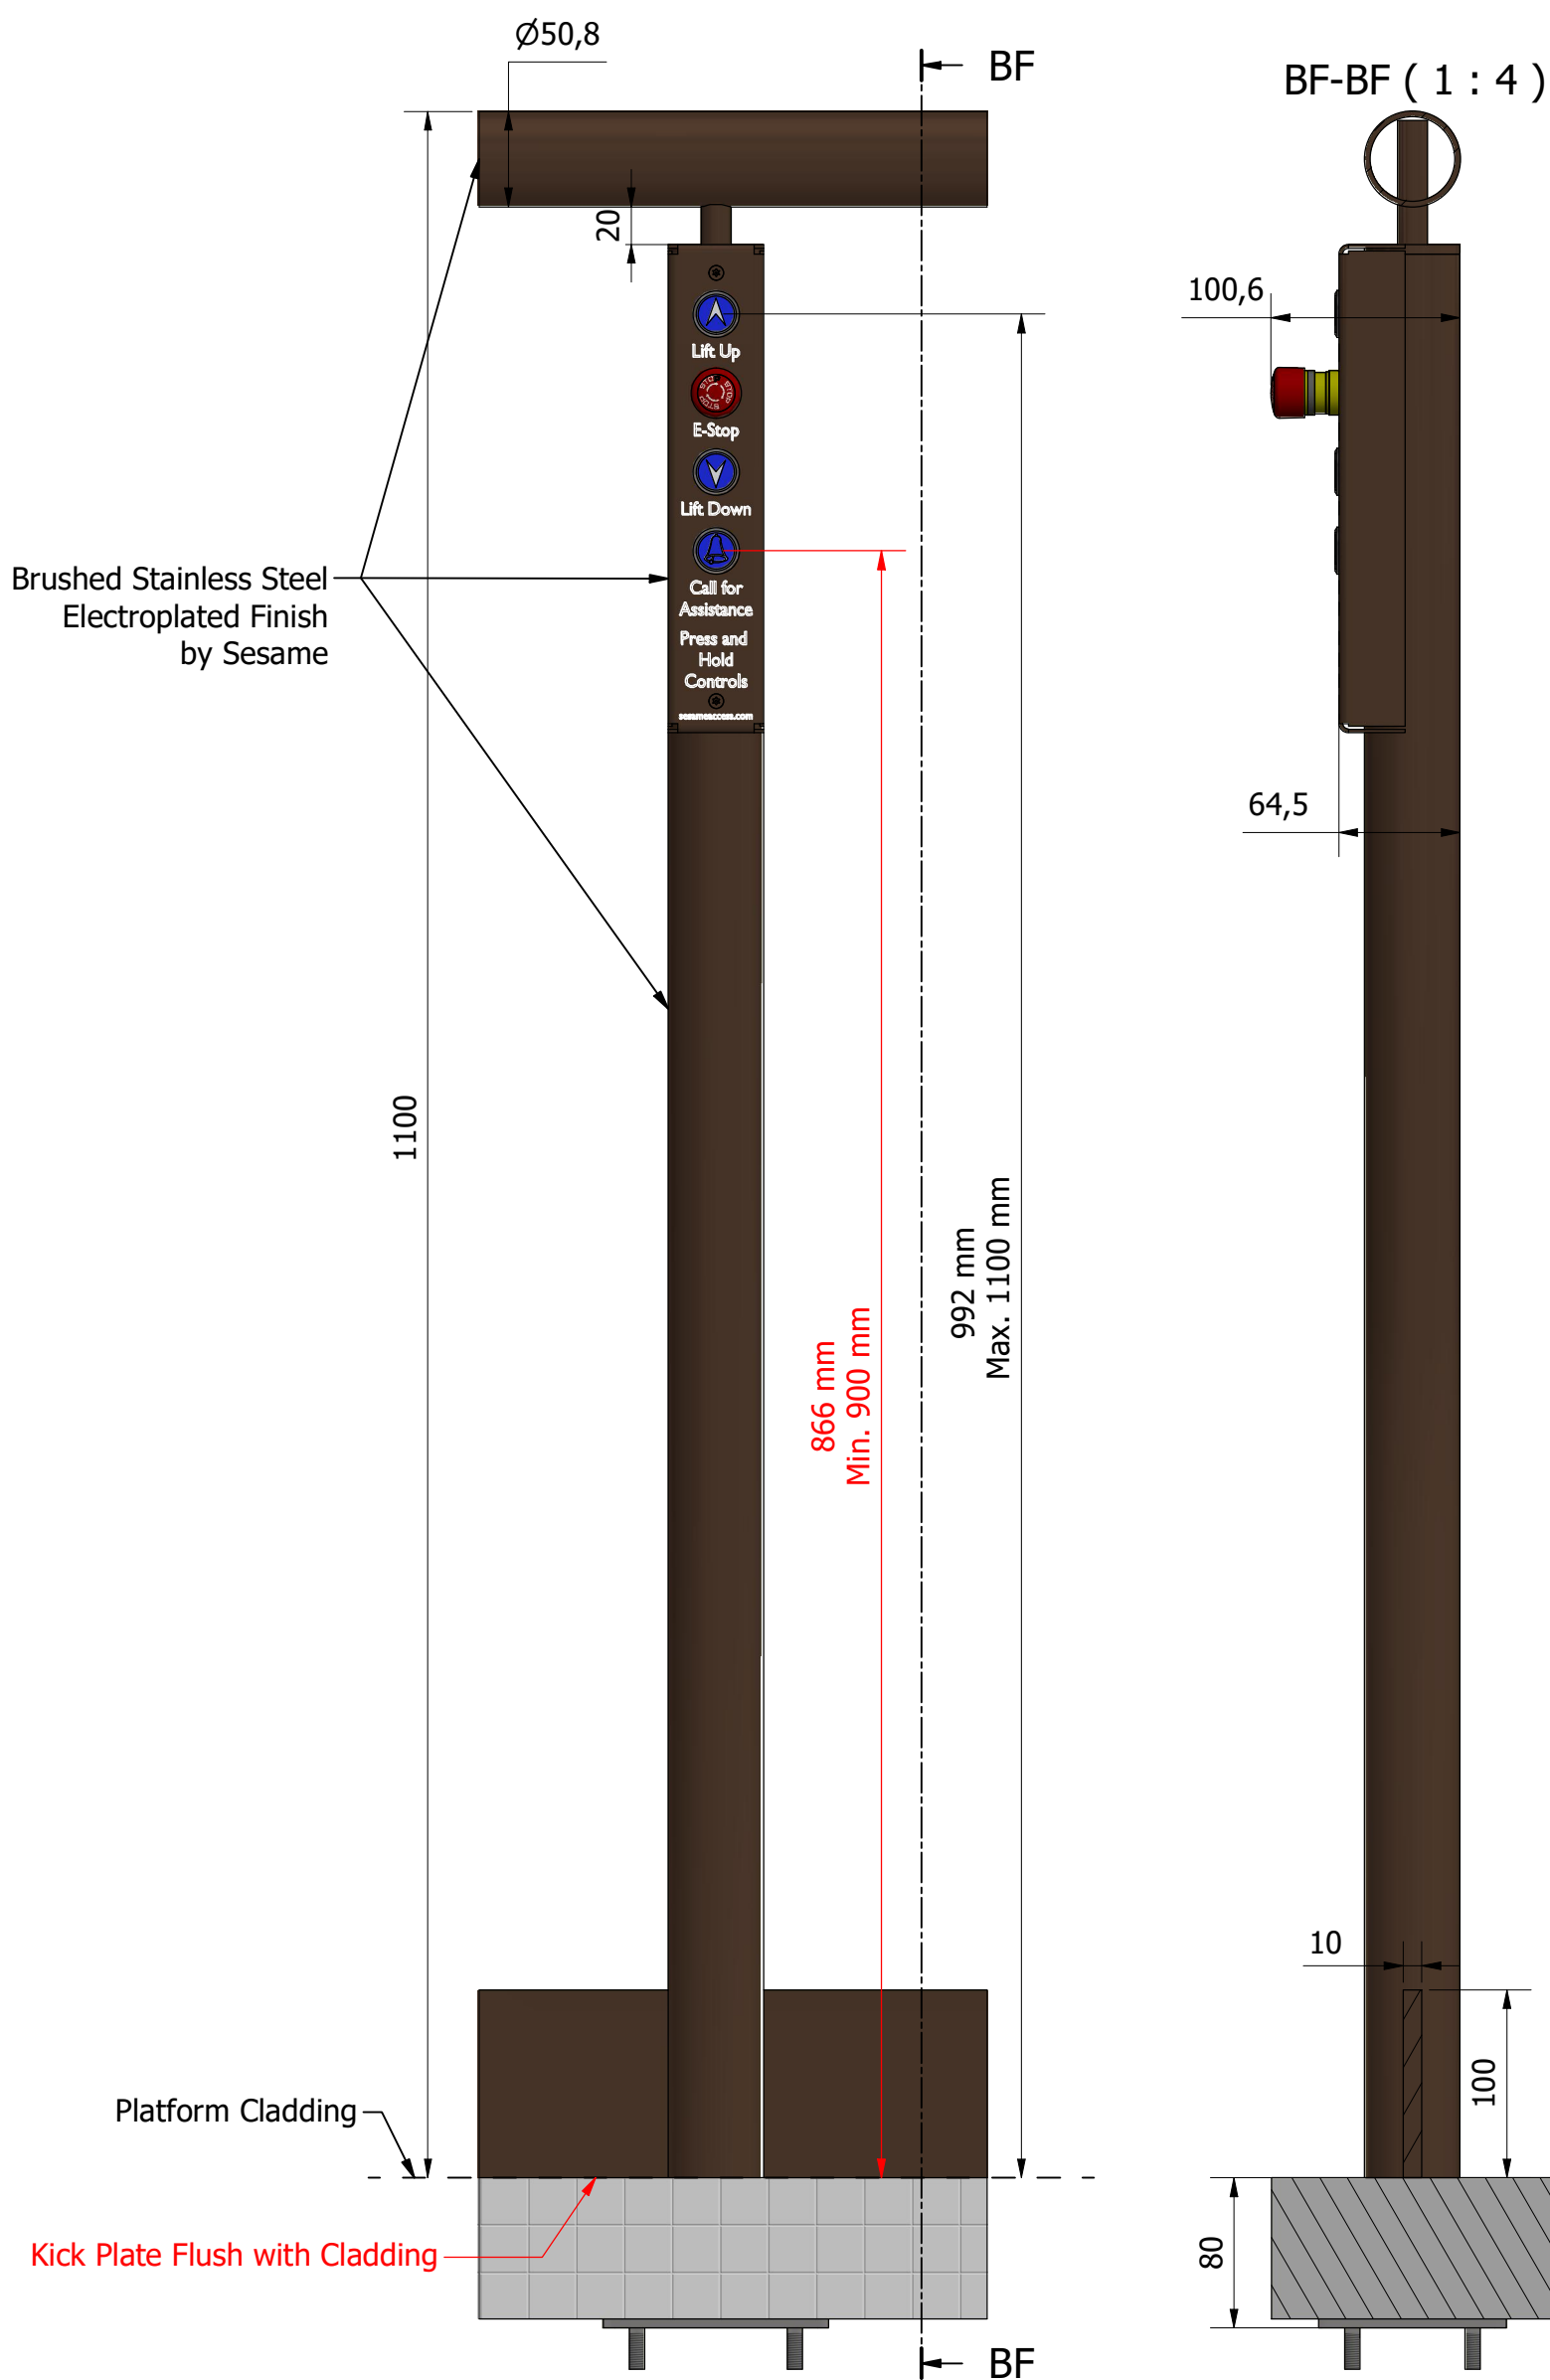

Machine Room Cabinet


Machine Room Cabinet
Location TBC by Main Contractor
(Room cabinet must be located in
10 m cable route length from Sesame System)

Sesame Power Requirements:
230V AC/50Hz Single Phase Rated;
32 Amp Supply;
Type MCB Breaker;
Waterproof Commando Socket;
Power supply must be live prior to Sesame Lift Install.


According to the relevant British Standards,
the buttons on the button Stations need to be
positioned a minimum of 900mm or maximum
of 1100mm, from Ground Level and a minimum
of 500mm from any moving parts of the Lift.

The manufacturing time from drawings approval
for these Buttons Stations is 12 weeks.


Upper Landing Button Post

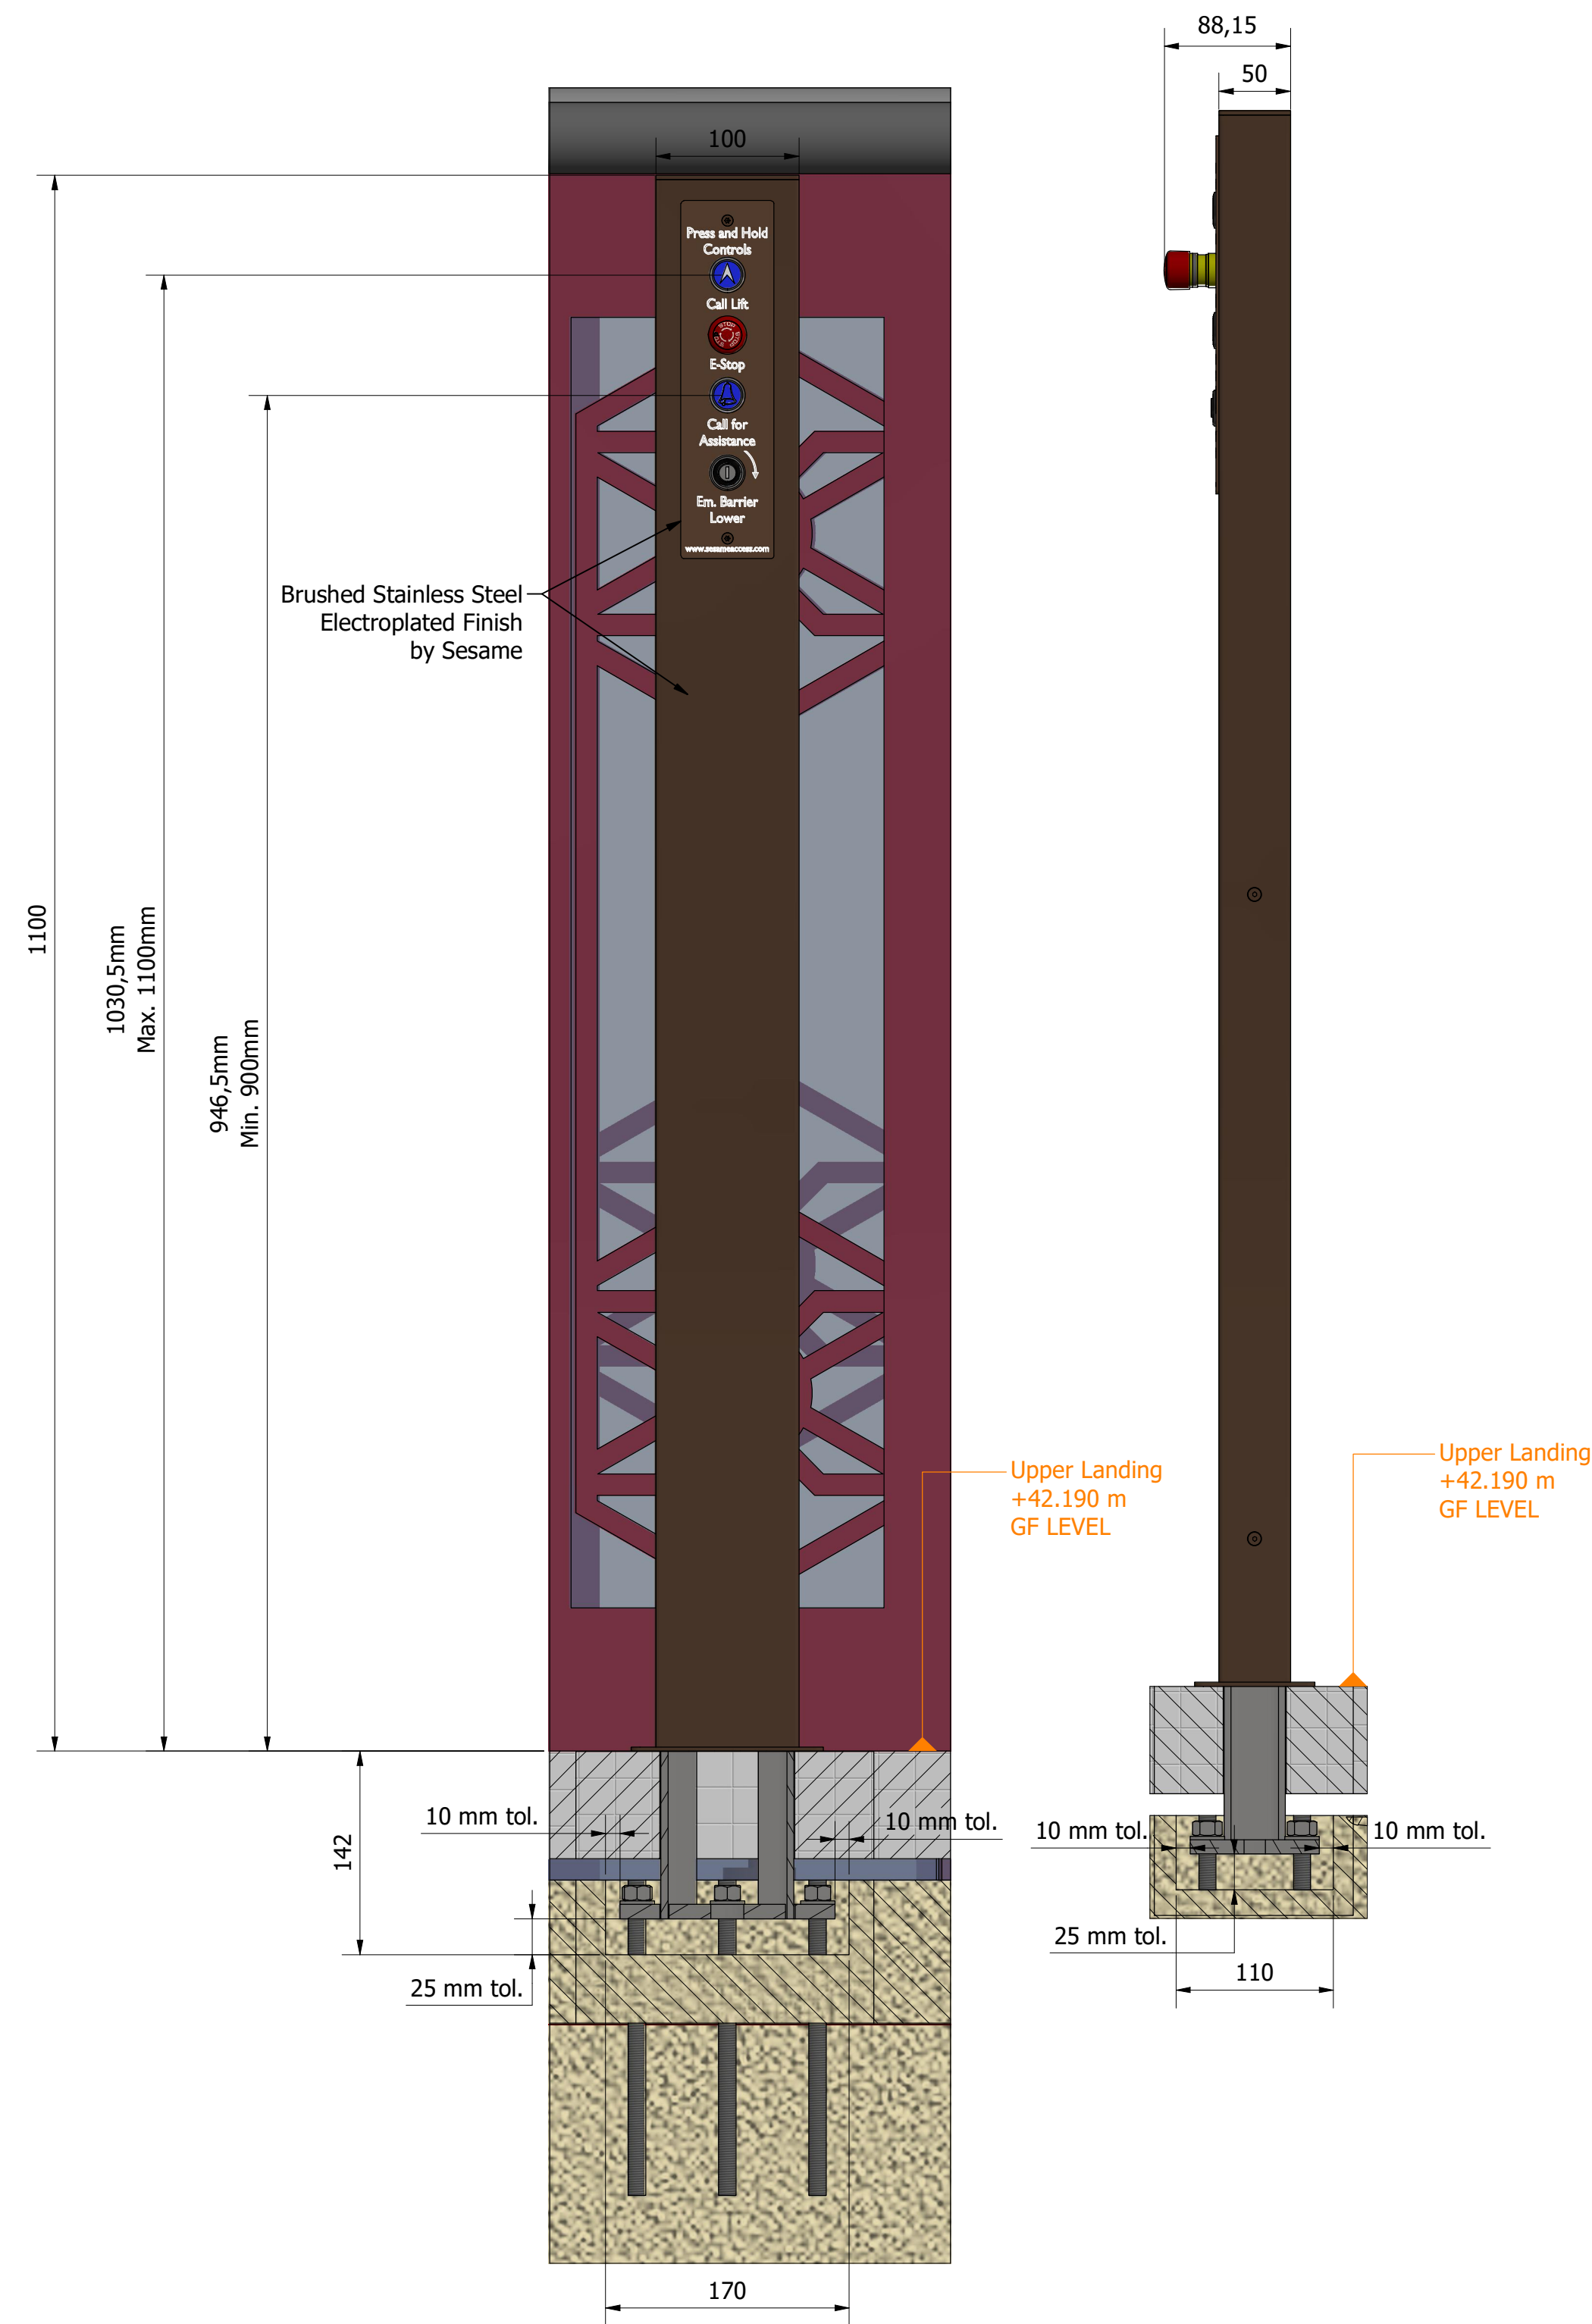


Call for Assistance Receiver

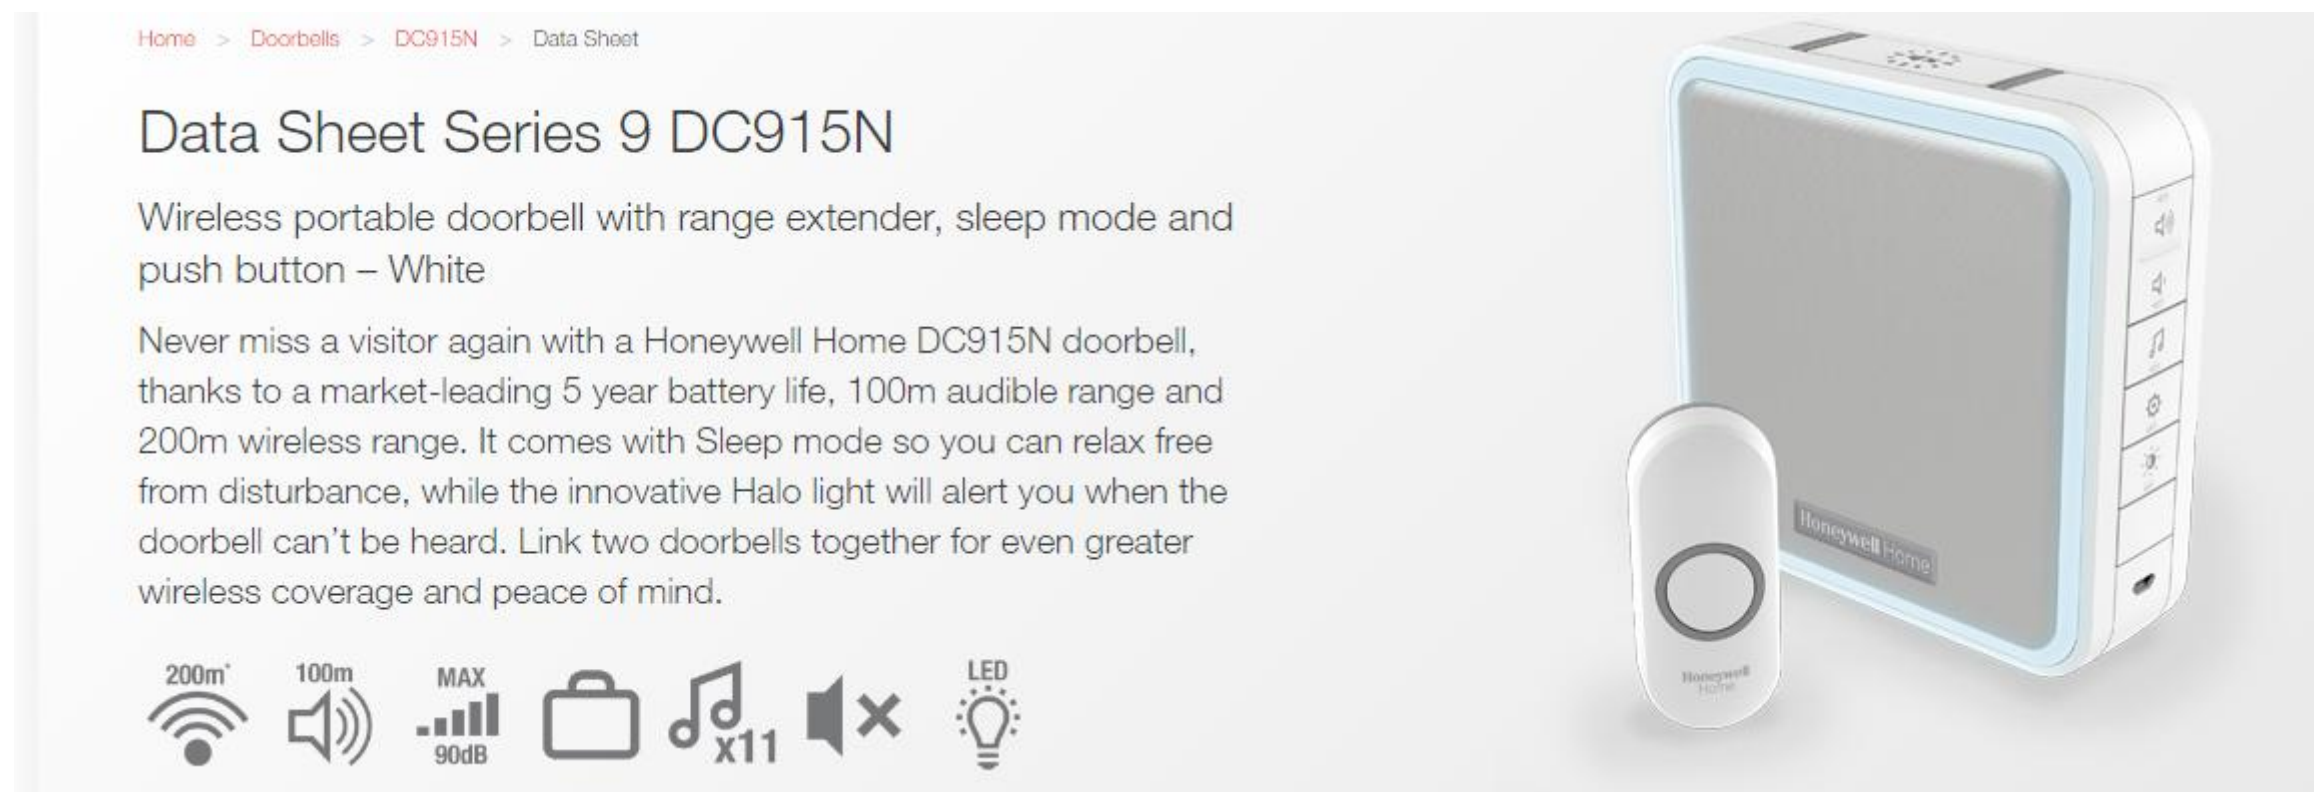

Lower Landing Button Post

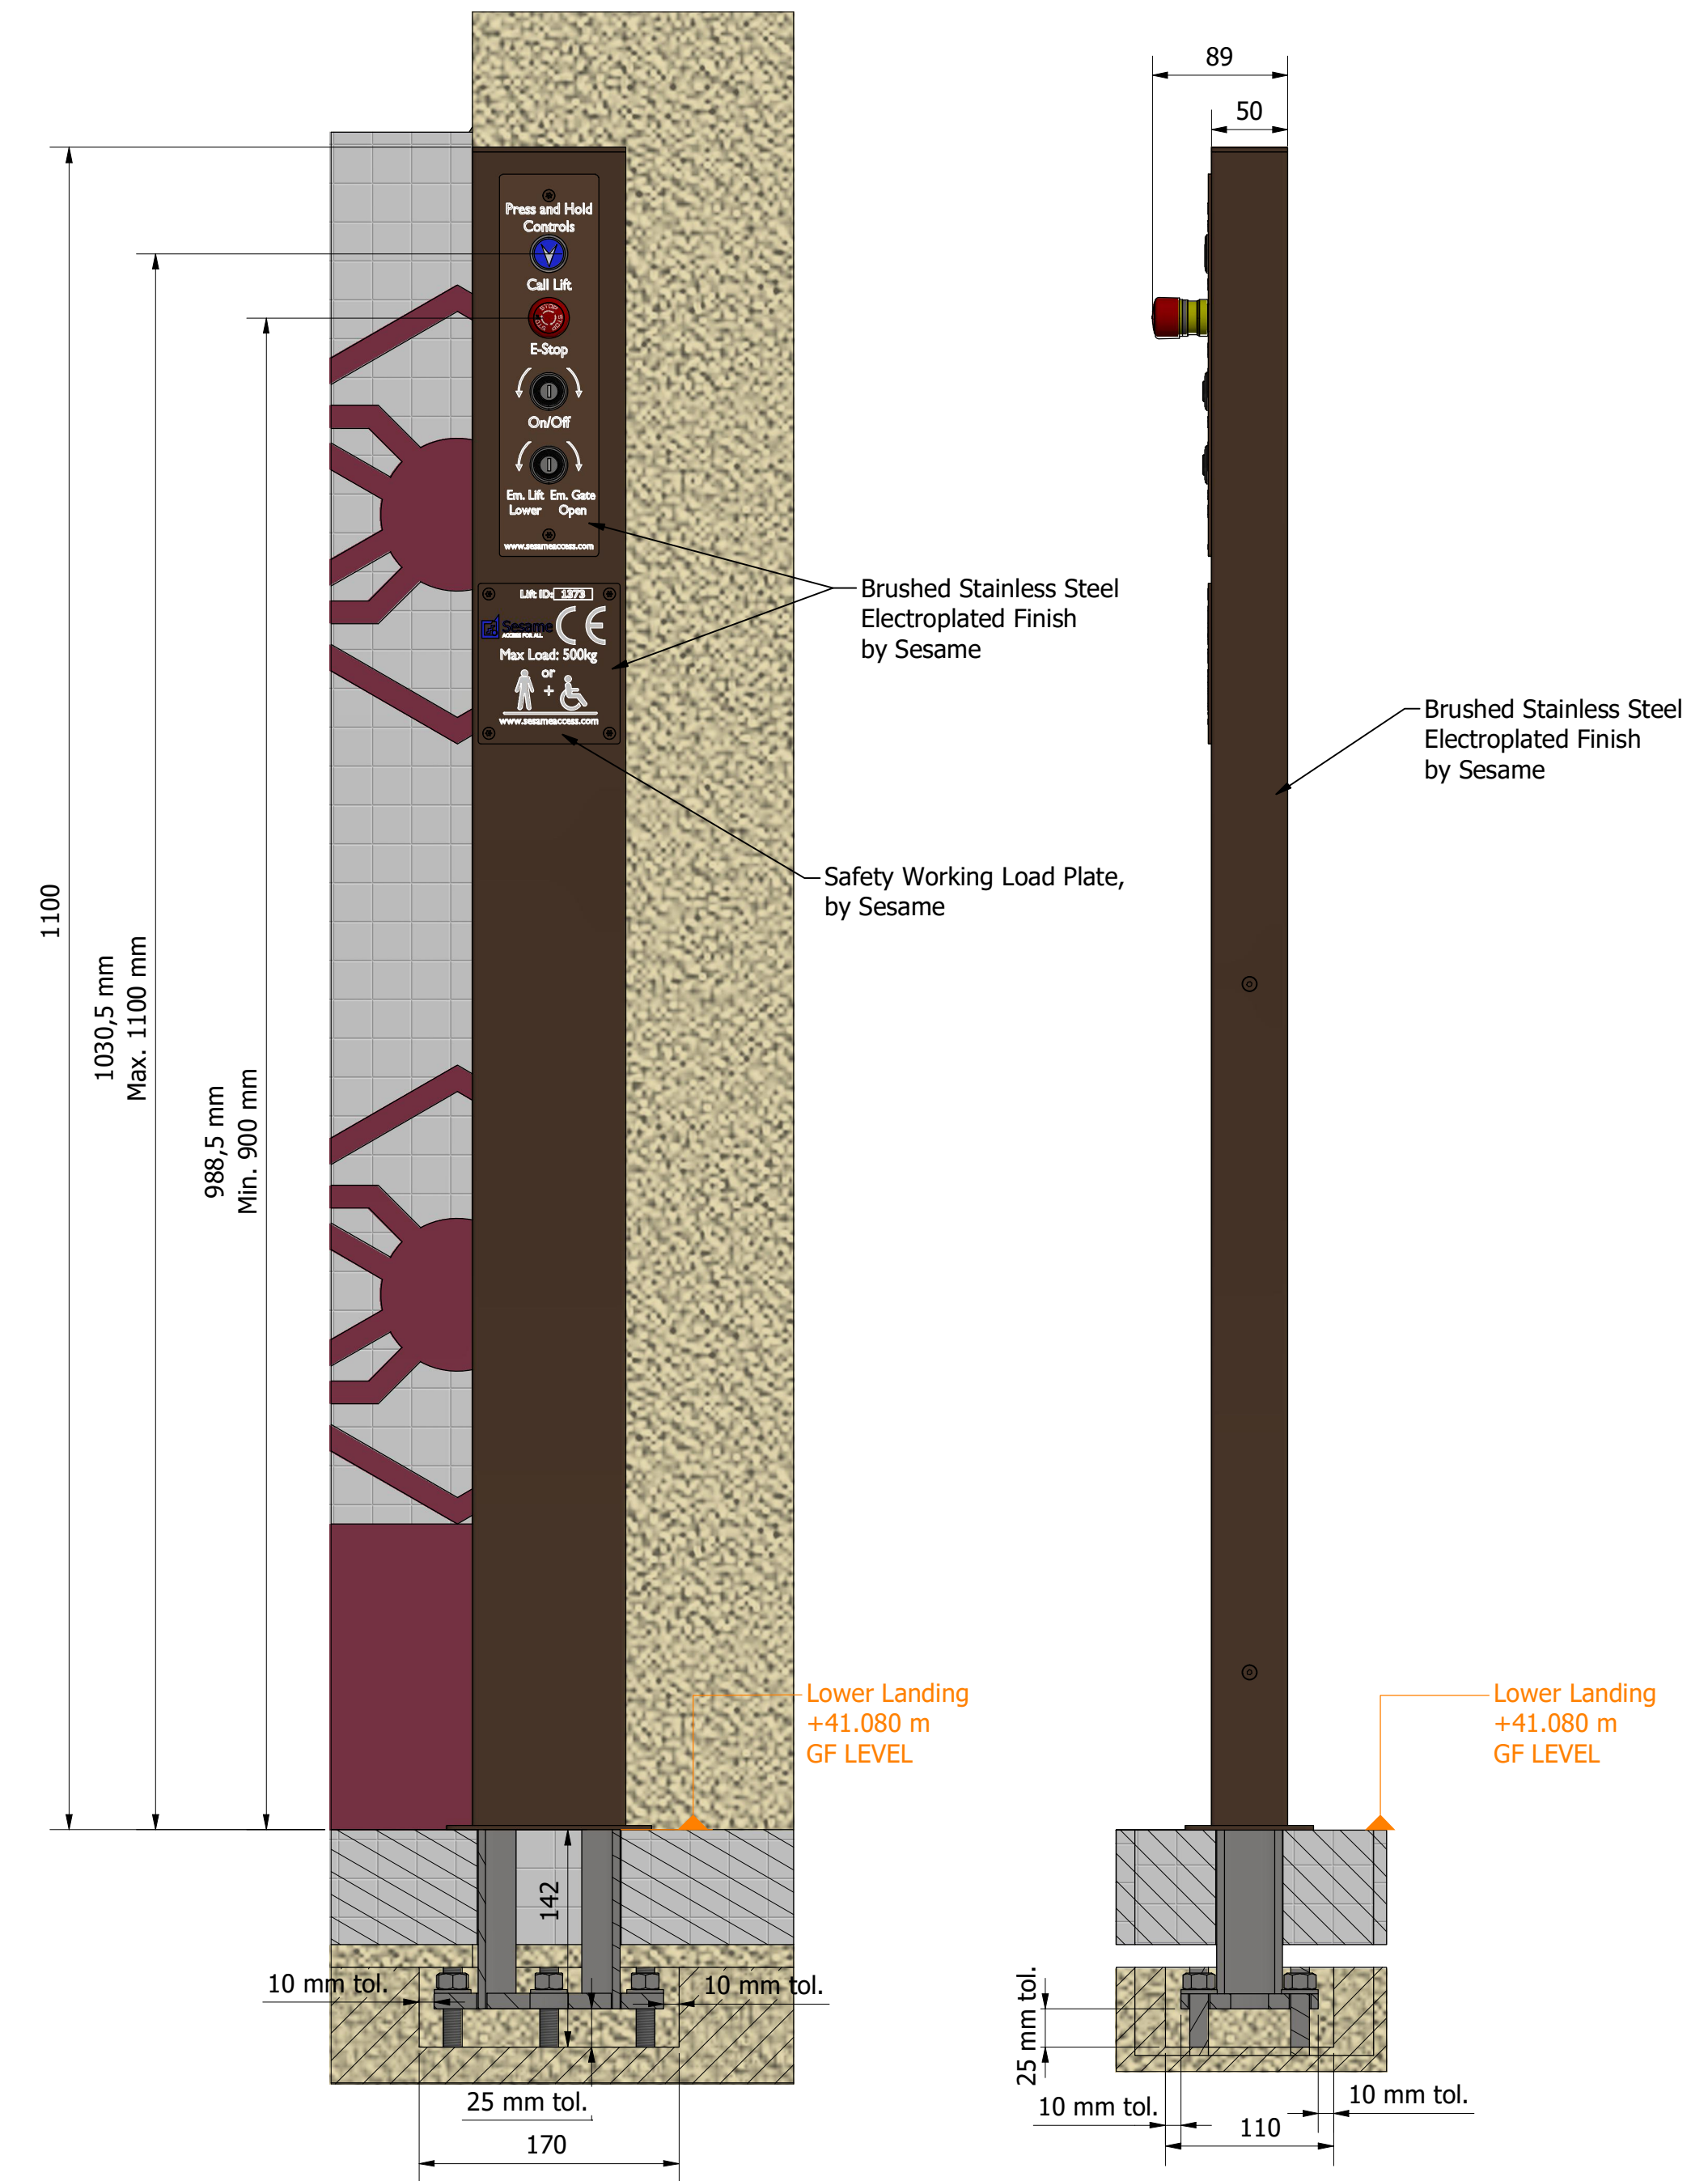

Safe Working Load Plate

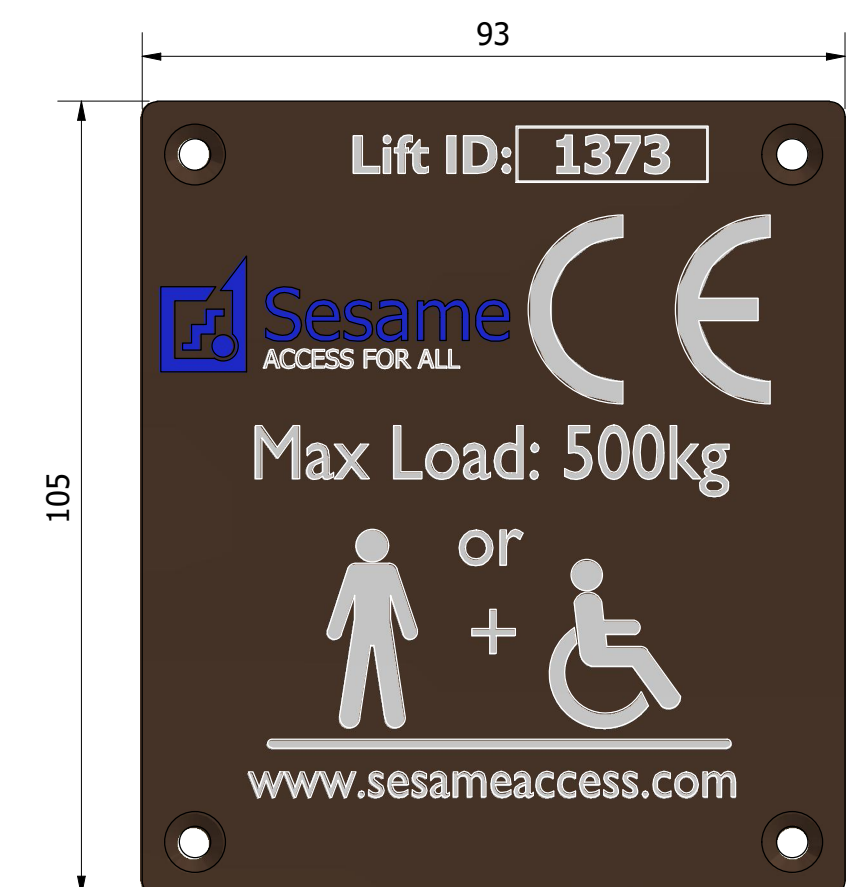

OTH-SAS-TH-GF-DWG-X-0006				Status S3	Revision P10	
This drawing and the information it contains is the property of Sesame Access Systems LTD. and must not be copied or issued to any third party	Designed by K. Porwol	Checked by S.J.Lyons	Date 28.01.2022	Project Name: OTH-SAS-TH-GF-DWG-X-0006	Revision P10	
	 Sesame ACCESS FOR ALL Unit 3, Cumberland Works Wintwell Business Park Surrey, KT14 7LP Tel: +44 (0)1753 440088 Fax: +44 (0)1753 705252 Email: foral@sesameaccess.com http://www.sesameaccess.com				Button Station and Hydraulic & Electric requirement	Sheet 6 / 6

The recess in the wall and the installation
of the back box by the Main Contractor
prior to the Sesame installation