




D-D (1:30)

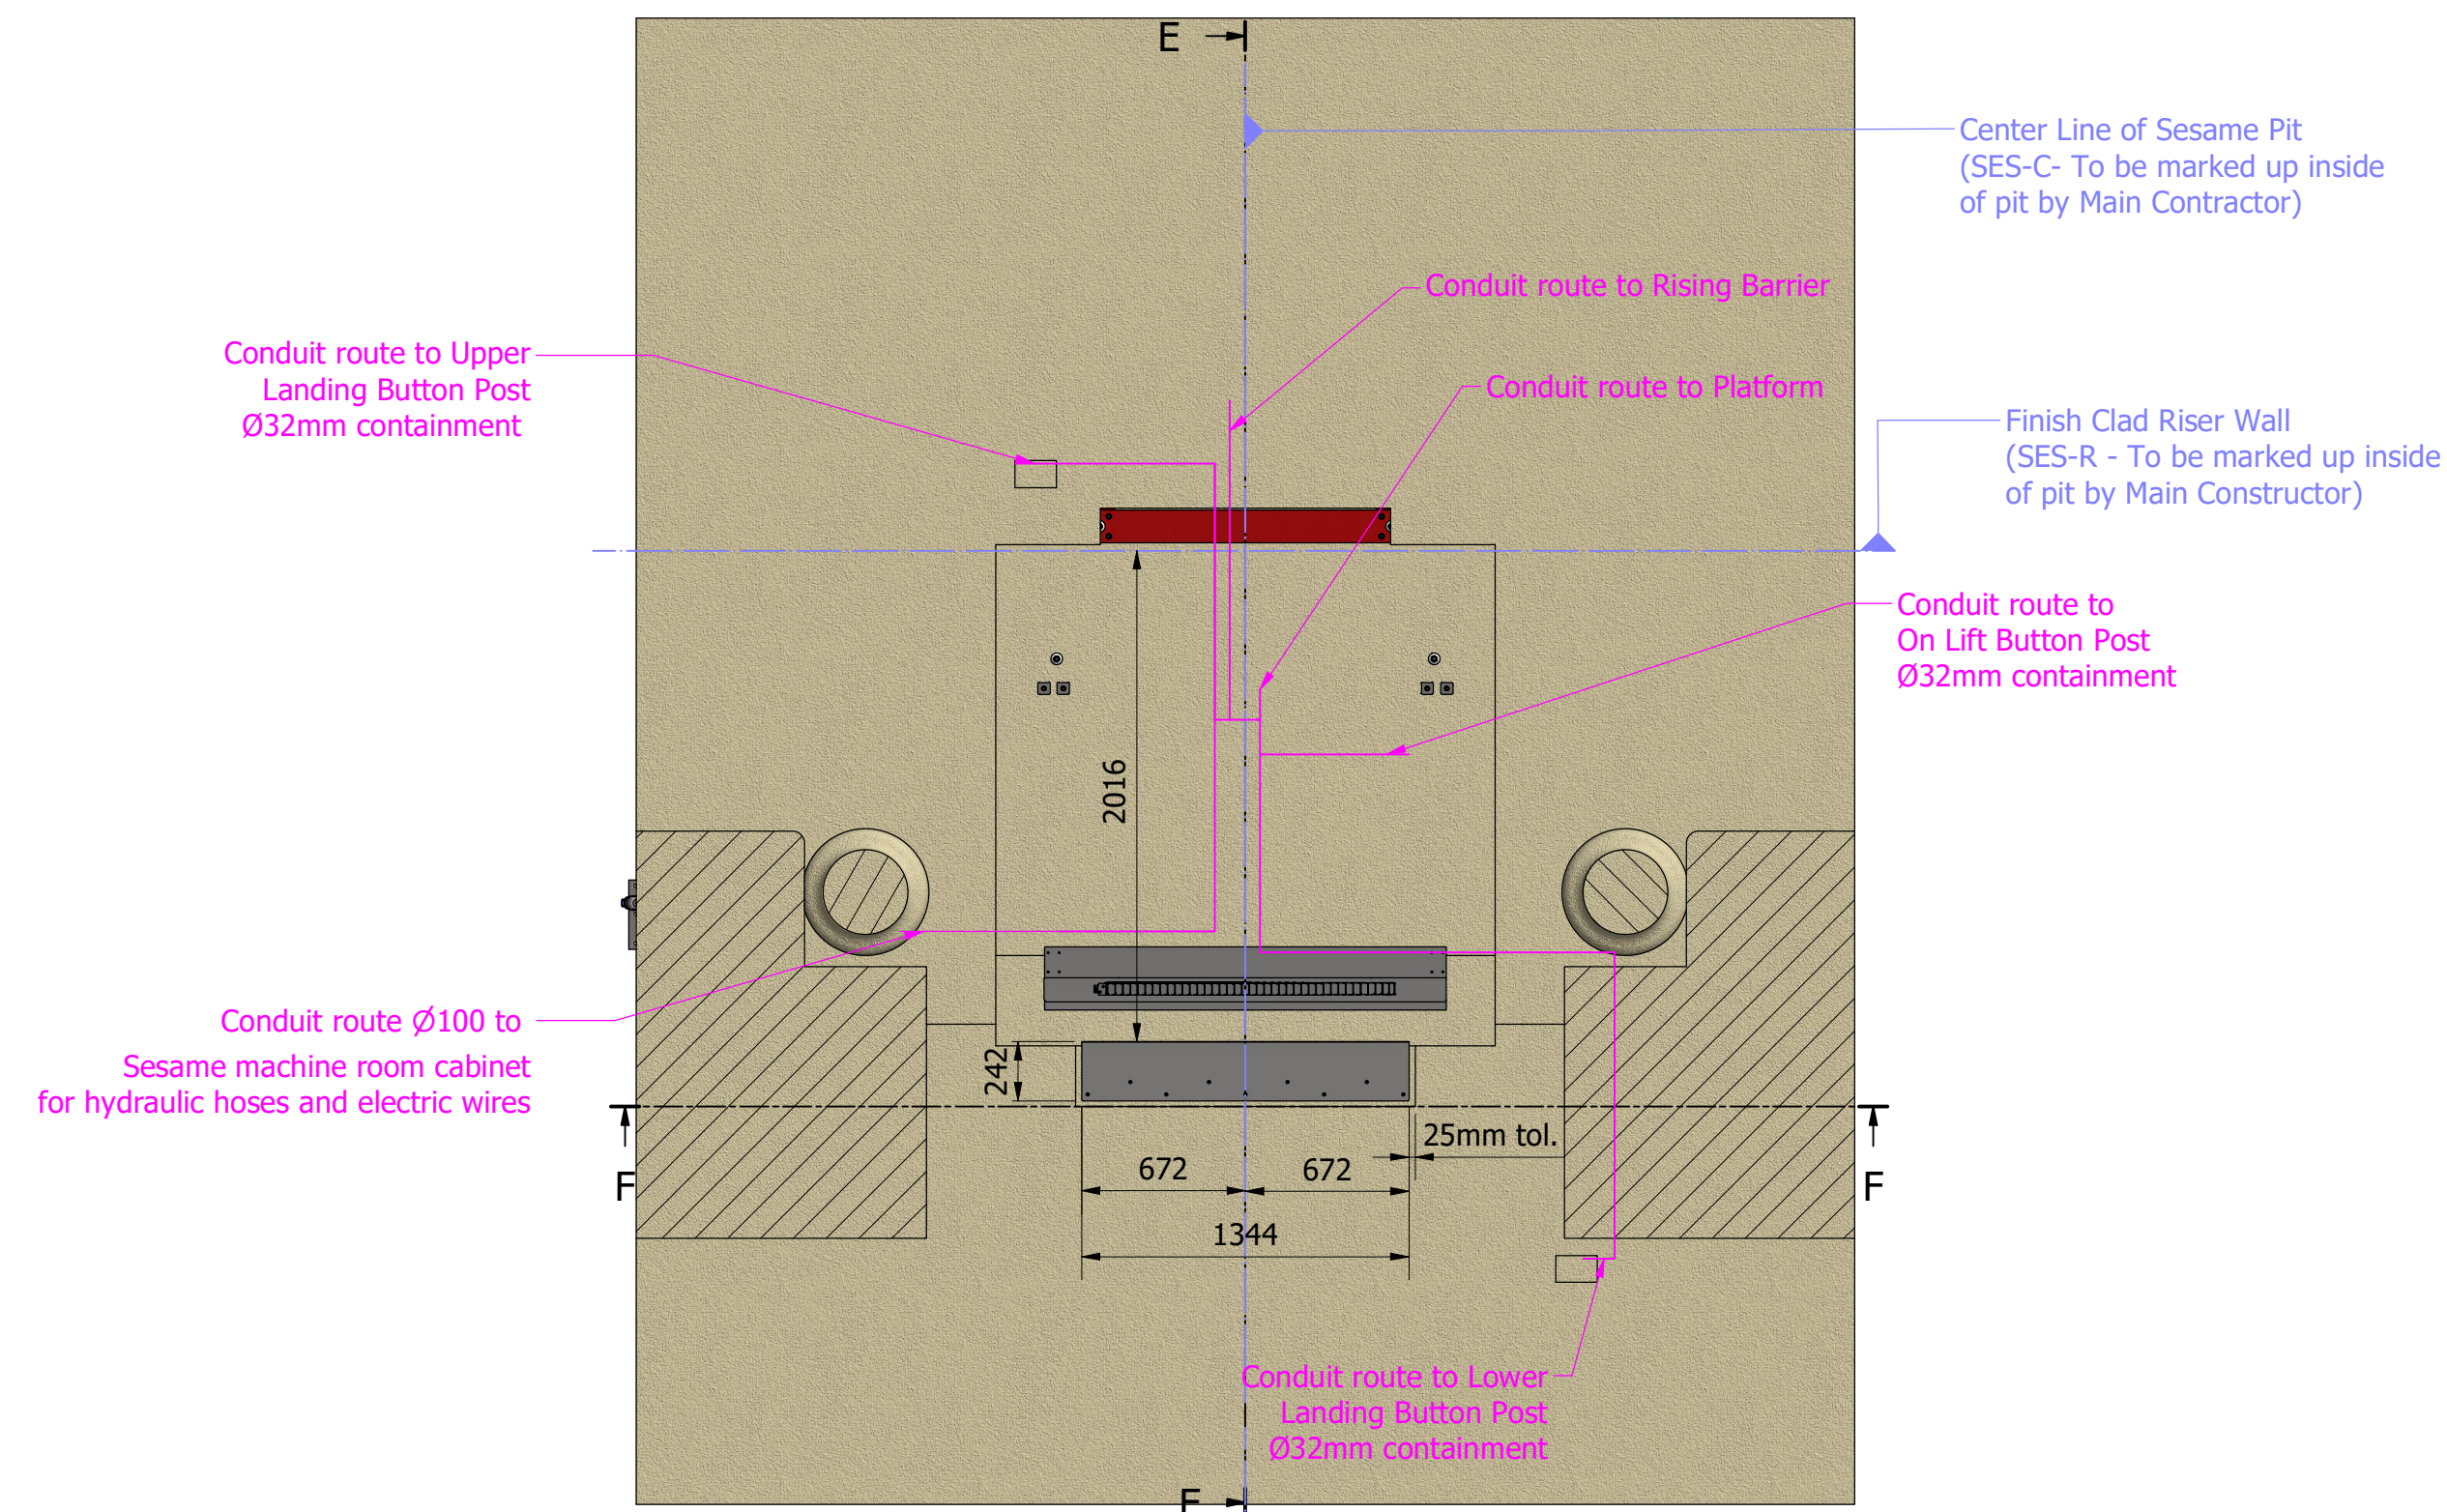


F-F (1:30)

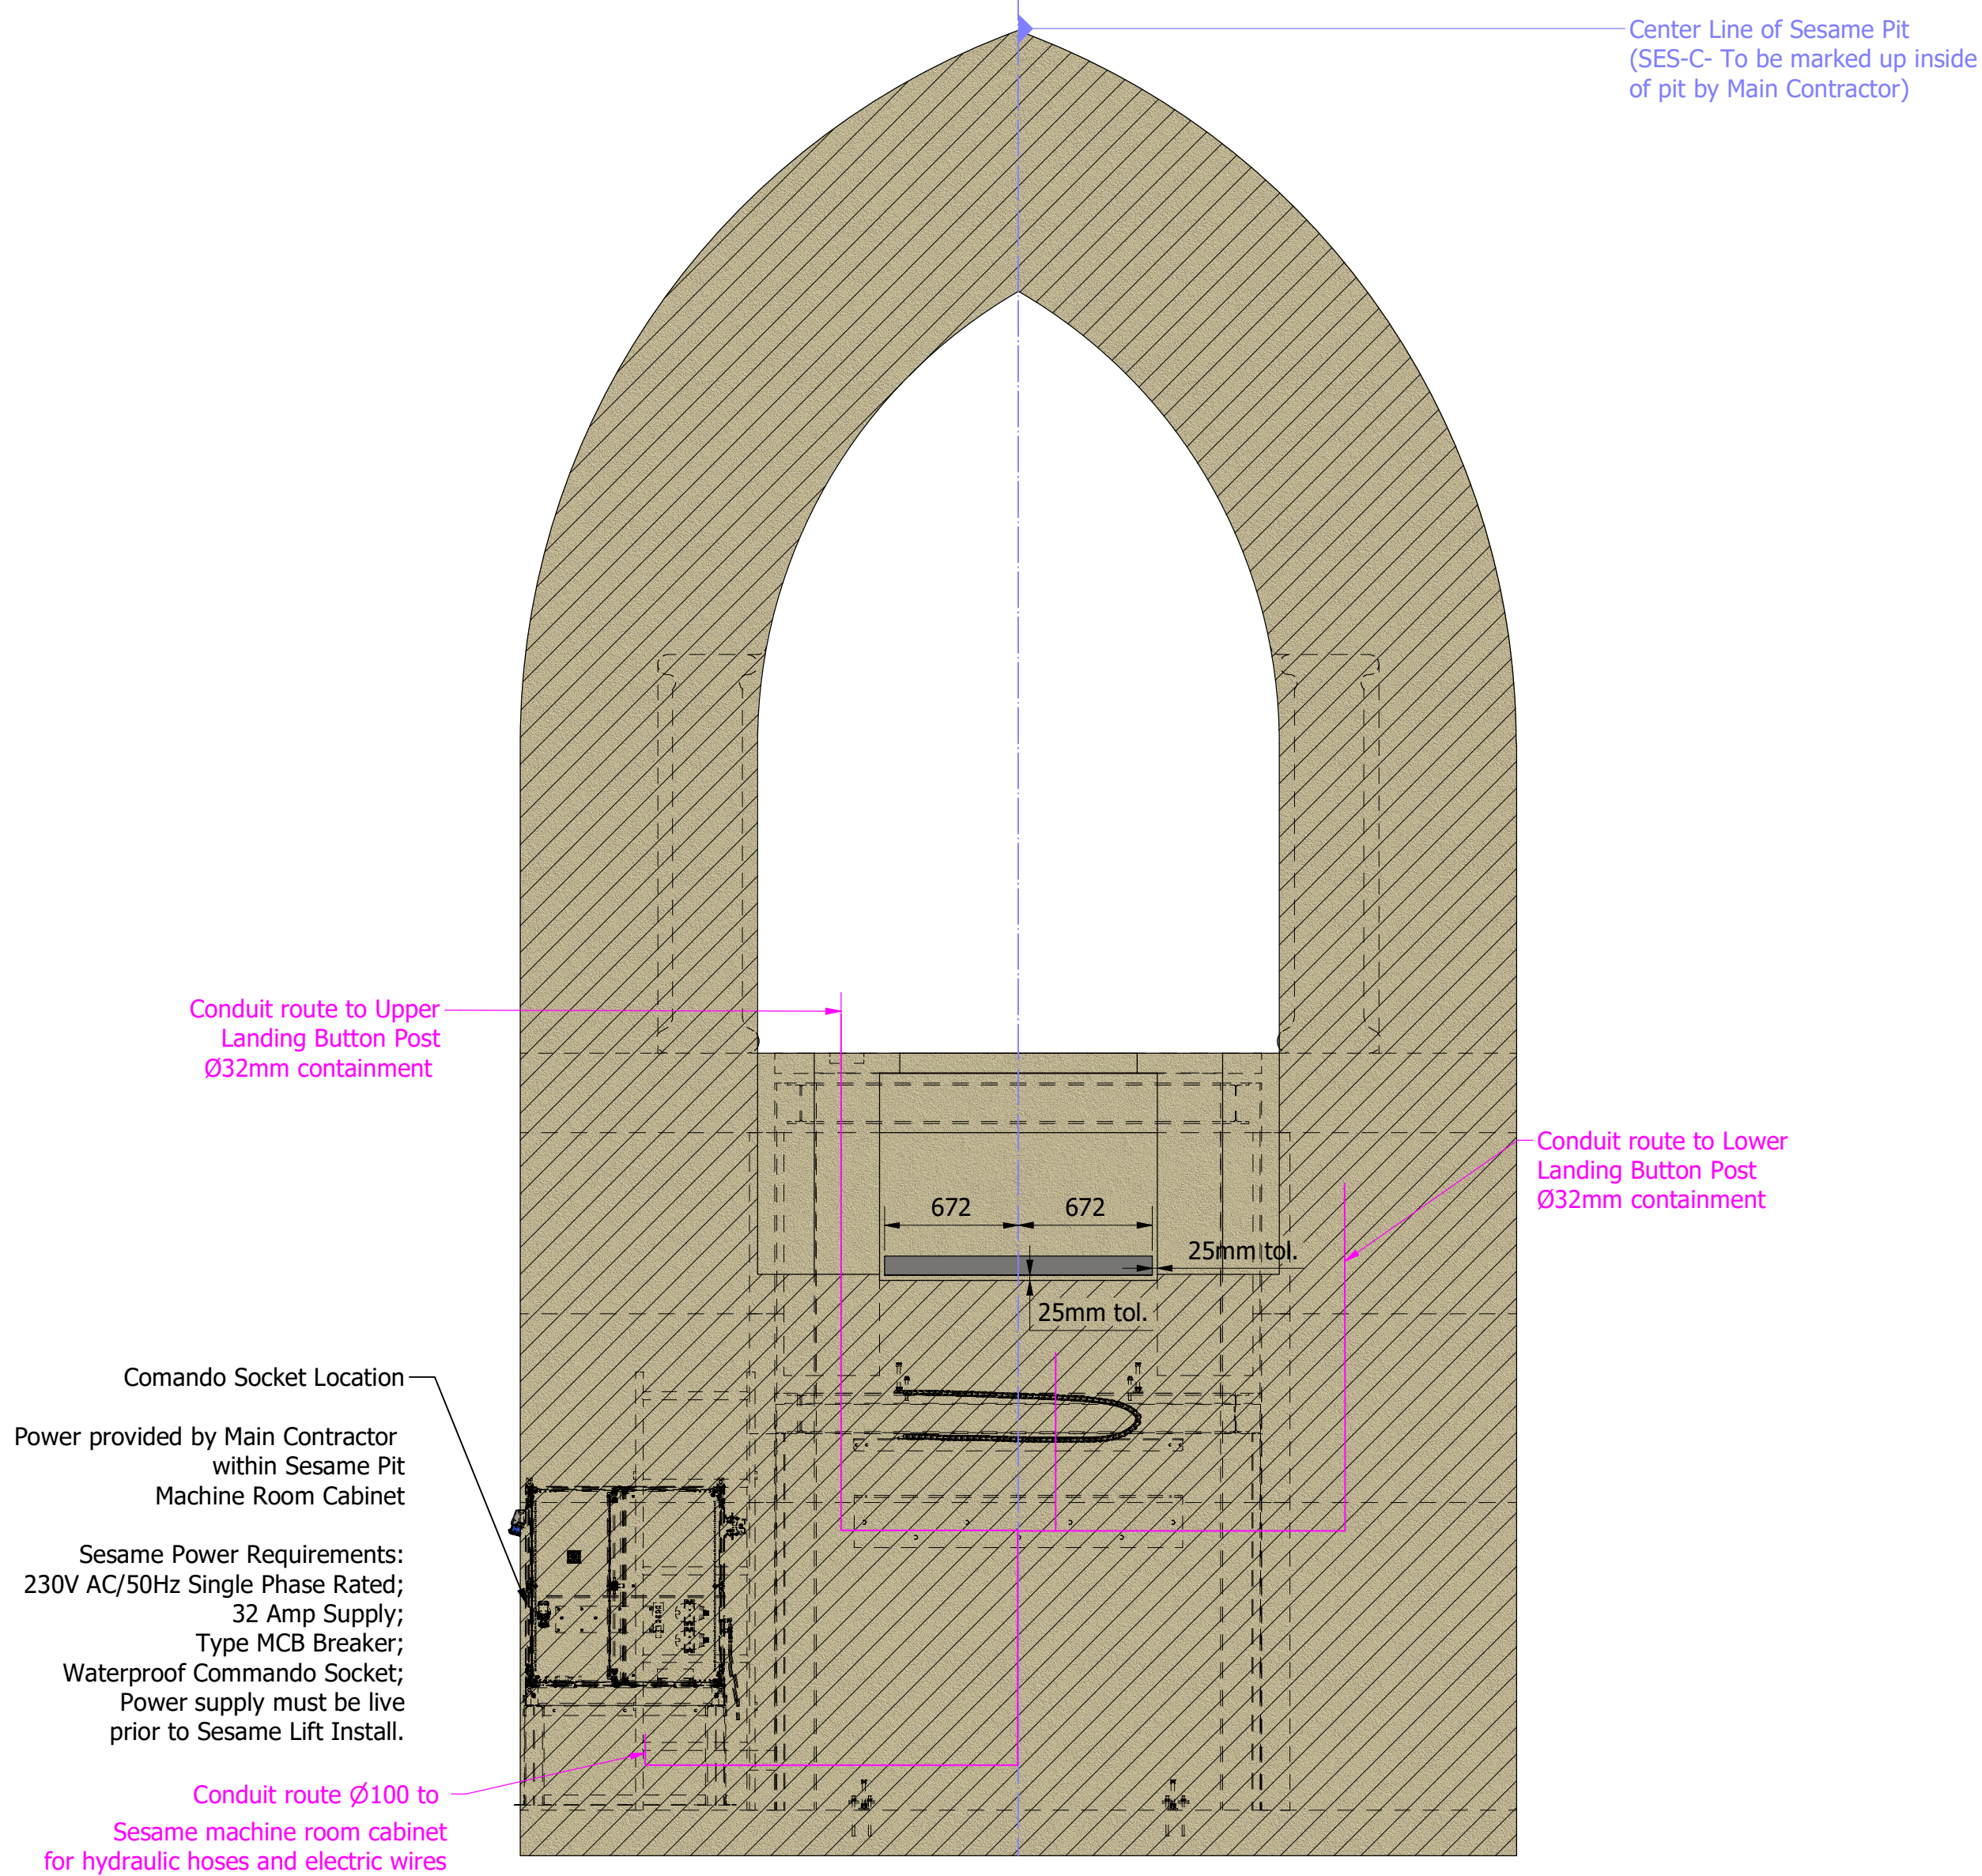

AM (1 : 7)

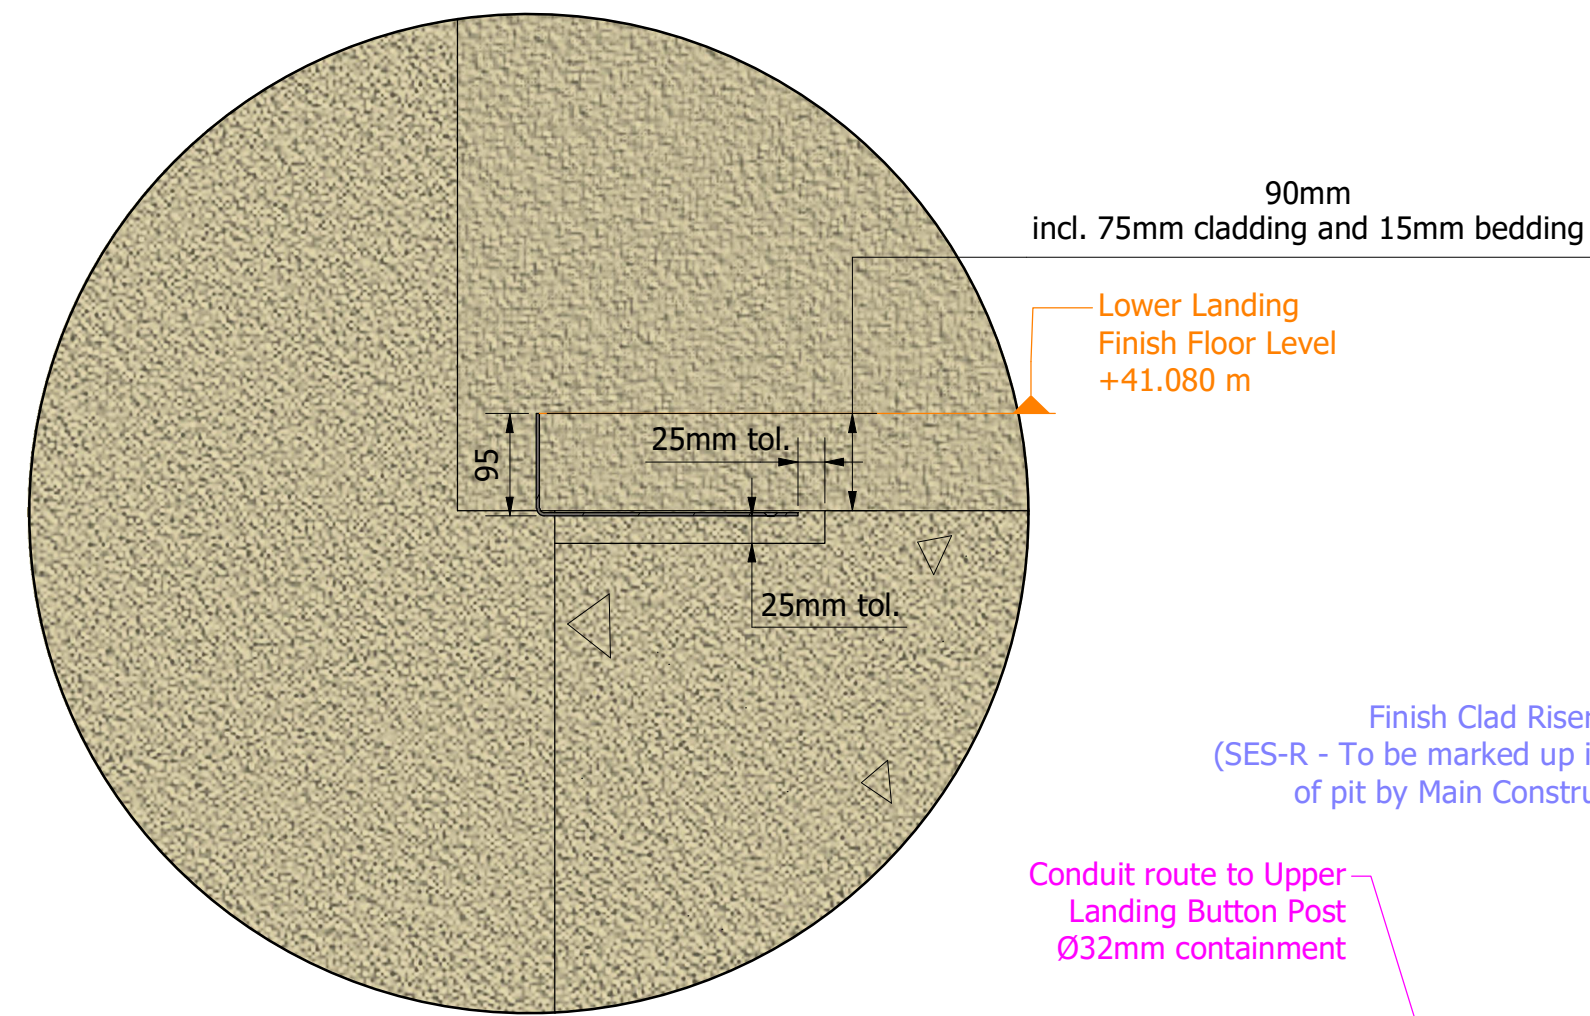

E-E (1:14)

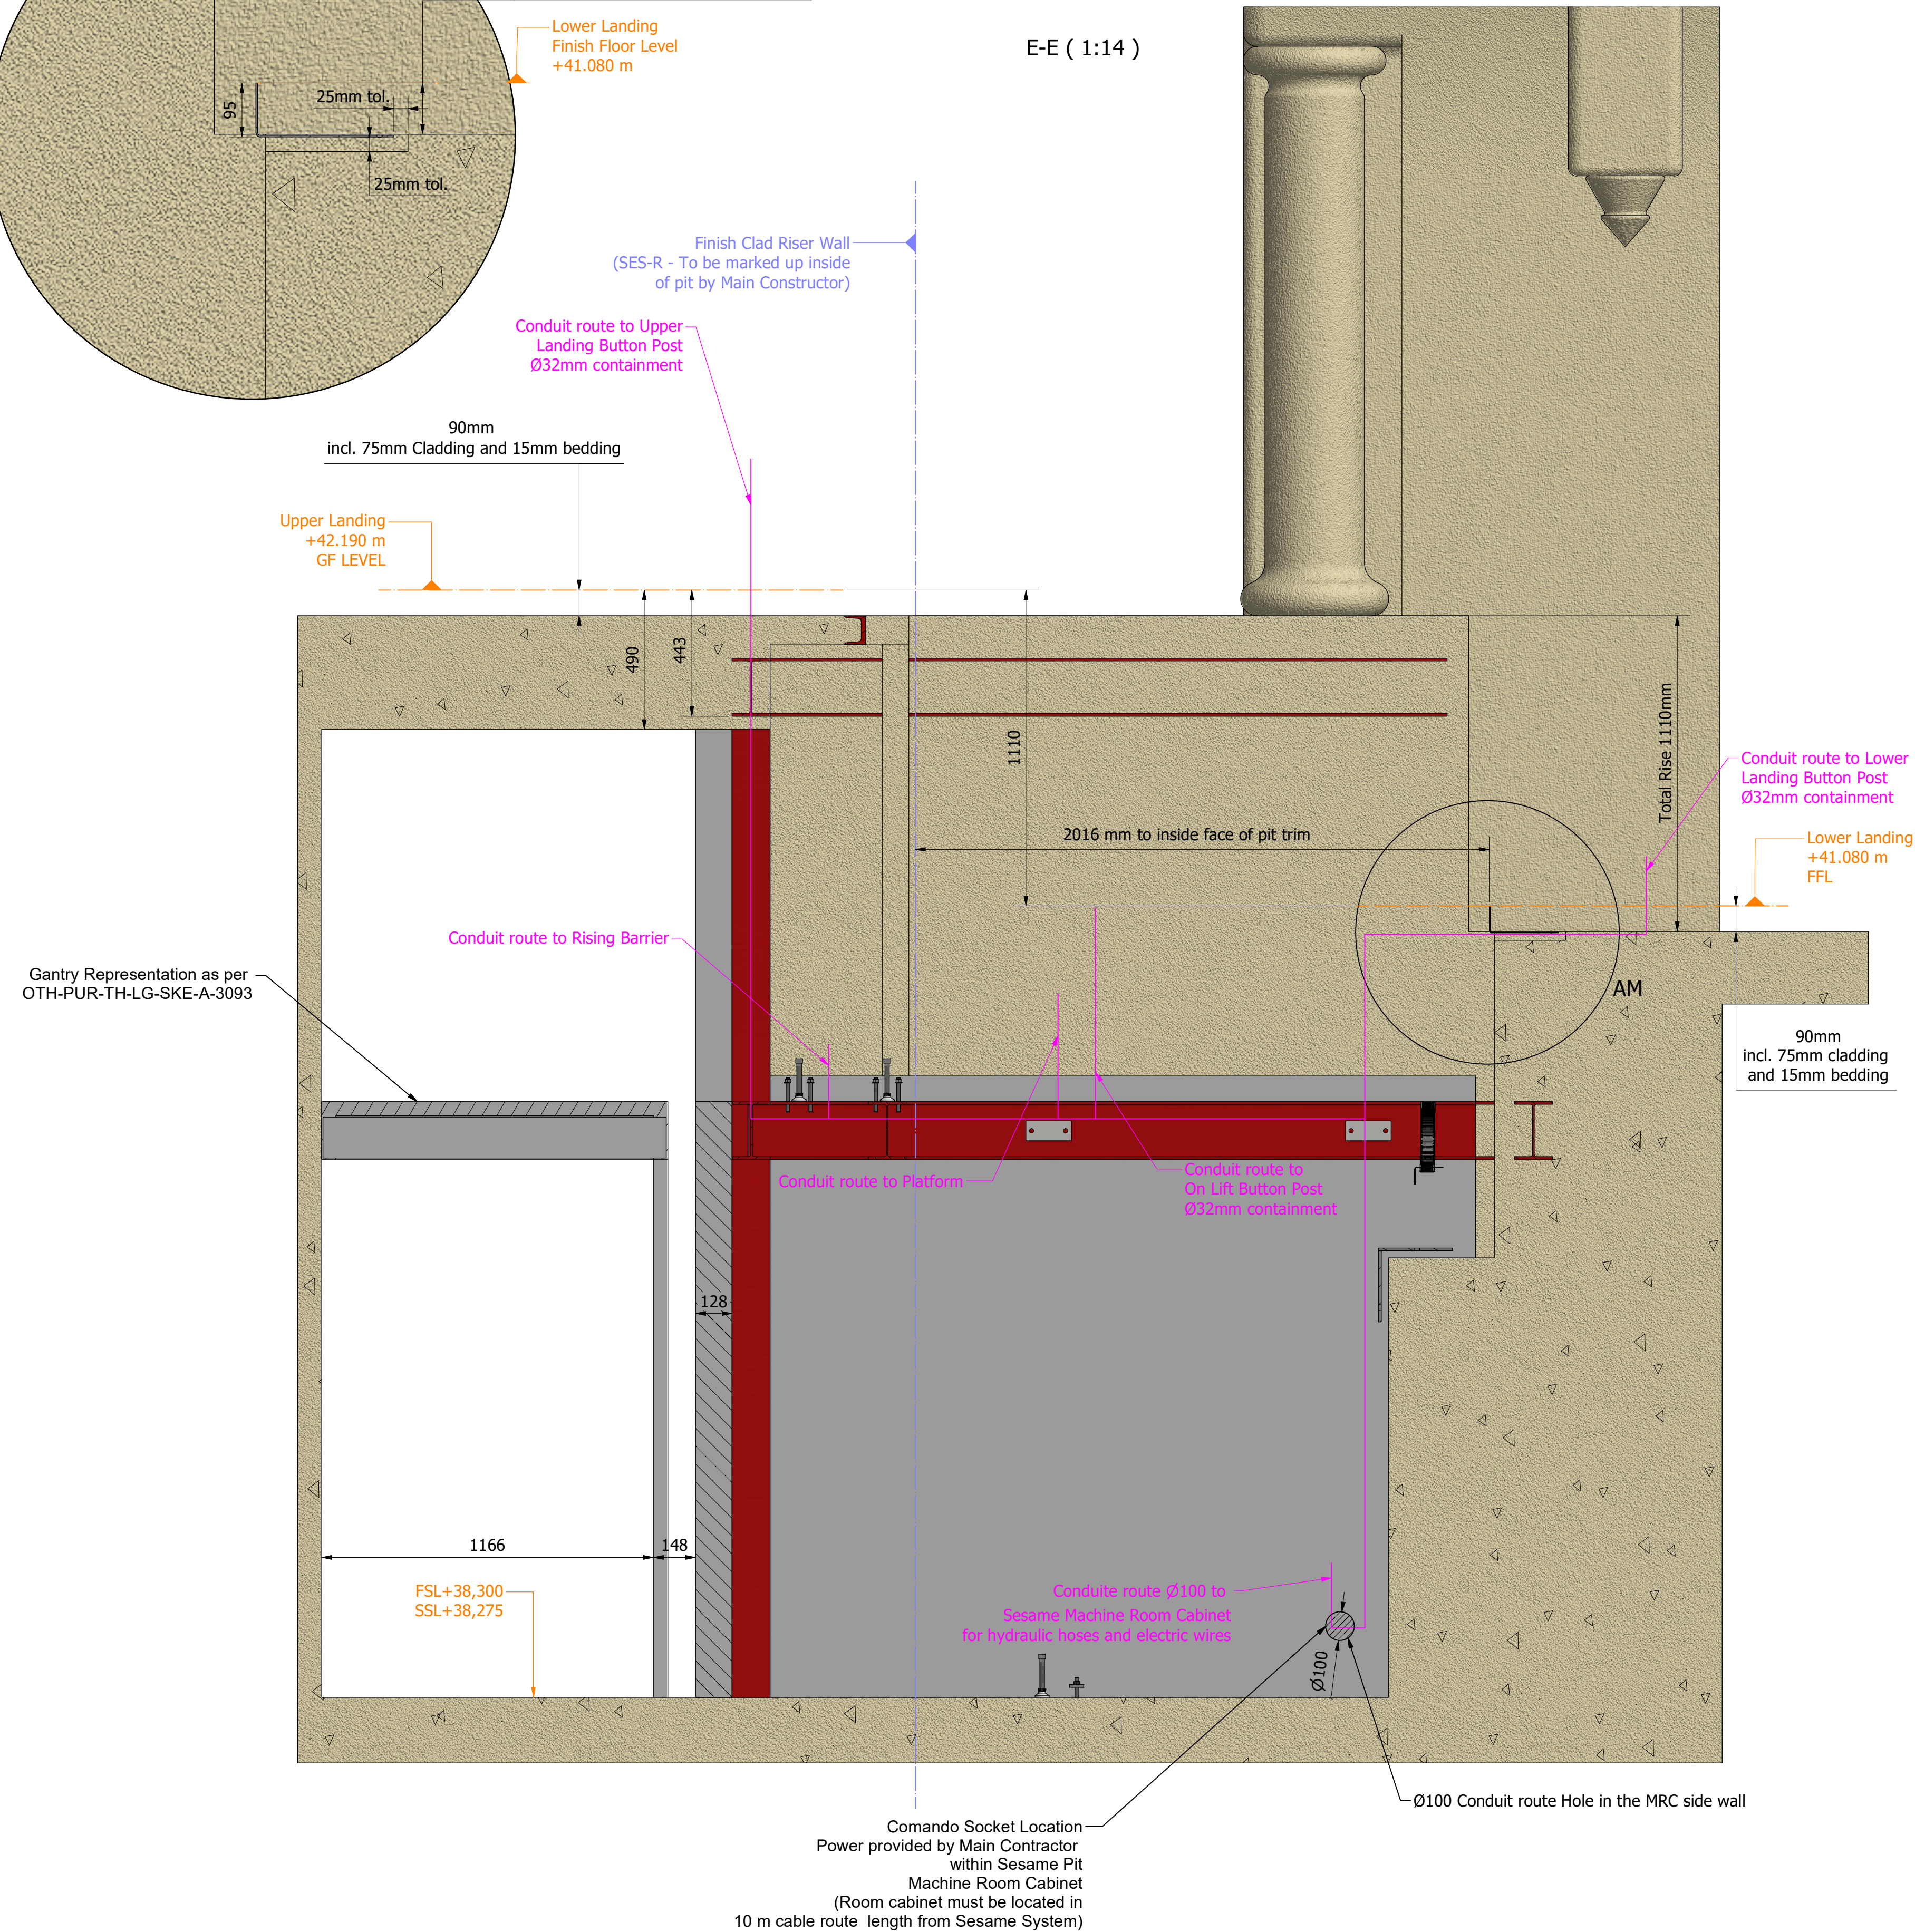

Sesame Power Requirements:
230V AC/50Hz Single Phase Rated;
32 Amp Supply;
Type MCB Breaker;
Waterproof Commando Socket;
Power supply must be live prior to Sesame Lift Install.

OTH-SAS-TH-GF-DWG-X-0003 Status S3 Revision P10

This drawing and the information it contains is the property of Sesame Access Systems LTD. and must not be copied or issued to any third party	Designed by K. Porwol	Checked by S.J.Lyons	Date 28.01.2022	Project Name: OTH-SAS-TH-GF-DWG-X-0003	Revision P10
				Pit Trim Installation	Sheet 3 / 6
	Sesame ACCESS FOR ALL Unit 3, Cumberland Works Wintwell Business Park Surrey, KT14 7LF Tel: +44 (0)1784 440088 Fax: +44 (0)1784 705252 Email: foral@sesameaccess.com www.sesameaccess.com				