


Design Intent: Provide Fabrication Drawings for Landscape Architects Approval

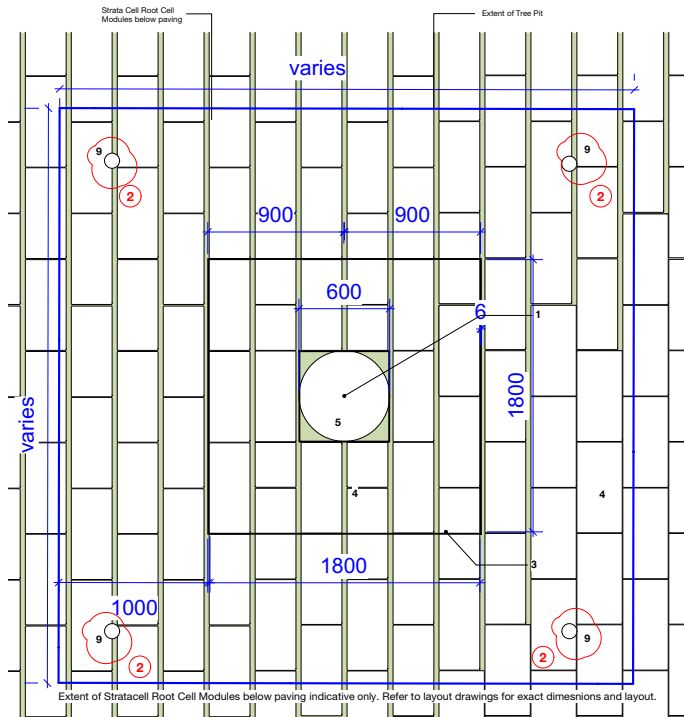

4 Plan - Semi-mature Tree in Hard Landscape (Green Gap Paving)
Scale: 1:20

1. Semi-Mature Tree Rootball and Wrapped
Refer to planting schedule for details

2. 1168mm Deep Tree Pit Trench
300mm topsoil to BS3882:2007, 600mm subsoil to BS8601:2013, 50-100mm drainage layer

3. Tree Grille
Concrete Tree Grille Unitsto potentially sit on steel frame subject to further detail
Size: 1.8m x 1.8m
Structural steel frame if required to tree grille - to take vehicular loading (BS EN 124 Class D400), anchored to concrete strip foundation.

4. Concrete Grass Gap Slab Paving - P1
Refer to drawing MF-PLA-XX-GF-DR-L-10-5000 for detail.

5. Gravel Mulch
Aperture in tree grille to base of tree to have aggregate fill, to be built up in graduated layers as follows:
Bottom layer - lightly hand-compacted open graded aggregate 8-20mm gauge
Middle layer - lightly hand-compacted intermediate dense graded stone aggregate 2-8mm gauge
Upper layer - 10mm gravel mulch. Supplier: CED oea. Installed to suppliers' instructions, submit proposals. Colour dark grey, subject to final detail design.

6. Irrigation System
100mm diameter heavy cast aluminium inlet and swivel vented lid. 60mm square. Cap to sit flush with surrounding surface material.

7. Geotextile
Terram 2000 Membrane.

8. Stratacell Root Cell Modules - 60 series
Dimension: 500 x 500 x 250mm

2 modules deep, backfilled with subsoil, (or equal and approved). General installation and load bearing requirements to be in accordance with manufacturer's recommendations. Final layout to allow min. 12-14.5m3 soil volume and to be adjusted on site if required. Manufacturer to produce layout for approval.

9. Aeration System

Cap to sit flush with surrounding surface material.
To be Greenleaf Precinct Watering System RRRPRECINCT1-version fit for application on tree pit cover, or equivalent 100mm diameter heavy cast aluminium inlet and swivel vented lid - 'RootRain Arborvent 150'. 60mm square circuit and vertical pipes.

10. Active Drainage

Using flexible, perforated plastic pipe within 600mm wide channel. 10-15mm gauge clean stone backfill. Subject to percolation test results and engineers detail.

11. ReRoot 2000 Linear Root Barrier


Installed around the upper 1500mm of the tree pit trench along all sides, to Supplier's specification (Green Blue Urban).

12. Drainage Layer

50-100mm clean stone. Base of tree pit trench loosened and shaped. As shown to aid root penetration and pit drainage.

13. Tree anchoring

Deadman Fixing Kit - Plati-Mat® - RF2RDMP or equal and approved.

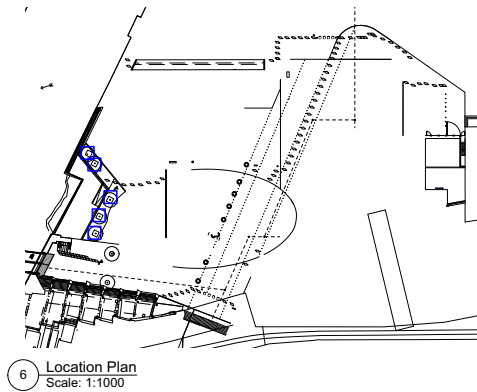


6 Location Plan
Scale: 1:1000

NOTES:

1. Do not scale from this drawing.
2. Always work to noted dimensions.
3. All dimensions are in millimetres unless otherwise stated.
4. All setting out, levels and dimensions to be agreed on site.
5. The dimensions of all materials must be checked on site before being laid out.
6. This drawing must be read with the relevant specification clauses and detail drawings.
7. Order of construction and setting out to be agreed on site.

LOCATION PLAN

- GF
□ L02



D2-P06	04-01-21	1. Additional Geotextile membrane added around drainage layers.	TF	AM
D2-P05	02-12-20	2. Aeration system shown on plan view	TF	AM
S1-P04	30-10-20	Tree pit locations and quantity updated	TF	AM
S1-P03	23-10-20	1. Stratacell module depth updated.	TF	AM
S1-P02	05-10-20	2. Paving build-up depth updated.	TF	AM
S3-P01	08-01-20	3. Tree pit soil depth updated to tie in with new stratacell depth.	TF	AM
S1-P02	05-10-20	1. Paving unit dimensions updated.	JH/AM	AM
S3-P01	08-01-20	2. Paving unit depth and tree pit updated.	AM	AM
S3-P01	08-01-20	3. Tree grille dimensions updated.	AM	AM

Revision	Date	Description	Drawn	Apprvd.
----------	------	-------------	-------	---------

Planit I.E. Limited
E: info@planit-ie.com W: planit-ie.com
MANCHESTER
2 Back Grafton St., Altrincham, WA14 1DY
T: 0161 928 9281
LONDON
Unit 6 Waterside, 44-48 Wharf Road, London, N1 7UX
T: 0207 253 5678
LIVERPOOL
No. 8 Princes Parade, Princes Dock, Liverpool, L3 1DL
T: 0151 705 6746

Client OMA / MCC

Project Factory

Drg Title Typical Tree Pit Details
TP1

Created on 16-09-19 Created by TF Approved by AM

Scale 1:20 Size A1 Workstage Stage 4

Drg No. MF-PLA-XX-GF-DR-L-10-6001 Suitability D2 Revision P06

© Planit I.E. Limited

NOTE

PERCOLATION TEST

To be performed on tree pits and planting areas where insufficient permeability might be an issue.
Perform the test in every tree pit or agree with the landscape architect on selected representative locations.

Instructions for performing a percolation test:

1. With a spade or soil auger, dig a hole 45-60 cm deep at the bottom of the proposed tree pit. The hole diameter should be a minimum of 10 cm. The diameter of the hole should be uniform from top to bottom with the bottom being flat.

2. Pre-wetting: Fill hole with water to the top and allow to stand for at least an hour to pre-wet the soil.

3. Refill hole to within a 5 cm of the top. Don't overflow the hole.

4. To aid in measurement, place a stick across the top of the hole and use a ruler or measuring tape to mark periodic drops in water level.

5. Allow the hole to drain for at least one hour. A longer period of time (2 to 3 hours) will give a more accurate reading of average percolation rates.

6. Determine the average drop in water level per hour and refer to the table below to interpret results.


If water level in hole drops:
-- Less than 1.25 cm per hour: Poorly drained and suited to wet-site species

-- 1.25-2.50 cm per hour: Moderately well drained and acceptable for many species including wet site species

-- More than 2.5 cm per hour: Well drained and suitable for all species including sensitive species.

The site manager of the main contractor/client must be informed of the tests and must be involved in the decision of the timing prior to undertaking the tests.

Please report the results to the landscape architect and the site manager prior to filling the tree pit.

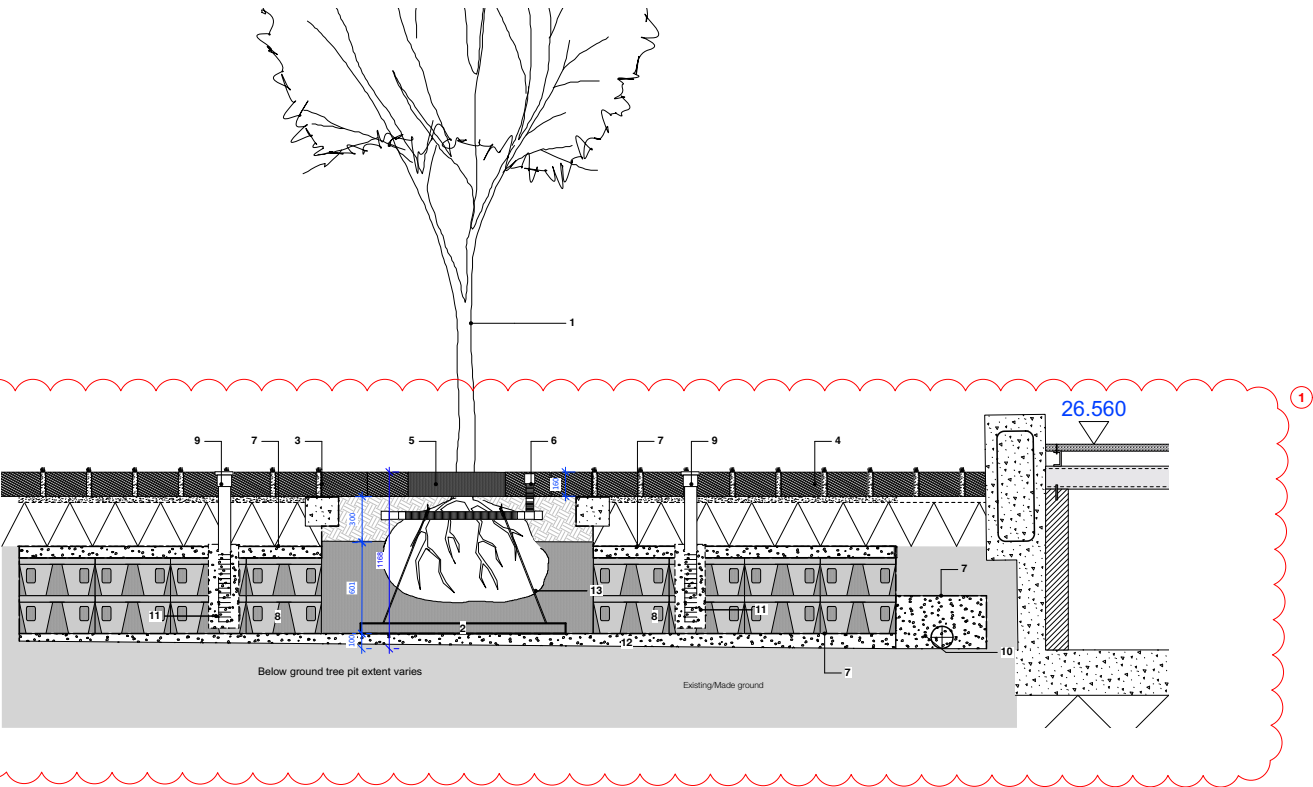

5 Semi-mature Tree in Hard Landscape Detail (Green Gap Paving)
Scale: 1:20