


Diagram illustrating the layout of a circular Stratacell Root Cell Module. The module is circular with a diameter of 1500. It features a central circular area with a diameter of 600, which is further divided into four quadrants. The outer ring of the module is labeled "varies" and has a diameter of 1500. The inner circle is labeled "600" and has a diameter of 600. The outer ring is divided into four quadrants, with the top-right quadrant labeled "1" and the bottom-right quadrant labeled "3". The bottom-left quadrant is labeled "4" and the top-left quadrant is labeled "2". The central area is labeled "6" and has a diameter of 600. The diagram is surrounded by a blue rectangular frame with dimensions 1500 by 1500. The frame is labeled "varies" on the top and left sides. The diagram is also labeled with "1500" and "600" dimensions.

- 9. Aeration System - Arboret**
Cap to sit flush with surrounding surface material.
To be Greenleaf Precinct Watercovering or RRP/REINCT1-version fit for application on tree pit cover, or equivalent 100mm diameter heavy cast aluminium inlet and swivel vented lid - 'RootRain Arboret 150'.
60mm diameter circuit and vertical pipes.
- 10. Active Drainage**
Using a flexible, perforated plastic pipe within 600mm wide channel.
10-15mm gauge clean stone backfill. Subject to pecculation test results and engineers detail.
- 11. reRoot 2000 Linear Root Barrier**
Installed around the upper 1500mm of the tree pit trench along two sides, to Supplier's specification (Green Blue Urban).
- 12. Drainage Layer**
100mm clean stone. Base of tree pit trench loosened and shaped. As shown to aid root penetration and pit drainage.
- 13. Tree anchoring**
Deadman Fixing Kit - Plati-Mat® - RF2RDMp or equal and approved.
- 14. Resin-bound gravel**
50mm depth, subject to confirmation by engineer if depth suitable for vehicular overrun suitable to class D400.
colour subject to further detail.
- 15. Type 3 MOT**
no fine or lime content.
to make up levels between concrete foundation to tree grille and topsoil.

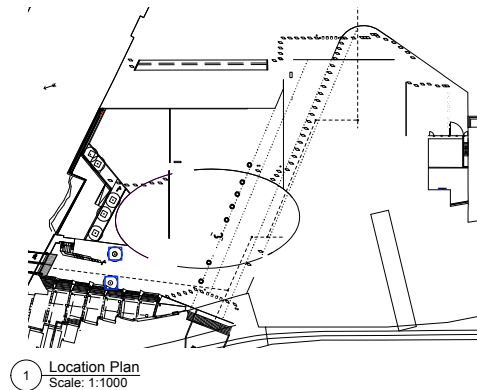

NOTES:


1. Do not scale from this drawing.
2. Always work to noted dimensions.
3. All dimensions are in millimetres unless otherwise stated.
4. All setting out, levels and ϕ dimensions to be agreed on site.
5. The dimensions of all materials must be checked on site before being laid out.
6. This drawing must be read with the relevant specification clauses and detail drawings.
7. Order of construction and setting out to be agreed on site.

☒ GF

☐ L02



2 Plan - Semi-mature Tree in Hard Landscape (In-situ Concrete)
Scale: 1:20

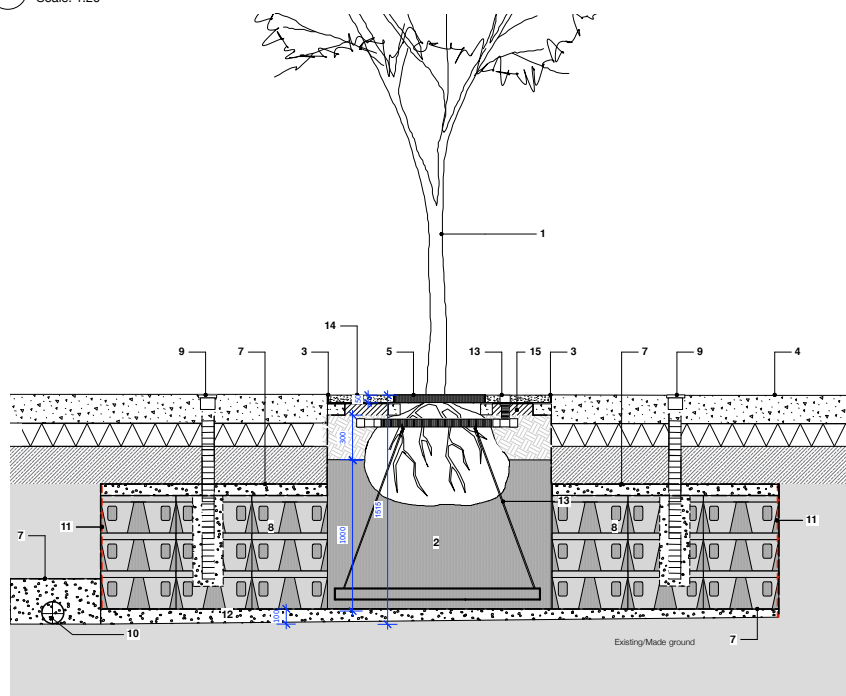

3 Semi-mature Tree in Hard Landscape Detail (In-situ Concrete)
Scale: 1:20

NOTE

PERCOLATION TEST

To be performed on tree pits and planting areas where insufficient permeability might be an issue.

Perform the test in every tree pit or agree with the landscape architect on selected representative locations.

Instructions for performing a percolation test:

1. With a spade or soil auger, dig a hole 45-60 cm deep at the bottom of the proposed tree pit. The hole diameter should be a minimum of 10 cm. The diameter of the hole should be uniform from top to bottom with the bottom being flat.
2. Pre-wetting: Fill hole with water to the top and allow to stand for at least an hour to pre-wet the soil.
3. Refill hole to within a 5 cm of the top. Don't overflow the hole.
4. To aid in measurement, place a stick across the top of the hole and use a ruler or measuring tape to mark periodic drops in water level.
5. Allow the hole to drain for at least one hour. A longer period of time (2 to 3 hours) will give a more accurate reading of average percolation rates.

6. Determine the average drop in water level per hour and refer to the table below to interpret results.

If water level in hole drops

- Less than 1.25 cm per hour: Poorly drained and suited to wet-site species
- 1.25-2.50 cm per hour: Moderately well drained and acceptable for many species including wet site species
- More than 2.5 cm per hour: Well drained and suitable for all species including sensitive species.

The site manager of the main contractor/client must be informed of the tests and must be involved in the decision of the timing prior to undertaking the tests.

Please report the results to the landscape architect and the site manager prior to filling the tree pit.

D2-P06	09-02-21	Planning	AM	AM
D2-P05	04-01-21	Additional Geotextile membrane added around drainage layers.	TF	AM
S1-P03	2020-10-26	1. update to build up depth and tree grill detail	AM	AM
S1-P02	2020-10-05	-	JH/AM	AM
S3-P01	08-01-20	for comment	AM	AM

Revision	Date	Description	Drawn	Apprvd.
----------	------	-------------	-------	---------



Planit I.E. Limited

E: info@planit-ie.com **W:** planit-ie.com

MANCHESTER

2 Back Grafton St, Altrincham, WA14 1DY
T: 0161 928 9281

LONDON

Unit 6 Waterside, 44-48 Wharf Road, London, N1 7UX
T: 0207 253 5678

LIVERPOOL

No. 8 Princes Parade, Princes Dock, Liverpool, L3 1DL
T: 0151 705 6746

1.0151 10.0740

OMA / MCC

Client	OMA / MCC
--------	-----------

Project	Factory
---------	---------

Drg Title Typical Tree Pit Details
Ground Floor

Created on	Created by	Approved by
16-09-19	TF	AM

Scale	Size	Workstage
1:20	A1	Stage 4

Drg No.	Suitability	Revision
MF-PLA-XX-GF-DR-L-10-6002	D2	P06