





VIEW AT 'A'

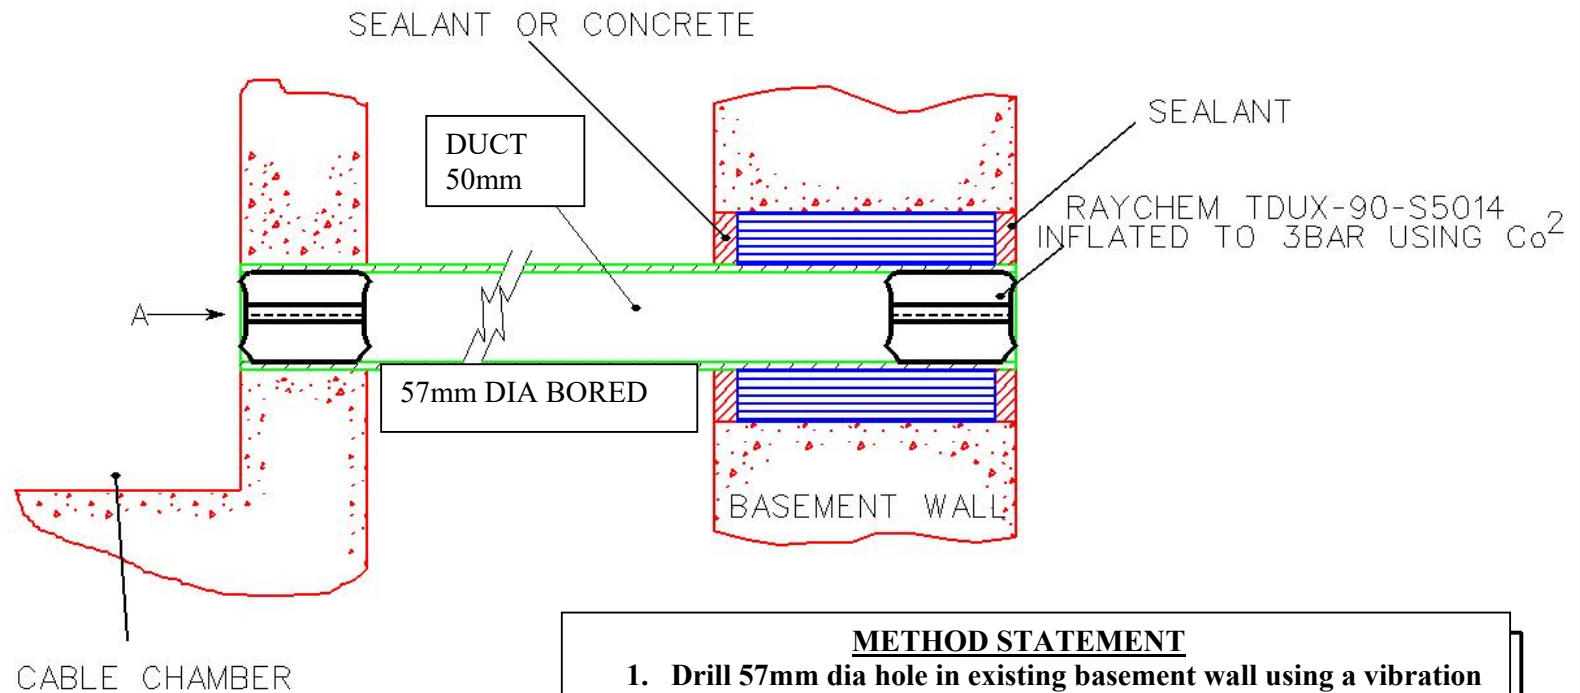

METHOD STATEMENT

1. Drill 57mm dia hole in existing basement wall using a vibration free method (diamond drill).
2. Drill from outside inwards.
3. Proposed duct to be 300/ 200mm from existing ducts.
4. No water, duct or coolant to enter basement area.
5. A protection envelope will be fitted to the inside of the basement wall to contain the above.
6. **Diameter of cable that will be installed will be 15mm**

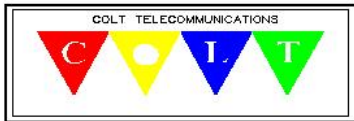

COLT TELECOMMUNICATIONS,
UNIT 2 CITY FORUM,
250 CITY RD,
LONDON, EC1V 2PU.

TEL:- 0171-390-3900
FAX:- 0171-390-3730

IN STRICTEST CONFIDENCE

CONSTRUCTION DETAILS
BUILDING ENTRY TYPE-2

Scale 1:NTS
O.S.:

E:
N:
Drawn by:
Date:

Drg.No.:ENTRY/002