


JODDRELL STREET

Little Quay Street

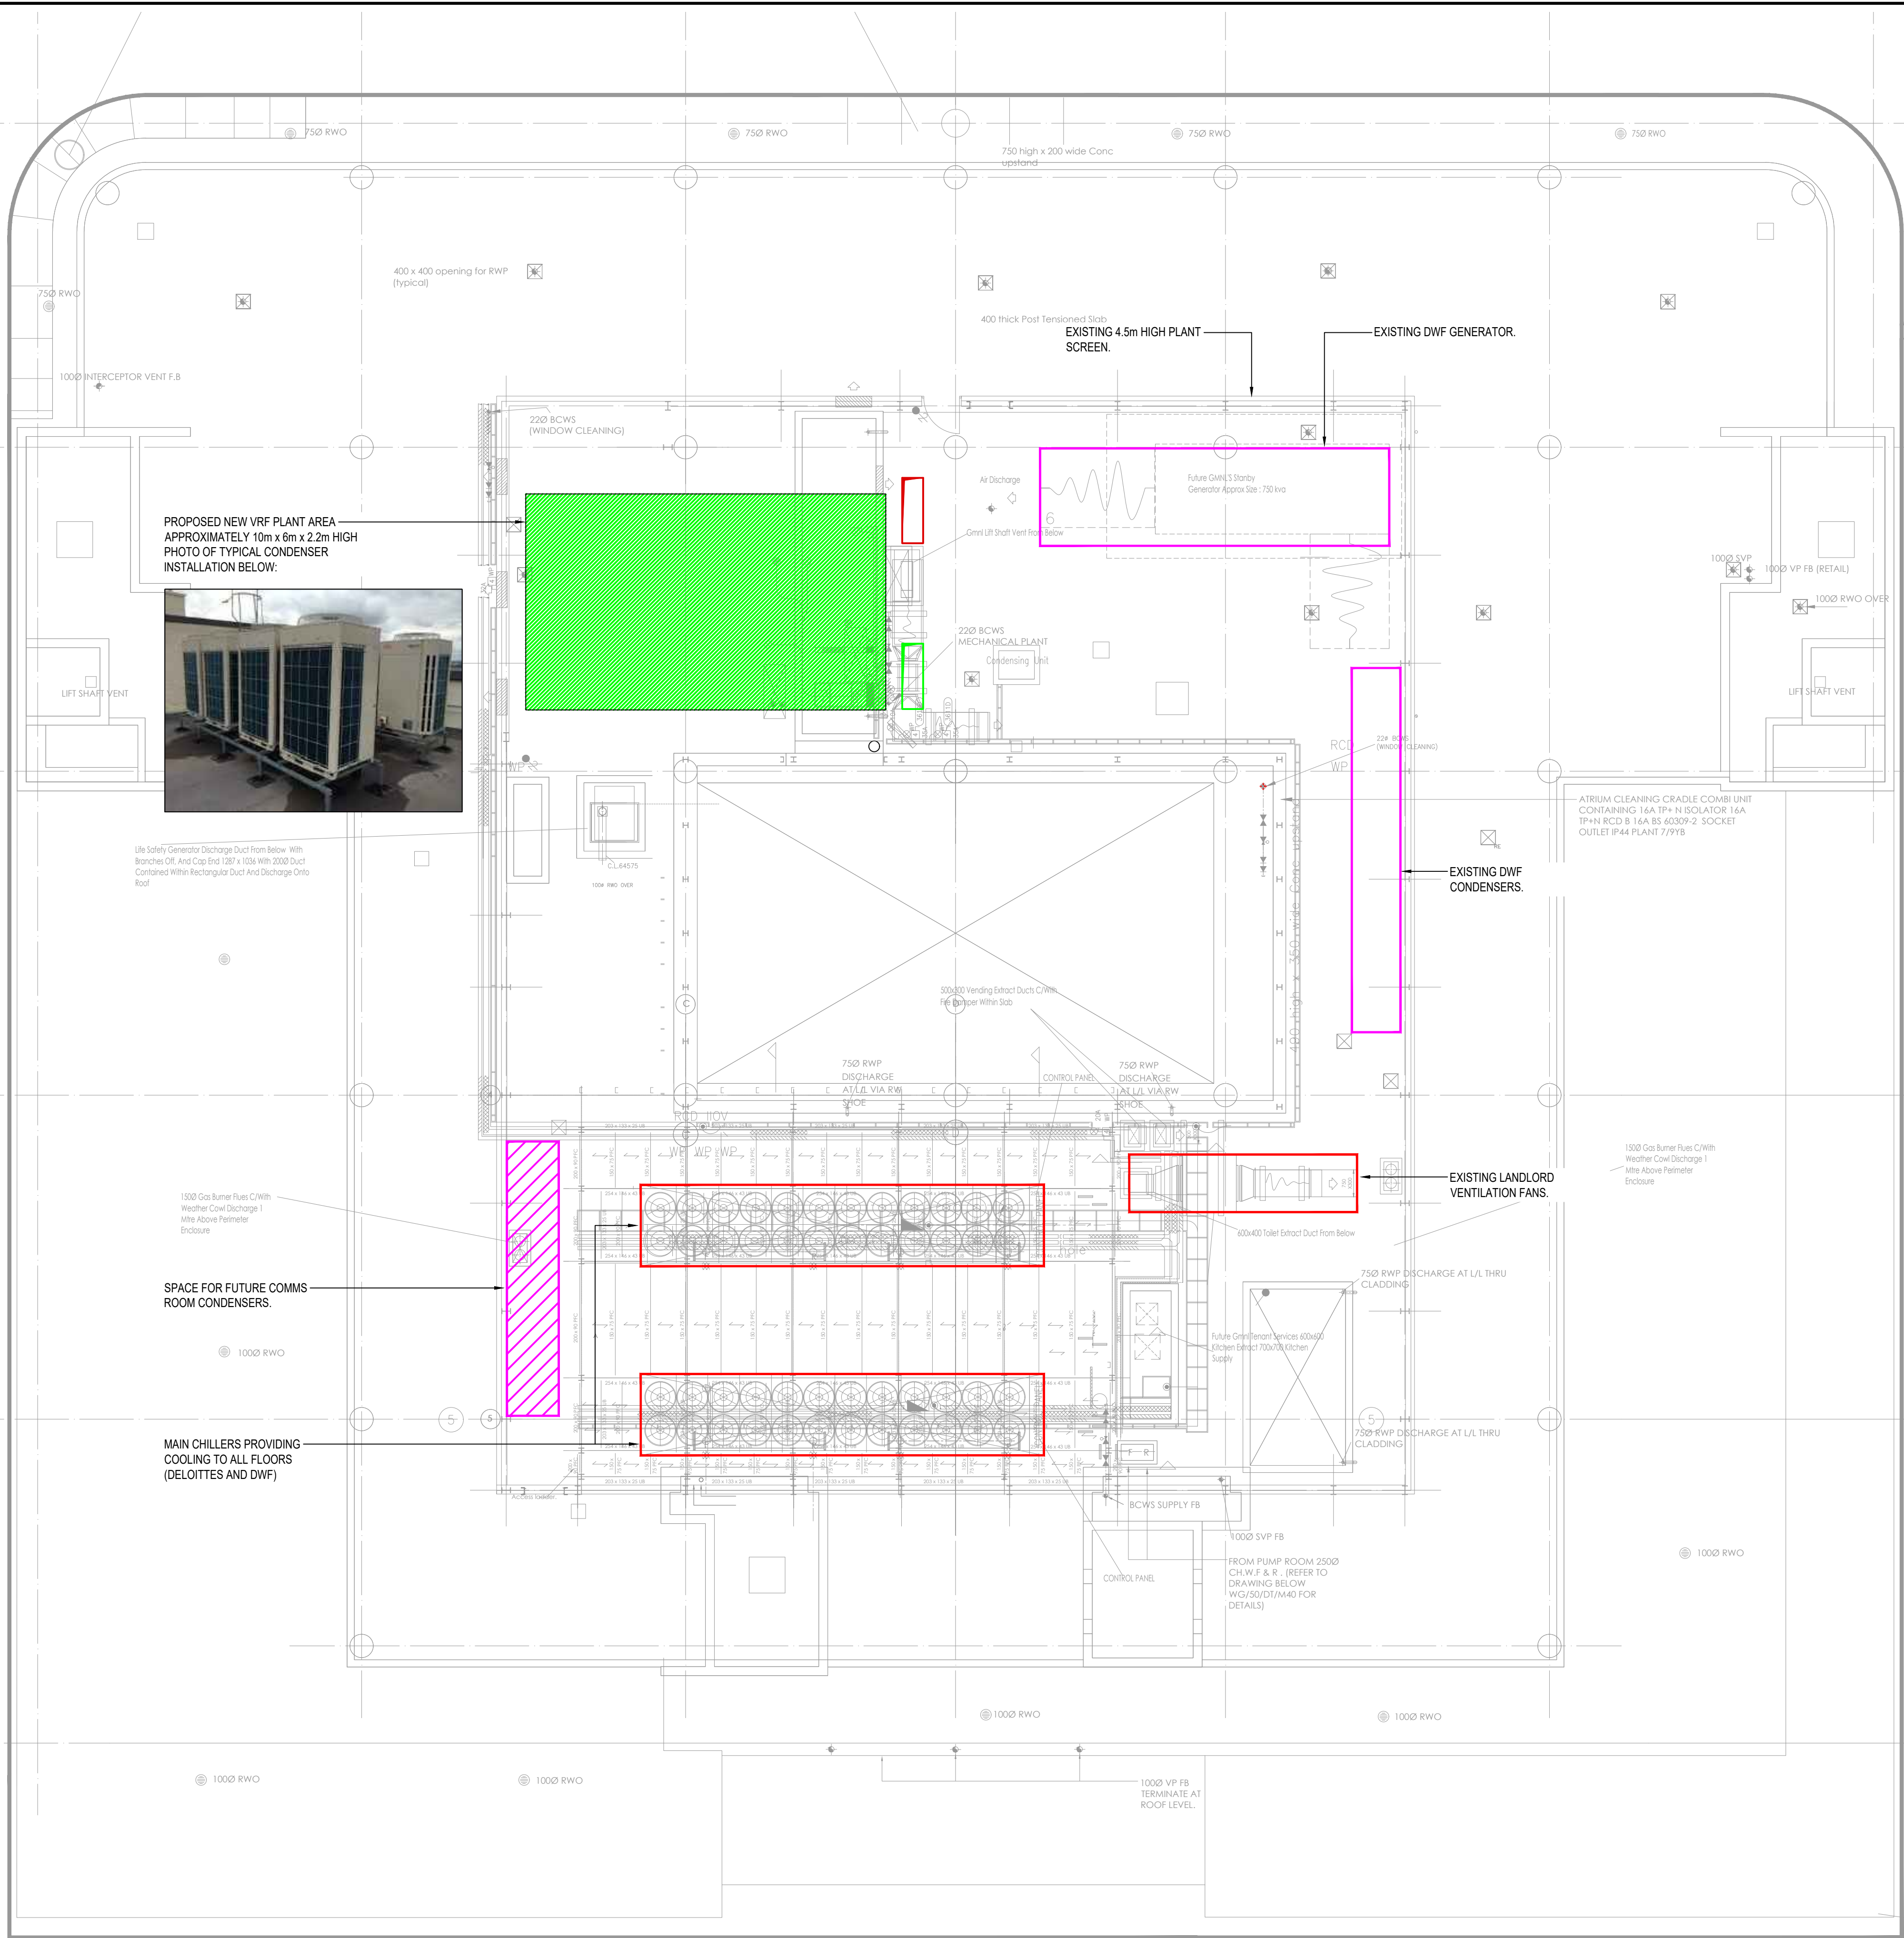

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.  
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).  
DO NOT SCALE FROM THIS DRAWING

DESIGNERS RISK ASSESSMENT  
REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

DRAWING BACKGROUND(S):

| LEGEND |                                                 |
|--------|-------------------------------------------------|
| SYMBOL | DESCRIPTION                                     |
|        | PROPOSED NEW VRF PLANT AREA                     |
|        | EXISTING ITEMS OF LANDLORD PLANT BEING RETAINED |
|        | EXISTING DWF TENANT PLANT BEING RETAINED        |

|     |          |                   |     |     |
|-----|----------|-------------------|-----|-----|
| P04 | 25.06.21 | PRELIMINARY ISSUE | RW  | RW  |
| P03 | 24.05.21 | PLANNING ISSUE    | RW  | RW  |
| P02 | 28.04.21 | PLANNING ISSUE    | RW  | RW  |
| P1  | 22.04.21 | PRELIMINARY ISSUE | RW  | RW  |
| Rev | Date     | Description       | Eng | Chk |



Alberton House, 30 St Mary's Parsonage  
Manchester M3 2WJ  
Tel: 0161 834 9999  
The Plaza, Old Hall Street,  
Liverpool L3 5QJ  
Tel: 0151 600 5409  
E-mail: admin@cwcon.co.uk  
Website: www.cwcon.co.uk

Client

HANSAINVEST

Project  
No2 HARDMAN St,  
MANCHESTER

Drawing Title  
ROOF LEVEL  
PROPOSED ROOF PLANT

Status  
PLANNING

|                     |             |                                  |
|---------------------|-------------|----------------------------------|
| Project No.<br>2042 | Drawn<br>WN | Scale / Paper Size<br>1:100 @ A1 |
|---------------------|-------------|----------------------------------|

|                             |            |
|-----------------------------|------------|
| Drawing No.<br>2042-RF-5002 | Rev<br>P04 |
|-----------------------------|------------|