

PLANNING NOTE

Under new regulations that came into force on 1 October 2008 an extension or addition to a house is considered to be permitted development and not requiring an application for planning permission, subject to the following limits and conditions:

- No more than half the area of land around the "original house" would be covered by additions to buildings.
- No extension forward of the principal elevation or side elevation fronting a highway.
- No extension higher than the highest part of the roof.
- Maximum depth of a single storey rear extension to be three metres for an attached house and four metres for a detached house.
- Maximum height of a single storey rear extension to be four metres.
- Maximum ridge and eaves height no higher than existing house.
- Roof pitch of extensions higher than one storey to match existing house
- Materials to be similar in appearance to the existing house.
- Upper-floor, side-facing windows to be obscure glazed: any opening to be 1.7m above the floor.

PARTY WALL ACT:

The owner, should they need to do so under the requirements of the Party Wall Act 1996, has a duty to serve a Party Structure Notice on any adjoining owner if the building work involves works on or to an existing Party Wall including:

- Support of beam
- Insertion of DPC through wall
- Raising a wall or cutting off projections
- Demolition and rebuilding
- Underpinning
- Insertion of lead flashings
- Excavations within 3 meters of an existing structure where the new foundations will go deeper than adjoining foundations, or within 6 meters of an existing structure where the new foundations are within a 45 degree line of the adjoining foundations.


A Party wall agreement is to be in place prior to start of works on site.

APPROVED DOCUMENT P (Electrical Safety):


All electrical work to which the requirements of part P apply, will be designed, installed, inspected & tested by a person competent to do so. Prior to completion of works the local authority must be satisfied that either:-

- An electrical installation certificate issued under a "competent persons" scheme has been issued; or appropriate certificates and forms defined in BS7671 (as amended) have been submitted that confirm that the work has been inspected and tested by a "competent person".


A "competent person" will have a sound knowledge and suitable experience relevant to the nature of the work undertaken and to the technical standards set out in BS7671, be fully versed in the inspection and testing procedures contained in the regulations and employ adequate equipment

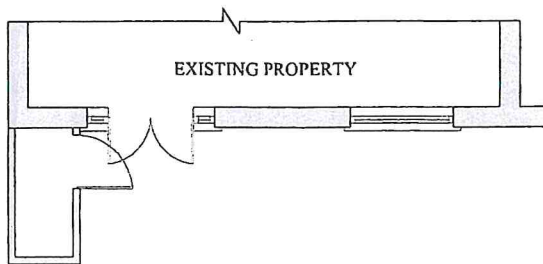


EXISTING GROUND FLOOR LAYOUT

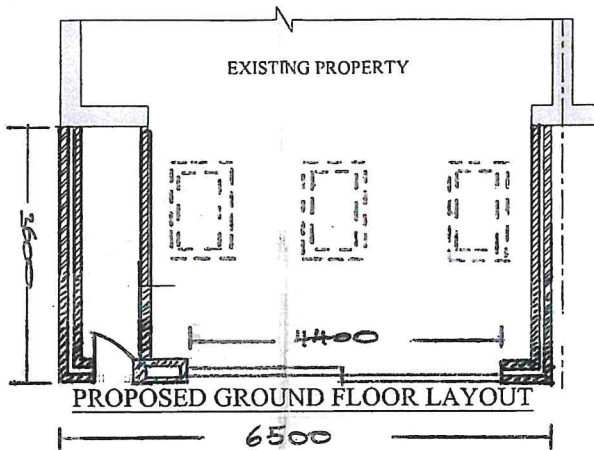


PROPOSED GROUND FLOOR LAYOUT

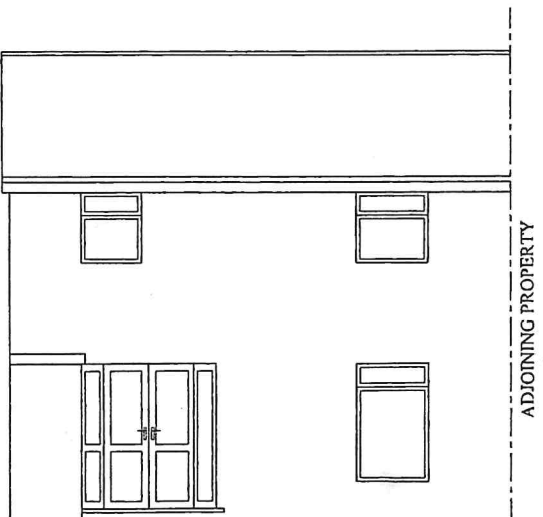

EXISTING REAR ELEVATION

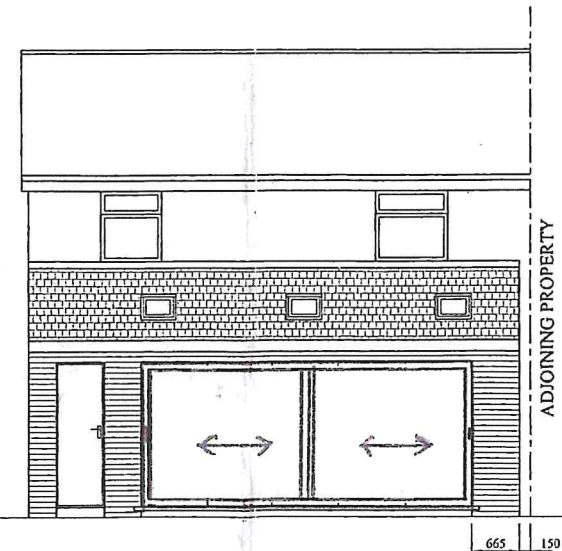

PROPOSED REAR ELEVATION

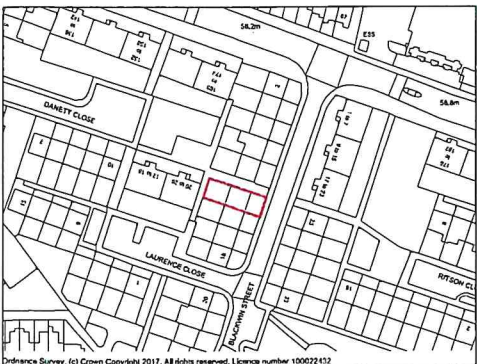

LOCATION PLAN
(SCALE 1:50)

A	08.06.17	ISSUED FOR BUILDING REGULATIONS
DRAWING STATUS: BUILDING REGULATIONS		
PROJECT: 12 BLACKWIN St., MANCHESTER		
TITLE: PROPOSED SINGLE STOREY REAR EXTENSION		
SCALE & SIZE: 1:100	STATUS: BUILDING REGS.	DATE: JUNE '17
PROPERTY No: BS-001	DRAWING No: 001	REV: A

12 BLACKWIN St. - MANCHESTER


BUILDING REGULATIONS

WALL BETWEEN HOUSE AND STORAGE

To achieve U-value of 0.28 W/m²K
Wall constructed using lightweight aggregate or aerated concrete block, r value 0.15, at least 215mm thick, eg. Topblock Supabloc or Celcon Solar. Insulate wall on the warm side using 77.5mm Celotex PL4000 insulated plasterboard.
Plasterboard to be fixed, using dot and dab method, by bonding to the existing construction with proprietary adhesive at 300mm centres vertically/horizontally and in accordance with manufacturer's instructions. Tape joints and the seal perimeter edges with mastic, to provide a vapour control layer (VCL). Note: These walls need to go full height and be fire stopped against the roof or floor above. A lesser provision of insulation may be appropriate where meeting such a standard would result in a reduction of more than 5% in the internal floor area of the room.

SOLID FLOOR INSULATION UNDER SLAB

To meet min U value required of 0.22 W/m²K
Solid ground floor to consist of 150mm consolidated well-rammed hardcore. Blinded with 50mm sand blinding. Provide a 1200mm gauge polythene DPM, DPM to be lapped in with DPC in walls. Floor to be insulated over DPM with 75mm Kingspan Kooltherm K3.
25mm insulation to continue around floor perimeters to avoid thermal bridging. A VCL should be laid over the insulation boards and turned up 100mm at room perimeters behind the skirting, all joints to be lapped 150mm and sealed. Provide 100mm ST2 or Gen2 ground bearing slab concrete mix to conform to BS 8500-2 over VCL. Finish over the slab with a floating layer of min 20mm tongue and groove softwood boards or moisture resistant particle/chipboard grade type C4 to BS EN 312:2010 as required. Lay with staggered joints. Where drain runs pass under new floor, provide A142 mesh 1.0m wide within bottom of slab min 50mm concrete cover over length of drain.
Where existing suspended timber floor air bricks are covered by new extension, ensure cross-ventilation is maintained by connecting to 100mm dia UPVC pipes to terminate at new 65mm x 215mm air bricks built into new cavity wall with 100mm concrete cover laid under the extension. Ducts to be sleeved through cavity with cavity tray over.

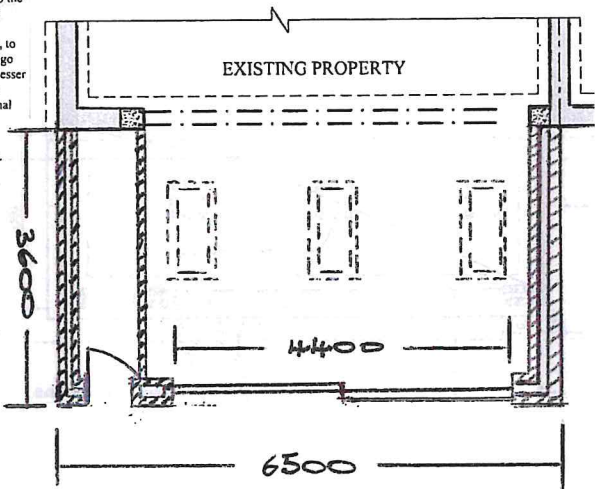

FOUNDATION / GROUND FLOOR LAYOUT

STEELWORK OVER KNOCK THROUGH

For steelwork over knock through refer to structural engineers calculations and details

EXTRACT TO KITCHEN

Kitchen to have mechanical ventilation with an extract rating of 60l/sec or 30l/sec if adjacent to hob to external air, sealed to prevent entry of moisture. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. Cooker hoods to BS EN 13141-3. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

STRIP FOUNDATIONS

Provide 600mm x 300mm concrete foundations, concrete mix to conform to BS EN 206-1 and BS 8500-2. All foundations to be a minimum of 1000mm below ground level, exact depth to be agreed on site with Building Control Officer to suit site conditions. All constructed in accordance with 2004 Building Regulations A1/2 and BS 8004:1986 Code of Practice for Foundations. Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions be found or any major tree roots in excavations, the Building Control Officer is to be contacted and the advice of a structural engineer should be sought.

NEW STEELWORK SUPPORT OVER BI-FOLD DOORS


Provide Extra Heavy duty 'Cavity Wall Fabricated CXL Lintel by Cataic' or similar approved. Lintel to have minimum end bearing of 200mm and sit on min. 330 Lg. x 215mm Dp. x 100mm Wide C30 Concrete Padstone

ROOF LIGHTS

Min U-value of 1.6 W/m²K.
Roof-lights to be double glazed with 16mm argon gap and soft low-E glass. Window Energy Rating to be Band C or better. Roof lights to be fitted in accordance with manufacturer's instructions with rafters doubled up to sides and suitable flashings etc.

LEAD WORK AND FLASHINGS

All lead flashings, any valleys or soakers to be Code 5 lead and laid according to Lead Development Association. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc. All work to be undertaken in accordance with the Lead Development Association recommendations.

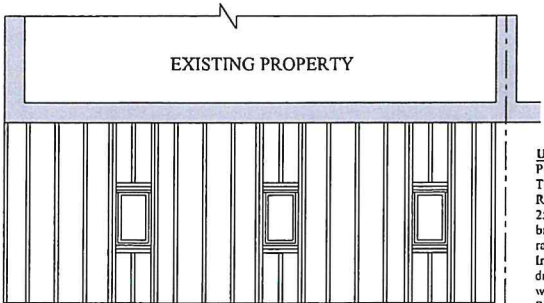

UNVENTED PITCHED ROOF - VAULTED CEILING

Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)
To achieve U-value 0.18 W/m²K.
Roofing tiles to match existing on 25 x 38mm tannalised sw treated battens on minimum 25mm thick treated vertical counter battens with a proprietary eaves carrier system on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 170mm grade C24 rafters at max 400mm centres. Rafters supported on 100 x 50mm sw wall plates. Insulation to be 125mm Kingspan Kooltherm K7 between rafters with K18 insulated dry-lining board comprising 12.5mm plasterboard and 25mm insulation under rafters with 5mm skim coat of finishing plaster to the underside of all ceilings.
Restraint strapping - 100mm x 30mm wall plate strapped down to walls. Rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1000 x 30 x 5mm galvanized straps or other approved to BSEN 845-1 at 2m centres.

ROOF LAYOUT

(SCALE 1:50)

BUILDING REGULATIONS NOTES

MATERIALS AND WORKMANSHIP

All works are to be carried out in a workmanlike manner. All materials and workmanship must comply with Regulation 7 of the Building Regulations, all relevant British Standards, European Standards, Agreement Certificates, Product Certification of Schemes (Kite Marks) etc. Products conforming to a European technical standard or harmonised European product should have a CE marking.

SITE PREPARATION

Ground to be prepared for new works by removing all unsuitable material, vegetable matter and tree or shrub roots to a suitable depth to prevent future growth. Seal up, cap off, disconnect and remove existing redundant services as necessary. Reasonable precautions must also be taken to avoid danger to health and safety caused by contaminants and ground gases e.g. landfill gases, radon, vapours etc. on or in the ground covered, or to be covered by the building.

EXISTING STRUCTURE

Existing structure including foundations, beams, walls and lintels carrying new and altered loads are to be exposed and checked for adequacy prior to commencement of work and as required by the Building Control Officer.

BEAMS

Supply and install new structural elements such as new beams, roof structure, floor structure, bearings, and padstones in accordance with the Structural Engineer's calculations and details. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance as agreed with Building Control. All fire protection to be installed as detailed by specialist manufacturer.

LINTELS

- For uniformly distributed loads and standard 2 storey domestic loadings only
Lintel widths are to be equal to wall thickness. All lintels over 750mm sized internal door openings to be 65mm deep pre-stressed concrete plank lintels. 150mm deep lintels are to be used for 900mm sized internal door openings. Lintels to have a minimum bearing of 150mm on each end. Any existing lintels carrying additional loads are to be exposed for inspection at commencement of work on site. All pre-stressed concrete lintels to be designed and manufactured in accordance with BS 8110, with a concrete strength of 50 or 40 N/mm² and incorporating steel strands to BS 5896 to support loadings assessed to BS 5977 Part 1. For other structural openings provide proprietary insulated steel lintels suitable for spans and loadings in compliance with Approved Document A and lintel manufacturers standard tables. Stop ends, DPC trays and weep holes to be provided above all externally located lintels.

STRAPPING FOR PITCHED ROOF

Gable walls should be strapped to roofs at 2m centres. All external walls running parallel to roof rafters to be restrained at roof level using 1000mm x 30mm x 5mm galvanised mild steel horizontal straps or other approved to BSEN 845-1 built into walls at max 2000mm centres and to be taken across minimum 3 rafters and screw fixed. Provide solid noggins between rafters at strap positions. All wall plates to be 100 x 50mm fixed to inner skin of cavity wall using 30mm x 5mm x 1000mm galvanised metal straps or other approved to BSEN 845-1 at maximum 2m centres.

OPENINGS AND RETURNS

An opening or recess greater than 0.1m² shall be at least 550mm from the supported wall (measured internally).

WALLS BELOW GROUND

All new walls to have Class A blockwork below ground level or alternatively semi engineering brickwork in 1:4 masonry cement or equal approved specification. Cavities below ground level to be filled with lean mix concrete min 225mm below damp proof course. Or provide lean mix backfill at base of cavity wall (150mm below damp course) laid to fall to weepholes.

Full Fill Cavity Wall

To achieve minimum U Value of 0.28 W/m²K
New cavity wall to comprise of 105mm facing brick to match existing. Full fill cavity with 110mm Rockwool Cavity insulation as manufacturer's details. Inner leaf to be 100mm block K value 1.13, e.g. Lafarge Sancrete. Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1:6 cement mortar.

DPC

Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins minimum 150mm above external ground level. New DPC to be made continuous with existing DPC's and with floor DPM. Vertical DPC to be installed at all reveals where cavity is closed.

WALL TIES

All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS 5628-6.1: 1996 and BS EN 845-1: 2003

CAVITIES

Provide cavity trays over openings. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

EXISTING TO NEW WALL

Cavities in new wall to be made continuous with existing where possible to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

CAVITY BARRIERS

30 minute fire resistant cavity barriers to be provided at at tops of walls, gable end walls and vertically at junctions with separating walls & horizontally at separating walls with cavity tray over installed according to manufacturers details.

ELECTRICAL

All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

INTERNAL LIGHTING

Install low energy light fittings that only take lamps having a luminous efficiency greater than 45 lumens per circuit watt and a total output greater than 400 lamp lumens. Not less than three energy efficient light fittings per four of all the light fittings in the main dwelling spaces to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

HEATING

Extend all heating and hot water services from existing and provide new TVRs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.

SMOKE DETECTION

Mains operated linked smoke alarm detection system to BS EN 14604 and BS5839-6:2004 to at least a Grade D category LD3 standard and to be mains powered with battery back up. Smoke alarms should be sized so that there is a smoke alarm in the circulation space on all levels/ storeys and within 7.5m of the door to every habitable room. If ceiling mounted they should be 300mm from the walls and light fittings. Where the kitchen area is not separated from the stairway or circulation space by a door, there should be an interlinked heat detector in the kitchen.

ESCAPE WINDOWS

Provide emergency egress windows to any newly created first floor habitable rooms and ground floor inner rooms. Windows to have an unobstructed openable area of 450mm high x 450mm wide, minimum 0.33m sq. The bottom of the openable area should be not more than 1100mm above the floor. The window should enable the person to reach a place free from danger from fire.

ROOF LIGHTS

Min U-value of 1.6 W/m²K.
Roof-lights to be double glazed with 16mm argon gap and soft low-E glass. Window Energy Rating to be Band C or better. Roof lights to be fitted in accordance with manufacturer's instructions with rafters doubled up to sides and suitable flashings etc.

SAFETY GLAZING

All glazing in critical locations to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1:2011 and Part K (Part N in Wales) of the current Building Regulations, i.e. within 1500mm above floor level in doors and side panels within 300mm of door opening and within 800mm above floor level in windows.

NEW AND REPLACEMENT WINDOWS

New and replacement windows to be double glazed with 16mm argon gap and soft coat low-E glass. Window Energy Rating to be Band C or better and to achieve U-value of 1.6 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

NEW AND REPLACEMENT DOORS

New and replacement doors to achieve a U-Value of 1.80W/m²K. Glazed areas to be double glazed with 16mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1:2011 and Part K (Part N in Wales) of the current Building Regulations.

RAINWATER DRAINAGE

New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill. Soakaway to be min of 1 cubic metre capacity (or to depth to Local Authorities approval) with suitable granular fill and with geotextile surround to prevent migration of fines. If necessary carry out a porosity test to determine design and depth of soakaway.

UNDERGROUND FOUL DRAINAGE

Underground drainage to consist of 100mm diameter UPVC proprietary pipe work to give a 1:40 fall. Surround pipes in 100mm pea shingle. Provide 600mm suitable cover (900mm under drives). Shallow pipes to be covered with 100mm reinforced concrete slab over compressible material. Provide rodding access at all changes of direction and junctions. All below ground drainage to comply with BS EN 1401-1: 2009.

INSPECTION CHAMBERS

Underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all changes of level, direction, connections and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways.

ABOVE GROUND DRAINAGE

All new above ground drainage and plumbing to comply with BS EN 12056-2:2000 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction.

Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used)

Wash basin - 1.7m for 32mm pipe 4m for 40mm pipe

Bath/shower - 3m for 40mm pipe 4m for 50mm pipe

W/c - 6m for 100mm pipe for single WC

All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m.

Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting.

Waste pipes not to connect on to SVP within 200mm of the WC connection.

Supply hot and cold water to all fittings as appropriate.

SOIL AND VENT PIPE

Svp to be extended up in 110mm dia UPVC and to terminate min 900mm above any openings within 3m. Provide a long radius bend at foot of SVP.

PIPEWORK THROUGH WALLS

Where new pipework passes through external walls form rocker joints either side wall face of max length 600mm with flexible joints with short length of pipe bedded in wall.

Alternatively provide 75mm deep pre-cast concrete plank lintels over drain to form opening in wall to give 50mm space all round pipe: mask opening both sides with rigid sheet material and compressible sealant to prevent entry of fill or vermin.

A	08.06.17	ISSUED FOR BUILDING REGULATIONS
DRAWING STATUS: BUILDING REGULATIONS		
PROJECT: 12 BLACKWIN St., MANCHESTER		
TITLE: PROPOSED SINGLE STOREY REAR EXTENSION		
SCALE & SIZE: 1:50 @ A1 U.N.O	STATUS: BUILDING REGS.	DATE: JUNE '17
PROJECT NO: BS-001	DRAWING NO: 002	REV: A