



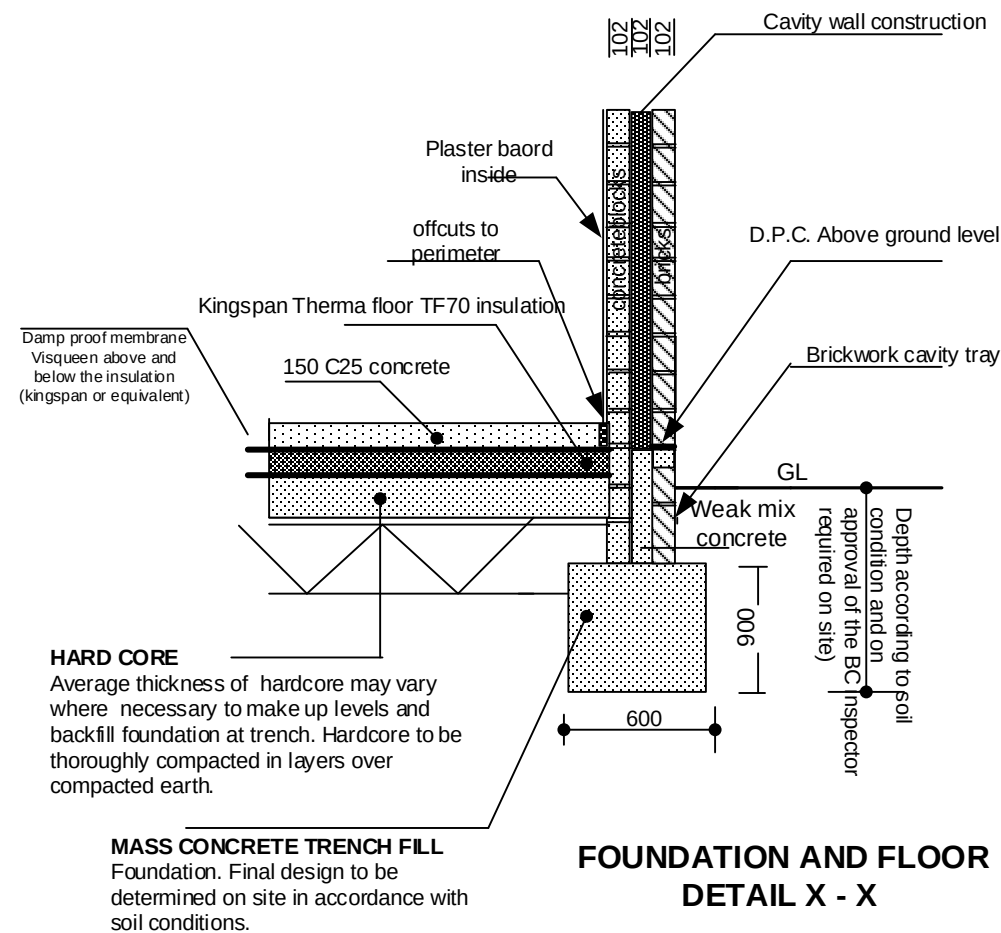


New Ground Floor

All vegetable soil and deleterious matter stripped off site. Lay min. 150 mm of clean crushed stone hardcore and compact. Lay 1200 gauge DPM and fully lap with DPC. Any joint in DPM to be lapped min. 300 mm. Provide 100 mm KINGSPAN / CELETE or equivalent insulation as shown in the section. Lay min. 100 mm concrete (1:2:4, 20 mm aggregate) slab finish surface of with 65 mm sand/ cement screed or 25 mm Asphalt. For any existing wood floor ventilation, , lay 100 mm dia PVC pipe in new ground floor. Consult architect or site engineer for minimum thicknesses.

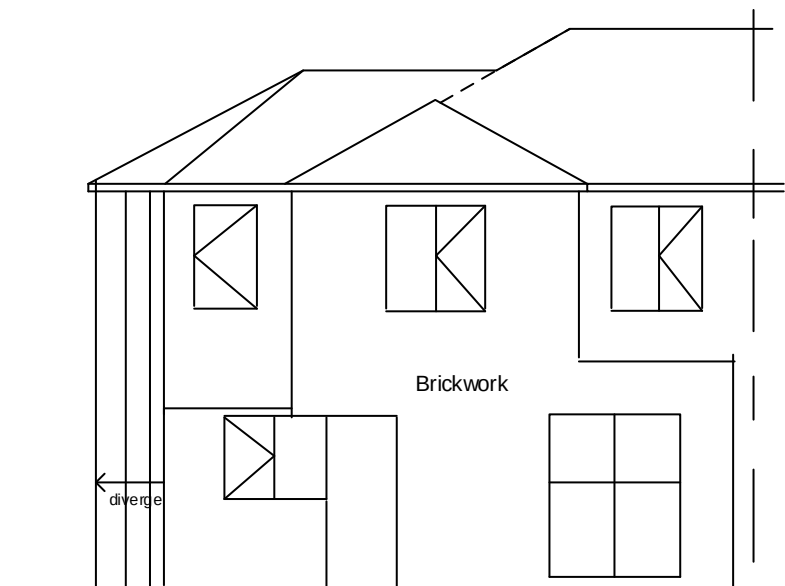


PROPOSED REAR ELEVATION

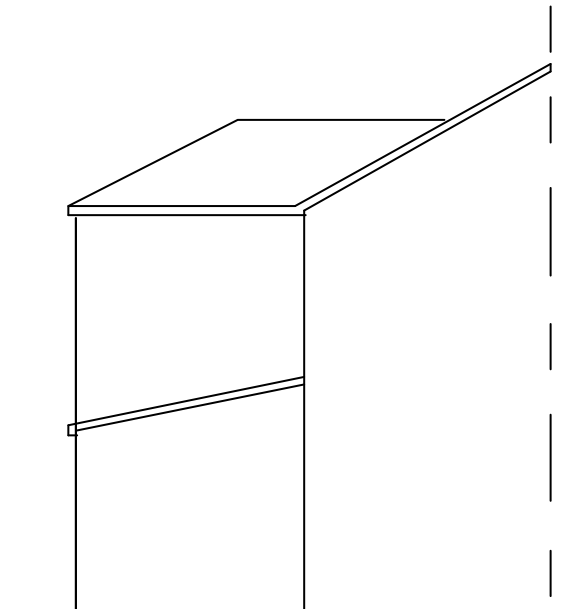

PROPOSED SIDE ELEVATION



PROPOSED FRONT ELEVATION

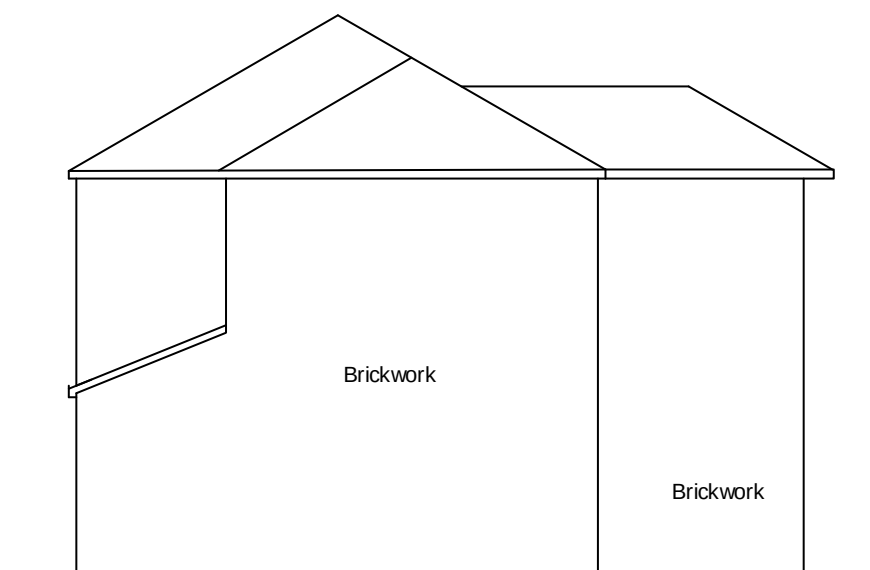

PROPOSED SIDE ELEVATION

Design 4 Build Services 77 Fields New Road, Oldham OL9 8BT Mob. 07722432673			
Client	Mr. M. Khalid 36 Holland Road, Manchester M8 4NQ		
Title	Erection of Double Storey side & Single Storey Rear Extension		
Scale	1 = 100 @A3	Drawing No.	MK-PP-03 03/06/2021