

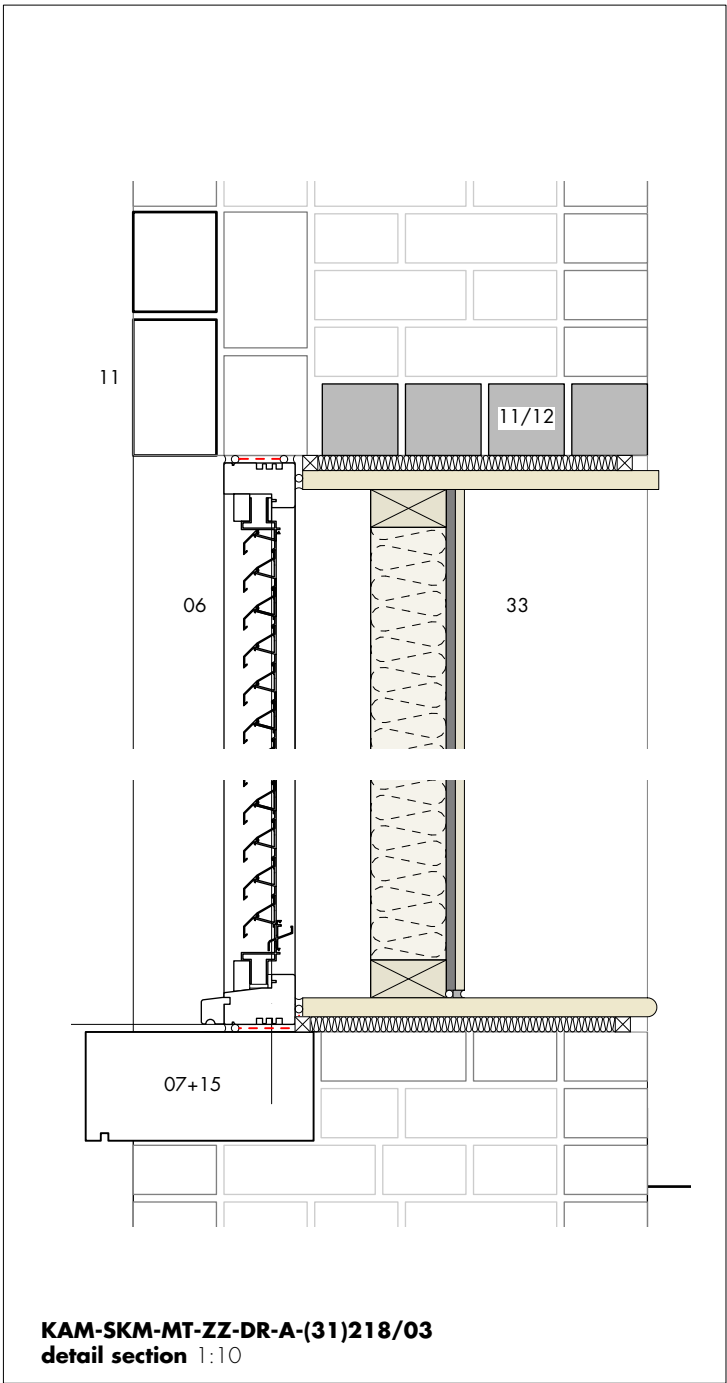
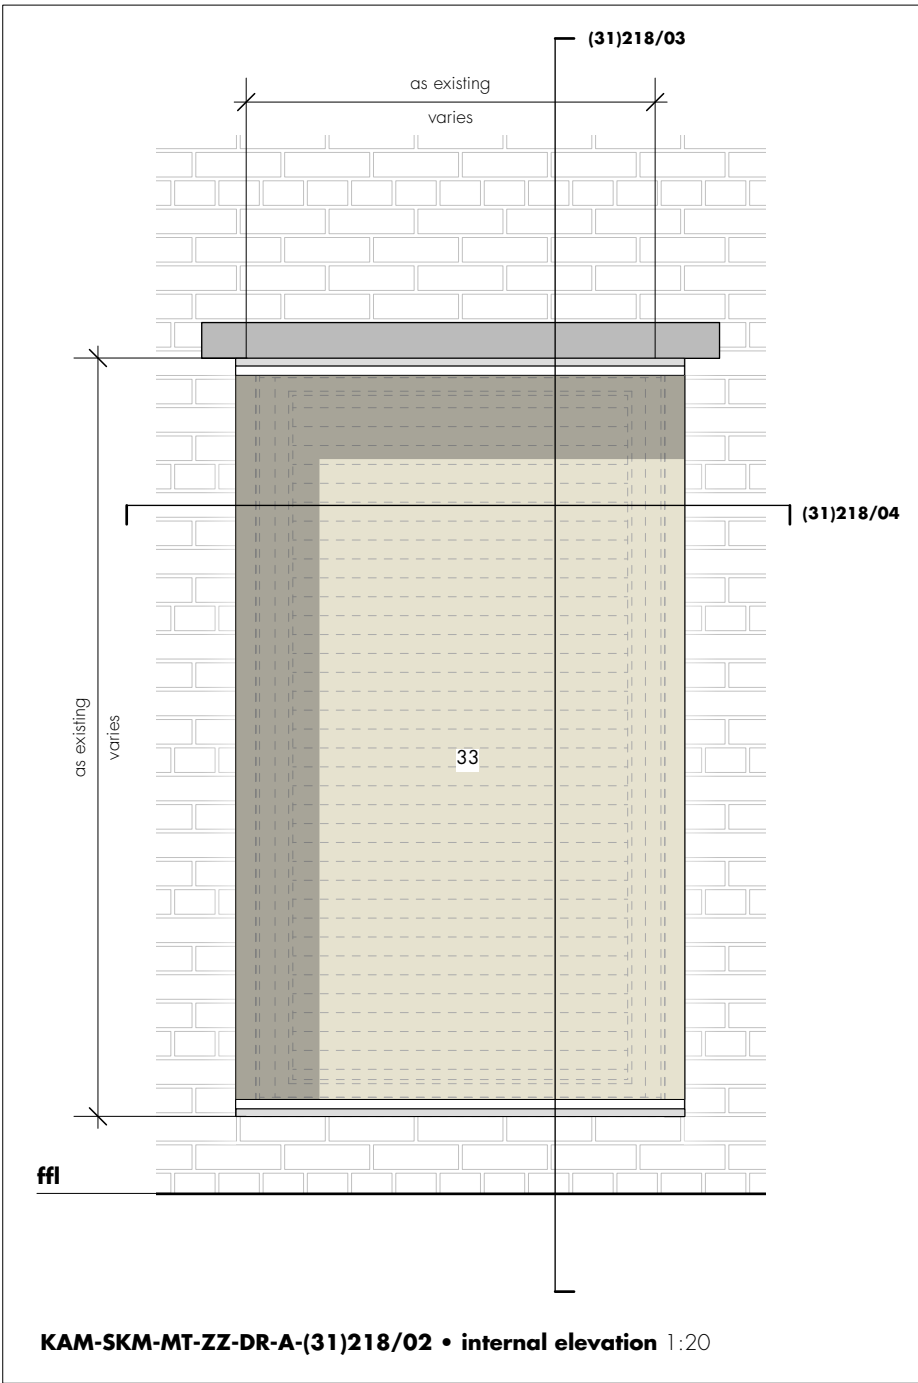
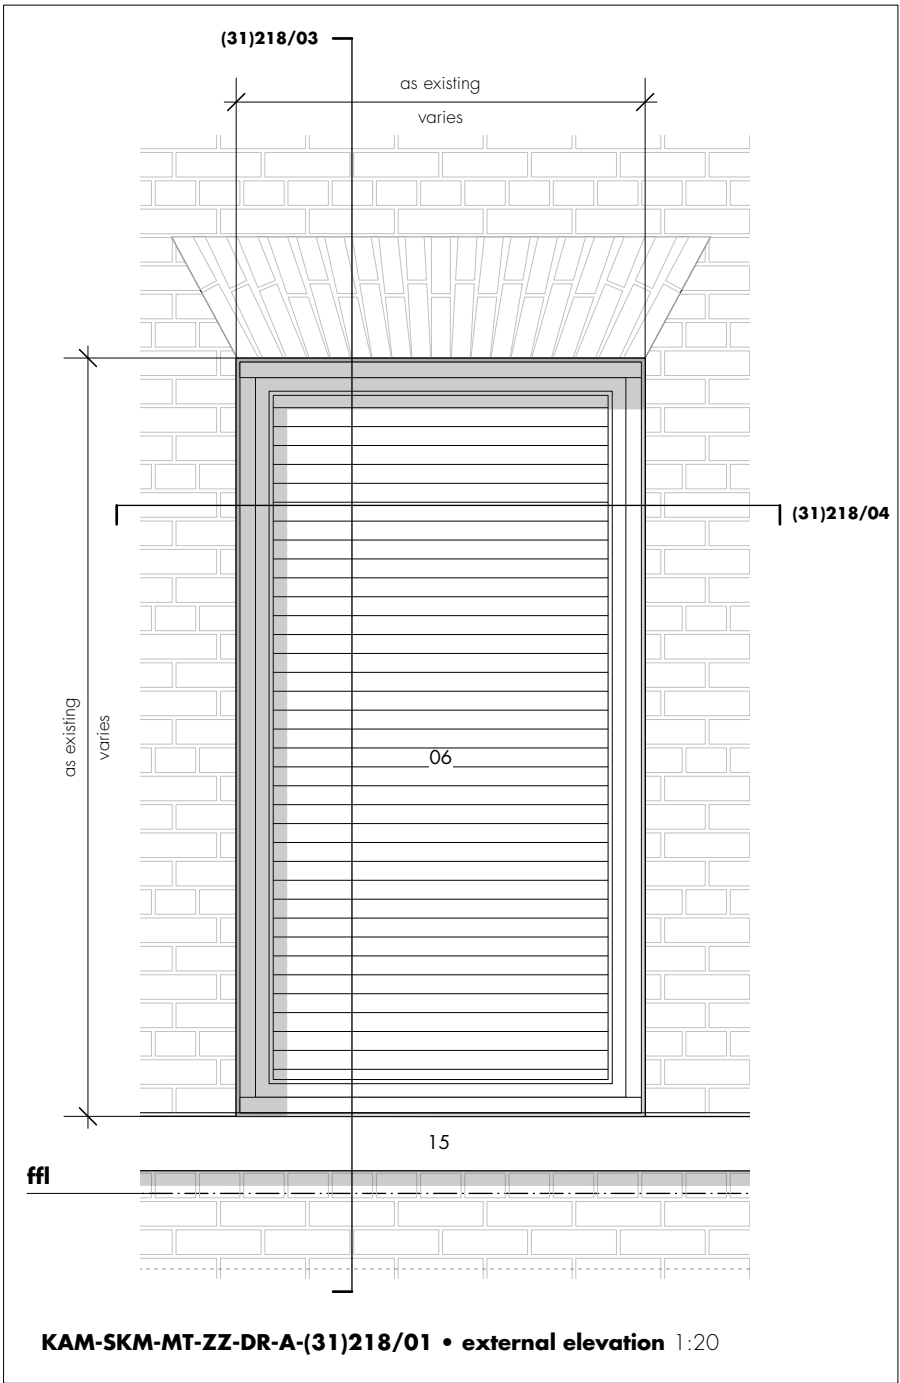


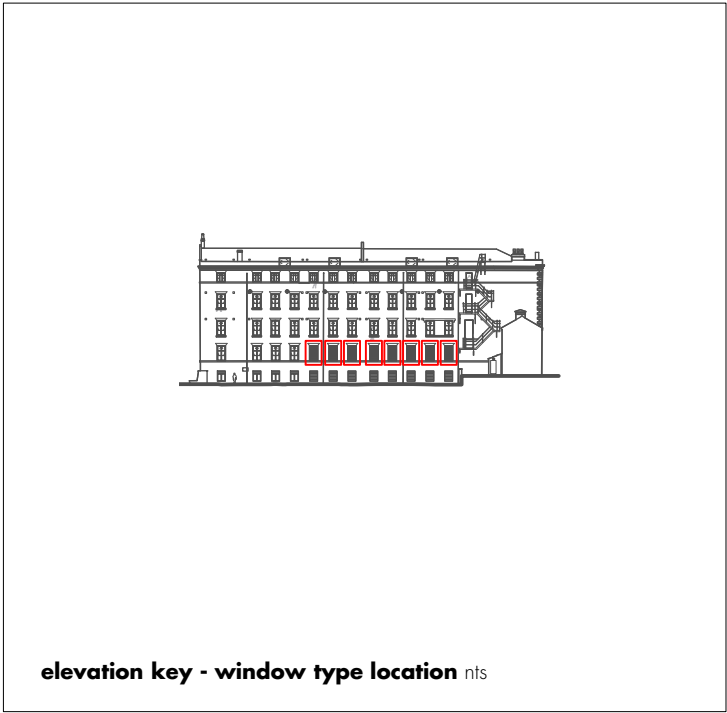

- key**
- 01 solid timber window frame
for glazing specification refer to window schedule
frame to sit on DPM with continuous mastic joints
to brickwork abutments as required
 - 02 solid timber camber infill scribed to ex. brick arch
profile to both int./ext elevations.
- painted finish to match window frame
 - 03 outward opening light - side hung
 - 04 outward opening light - centre pivot
 - 05 fixed light
 - 06 ppc alu. louvre glazed in to solid timber
frame
- lbc by specialist manufacturer
 - 07 existing stone cill retained - minor damage to be
repaired locally/like-for-like replacement as req.
new stone cill to match existing
timber cill + head board to be installed over
exposed brick cill. to be scribed to reveal profile
with mastic joints to brick abutments as req.
insulation to be fitted in void.
- screw fixed (countersunk) + pelleted
- painted finish
 - 10 chamfered brickwork reveal and aperture in
general to be made good - refer to remedial
works document for initial guidance.
 - 11 existing lintel to be made good where possible
 - 12 new lintel - as per SE design & specification
 - 13 new brick opening to be made good with
reclaimed bricks from demolition works to match
existing type/coursing.
- refer to demolition elevations
 - 14 existing stone/brick junction at cill finished with
mortared joint where brickwork is replaced/made
good
 - 15 existing masonry detailing surrounding aperture
to be made good as req.
 - 16 glass barrier
 - 17 metal flat bar barrier
 - 18 back painted glass to conceal floor build up
ironmongery - refer to schedule
 - 19 PPC aluminium planter with integrated spitter
fixing method - lbc. colour - lbc
 - 20 10mm slate tile on mortar bed to protect exposed
cill tile size and setting out - lbc
 - 22 existing steel detail to be retained.
condition to be assessed to ascertain scope of
remedial works
 - 23 aluminium flashing fixed to subframe
- scope of area to be demountable to be reviewed
against installation of fire curtain and access req.
 - 24 aluminium bottom hung window
(opening between 15-30°)
 - 25 painted MDF reveal colour - lbc
 - 26 timber packer
 - 27 skirting
 - 28 demountable aluminium flashing
- to provide access to fire curtain
 - 29 BLE fire + smoke curtain or acceptable equivalent
masonry infill
 - 31 curtain wall - with inner sleeve
- EDPM to perimeter with continuous mastic joints
to brickwork abutments as required
 - 32 silicon joint
 - 33 acoustic boxing out to int. face of louvre
- timber framing inset to reveal
- 12mm cem.board (≥ 1150 kg/m3) and
- 12 mm plywood (≥ 560 kg/m3)
- insulation req.lbc building control
cavity drainage system
- independent wall lining to be installed by tenant

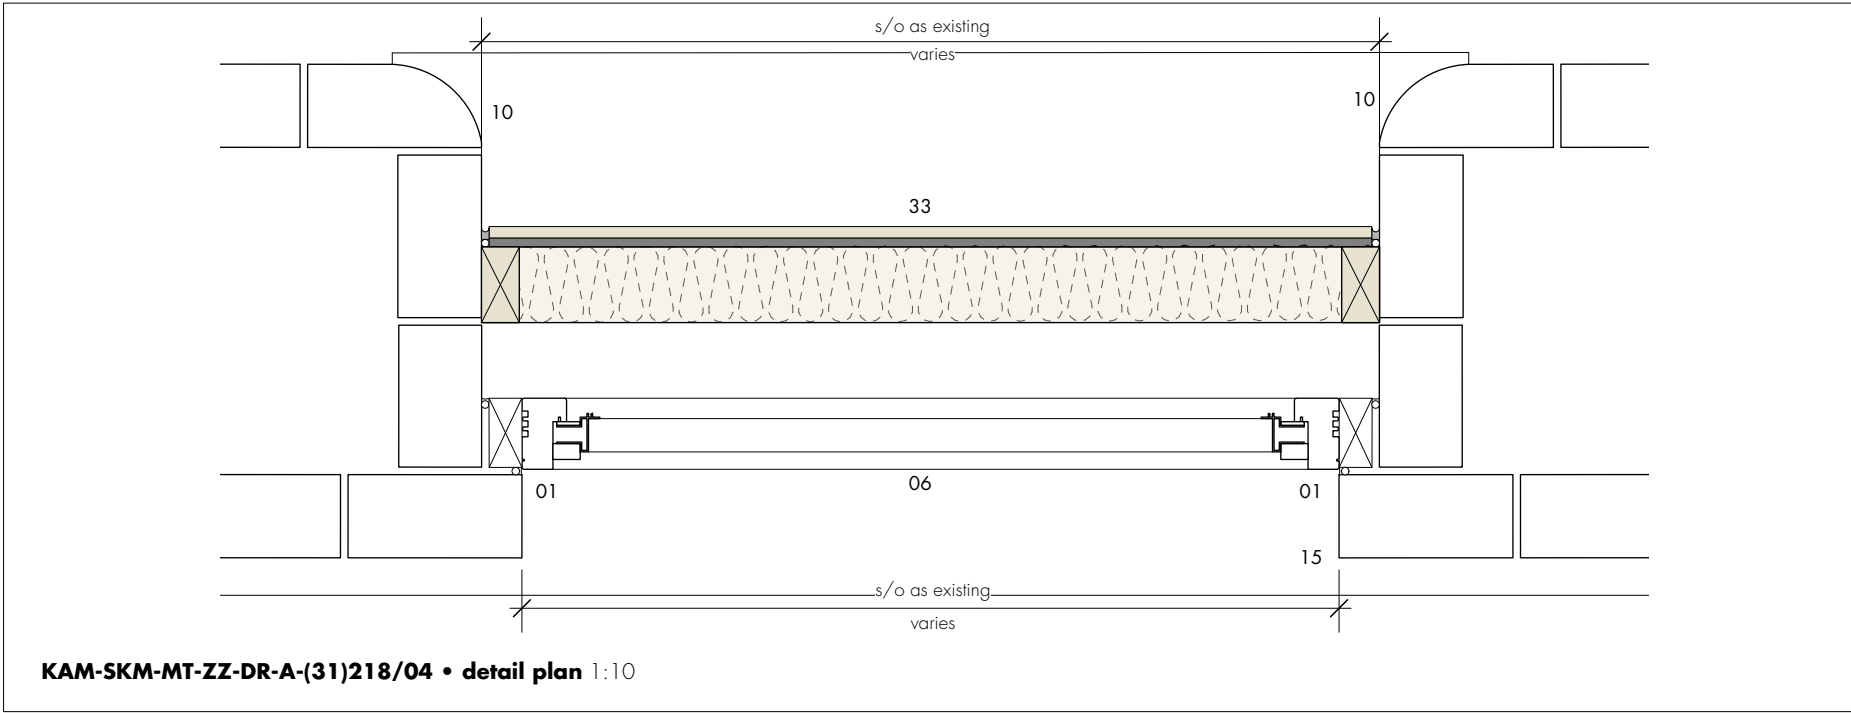

notes

for window type location drawings ref:
KAM-SKM-MT-ZZ-DR-A-(31) 200 to 201.

window types to be read in conjunction with
window schedule KAM-SKM-MT-ZZ-SH-W001
and GA plans KAM-SKM-00-DR-A-(00)150
onwards.

all existing window structural openings to be
site measured. for approximate sizes, refer
to window schedule. all windows are subject
to site measurement prior to manufacture.

change from original application. refer to
changes schedule for further details

section 19/73 application issue 23.04.21 • hlm • jr
rev • description issued • drawn • checked

shedkm +44 (0)151 709 8211
+44 (0)207 253 8881

project kampus • listed buildings
client mount anvil
drawing number KAM-SKM-MT-ZZ-DR-A-(31) 218 a
scale as shown @ a3
status **planning**
minto + turner • proposed window type 04

do not scale from this drawing • all dimensions are to be set out and checked on site prior to starting
construction • any discrepancy found between information given on this drawing and that given elsewhere
or recorded on site shall be brought to the attention of the project architect immediately