


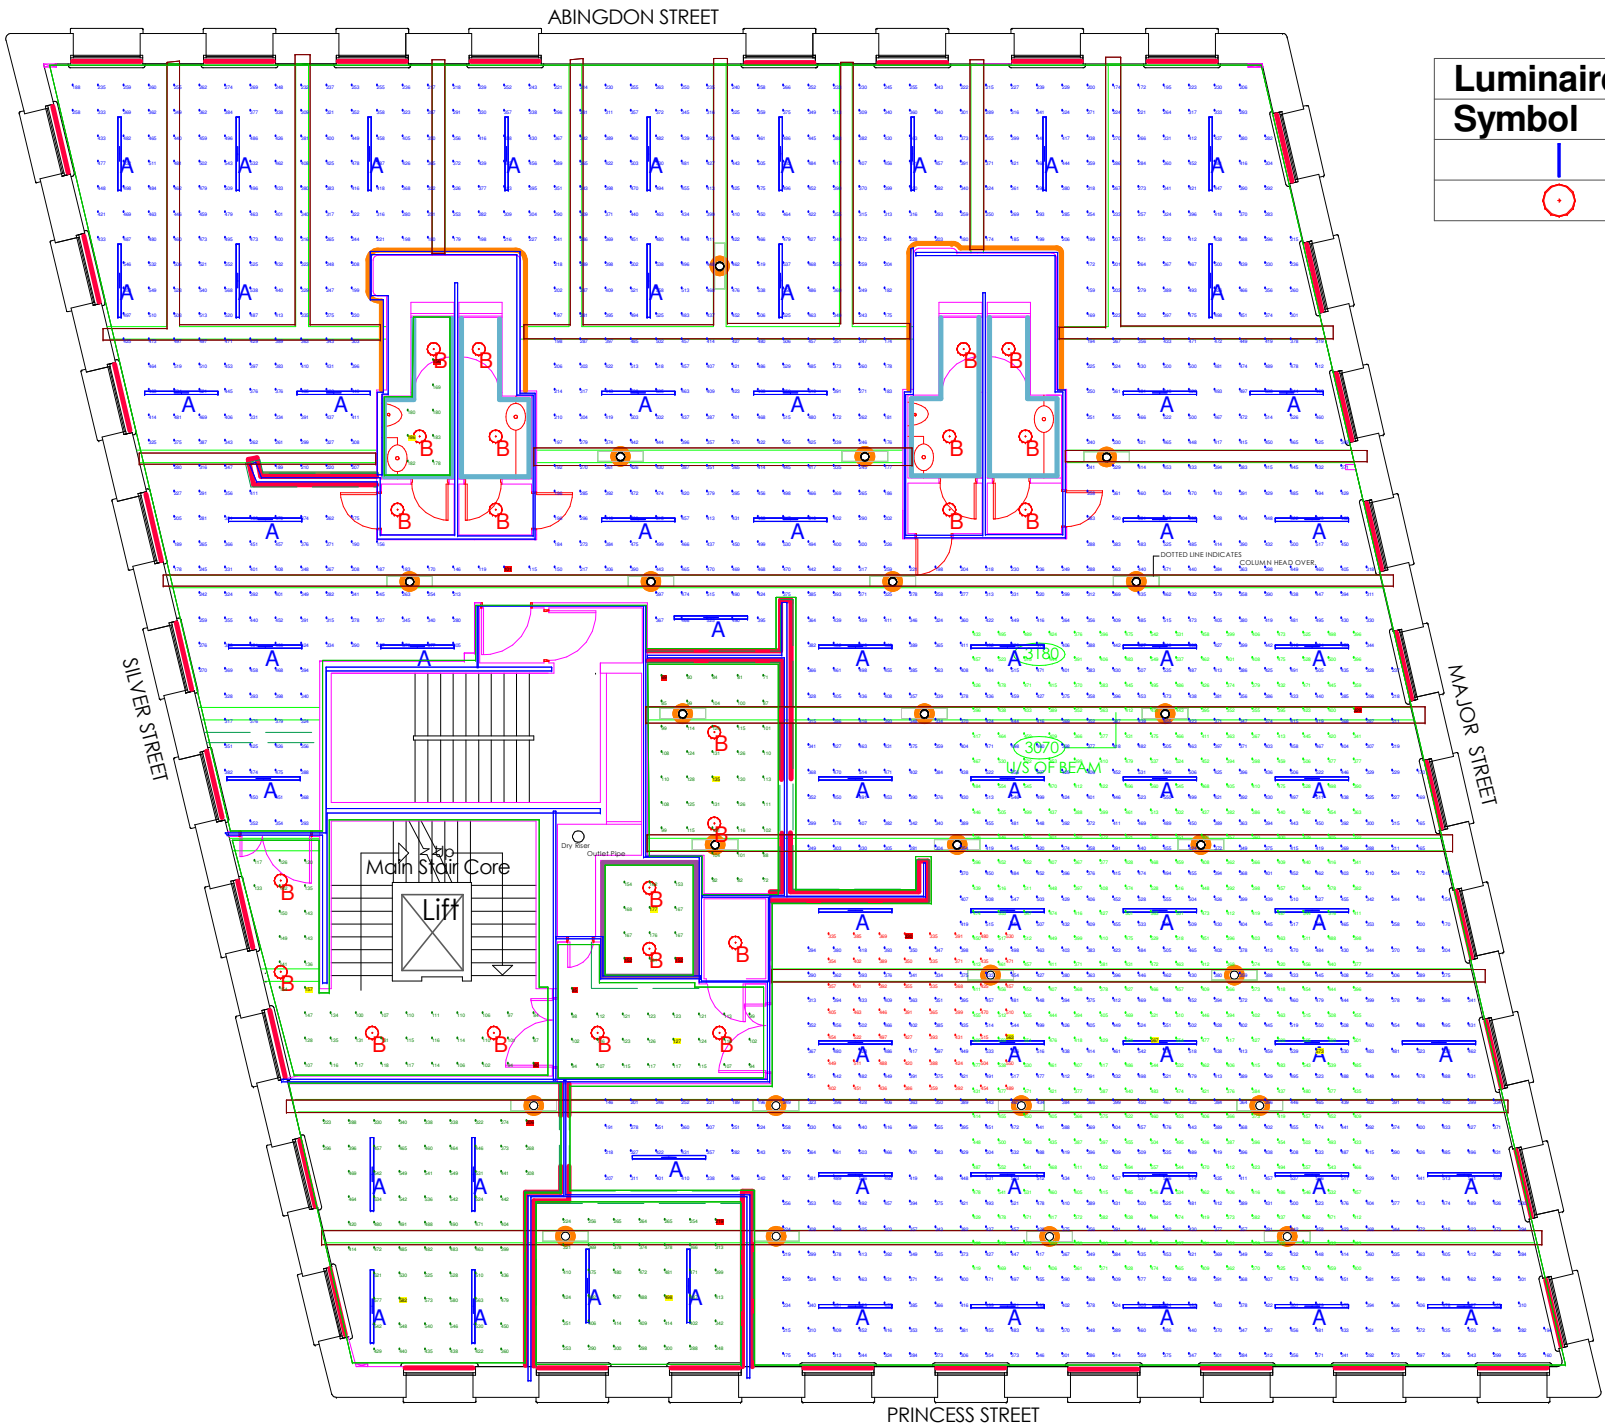

Luminaire Schedule					
Symbol	Qty	Label	Luminaire Lumens	LLF (MF)	Description
	63	A	4530	0.800	Facet D/I Suspended 37W 4000K Ra>80 CD Lens C
	23	B	1430	0.800	Sense 255 Matt White 13W LED 4000K Ra>80 Recessed

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Uniformity	Diversity	Workplane Height
-Open Plan Office	Illuminance	Lux	389.63	573	101	0.26	0.18	0.75
-Open Plan Office - Task	Illuminance	Lux	445.11	567	329	0.74	0.58	0.75
-Welcome Area - Reception	Illuminance	Lux	423.32	563	330	0.78	0.59	0.75
Circulation	Illuminance	Lux	111.88	127	85	0.76	0.67	0
Comms-Store	Illuminance	Lux	105.05	135	69	0.66	0.51	0
DWC-SH	Illuminance	Lux	163.00	177	152	0.93	0.86	0
Large Stairs-Lobby area	Illuminance	Lux	120.25	157	80	0.67	0.51	0
Meeting Room	Illuminance	Lux	455.27	582	206	0.45	0.35	0.75
Small Meeting Room	Illuminance	Lux	367.81	498	219	0.60	0.44	0.75
WC	Illuminance	Lux	176.75	186	156	0.88	0.84	0

Ceiling Height in Open Plan Office: 3.180m
From Underside of Ceiling Beam to Floor: 3.070m
Facet Luminaires Mounted at: 2.7m
Ceiling Height in Core: 3.180m

Working Plane in Office and Meeting rooms: 0.75m
Working Plane in WC's and Corridors: 0m

Reflectances: 70:50:30
Maintenance Factor: 0.8

P46591

Sg

101 Princess St,
Manchester - 3rd Floor - R02

By Jessica Hallam17/02/21