


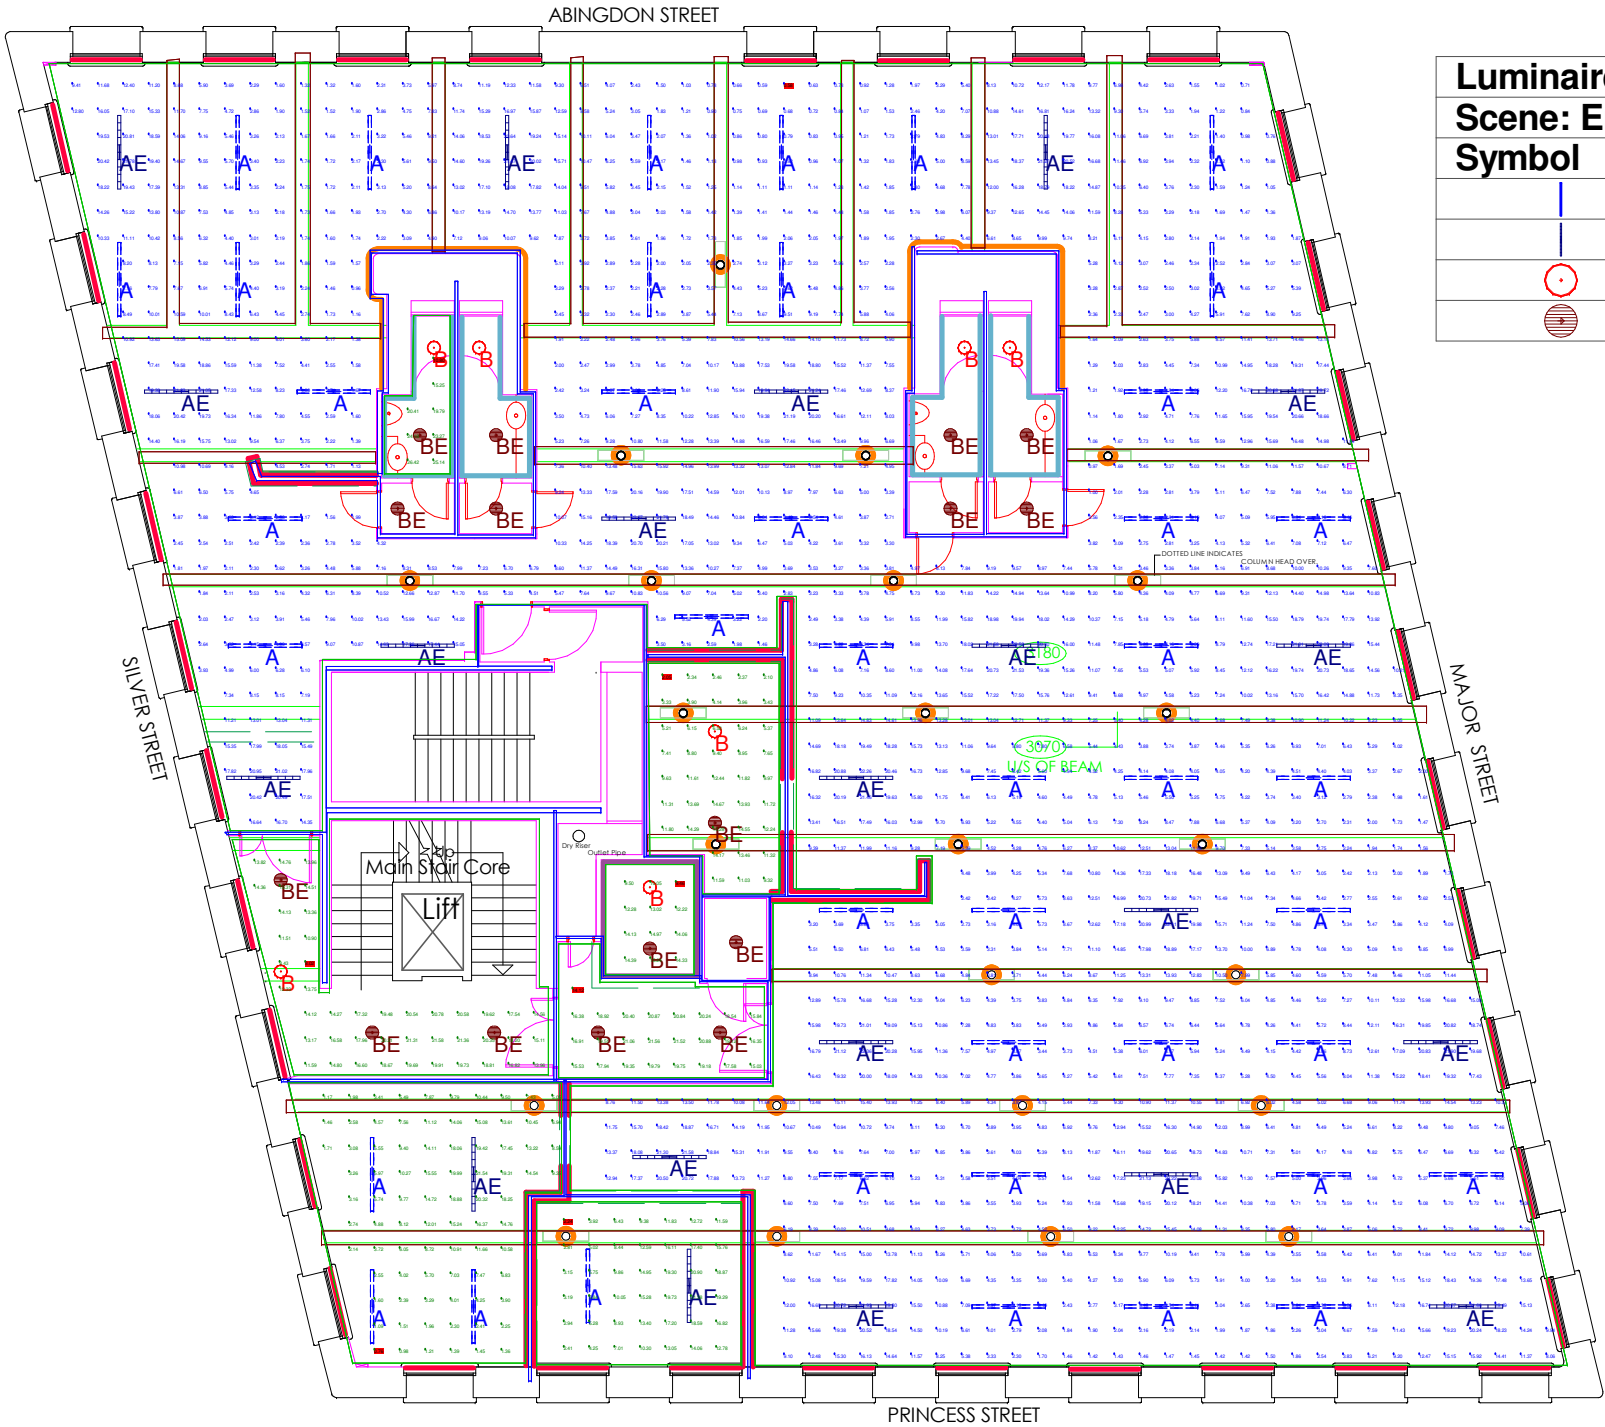

Luminaire Schedule					
Scene: Emergency					
Symbol	Qty	Label	Luminaire Lumens	LLF (MF)	Description
	42	A	4530	0.800	Facet D/I Suspended 37W 4000K Ra>80 CD Lens C
	21	AE	540	0.800	Facet D/I Suspended 37W 4000K Ra>80 CD Lens C
	7	B	1430	0.800	Sense 255 Matt White 13W LED 4000K Ra>80 Recessed
	16	BE	340	0.800	Sense 255 Matt White 13W LED 4000K Ra>80 Recessed

Calculation Summary								
Scene: Emergency								
Label	CalcType	Units	Avg	Max	Min	Uniformity	Diversity	Workplane Height
-Open Plan Office	Illuminance	Lux	8.31	22.52	0.58	0.070	0.030	0
Circulation	Illuminance	Lux	18.69	21.56	14.12	0.760	0.650	0
Comms-Store	Illuminance	Lux	8.82	15.28	2.05	0.230	0.130	0
DWC-SH	Illuminance	Lux	12.80	15.24	9.46	0.740	0.620	0
Large Stairs-Lobby area	Illuminance	Lux	16.24	21.58	8.02	0.490	0.370	0
Meeting Room	Illuminance	Lux	7.98	21.54	0.76	0.100	0.040	0
Small Meeting Room	Illuminance	Lux	11.21	21.38	2.24	0.200	0.100	0
WC	Illuminance	Lux	20.66	26.42	10.80	0.520	0.410	0

Ceiling Height in Open Plan Office: 3.180m
From Underside of Ceiling Beam to Floor: 3.070m
Facet Luminaires Mounted at: 2.7m
Ceiling Height in Core: 3.180m

Working Plane in Office and Meeting rooms: 0m
Working Plane in WC's and Corridors: 0m

Reflectances: 00:00:00
Maintenance Factor: 0.8

P46591

Sg

101 Princess St, Manchester
3rd Floor - R02 - EMG

By Jessica Hallam17/02/21