

STAIRS
To be checked and measured on site prior to fabrication of stairs. Timber stairs to comply with BS585 and with Part K of the Building Regulations. Max rise 220mm, min going 220mm. Two risers plus one going should be between 550 and 700mm. Tapered treads to have going in centre of tread at least the same as the going on the straight. Min 50mm going of tapered treads measured at narrow end. Pitch not to exceed 42 degrees. The width and length of every landing should be at least as great as the smallest width of the flight. Doors which swing across a landing at the bottom of a flight should leave a clear space of at least 400mm across the full width of the flight. Min 2.0m headroom measured vertically above pitch line of stairs and landings. Handrail on staircase to be 900mm above the pitchline, handrail to be at least one side if stairs are less than 1m wide and on both sides if they are wider. Ensure a clear width between handrails of minimum 600mm. Balustrading designed to be unclimbable and should contain no space through which a 100mm sphere could pass. Allow for all structure as designed by a Structural Engineer.

LEAD VALLEYS Lead-lined valleys to be formed using Code 5 lead sheet. Valley lead and two tiling fillets to be supported on min 19mm thick and 225mm wide marine ply valley boards on either side of the rafters. Lead to be laid in lengths not exceeding 1.5m with min 150mm lap joints and be dressed 200mm under the tiles. Roofing tiles to be bedded in mortar placed on a tile slip to prevent direct contact. Valley to have a minimum 100mm wide channel (125mm minimum for pitches below 30°). All work to be in accordance with the roof cladding manufacturers and the Lead Development Association recommendations.— Code 5 lead lapped over tilt file water bar on 220 x 25mm layboards on existing roof structure.

HEATING
Extend all heating and hot water services from existing and provide new TVRs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations

ELECTRICAL
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion

SMOKE DETECTION
Mains operated linked smoke alarm detection system to BS 5446 - 1:2000 and BS5839-6:2004 to at least a Grade D category LD3 standard and to be mains powered with battery back up. Smoke alarms should be sited so that there is a smoke alarm in the circulation space on all levels/ storeys and within 7.5m of the door to every habitable room. If ceiling mounted they should be 300mm from the walls and light fittings. Where the kitchen area is not separated from the stairway or circulation space by a door, there should be an interlinked heat detector in the kitchen.

INTERNAL LIGHTING
Install low energy light fittings that only take lamps having a luminous efficiency greater than 45 lumens per circuit watt and a total output greater than 400 lamp lumens. Not less than three energy efficient light fittings per four of all the light fittings in the main dwelling spaces to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.



BACKGROUND VENTILATION
Background ventilation - Controllable background ventilation via trickle vents to BS EN 13141-3 within the window frame to be provided to new habitable rooms at a rate of min 5000mm²; and to kitchens, bathrooms, WC's and utility rooms at a rate of 2500mm 2

ABOVE GROUND DRAINAGE All new above ground drainage and plumbing to comply with BS. 5572.1978 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction. Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used) All branch pipes to connect to 110mm soil Stub Stack.Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting.Waste pipes not to connect on to SVP within 200mm of the WC connection.Supply hot and cold water to all fittings as appropriate


INTERNAL STUD PARTITIONS 100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (e.g. 100mm Rockwool or Isowool mineral fibre sound insulation) in all voids the full depth of the stud. Partitions built off doubled up joists where partitions run parallel or provide noggins where at right angles, or built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plaster board with skim plaster finish. Taped and jointed complete with beads and stops

EXTRACT TO BATHROOM - To Bathroom provide mechanical ventilation ducted to external air capable of extracting at a rate of 30 litres per second. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body

BALUSTRADING All balcony balustrades to be min 1.1m in height. No openings in any balustrading should allow the passage of a 100mm sphere and children should not readily be able to climb the guarding

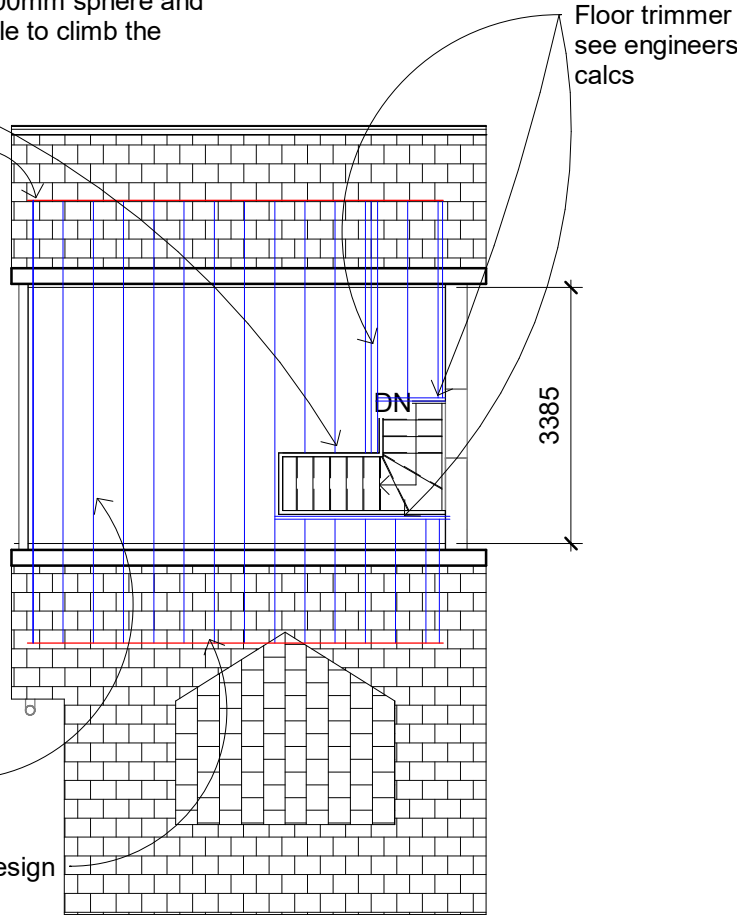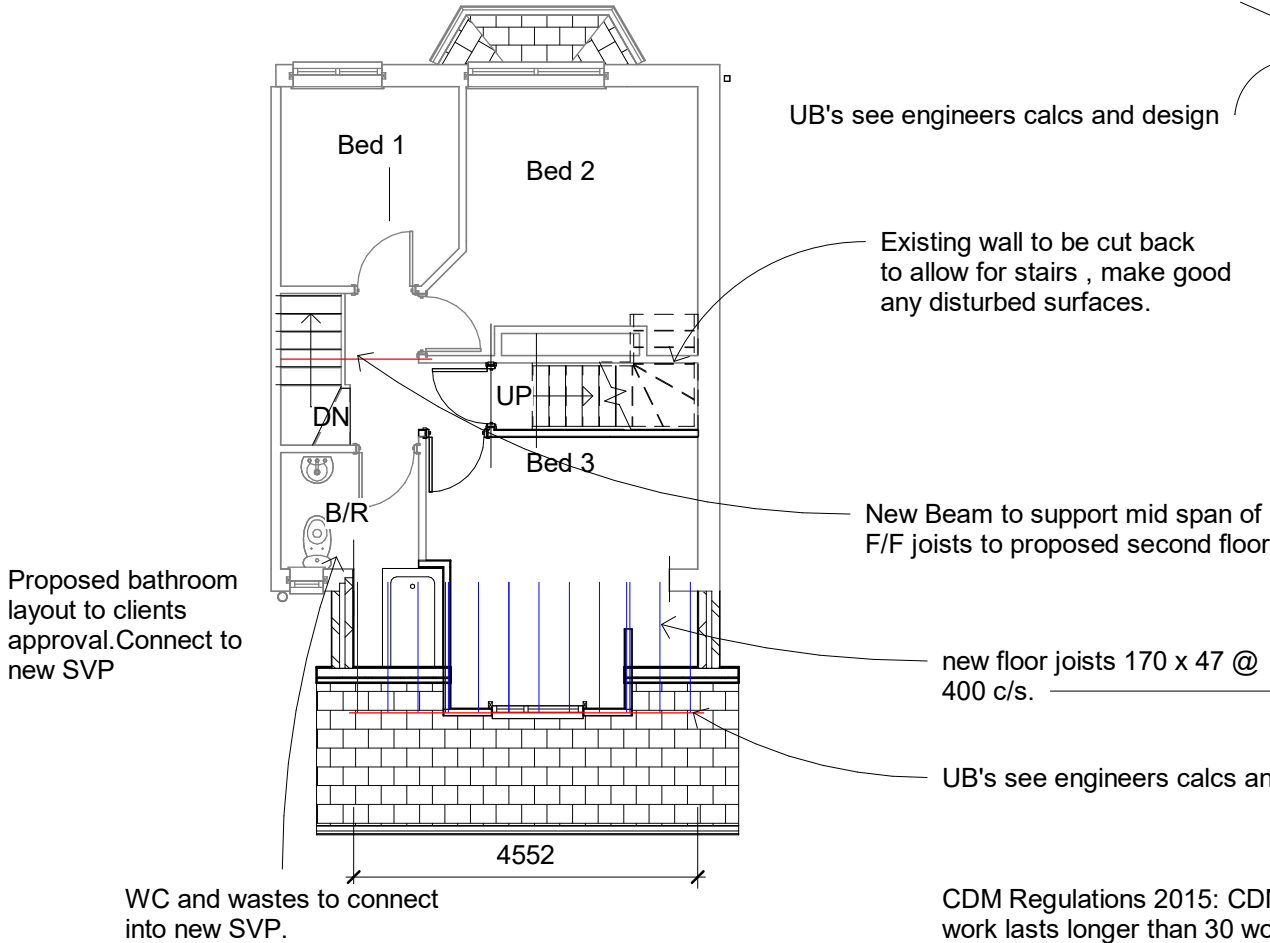

CDM Regulations 2015: CDM regulations apply to projects where construction work lasts longer than 30 working days and has more than 20 workers on site together at any point or if the project exceeds 500 person days. Such projects are legally notifiable to HSE. Wherever there is more than one contractor, the client must appoint a Principal Designer to be responsible for the coordination of health & safety during the preconstruction and construction phase of the project.



1 ffl
1 : 100

2 SFL
1 : 100



No.	Description	Date



Planning
Building Control
Structural Calculations
Project Management

PROJECT		CLIENT		
Proposed Extension To Rear With Hip To Gable Conversion And Alterations To 36 Shannon Road, Wythenshawe, Manchester, M22 9UD.		Mr D Shea		
SHEET		Date 30/12/2020	Project number NDH/DS/12/20	Scale (@ A3) 1 : 100
Proposed First And Second Floor		Drawn by Neil	DRAWING NUMBER 3 OF 7	REV
		Checked by Checker		