

Project Name
BELLAMY COURT


Project Description

Client
KITCH EQUIP

Project Number
3561



Revision Schedule			
Rev	Description	Date	Issued to
P01	WIP	29-07-20	DARREN HALL
P02	WALL VOID ADDED	08-09-20	PETER TAYLOR
P03	PROPOSED UV ODOUR UNIT LOCATION ADDED	14-12-20	

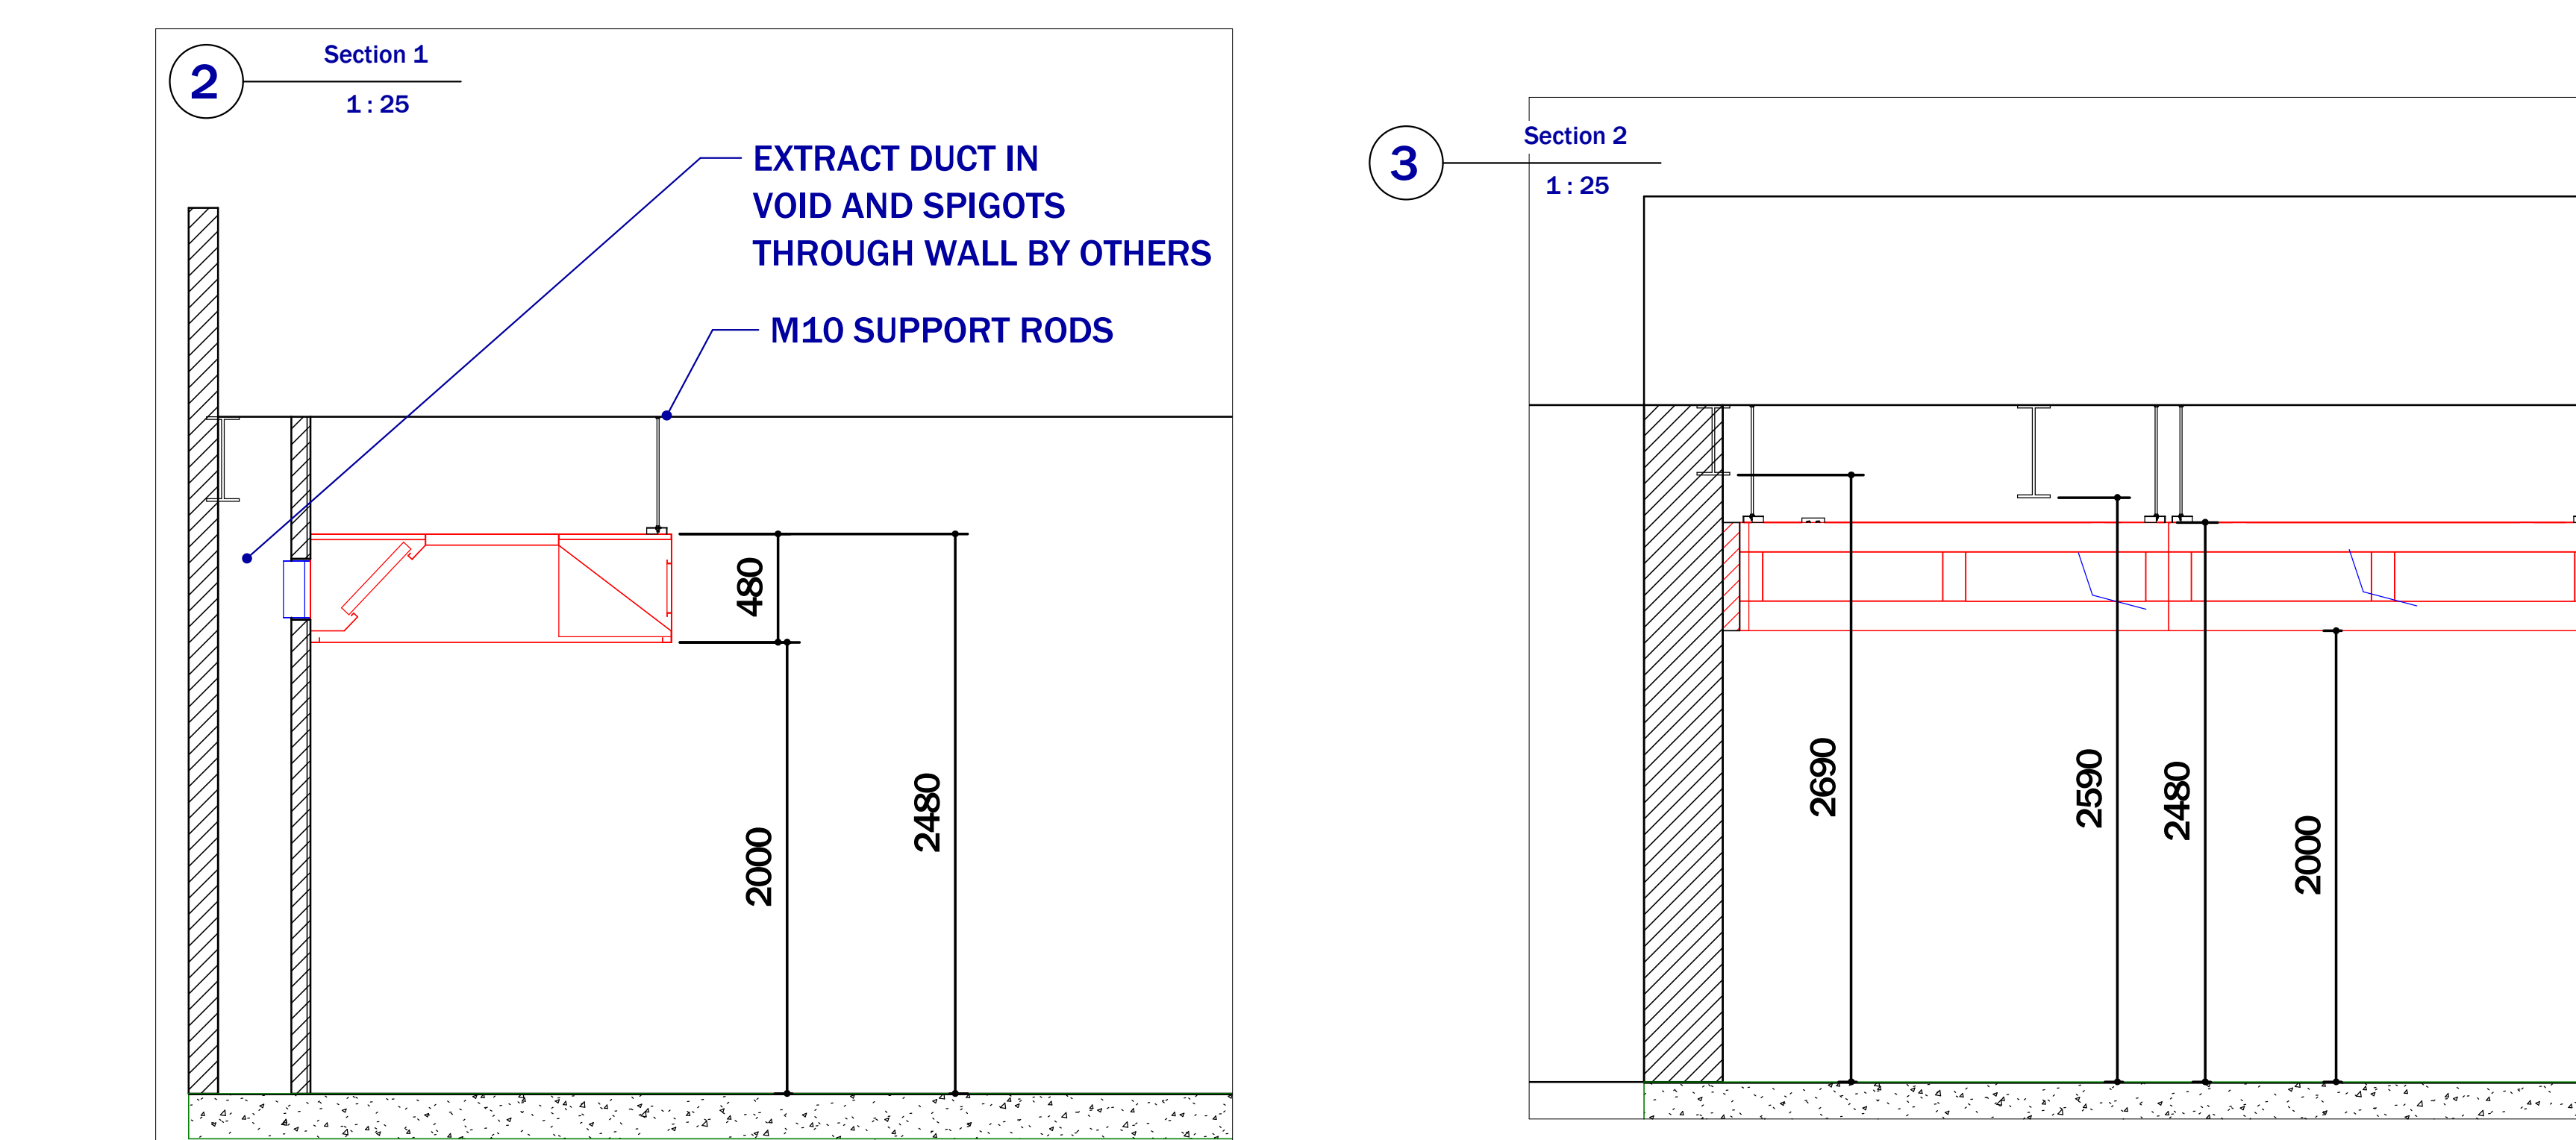

SUPPLY AIR VOLUME						
Item Number	Supply Air Volume	Supply Air Pressure Drop	No of Supply Air Spigots	Supply Air Spigot Width	Supply Air Spigot Depth	Supply Air Spigot Velocity
IFESW 1.	0.711 m³/s	80.0 Pa	2	300	300	3.953 m/s

- ALL ELECTRICAL CONNECTIONS BY OTHERS.
- ALL SERVICES MUST AVOID CANOPY HANGING POINTS.
- NEW WALL TO BE BUILT TO REAR OF HOOD TO ALLOW FOR EXTRACT DUCT AND SPIGOT CONNECTIONS TO REAR OF HOOD.
- ALL FANS AND DUCT WORK BY OTHERS.
- EXTRACT DUCT AND SPIGOTS IN REAR WALL VOID BY OTHERS. SPIGOTS MUST BE LOCATED IN POSITIONS SHOWN TO ALLOW FOR CONNECTION TO EXTRACT PLENUM.
- HOOD IS MANUFACTURED TO SUIT A MAX SUSPENDED CEILING HEIGHT OF 2450MM. HIGHER CEILINGS WILL REQUIRE VALANCE TO TOP OF HOOD AT EXTRA COST.
- NO ALLOWANCE HAS BEEN MADE FOR STAINLESS STEEL WALL CLADDING.
- STRUCTURAL SLAB HEIGHT 3000mm




PROJECT NAME	
--------------	--

**ABBAY HEY
LANE
GORTON
MANCHESTER
M18 8PF**



CLIENT

KITCHEQUIP

PROJECT NUMBER		REV
3561		P03
DRAWING NUMBER		SCALE (@ A1)
001		1 : 25
DRAWN BY	CHECKED BY	DATE
Author	Checker	06/05/20

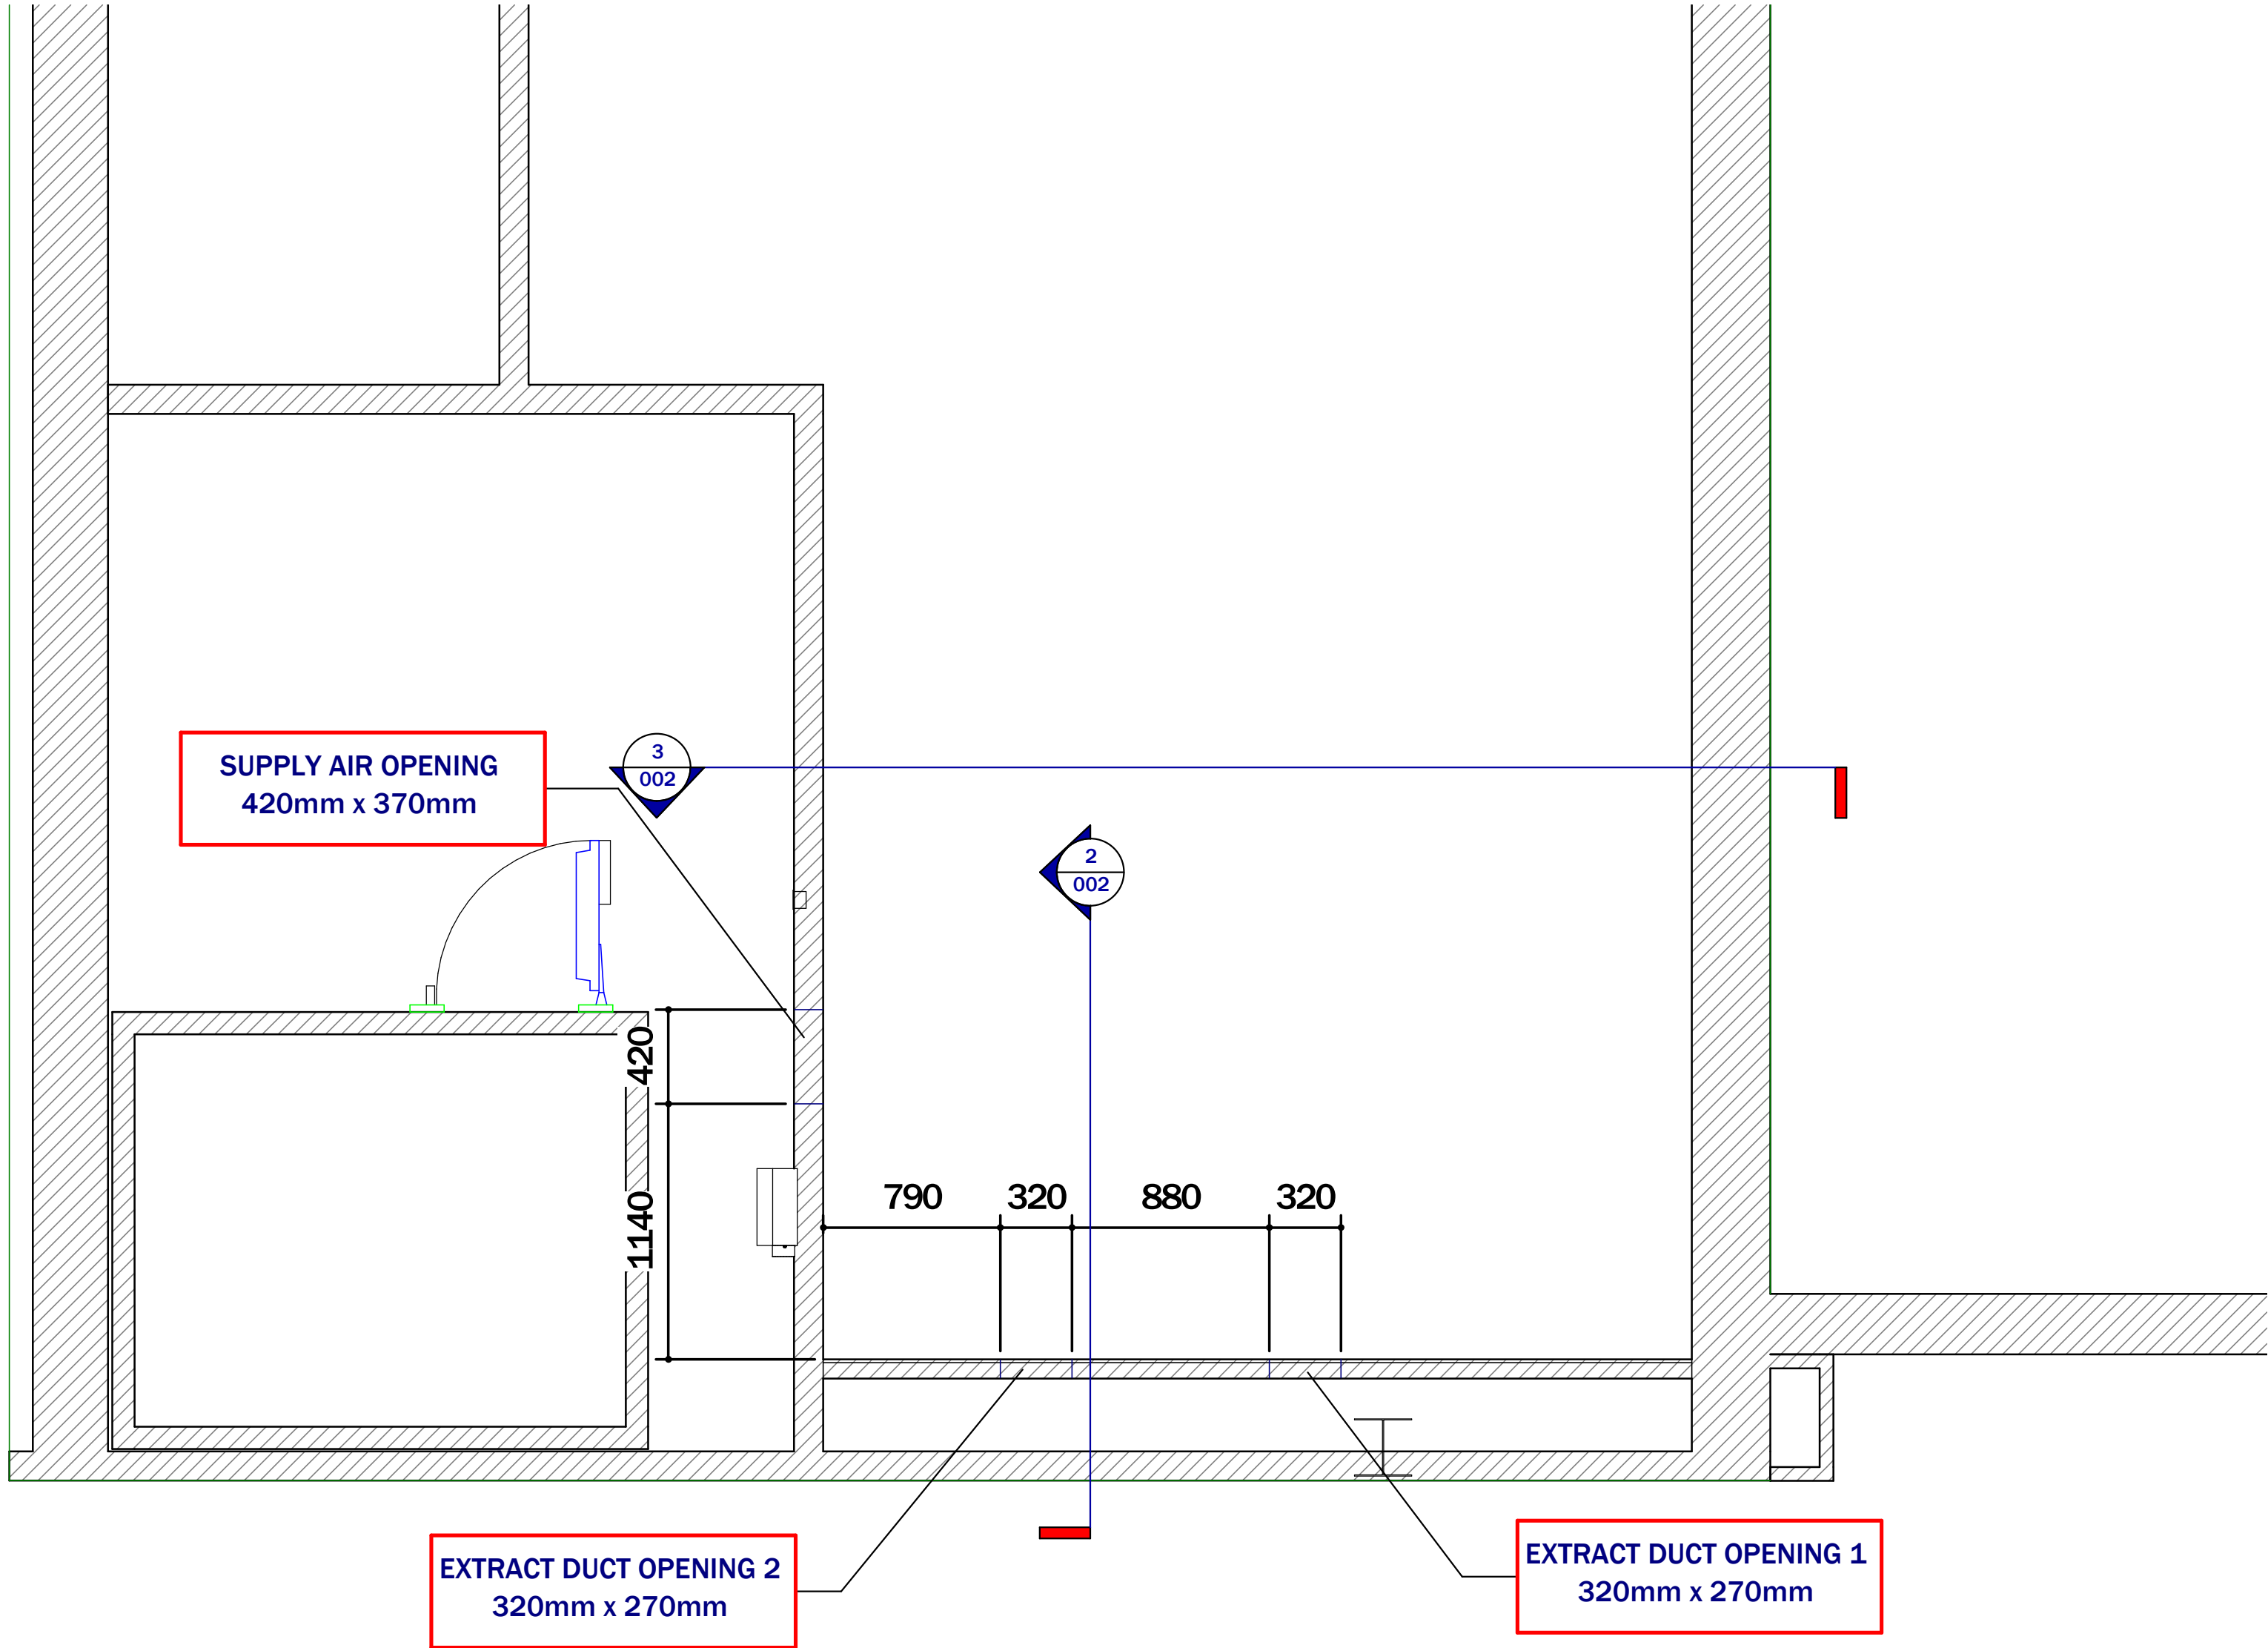

WALL OPENING SCHEDULE			
Wall Opening ID Number	Wall Opening Width	Wall Opening Height	Height from Floor
EXTRACT DUCT OPENING 1	320	270	2100
EXTRACT DUCT OPENING 2	320	270	2100
SUPPLY AIR OPENING	420	370	2095

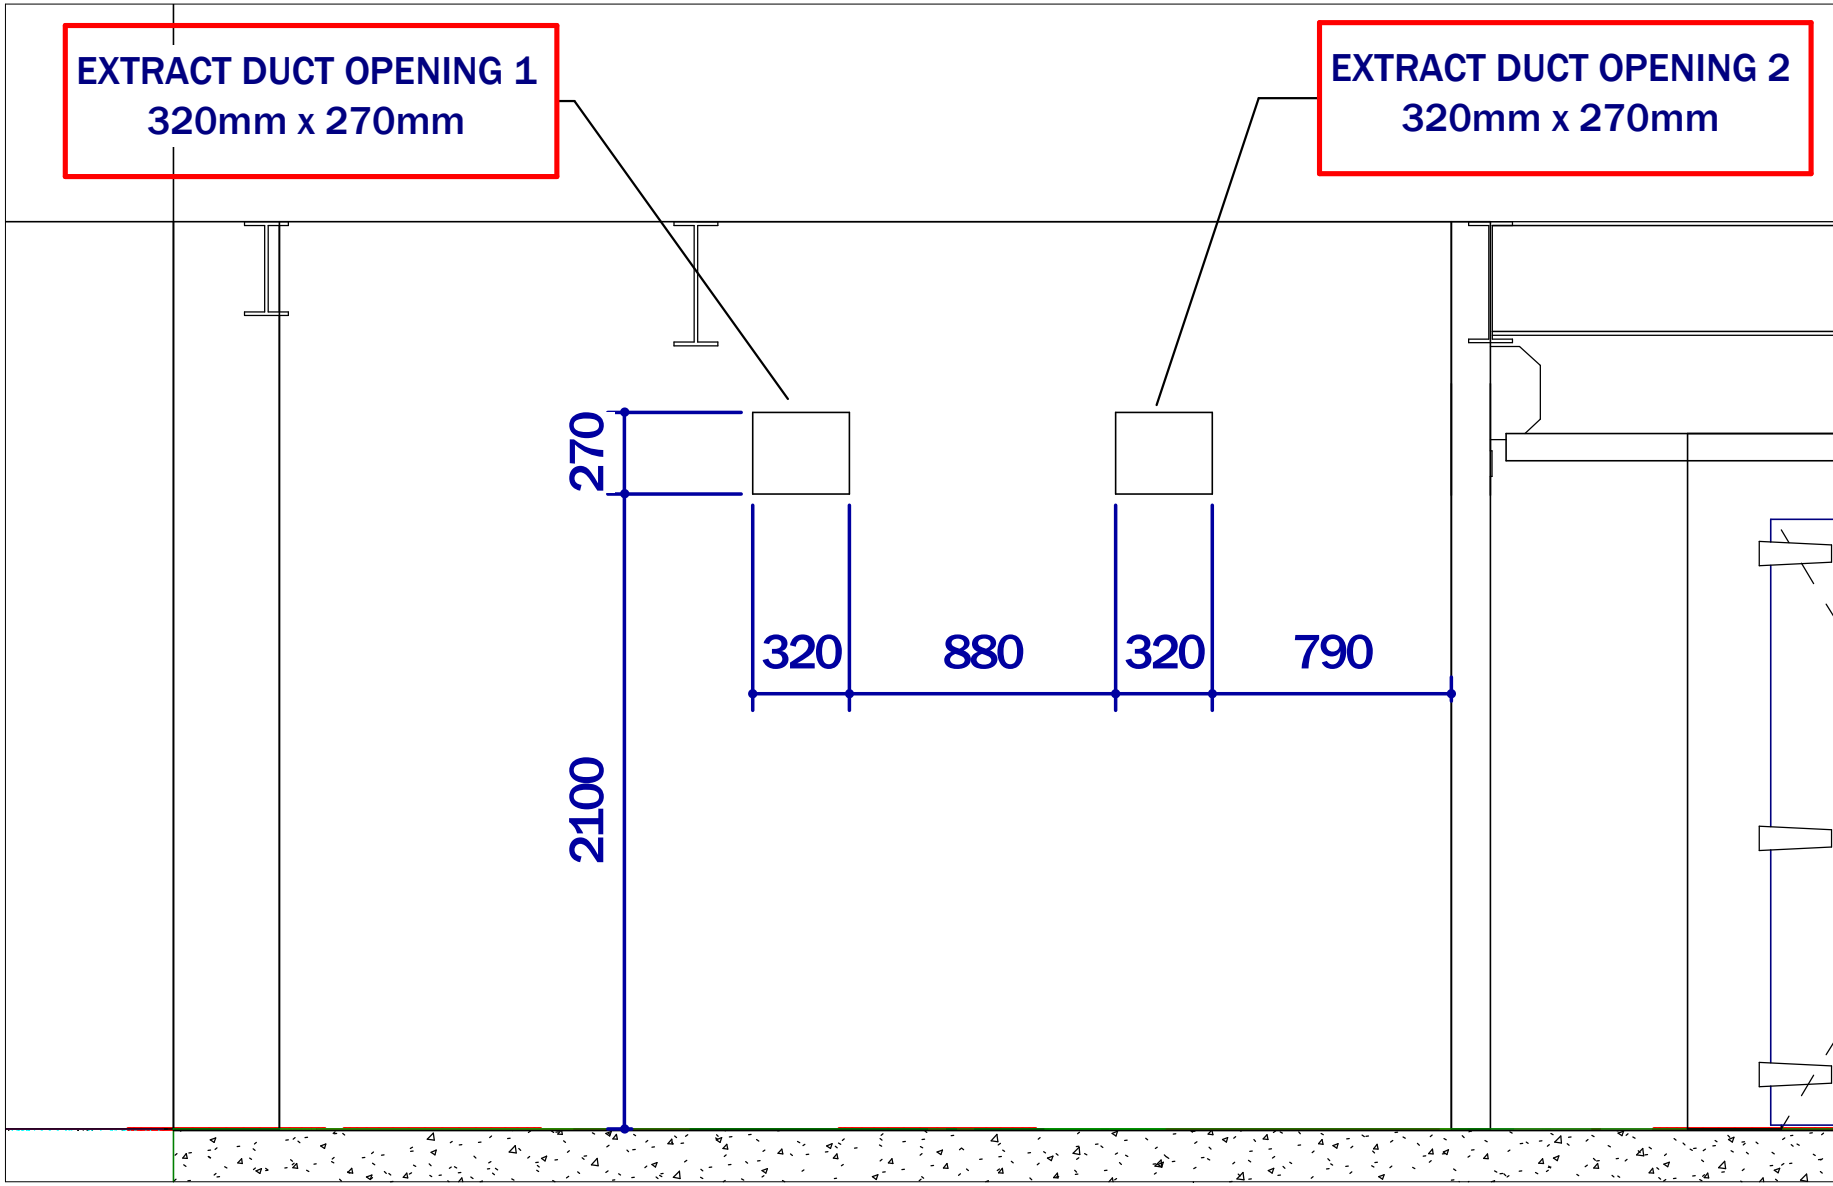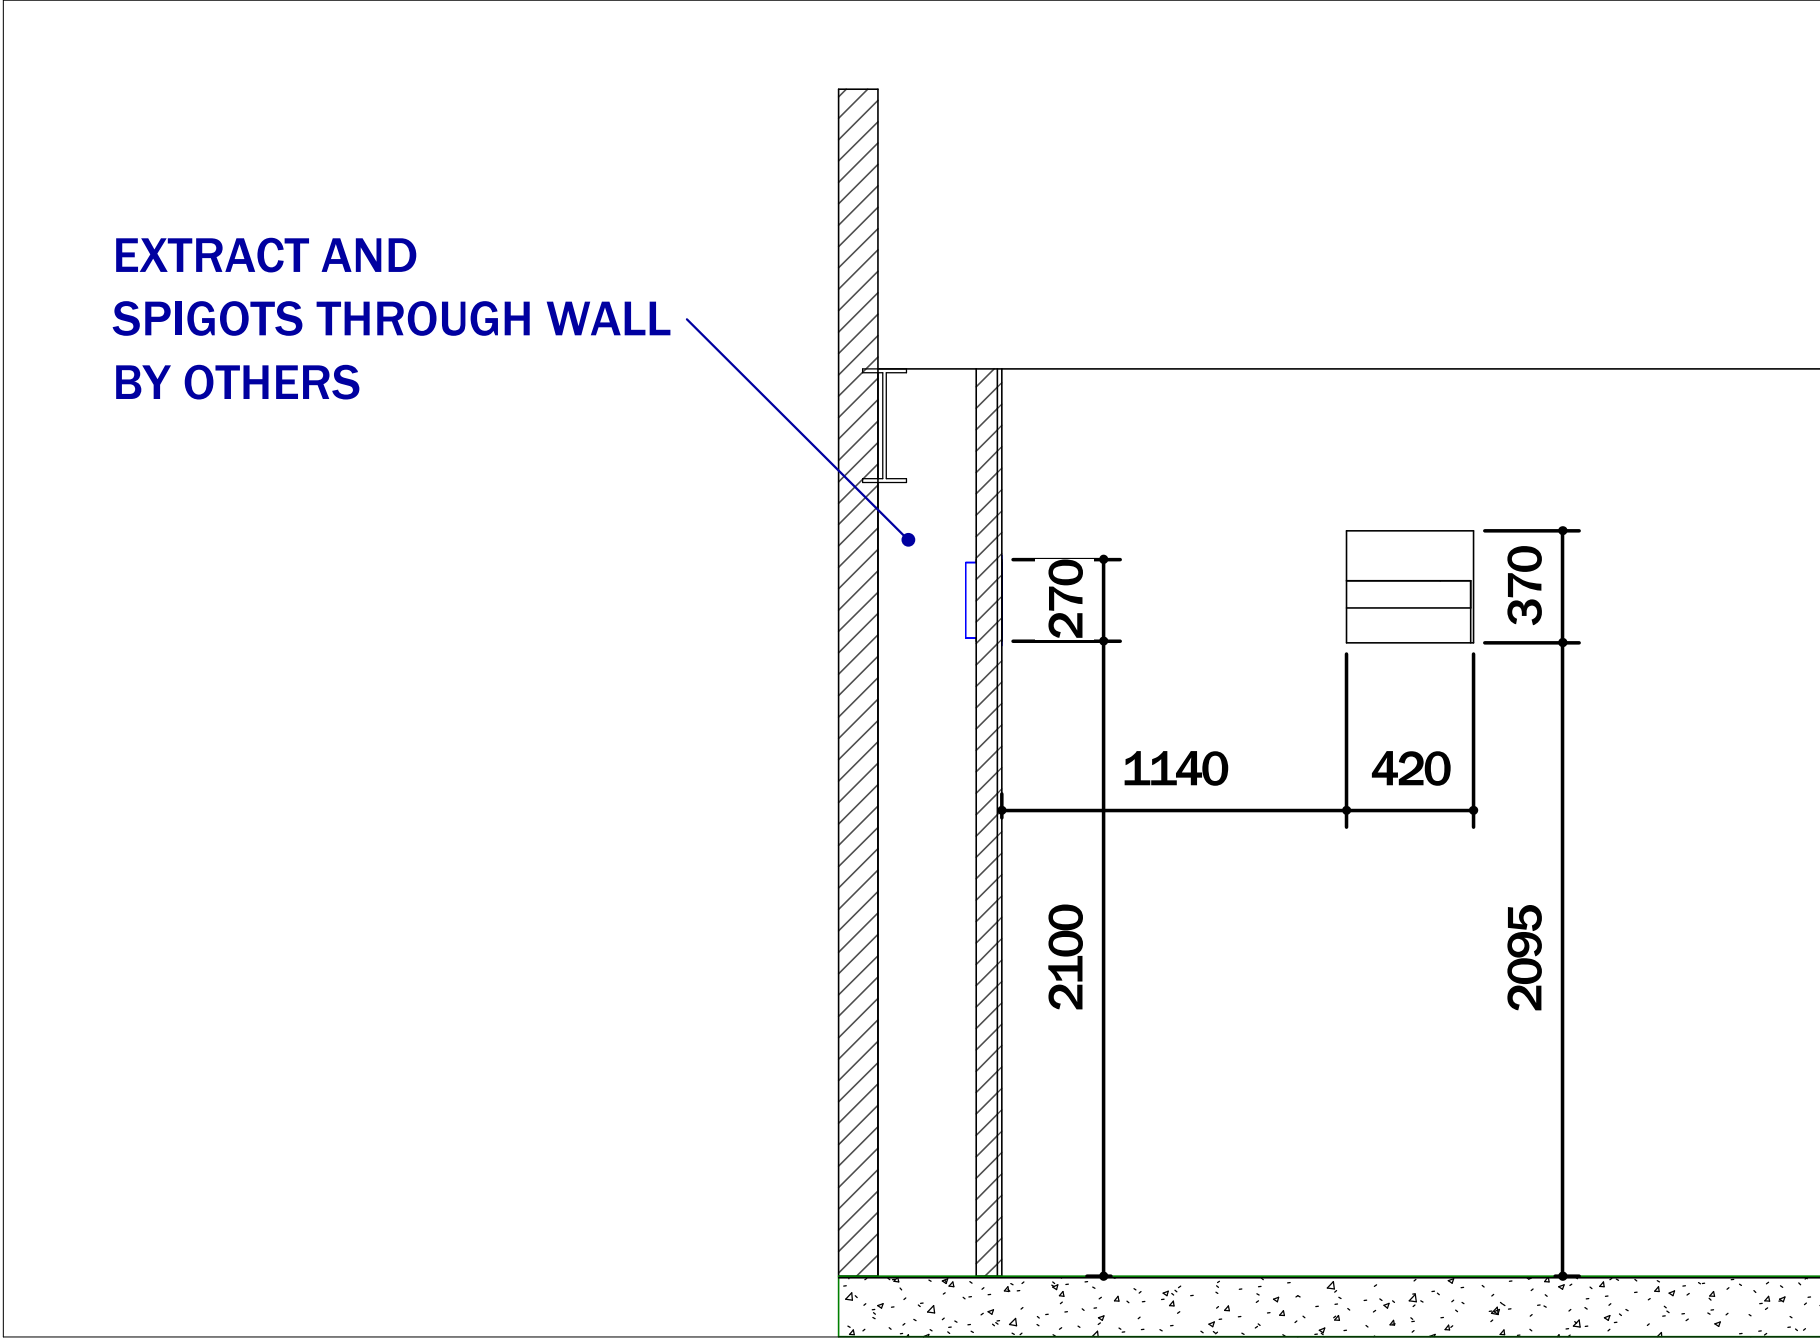

Unit 1
Adhan Trading Estate
Temple Drive
Blackburn
BB1 1NL

Rev	Description	Date
P01	WIP	29-07-20
P02	WALL VOID ADDED	08-09-20
P03	PROPOSED UV ODOUR UNIT LOCATION ADDED	14-12-20

PROJECT NAME

BELLAMY COURT

PROJECT ADDRESS

**ABBAY HEY
LANE
GORTON
MANCHESTER
M18 8PF**

TITLE

WALL OPENINGS


CLIENT

KITCHEQUIP

PROJECT NUMBER	REV
3561	P03

DRAWING NUMBER	SCALE (@ A1)
002	1 : 25

DRAWN BY	CHECKED BY	DATE
Author	Checker	09/08/20

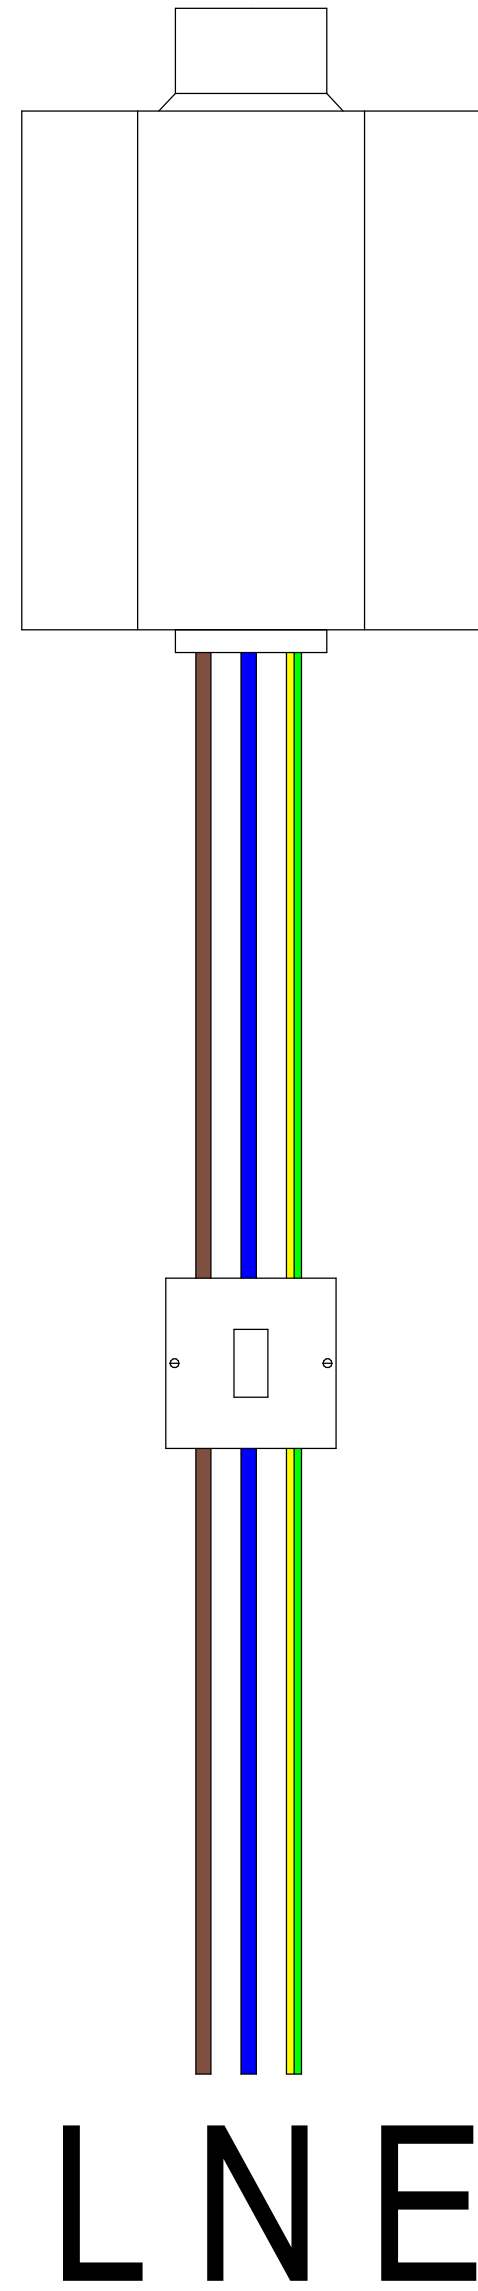

XTRACT 2100 ODOUR NEUTRALIZER

SWITCHED FUSE SPUR (NOT SUPPLIED)

ODOUR NEUTALIZER UNIT NOTES:

- UNIT TO BE CONNECTED TO KITCHEN EXTRACT DUCT VIA 100mm DIAMETER GALVANIZED STEEL DUCT.
- UNIT REQUIRES A 2 SECOND DWELL TIME
- UNIT REQUIRES A SWITCHED FUSE SPUR
- LOCATION IS PROPOSED AND SUBJECT TO APPROVAL
- UNIT REQUIRES ACCESS FOR MANITENANCE.

POWER REQUIREMENTS:

SUPPLY 230 Vac
PHASE 1
FREQ 50 Hz
POWER 160 W



Unit 1
Adhan Trading Estate
Temple Drive
Blackburn
BB1 1NL

Rev	Description	Date
P01	WIP	29-07-20
P02	WALL VOID ADDED	08-09-20
P03	PROPOSED UV ODOUR UNIT LOCATION ADDED	14-12-20

PROJECT NAME

BELLAMY COURT

PROJECT ADDRESS

**ABBAY HEY
LANE
GORTON
MANCHESTER
M18 8PF**

TITLE

**UV ODOUR UNIT
WIRING**

CLIENT

KITCHEQUIP

PROJECT NUMBER

3561

REV

P03

DRAWING NUMBER

003

SCALE (@ A1)

1 : 5

DRAWN BY

Author

CHECKED BY

Checker

DATE

12/14/20

1

UV Odour Unit Wiring

1 : 5