
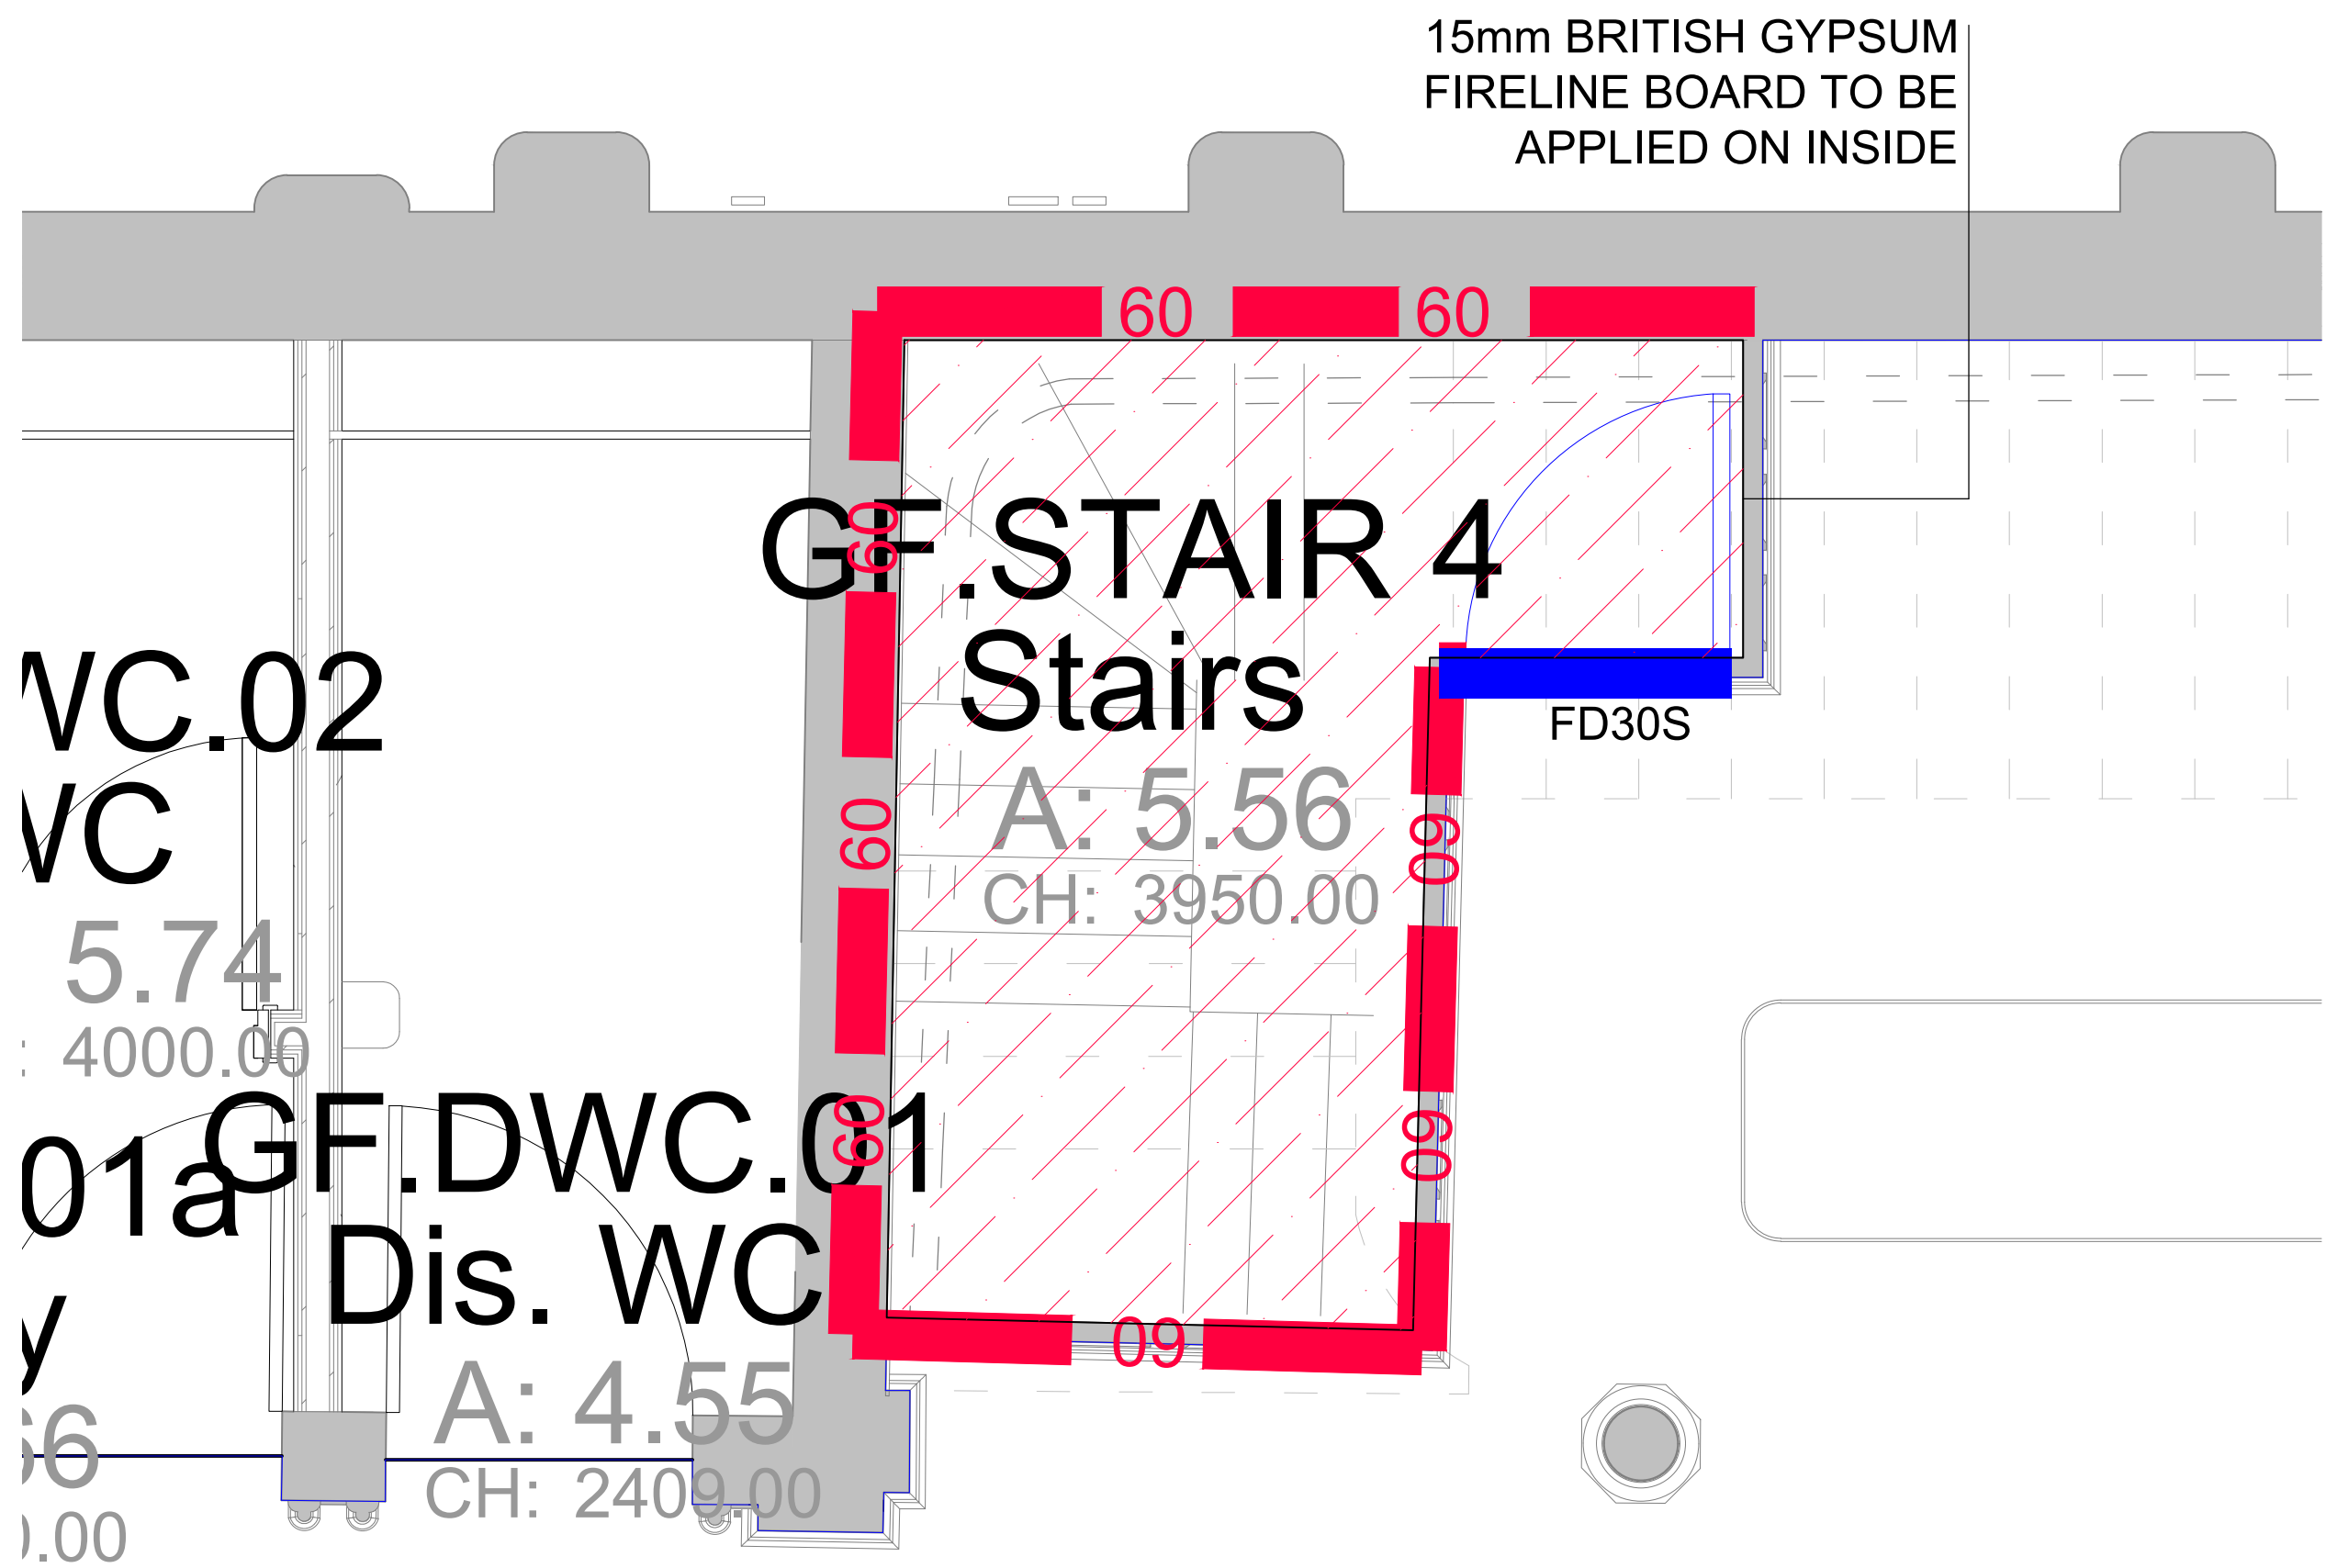


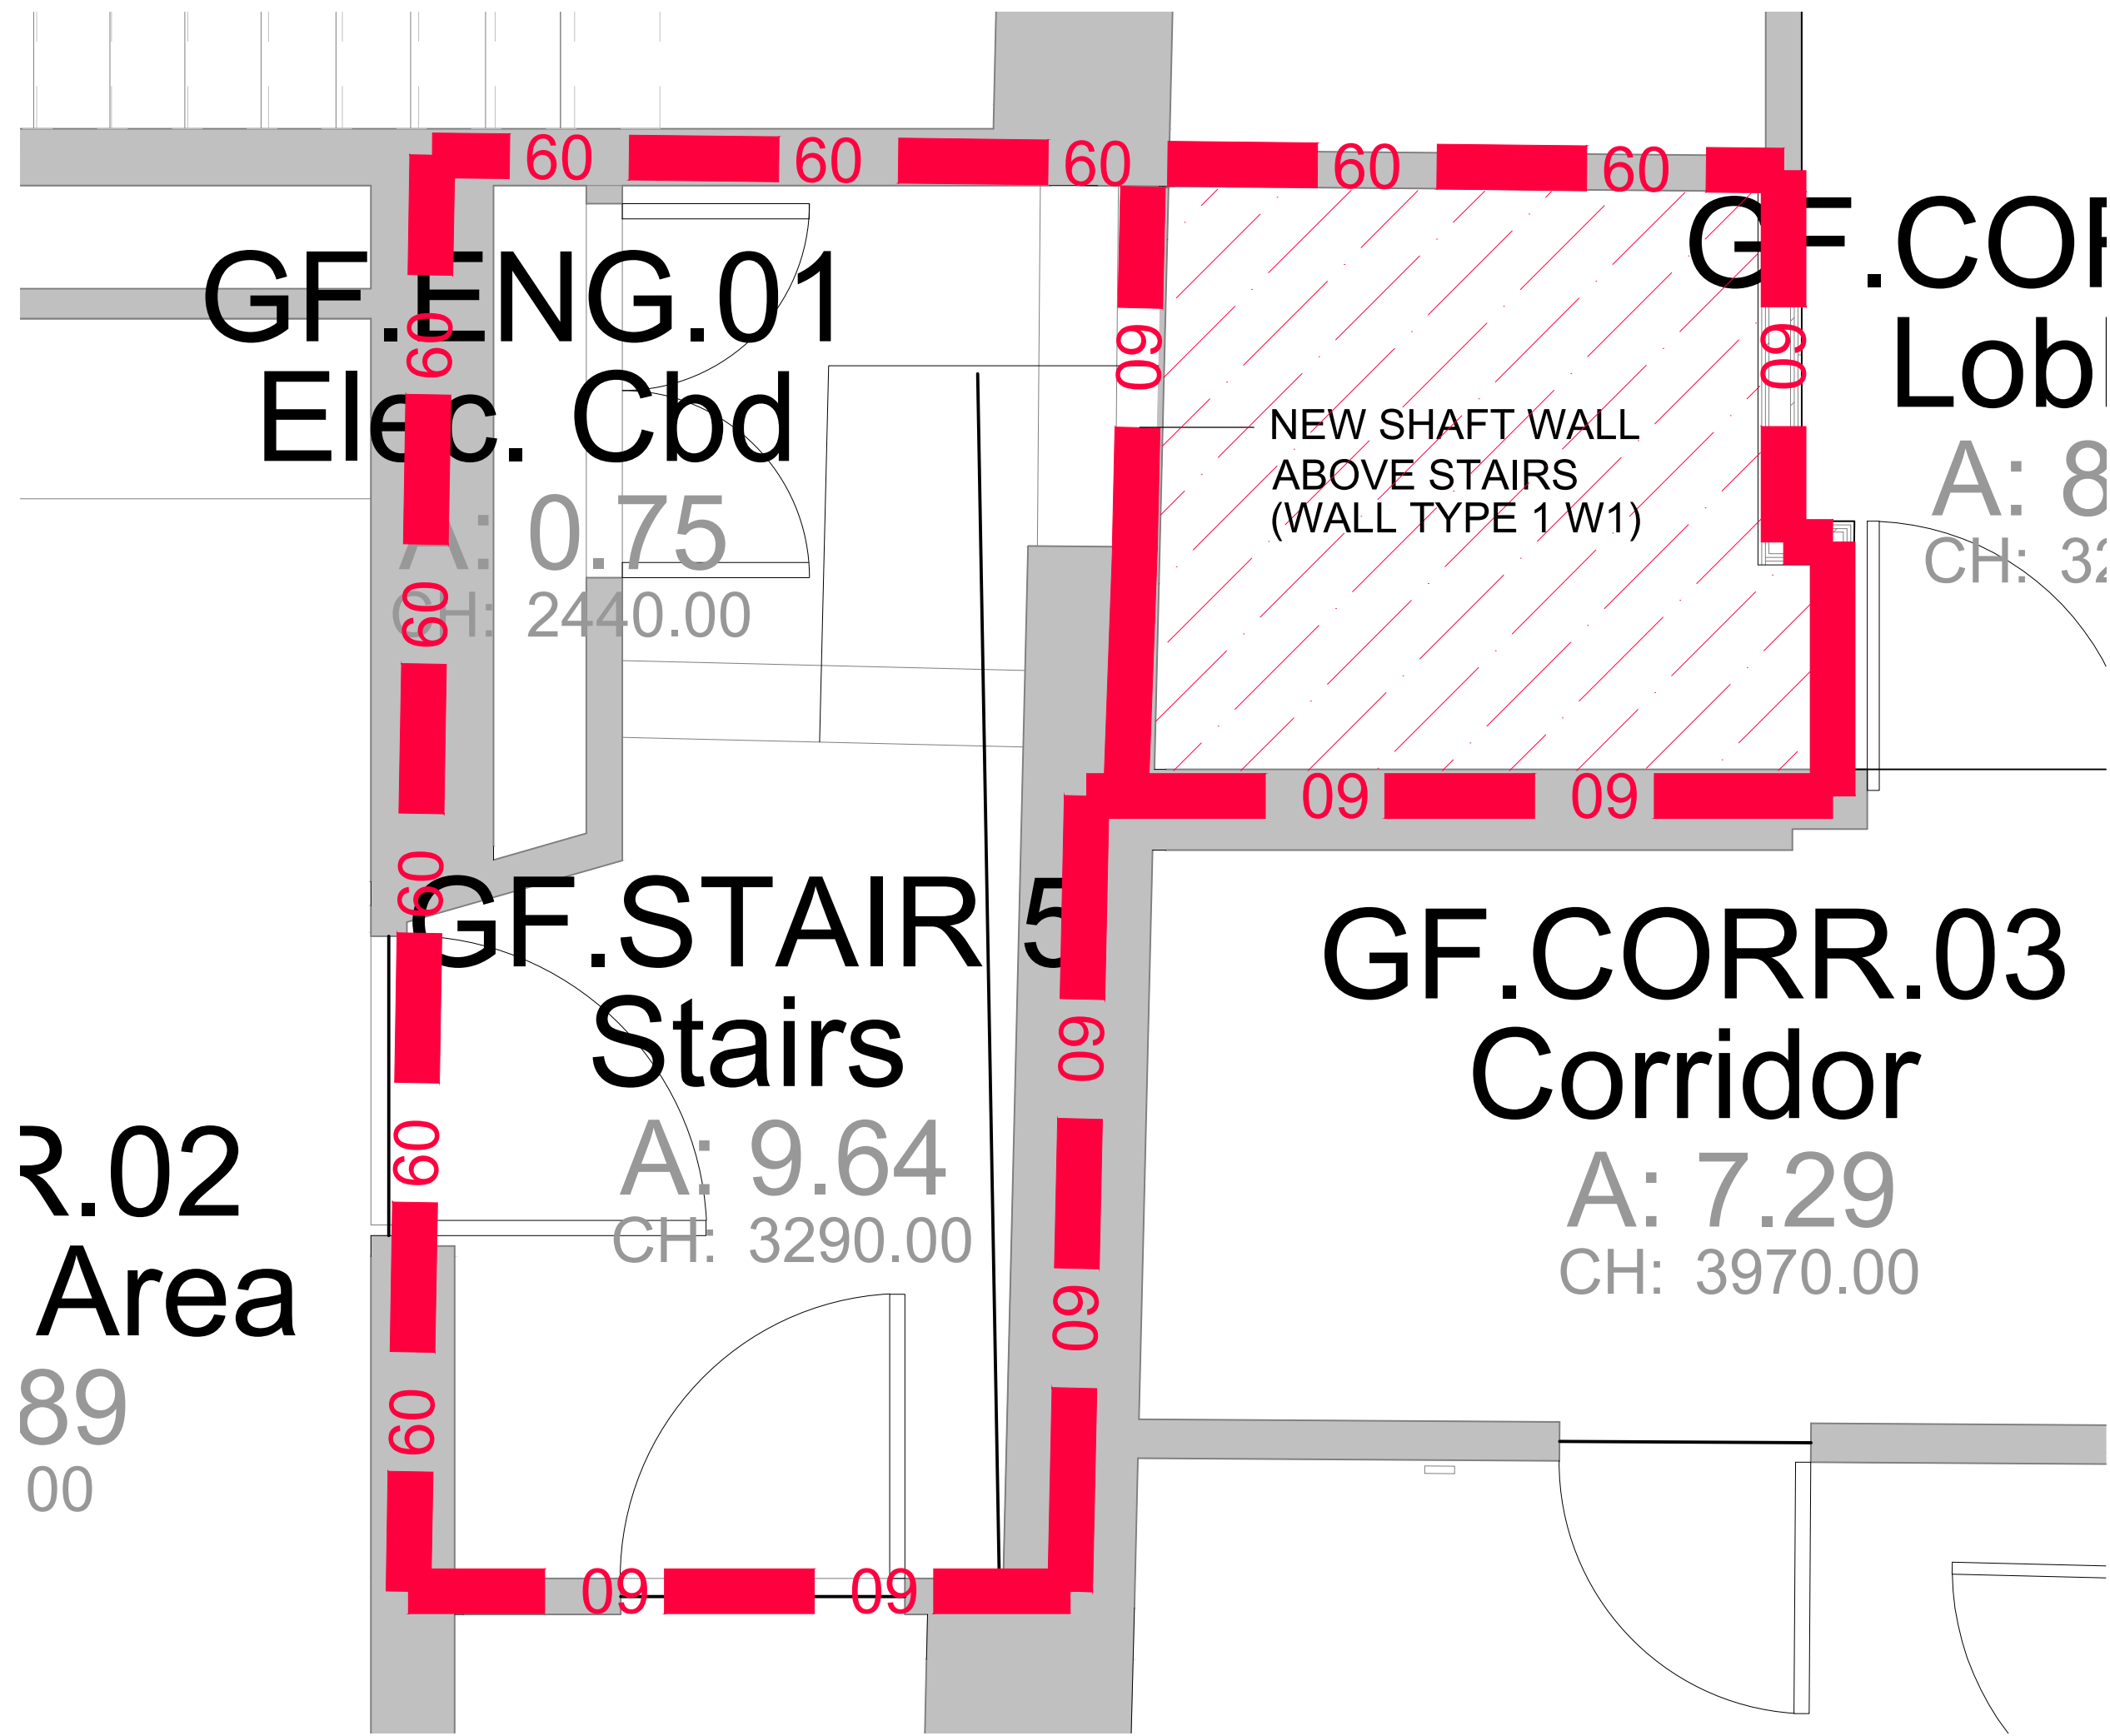

- Wall and Door Ratings
- 60 60 Minute fire resisting construction
 - 30 30 Minutes fire resisting construction
 - FD60s 60 minutes fire self closing and smoke resisting doorset
 - FD30s 30 minutes fire self closing and smoke resisting doorset
 - New FD30S Door and frame
 - New FD60s Door and frame
 - Existing Door Retained

- KEY
- SERVICES ON EITHER INDIVIDUAL SCREW RODS OR UNISTRUT.
 - SERVICES ON SUSPENDED BASKET OR TRAY
 - CABLE OR PIPE PENETRATIONS THROUGH SLAB
 - SD / PIR SMOKE OR PIR DETECTOR
 - SURFACE FIXED LIGHTING WITH CONDUIT

- NOTES:
1. ALL SMOKE DETECTORS WILL REQUIRE TEMPORARY REMOVAL FOR REFITTING AGAINST NEW CEILING LINING.
 2. UNI STRUT AND SCREW RODS TO REMAIN IN PLACE FOR FITTING NEW CEILING AROUND WITH FR SEALANT AROUND RODS.
 3. NEW WALLS AROUND SERVICES WILL REQUIRE SEALING WITH ABLATIVE BATTS AND FR SEALANT.
 4. ALL ELECTRICAL PENETRATIONS (UPTO 40MMØ I.E DATA, SMOKE LIGHTING) AROUND EXISTING SERVICES WILL REQUIRE FR SEALANT.
 5. ALL MECHANICAL SERVICES ABOVE 40MM Ø (I.E. HEATING PIPES, SOIL/RWP PIPES) WILL REQUIRE A FR60 FIRE COLLAR FITTING IN THE NEW CEILING.

- TYPE 1
AREA OF CEILING TO BE UNDERDRAWN USING:
- METAL MESH, (CHICKEN WIRE) FIXED IN ACCORDANCE WITH MANUFACTURER INSTRUCTIONS. 38X3MM SWD BATTENS (OR MF GRID AT 610MM CENTRES, 2 LAYERS OF 12.5MM FIRELINE PLASTERBOARD, ALL BOARD JOINTS AND JUNCTIONS FILLED WITH BONDING PRIOR TO 2MM SKIM PLASTER FINISH.
- NB: BULKHEADS AROUND TOP OPENING LIGHTS REQUIRED IN OFFICE ROOMS GF13 AND GF14 TO MAINTAIN HISTORIC FABRIC.

- WALL TYPE W1
SHAFTWALL - NBS K10 - 255
BOARD TYPE: 19mm Coreboard and 2x15mm FireLine+skim room side
STUDS TYPE: Gypframe 60 | 70 at 600mm centres
ACOUSTIC: Rw45 - 25mm Isover Acoustic Partition Roll (APR 1200)
FIRE: 60mins
Bg Ref.A206197s



KEY

REVISIONS	-	FIRST_ISSUE_FOR_PLANNING	09/04/21	TB	LM
DATE: DRAWN: CHECK					

CLIENT	Manchester Metropolitan University
PROJECT	Ormond Building
TITLE	PROPOSED GROUND FLOOR STAIR ENCLOSURES
NUMBER	20608_P222
REVISION	-
STATUS	PLANNING
SCALE	1:100 @A1
DATE	05/03/21
DRAWN BY	TB
CHECKED BY	SG

seven.

SEVENARCHITECTURE.CO.UK

Studios at:
61 Oxford Street,
MANCHESTER, M1 6EQ
t: 0161 236 5655
Clarendon House, Victoria Avenue,
HARROGATE, HG1 1DY
t: 01423 709 807
Galeri 6, Doc Factory,
CAERNARFON, LL55 1SQ
t: 01296 685 253
24 Grenville Street,
LONDON, EC1N 6SS
t: 0203 036 0691