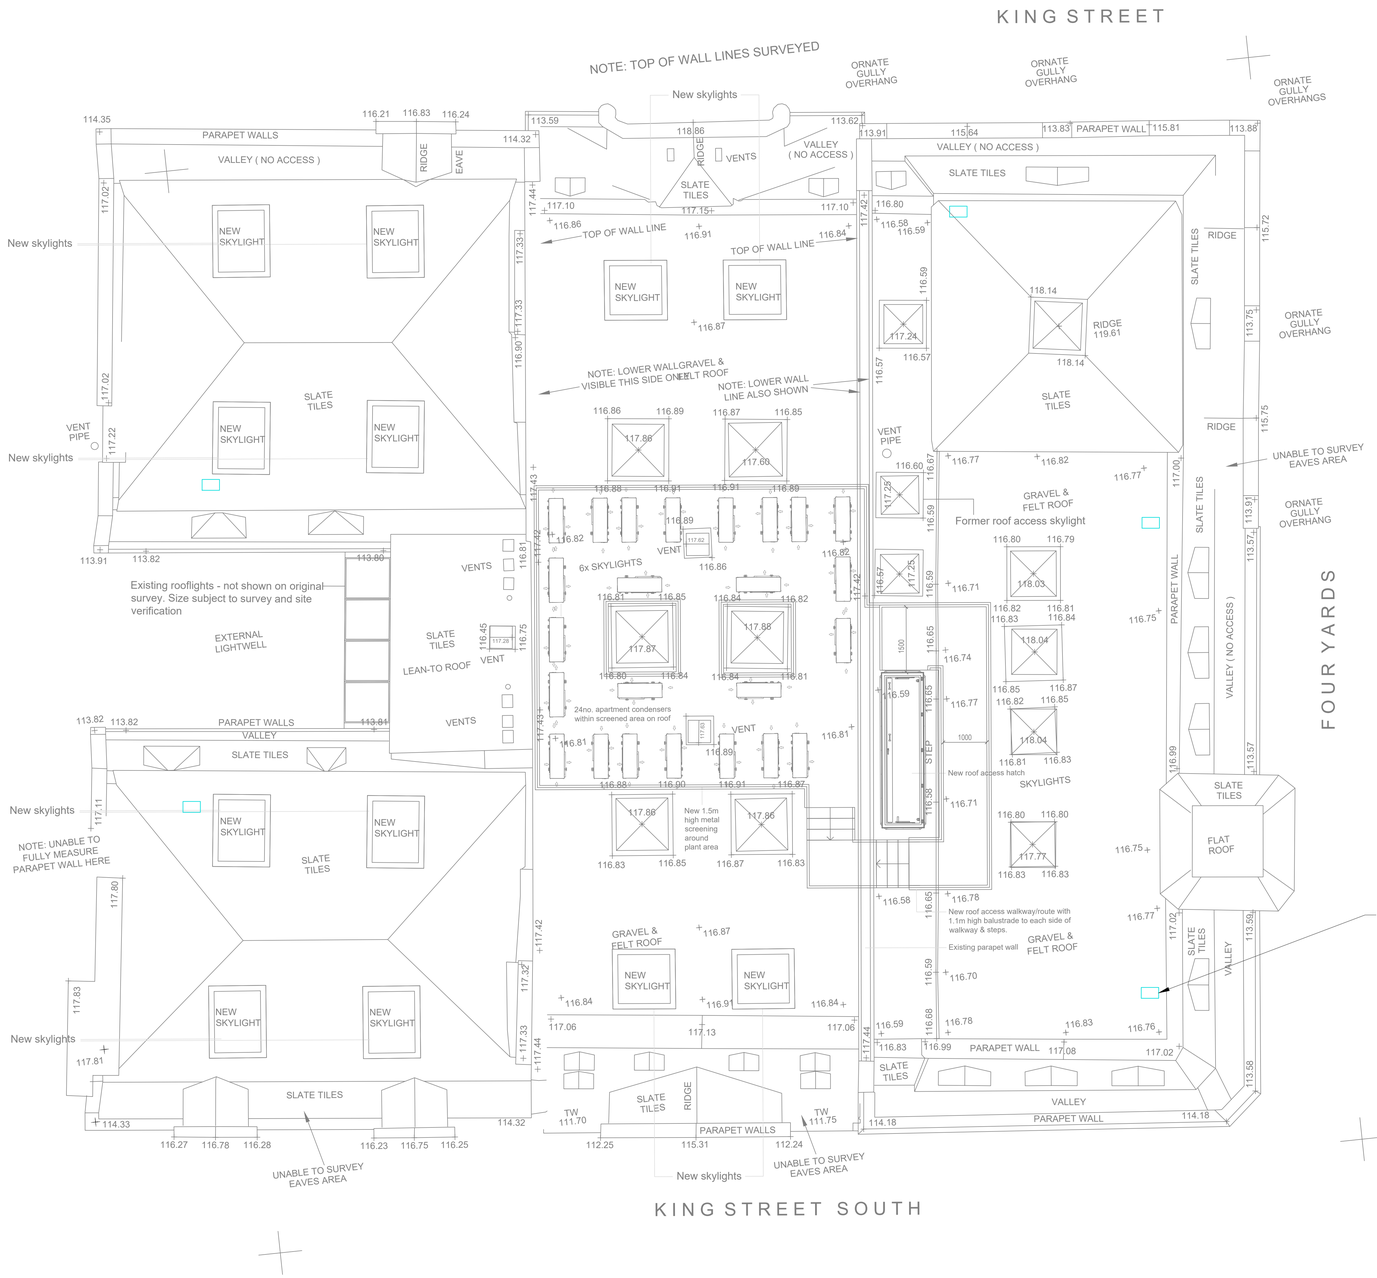


NOTES


1. This drawing must be read in conjunction with all other M&E drawings, specifications, schedules and other designers' information

2. Do not scale from this drawing

3. Refer to the Peters Hay Mechanical and Electrical Specifications and Prelims documents for technical requirements

4. Refer to the architect's specification for sanitary ware, taps, wastes, water boilers and showers

5. Wall mounted controllers to be positioned for wheelchair users



6. Electric water heaters to be supplied and fitted with manufacturer's unvented mains connection kit including expansion vessels and safety valves

7. Bath and shower rooms to have electric towel rails shown thus Towel rail

8. All sanitary fittings to have local isolation valves

9. Bedrooms and living rooms to have heat pump units




10. 140 l electric hot water cylinders within the airing cupboard



11. 3kW electric heater serving the kitchen sink

12. Mechanical ventilation unit with heat recovery (MVHR) mounted in the ceiling void supplies air to habitable rooms and extracts from wet rooms and kitchens



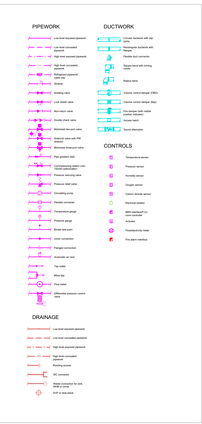

PETERSHAY

EDINBURGH
Suite 1a Fleming House
Fleming Road
Livingston
EH54 7BN
++44(0) 7876 751945

MANCHESTER
7 Garnett Lane
Davenport
Stockport
SK3 8SS
++44(0) 7500 908333

Drawn by:	**AP**
Reviewed by:	**JH**
Drawn date:	**December 2020**
Scale:	**1:50 @A0**
Client:	**DTZI**
PHL Project number:	**1176**
Project title:	**58-64 King Street Manchester**
Drawing title:	**Ventilation - roof**
Drawing number:	**1176-PHL-KS-1-DR-M-408**

Rev	Description	Date	By
P1	Stage 3	18 Dec 2020	AP