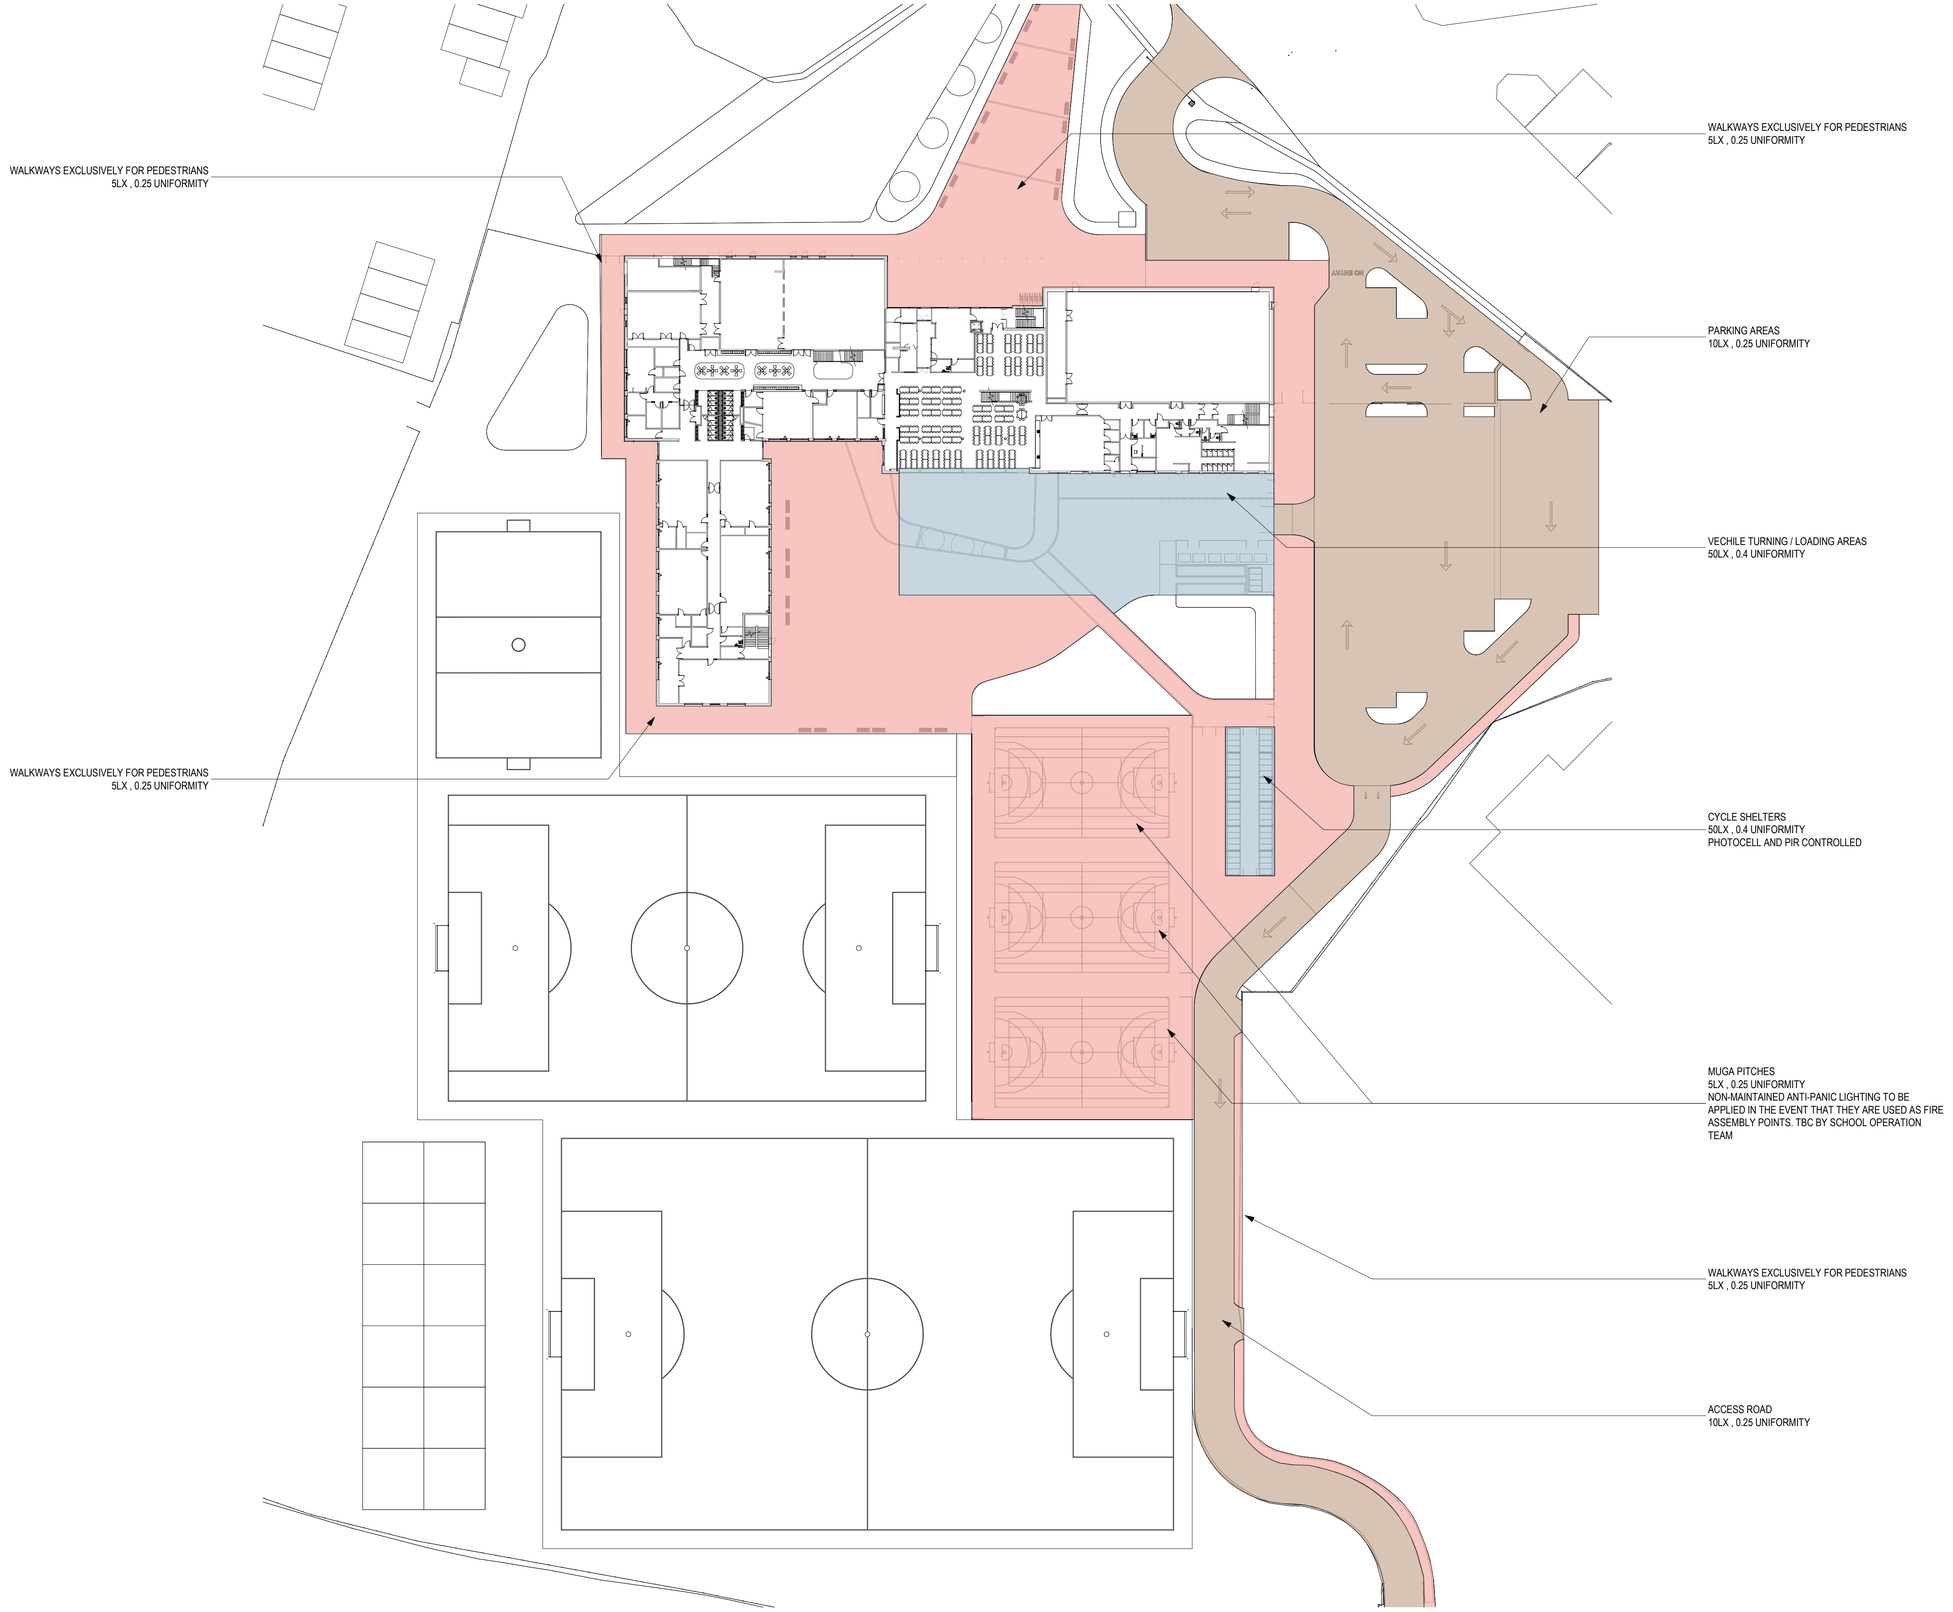


BUILDING DESIGN PARTNERSHIP SHALL HAVE NO RESPONSIBILITY FOR ANY USE MADE OF THIS DOCUMENT OTHER THAN FOR THAT WHICH IT WAS PREPARED AND ISSUED.

ALL DIMENSIONS SHOULD BE CHECKED ON SITE.

DO NOT SCALE FROM THIS DRAWING

ANY DRAWING ERRORS OR DIVERGENCIES SHOULD BE BROUGHT TO THE ATTENTION OF BUILDING DESIGN PARTNERSHIP AT THE ADDRESS SHOWN BELOW.

DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE FOLLOWING BEFORE WORK COMMENCES:
- THE CDM DESIGN ISSUES REGISTER
- THE BDP RISK SERIES OF DRAWINGS.
- THE PROJECT CDM RISK REGISTER

NOTES

1) LIGHTING QUANTITIES TO BE CONFIRMED AT NEXT DESIGN STAGE.

LIGHTING ZONE

- 5 LUX
- 10 LUX
- 50 LUX

INDICATIVE LIGHTING TYPES


360º BOLLARD LIGHT FITTING


ASYMMETRIC FLOODLIGHT


LED POST TOP LUMINAIRE


WALL MOUNTED CONICAL LUMINAIRE

REVISION	DATE	DESCRIPTION	DRN	CHK
P02	21/01/08	Externals Layout Update	JC	AR
P01	21/01/04	Stage 2 Planning Issue	JC	AR

THE DESIGN ILLUSTRATED UPON THIS DRAWING HAS BEEN COORDINATED WITH THE FOLLOWING MODELS:

DATE	MODEL NAME
07/01/2021	08191-SPACE-01-ZZ-M3-A-0001
07/01/2021	08191-SPACE-01-ZZ-M3-L-0001

KEYPLAN

CLIENT

BDP.

11 Ducie Street
PO Box 85
Piccadilly Basin
Manchester
M60 3JA
United Kingdom

T +44 [0]161 828 2200
www.bdp.com

PROJECT TITLE
Hyde Road School

BDP JOB NUMBER
P3001502

DRAWING TITLE
Lighting Systems Strategy
External

SCALE @ A1
As indicated

DISCIPLINE
E

DATE ISSUED
21/01/08

DRAWING NO.
HRS-BDP-EX-00-PL-E-6301

REVISION
P02