


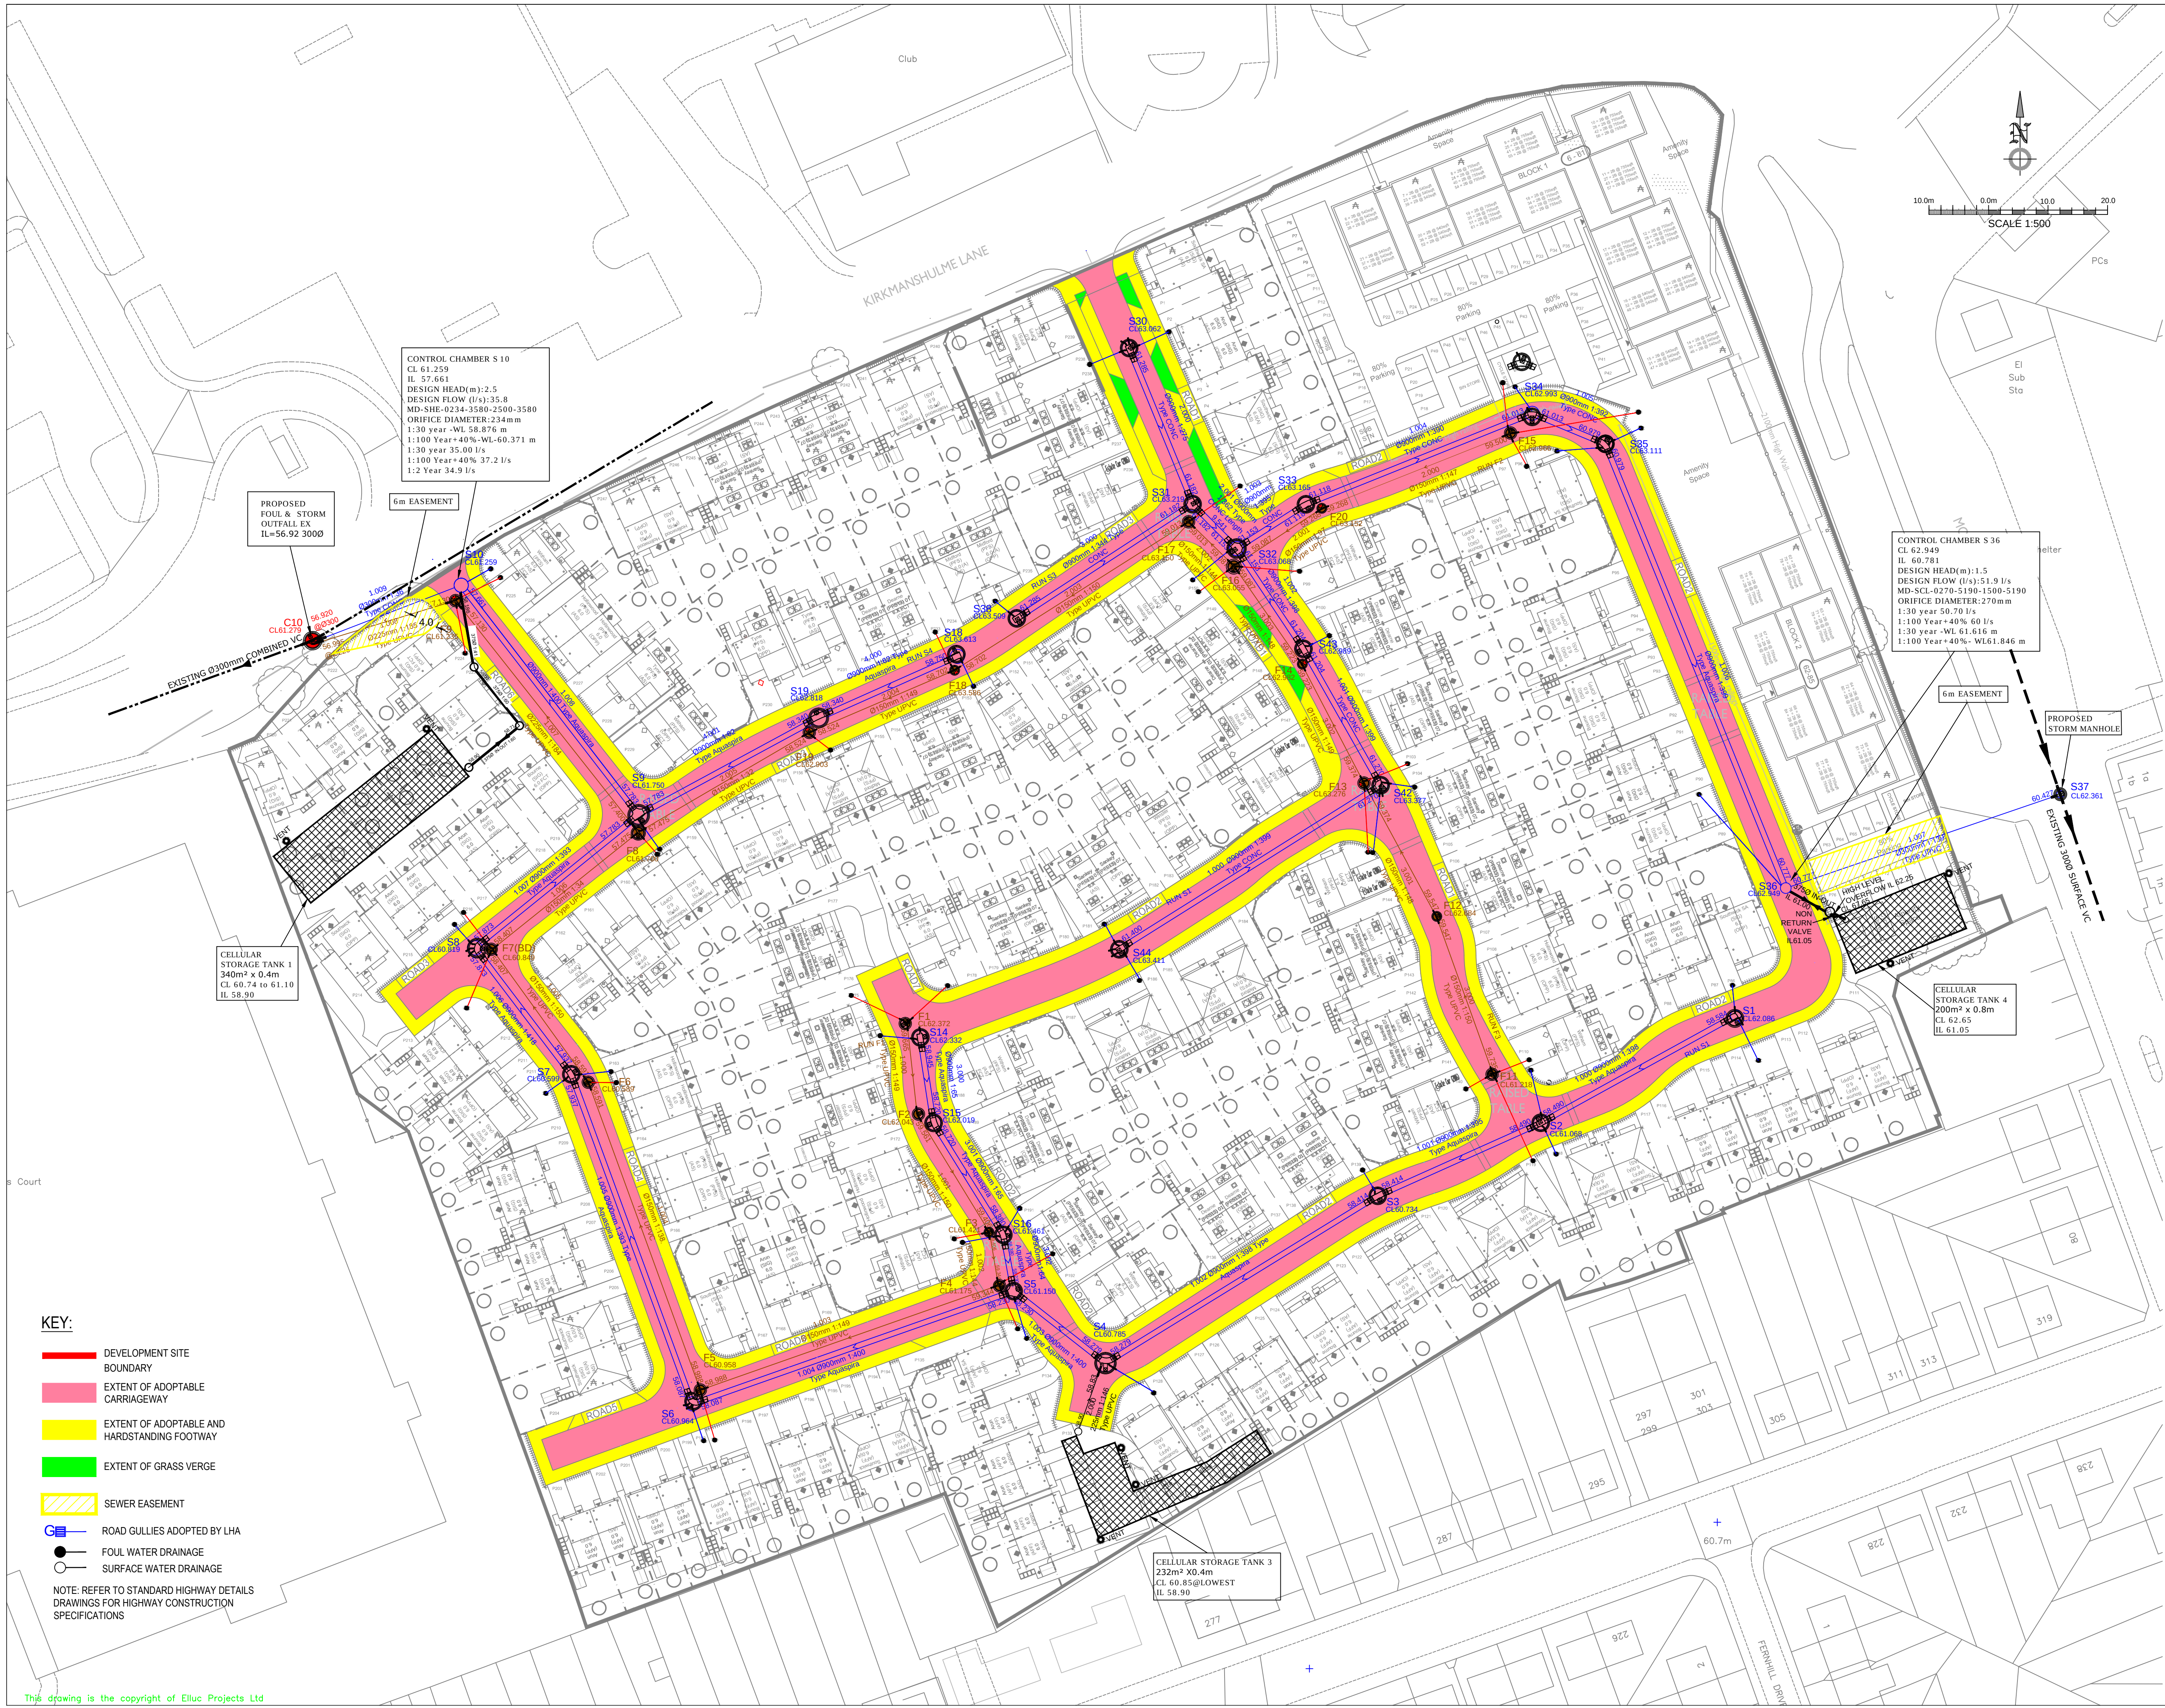

KEY:

- DEVELOPMENT SITE BOUNDARY
- EXTENT OF ADOPTABLE CARRIAGEWAY
- EXTENT OF ADOPTABLE AND HARDSTANDING FOOTWAY
- EXTENT OF GRASS VERGE
- SEWER EASEMENT
- ROAD GULLIES ADOPTED BY LHA
- FOUL WATER DRAINAGE
- SURFACE WATER DRAINAGE

NOTE: REFER TO STANDARD HIGHWAY DETAILS DRAWINGS FOR HIGHWAY CONSTRUCTION SPECIFICATIONS

- NOTES:**
1. ALL ADOPTABLE DRAINAGE WORKS HAVE BEEN DESIGNED AND ARE TO BE CONSTRUCTED IN ACCORDANCE WITH "SEWERS FOR ADOPTION 6TH EDITION" AND UU SUPPLEMENT GUIDELINES AND STANDARD DETAILS
 2. ALL CLAY PIPE WORK SHALL BE EXTRA STRENGTH CLAYWARE TO B.S EN 295:1991 PART 1
 3. ALL PRECAST CONCRETE PIPEWORK SHALL BE TO THE CLASS STATED ON THE DRAWINGS IN ACCORDANCE WITH B.S EN 1916:2002. ALSO, ALL MANHOLES AND CHAMBERS SHALL BE TO B.S EN 1917:2002
 4. THE CONTRACTOR MAY ELECT TO USE REINFORCED PVC PIPES AS COVERED BY B.S 4660:2000 & B.S EN 1401-1. STRUCTURED WALL UPVC PIPES TO COMPLY WITH WIS 4-35-01 UPTO AND INCLUDING 300MM. (BY PRIOR AGREEMENT WITH ADOPTING AUTHORITY) MAX. PIPE LENGTH TO BE 3.0M
 5. ALL LEVELS RELATE TO TOPOGRAPHICAL SURVEY DATUM
 6. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS
 7. PLOT DRAINAGE CONNECTIONS TO SEWERS MUST BE 150MM DIAMETER AND UNLESS OTHERWISE STATED LAID TO THE INVERT SHOWN.
 8. LEVELS GIVEN ON DRAGOUT CHAMBERS ARE INCOMING PIPE LEVELS
 9. PLOT DRAINAGE RUNS TO BE KEPT WITHIN THE CURTLAGGE OF THE PLOT THEY SERVE WHEREVER POSSIBLE.
 10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT ANY EXISTING INVERT LEVELS AND EXISTING SITE LEVELS (EXISTING BOUNDARY LEVELS) INDICATED ON DRAWINGS ARE CORRECT BEFORE WORKS COMMENCE.
 11. ALL CONNECTIONS TO ADOPTABLE SEWERS SHALL BE MANUFACTURED JUNCTION PIPES. SADDLE CONNECTIONS WILL NOT BE PERMITTED, UNLESS SPECIFIED.
 12. ALL SEWERS FOR ADOPTION WITH GREATER THAN 1.20M COVER IN ROADS OR 0.9M COVER IN FIELDS SHALL HAVE CLASS S GRANULAR BED AND SURROUND.
 13. ANY SEWER FOR ADOPTION WITH LESS THAN 1.2M COVER IN ROADS OR 0.9M COVER IN FIELDS SHALL HAVE A MINIMUM OF 150MM ST4 CONCRETE SURROUND. FLEXIBILITY SHALL BE MAINTAINED BY THE PROVISION OF FLEXCELL OR SIMILAR APPROVED JOINT FILLER BREAKS IN THE CONCRETE SURROUND AT EACH PIPE JOINT
 14. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK ALL ONSITE EXISTING GROUND LEVELS PRIOR TO COMMENCING AND IF THERE ARE ANY DISCREPANCIES THE CONTRACTOR MUST REPORT TO THE ENGINEER IMMEDIATELY
 15. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE DRAINAGE AUTHORITY OF THE COMMENCEMENT OF ANY DRAINAGE WORKS AND TO COMPLETE ANY REQUIRED SEWER CONNECTION FORMS INCLUSIVE OF PAYING ANY REQUIRED FEES. THE CONTRACTOR MUST ALLOW FOR THE SUPERVISION OF THE SEWER CONSTRUCTION WORKS BY THE LOCAL AUTHORITY AND NOTIFY THE SUPERVISING OFFICER, GIVING NOTICE WHICH IN ACCORDANCE WORTH THE L.A REQUIREMENTS.
 16. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO APPLY FOR ANY REQUIRED ROAD OPENING PERMITS WITH THE LOCAL AUTHORITY INCLUDING THE PAYMENT OF ANY FEES
 17. BEFORE COMMENCING ANY WORKS ON SITE, THE CONTRACTOR MUST CONTACT THE RELEVANT STATUTORY UNDERTAKER AND BE IN POSSESSION OF THE LATEST AVAILABLE DRAWINGS FROM THE STATUTORY UNDERTAKERS WHICH SHOWS DETAILS OF THEIR SERVICES/APPARATUS. THE CONTRACTOR MUST CONFIRM EXACT LOCATION AND DEPTH OF ANY SERVICES/APPARATUS BY THE USE OF ELECTRO-LOCATION OR SIMILAR DEVICES AND BY HAND DUG TRIAL HOLES. MECHANICAL EXCAVATOR, POWER TOOLS ETC. MUST NOT BE USED TO LOCATE EXISTING SERVICES/APPARATUS.

D	MAIN DRAINAGE REVISED TO UU COMMENTS	23.07.2020	ARA	ARA
C	HATCHING AMENDED TO ROAD 5 EXTENSION AND NEW LAYOUT	03.12.2018	CDW	ARA
B	TANK 2 OMITTED, TANK 1 UPSIZED & RE-LOCATED TO CLIENT'S COMMENTS	02.09.2018	CDW	ARA
A	SECTION 38 EXTENTS AMENDED TO NEW SITE LAYOUT	27.08.2018	CDW	ARA
Rev.	Description:	Date:	By:	Chkd:

APPROVAL

Client: **COUNTRYSIDE PROPERTIES**

Project: **BELLE VUE GREYHOUND TRACK GORTON**

Dwg Title: **SECTION 38 PLAN**

ELLUC Projects

ELLUC PROJECTS
7 REGENTS COURT
FARMOR LANE
REDDITCH
B96 0SD

t: (01527) 52 000 1
info@ellucprojects.co.uk
www.ellucprojects.co.uk

Scale:	Size:	First Issue:	Drawn:	Checked:
1:500	A1	MAR 2019	CDW	ARA
Dwg No:	ELL-18039-B-C-500			Rev: D