



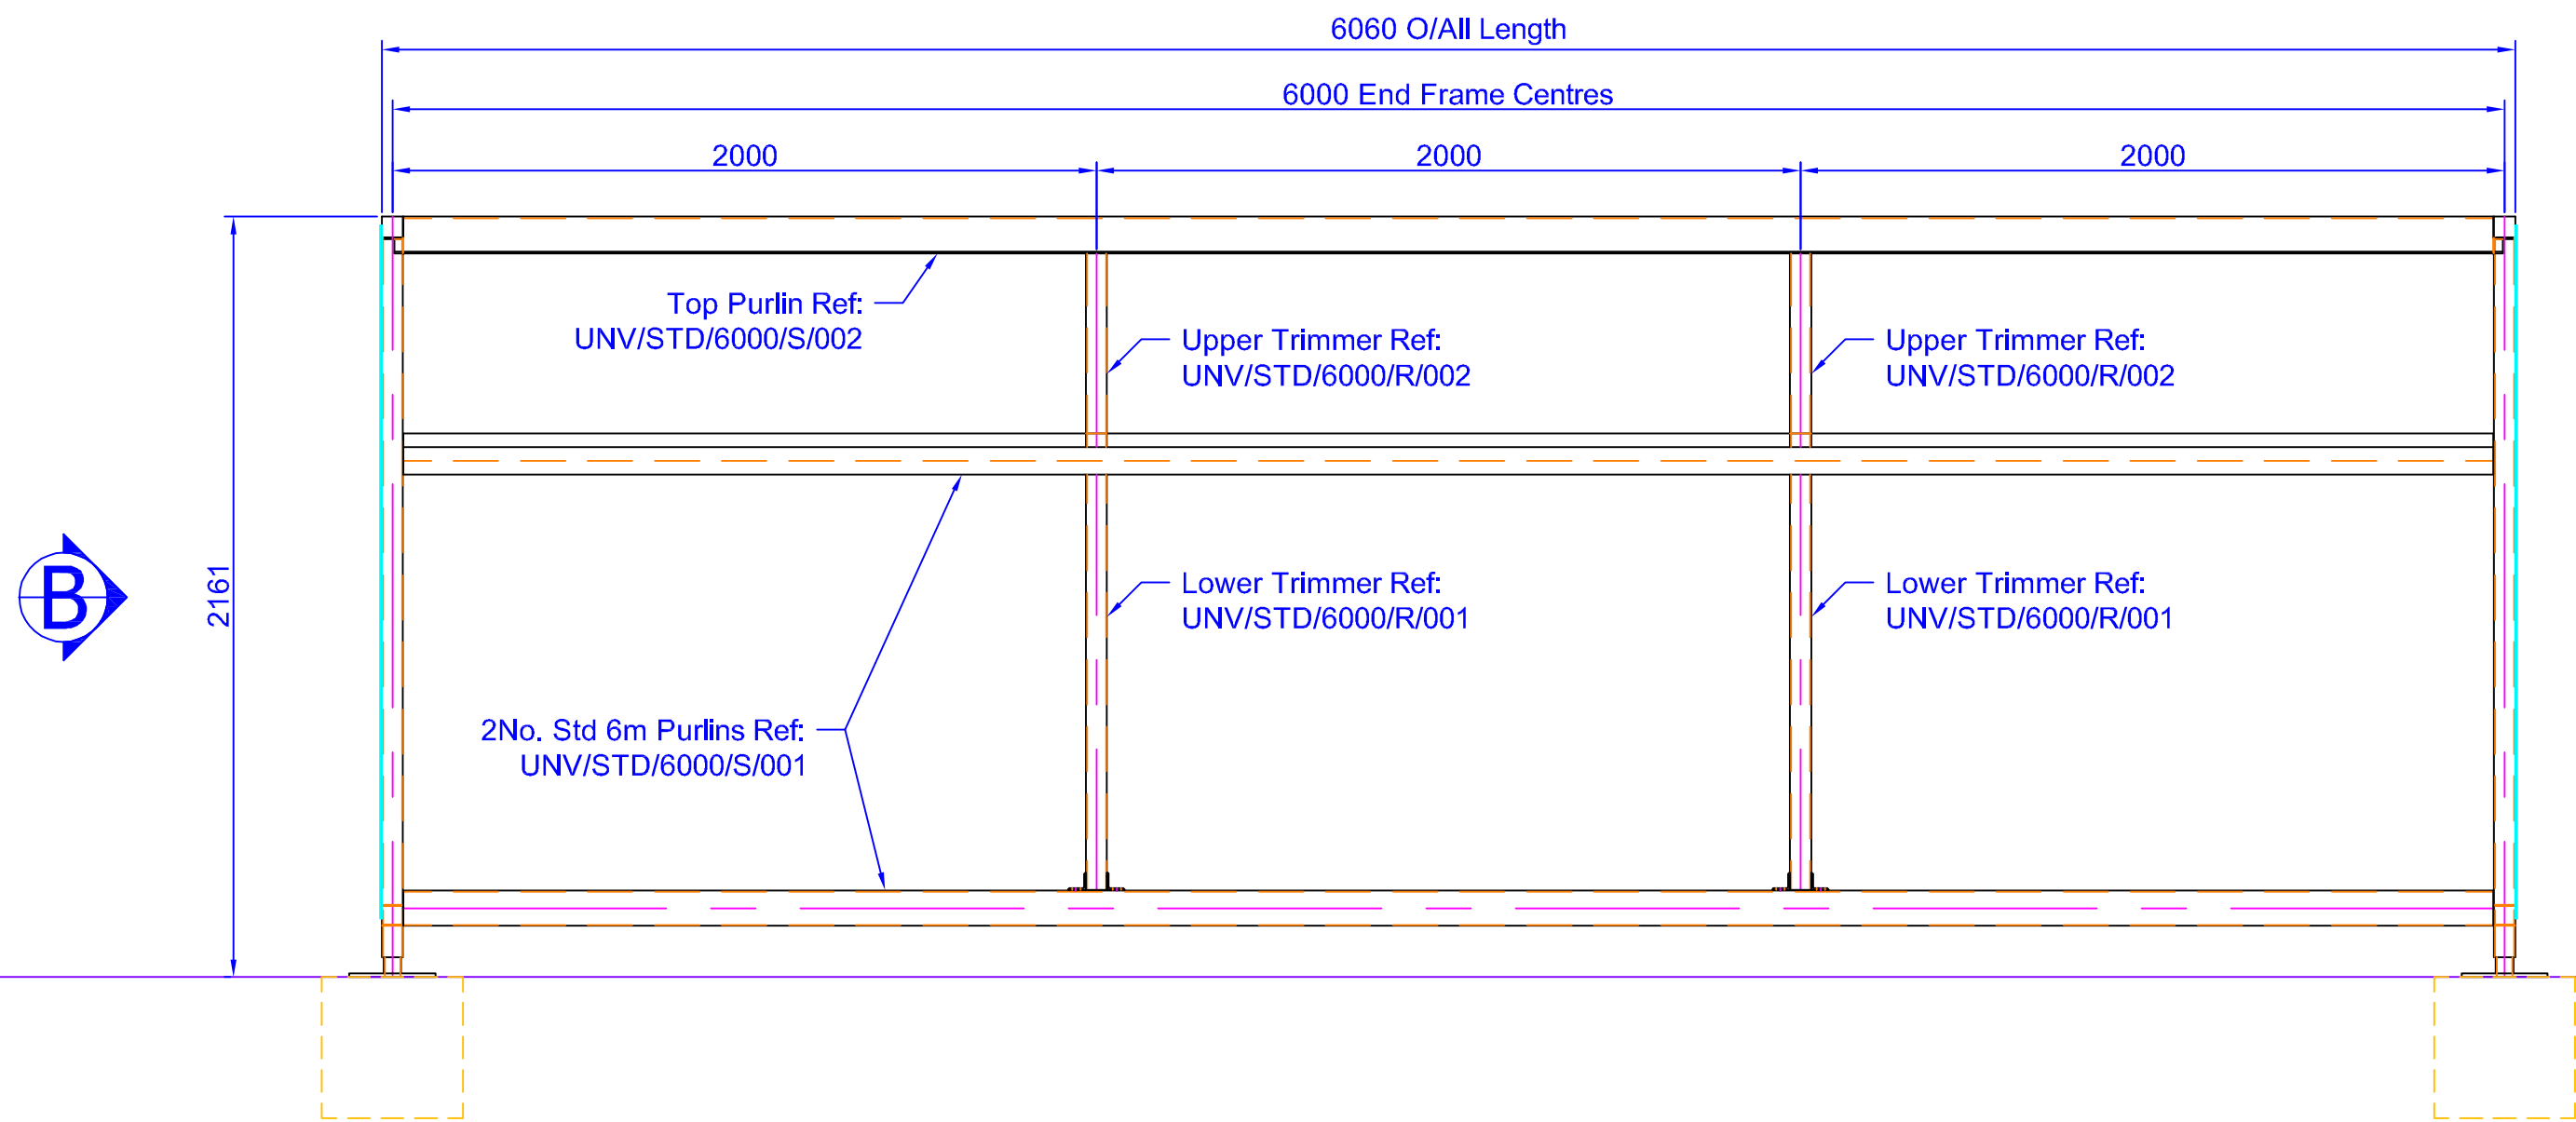


View on 'A'

Scale: 1:20 @ A1

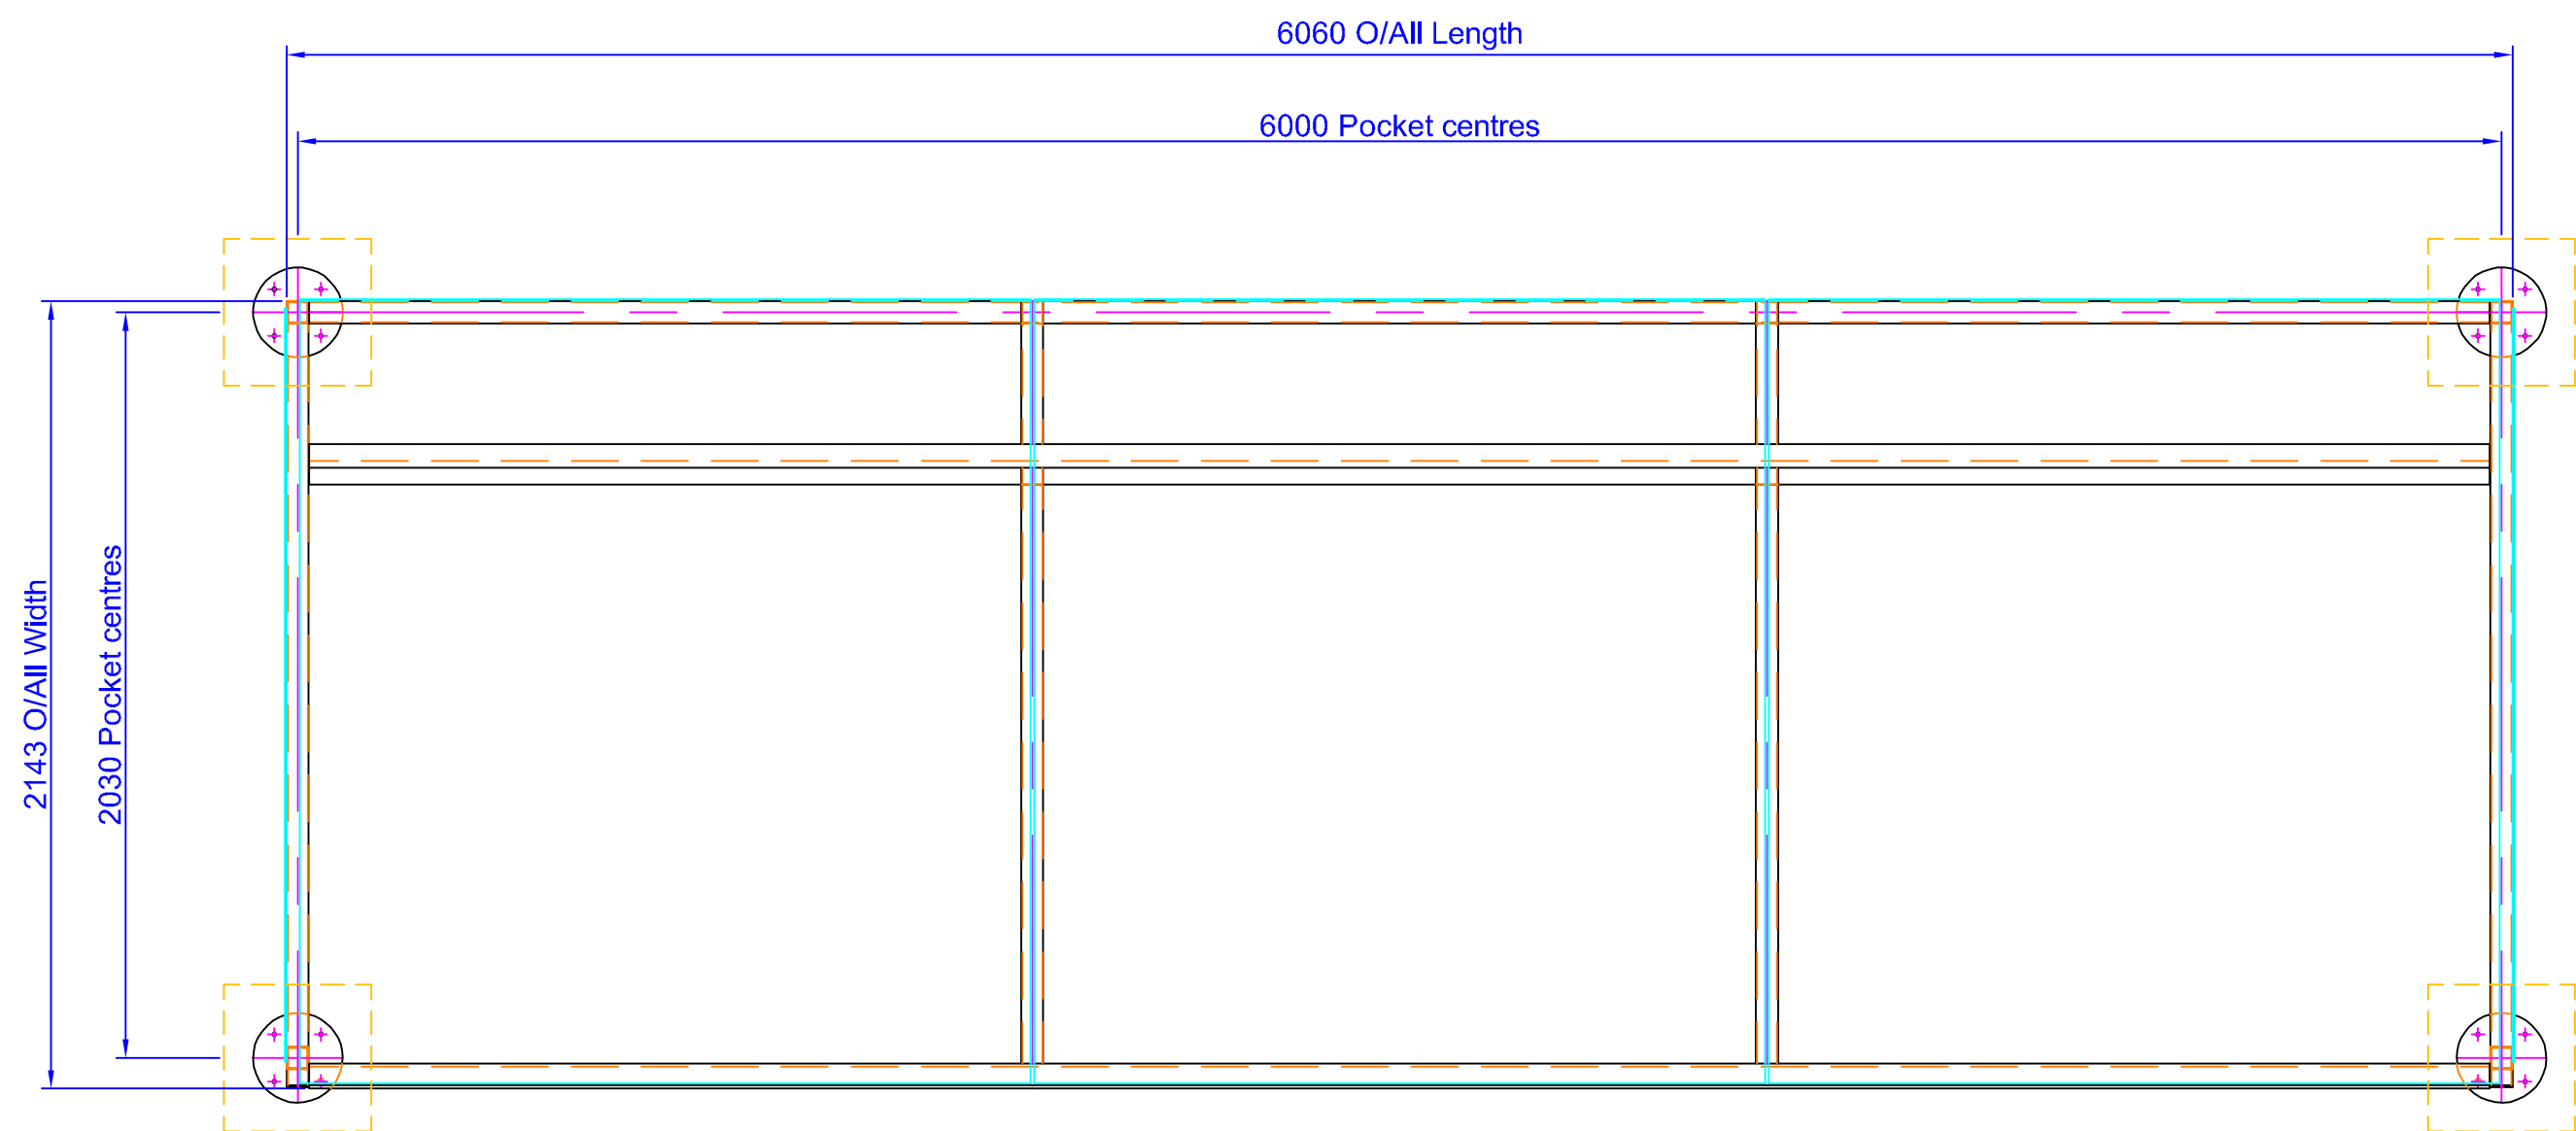

Plan View

Scale: 1:20 @ A1

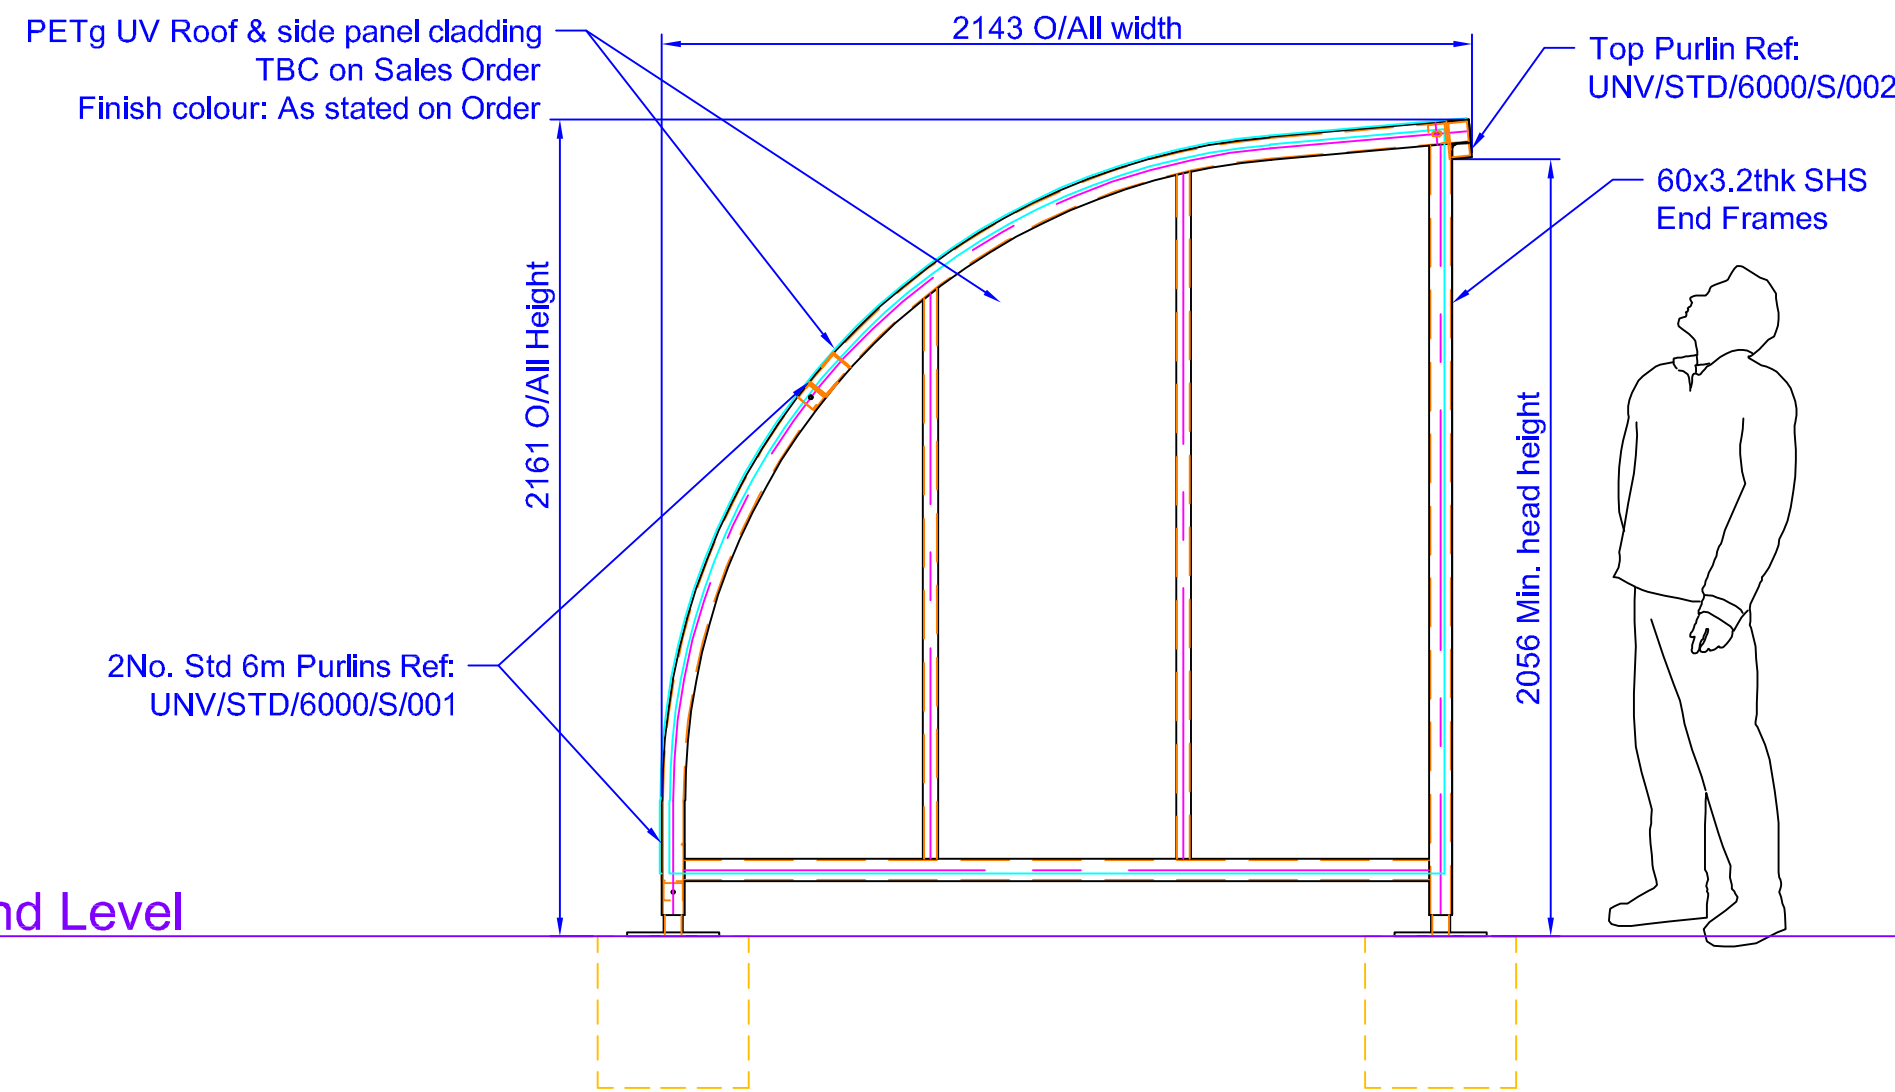

View on 'B'

Scale: 1:20 @ A1

Ground Level

Disclaimer

Please Note That Due To A Survey Not Being Performed By Broxap, The Position Of The Shelter Is To Be Advised By The Client

The Client Must Ensure That The Location In Which The Shelter Is To Be Installed Is Of Sufficient Size To Enable The Shelter To Be Fitted With Out Complication Or Impediment From Buildings, Walls Or Any Free Standing Structures In The Vicinity. The Client Is Also Responsible For The Legs Of The Shelter Being Positioned So Not To Foul With Any Drains, Services, Manhole Covers Or Underground Foundations.

Broxap Ltd May Be Contacted Should You Wish To Discuss Shelter Location Or Site Suitability, Alternatively Feel Free To Seek Independant Advice.

General Notes:
All dimensions are to be checked on site with allowances for variations due to normal manufacturing tolerance.

Drawing errors or omissions are to be reported and checked with the Design Office.

Where items are drawn as assemblies these items must be trial assembled in workshop by manufacturer to ensure correct fit.

None of the work content shown in this drawing for any company may proceed until approved copies are distributed and clearly marked "ISSUED FOR CONSTRUCTION"

This drawing is copyright and no portion should be copied or reproduced without the consent of Broxap Limited

Fabrication Tolerances
0mm - 1000mm = +/- 1.0mm
1001mm - 2500mm = +/- 1.5mm
2501mm - 5000mm = +/- 2.0mm
5001mm - 10000mm = +/- 2.5mm
Unless stated otherwise

Project Specific Notes:
Shelter Galvanised In Accordance With BS EN ISO 1461:2009 & Powder Coated.
Finish Colour To Be As Stated on Order

Roof Cladding To Be As Stated on Sales Order
Finish Colour To Be As Stated on Sales Order

Material Grade;
All Mild Steel Hollow Sections To Be S235 JRH Cold Rolled To BS EN 10219
All Mild Steel Plate To Be S275 JR Hot Rolled To BS EN 10025
All Mild Steel Rolled Angle To Be S275 JR Hot Rolled To BS EN 10025
All Mild Steel Flats To Be S275 JR Hot Rolled To BS EN 10025
All Welds To Be 5mm Fillet Welds Unless Otherwise Stated

Installation Notes
Steelwork To Be Installed To BS 5606:1990
Columns Position +/- 10mm Per Bay
Column Vertically +/- 5mm
Level At Eaves +/- 6mm
O/all Length +/- 5mm

Foundations To Be Installed
The Foundation Design Assumes That Passive Resistance Can Be Utilised From The Adjacent Well Compacted Hard-core Fill Around The Full Depth Of The Pads And The Net Allowable Ground Bearing Pressure Of 100 KN/m².

Concrete Grade To Be Gen 3 Min Strength C16/20 To BS 8500 (Equivalent To C20 Concrete).

Foundations To Be Installed To BS5606:1990
Foundation Position +/-25mm Per Bay
Foundation Level - +/- 10mm

C				
B				
A	Top Purlin 'Ref' amended & redrawn in AutoCAD	L.C	RMG	14/10/16
Rev.	Description	Drawn	Checked	Date

Drawing Status:
Construction Issue



Client :

Project :
Standard Products

Drawing Title :
General arrangement of Broxap's
Standard 6m 'Wardale' Shelter

Drawn:
L.C

Checked:
R.McGorie

Date : 12/10/16 Scale : 1:20 @ A1

Drawing No :
UNV/WAR/6000/STD/100

Rev. No :
A

Broxap Order No :