LOWER GROUND FLOOR

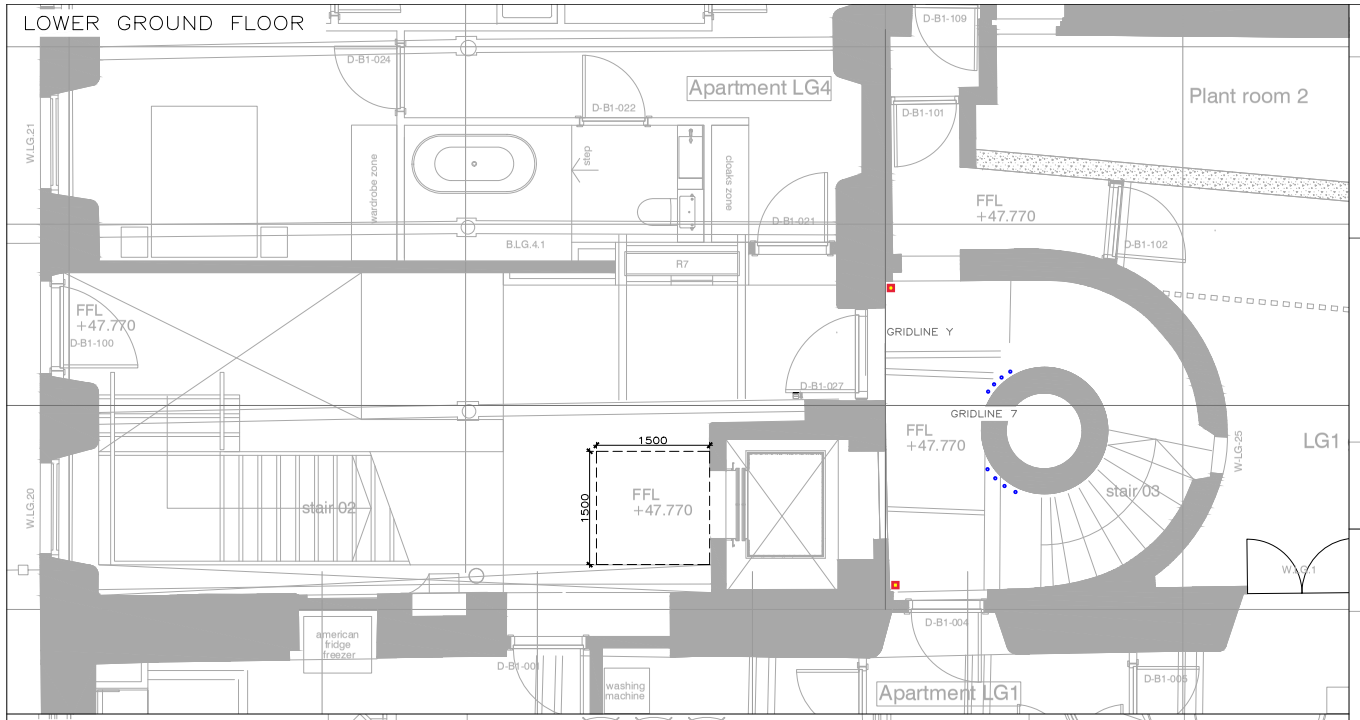

GROUND FLOOR

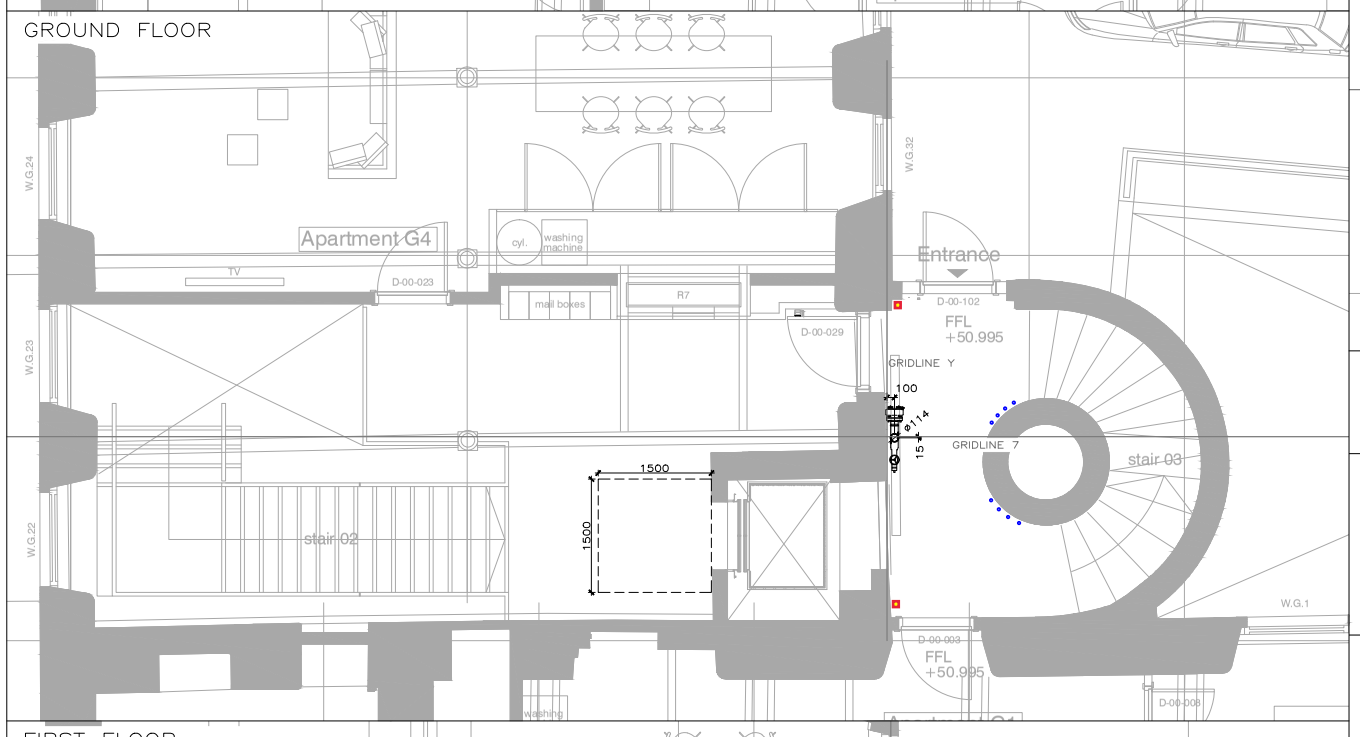

FIRST FLOOR

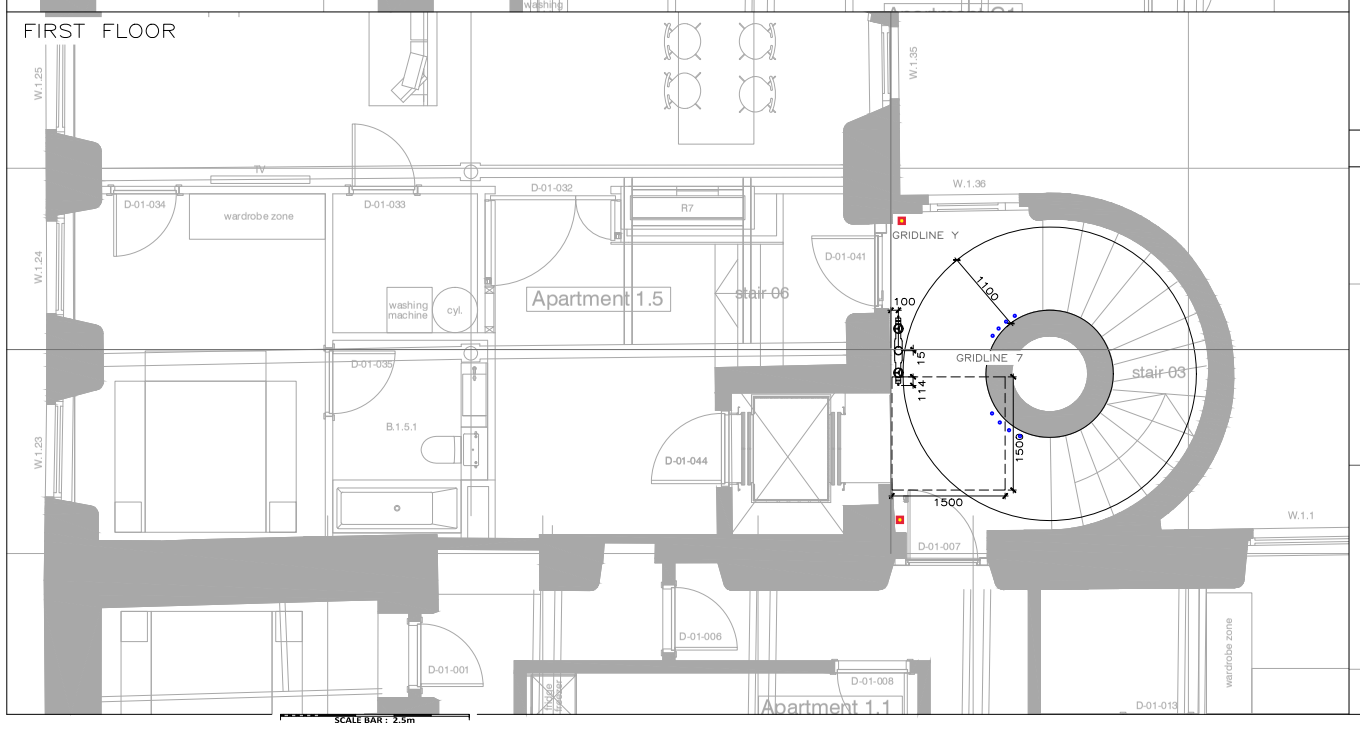

SCALE BAR : 2.5m

SECOND FLOOR

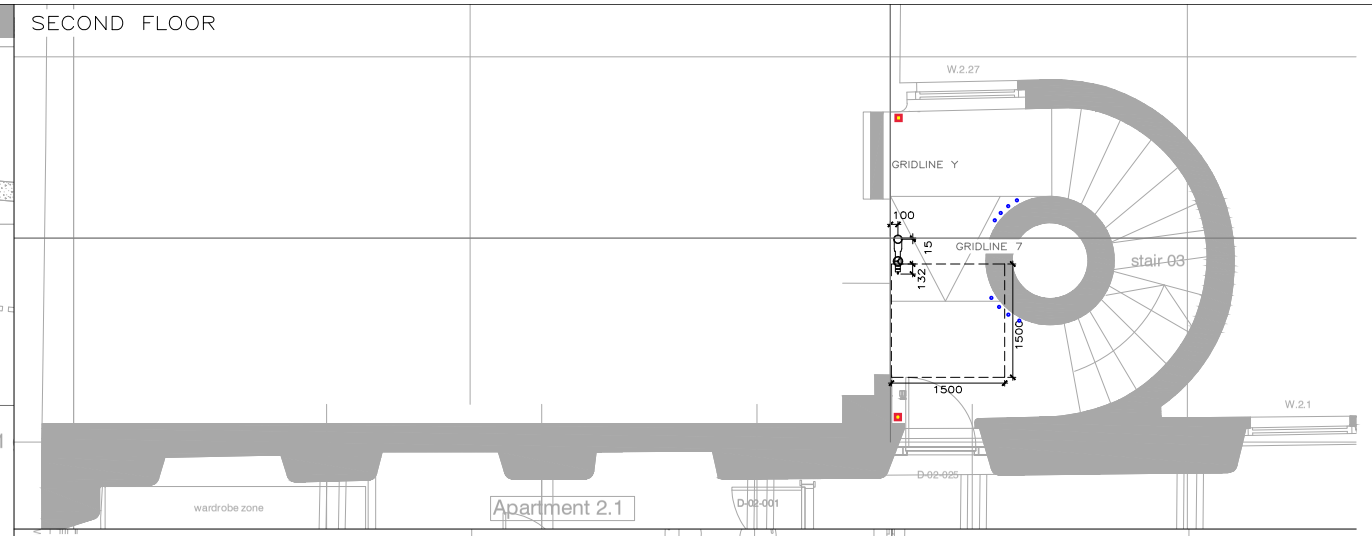

THIRD FLOOR

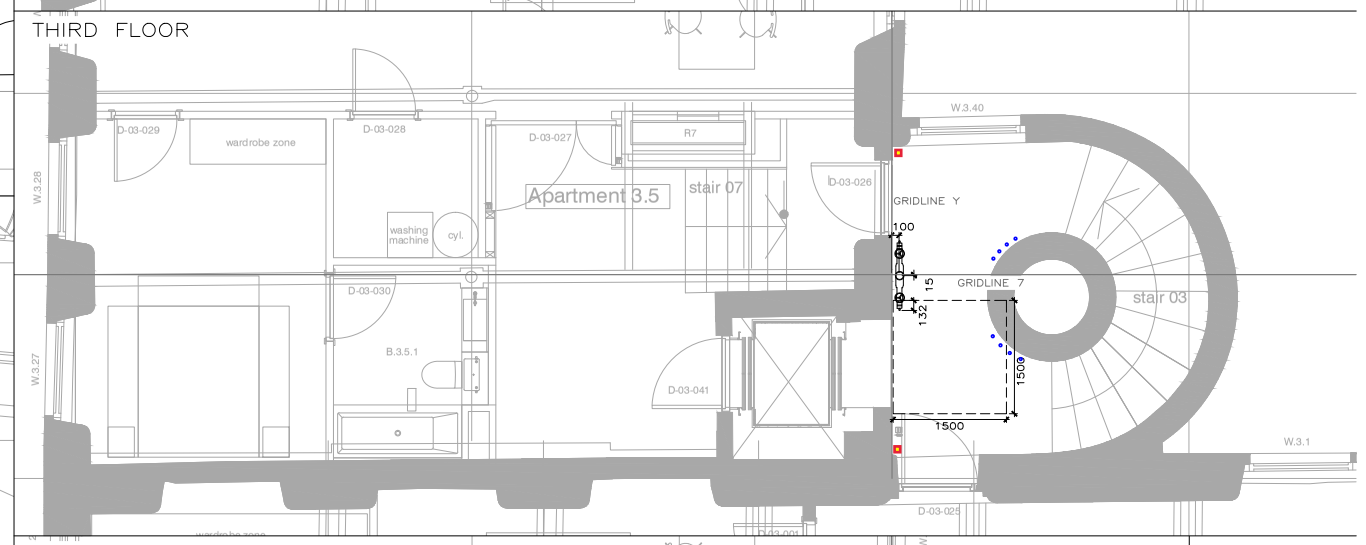

FOURTH FLOOR

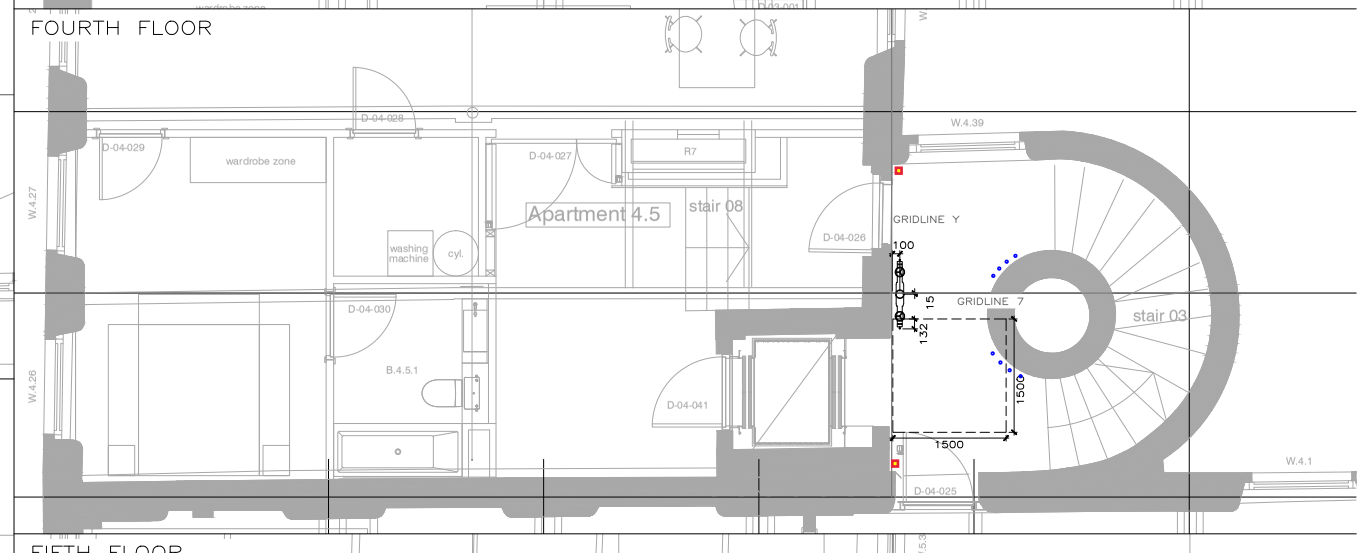

FIFTH FLOOR

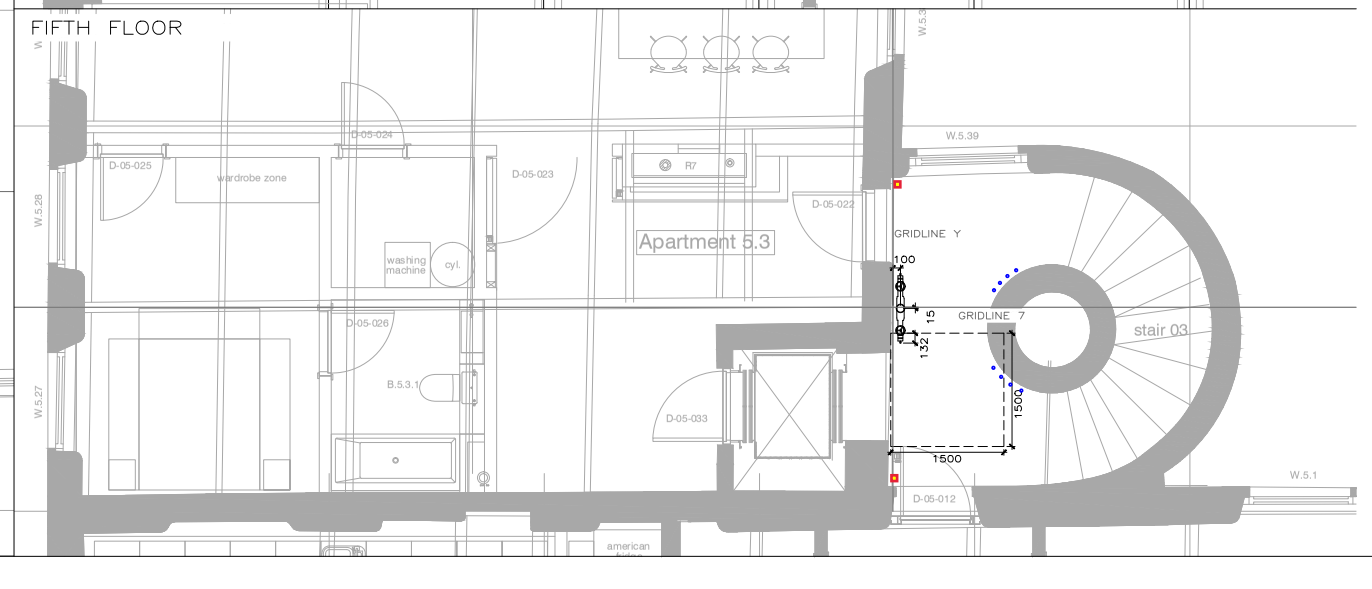

NOTES:

1. FOR INFORMATION
2. DO NOT SCALE FROM THIS DRAWING
3. DIMENSION OF THE EXTERNAL OF PIPE PENETRATION SIZE AND LOCATION TO BE CONFIRMED ON SITE.
4. ø200MM PROTRUSIONS THROUGH SLABS TO CONTINUE VERTICALLY FROM GROUND FLOOR CEILING THROUGH TO FIFTH FLOOR FLOOR
5. DISTANCE FROM WALL FOR DRY RISER TO BE CONFIRMED ON SITE BASED ON SIZE OF RESTRAINING CLAMPS

KEY:

DRY RISER INLET VALVE

DRY RISER LANDING VALVE

1500 x 1500 LANDING SPACE FOR THOSE OF LIMITED MOBILITY

Opt. 1 100 x 100mm galvanised trunking

Opt. 2 Dia. 25mm galvanised conduit

SSL Comment 20190115

rev	date	description	eng
C	17/12/18	FOR INFORMATION	HC
B	05/12/18	FOR ON SITE REVIEW	HC
A	05/12/18	FOR INFORMATION	HC
*	13/11/18	FOR INFORMATION	HC

MAX FORDHAM

Max Fordham LLP
Carver's Warehouse
77 Dale Street
Manchester
M1 2HG
T. +44 (0) 161 312 8071
F. +44 (0) 20 7482 0329
maxfordham.com

Registered in England No. OC300026
Registered Office 42-43 Gloucester Crescent London NW1 7PE

architect
STEPHENSON STUDIO

job title
AVRO

project leader	date	scale (at A1)
MD	**NOV '18**	**1:50**

drawing title
DRY RISER SETTING OUT

LOWER GROUND TO FIFTH FLOOR

job no	dwg no	rev
J6169	**SK121**	**/C**

©Copyright Max Fordham LLP