

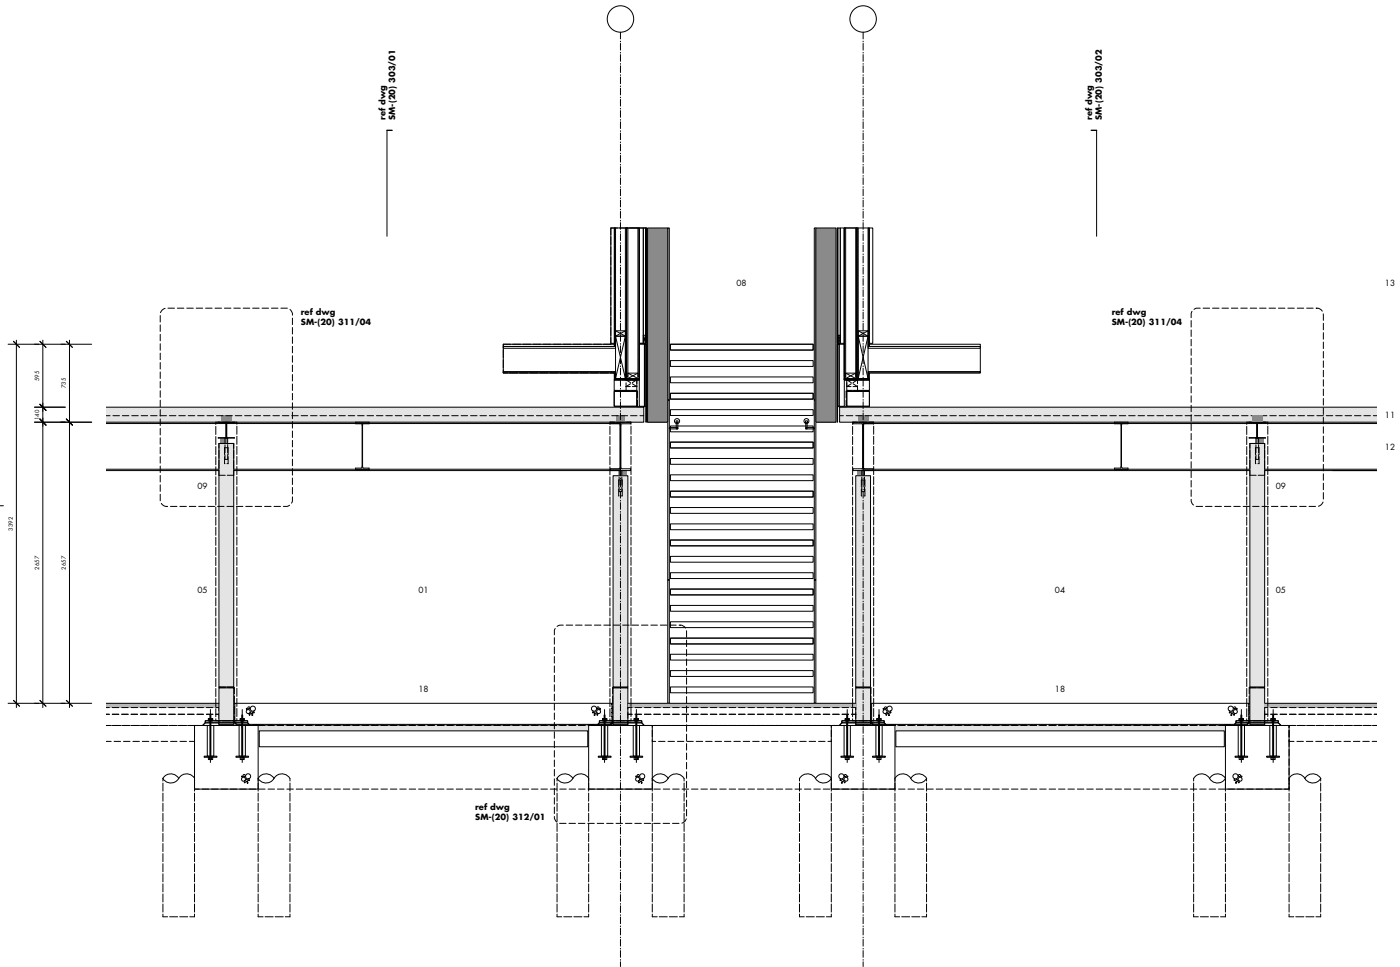



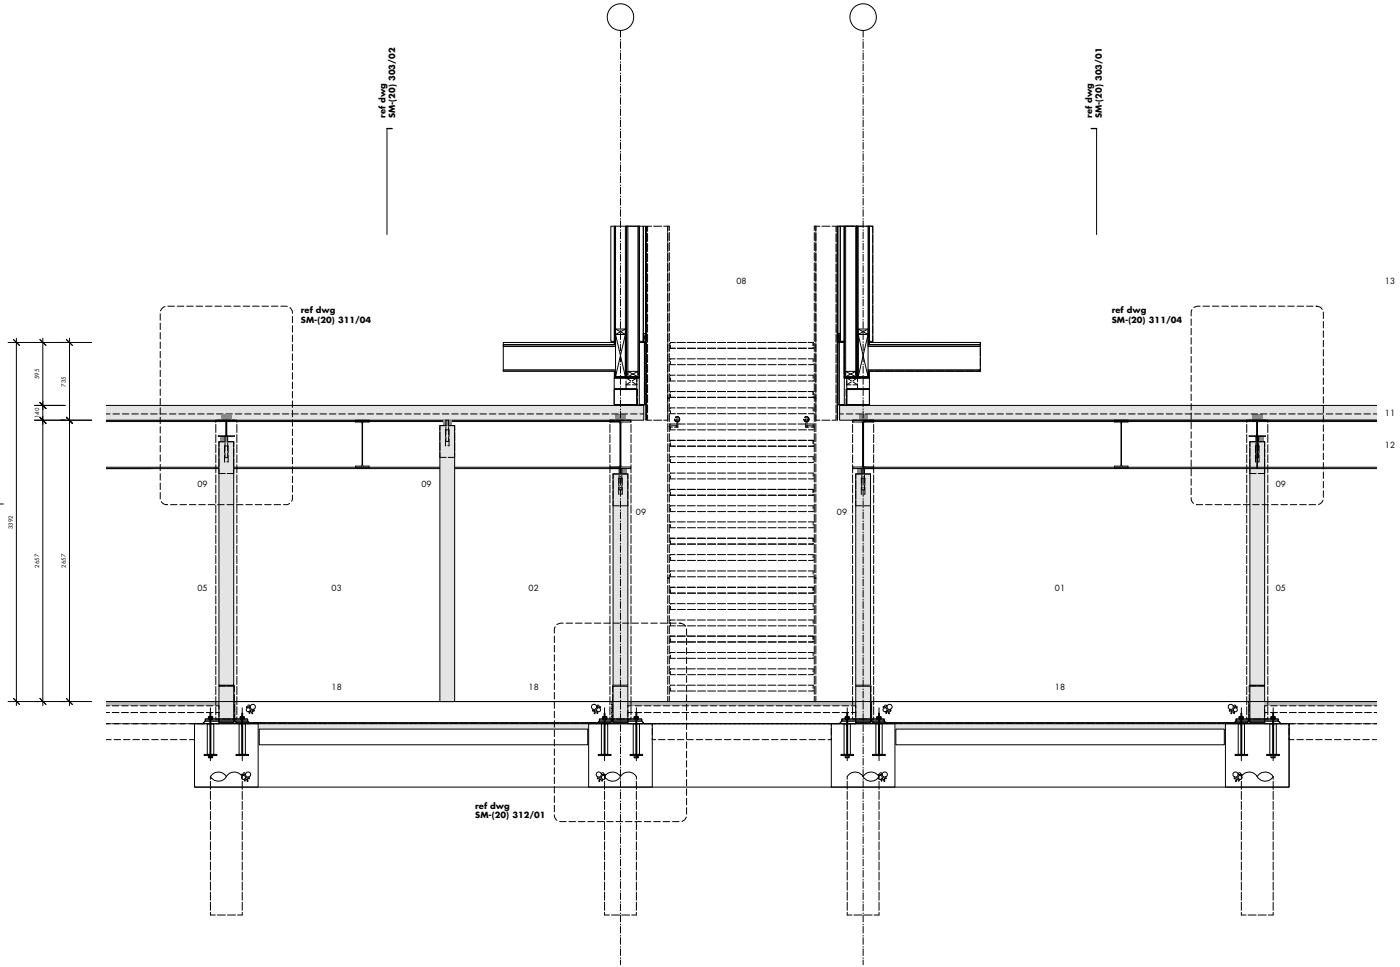

SM (20) 304/01 plant rooms • sections 03



SM (20) 304/02 plant rooms • sections 04

- 01 bin store
02 water meters
- heated space
03 switchroom
- heated space
- distribution boards
- fire alarm panel
04 water tank room
- heated space
05 blockwork
- masonry paint finish • M60/
06 door •
- single leaf
- fd30
07 door •
- double leaf
- fd30
08 centre staircase • L30/250A • L30/250B • M60/175B

- 09 letter box opening
- high level
- service route distribution fbc + subject to specialist
sub-contractor input
- assume fire batt and appropriate sealant relative to typology of
services
10 large scale graphics
- masonry paint
11 podium deck
- refer structural engineer's details + spec.
12 steel frame
- intumescent paint finish • M61/110A
13 townhouse
14 luminaire
- refer m+e specification
15 wall mounted sounder
- refer m+e specification
16 gully

- 17 windpost • F30/255A
- note post not required for wind pressure, but to accommodate
letter box opening and services distribution
18 paint finish to slab • M60/180A

notes
- refer dwgs (20) 300 - 304 for plant room go's, eles +
sections
- refer dwgs (20) 310 - 312 for plant room details

**bin store enclosure and water tank / meter room
enclosure to achieve 60mins fire protection**

- • first issue
rev • description

22.11.19 • ar • jal
issued • drawn • checked

shedkm	+44 (0)151 709 8211 +44 (0)207 253 8881
project	stubbs mews
client	urban splash
drawing number	SM (20) 304 -
scale	1:25 @ c0
status	stage 04
stubbs mews • plant rooms • sections 02	
do not scale from this drawing • all dimensions are to be set out and checked on site prior to starting construction • any discrepancy found between information given on this drawing and that given elsewhere or recorded on site shall be brought to the attention of the project architect immediately	