

Alexandra House

Design Criteria.

Surface Reflectances -
Building elevations: 50 %
Ground: 30 %

Maintenance Factor: 0.8

SB 15.05.20 - Stairwell Turret floodlights re-positioned in accordance with client's request.

"These calculations have been created in accordance to CIBSE guidance or, where supplied, project specification. Variances in measured values to calculated results may occur as a result of software calculation methods to site testing procedure and/or field conditions to assumed room details. Luxonic accept no liability or design responsibility for projects calculated free of charge unless previously agreed.":

Date: 20.05.2020
Operator: Steve Brough

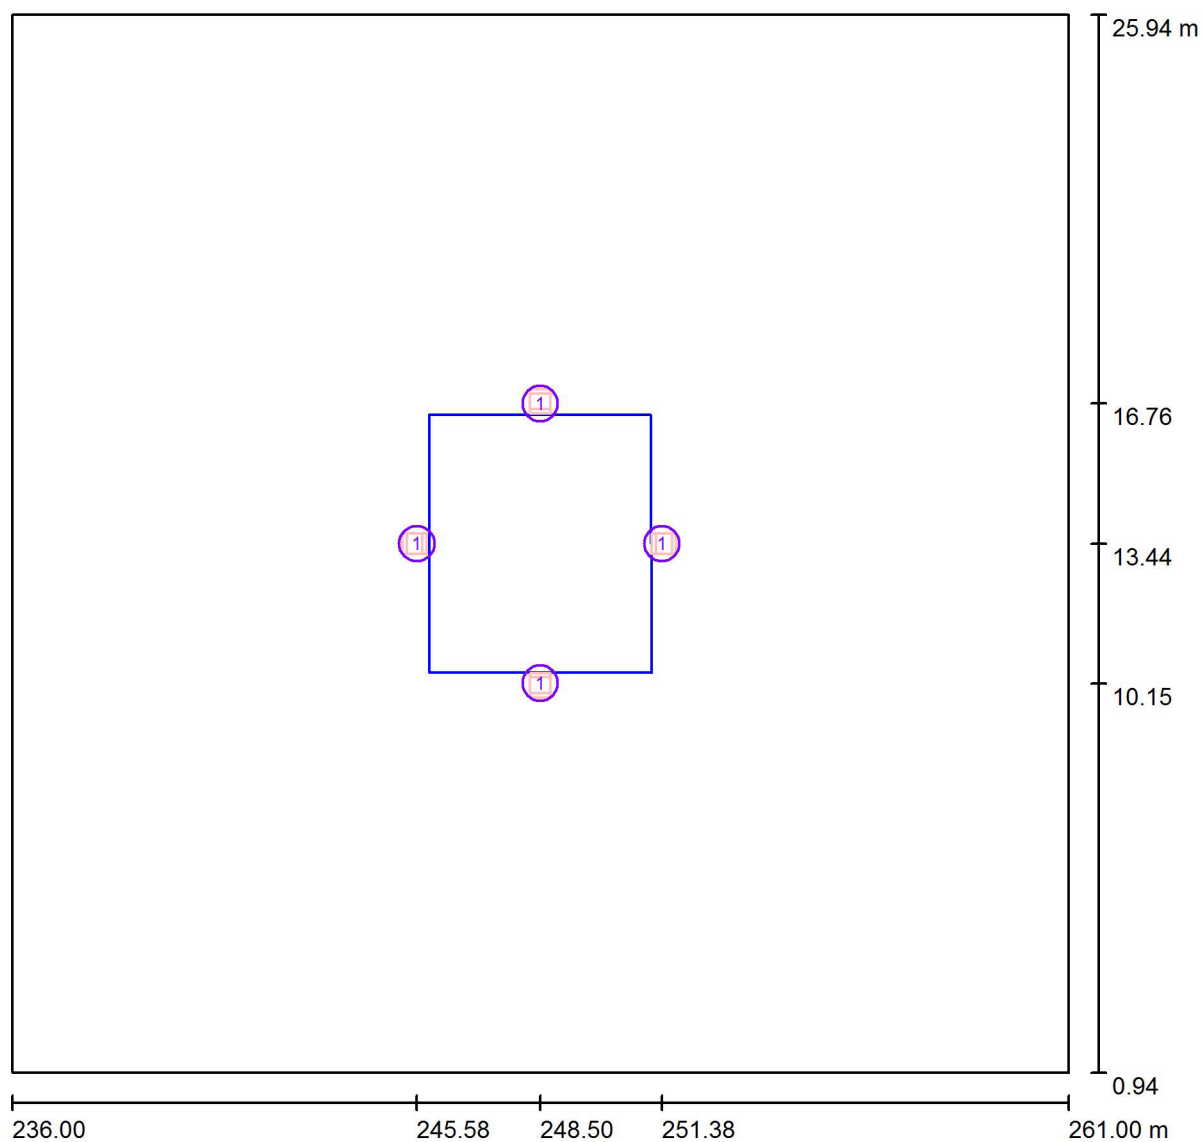
Luxonic Lighting

Suite 15, Earl Business Centre, Dowry Street
Chadderton OL8 2PFOperator Steve Brough
Telephone +44 (0)7557 472107
Fax
e-Mail SteveB@Luxonic.co.uk

Table of contents

Alexandra House	
Project Cover	1
Table of contents	2
Car Park Stairwell	
Luminaires (layout plan)	3
Exterior Surfaces	
Perimeter	
Surface 1	
Value Chart (E)	4

Luxonic Lighting

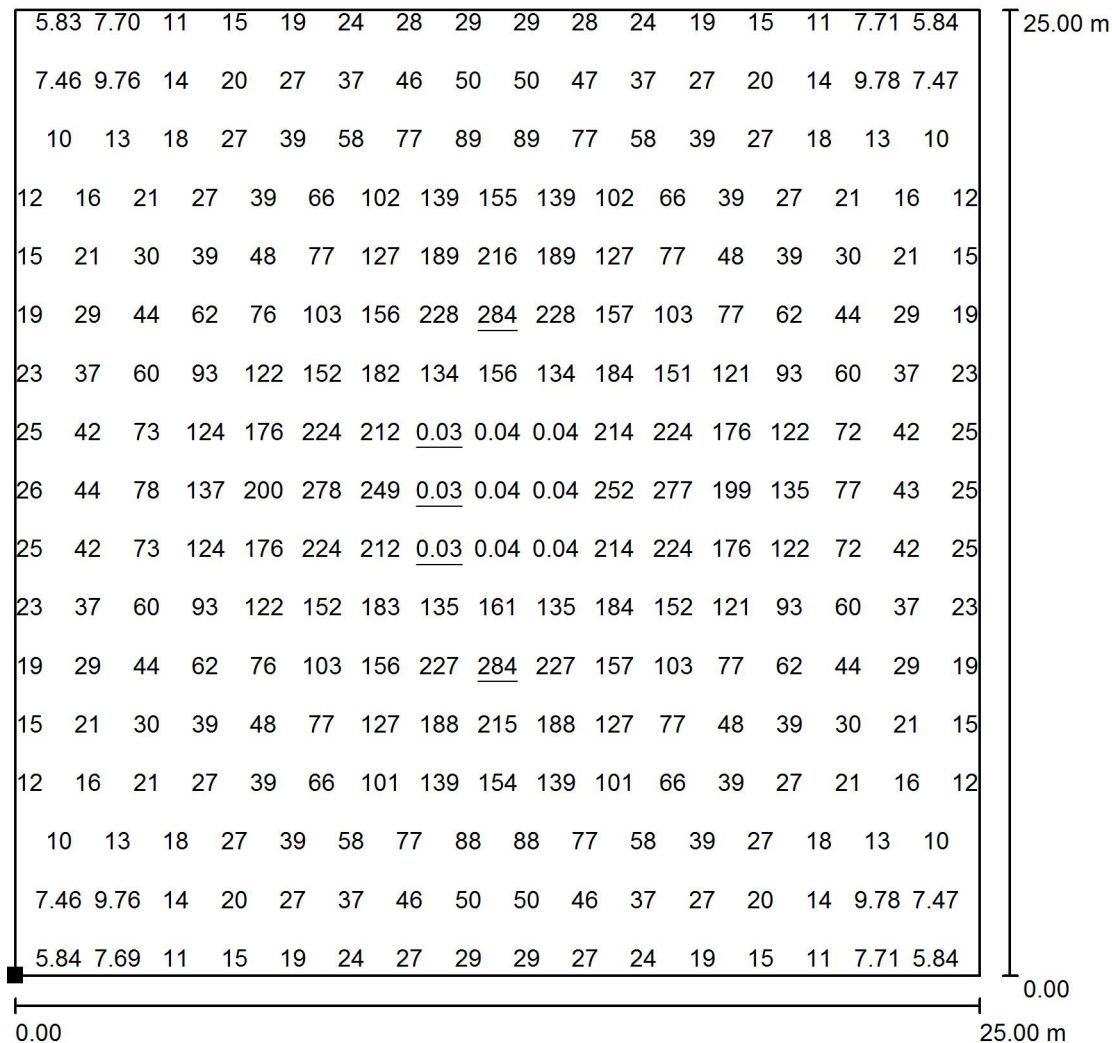
Suite 15, Earl Business Centre, Dowry Street
Chadderton OL8 2PFOperator Steve Brough
Telephone +44 (0)7557 472107
Fax
e-Mail SteveB@Luxonic.co.uk**Car Park Stairwell / Luminaires (layout plan)**

Scale 1 : 179

Luminaire Parts List

No.	Pieces	Designation
1	4	Luxonic FL200LED40 LUXFL200

Luxonic Lighting

Suite 15, Earl Business Centre, Dowry Street
Chadderton OL8 2PFOperator Steve Brough
Telephone +44 (0)7557 472107
Fax
e-Mail SteveB@Luxonic.co.uk**Car Park Stairwell / Perimeter / Surface 1 / Value Chart (E)**


Values in Lux, Scale 1 : 196

Not all calculated values could be displayed.

Position of surface in external scene:

Marked point:

(235.998 m, 0.943 m, 0.000 m)



Grid: 33 x 33 Points

 E_{av} [lx]
70 E_{min} [lx]
0.03 E_{max} [lx]
284 u_0
0.000 E_{min} / E_{max}
0.000