


LEGEND	
SYMBOL	DESCRIPTION
	LED POST TOP AS WHITECROFT SIROCCO PARK, 9031 LUMEN, 35W SIPAHE14K SYMETRIC DISTRIBUTION
	LED POST TOP AS WHITECROFT SIROCCO PARK, 5210 LUMEN, 35W SIPAHE14K WIDE DISTRIBUTION
	LED POST TOP AS WHITECROFT SIROCCO PARK, 3178 LUMEN, 33.5W SIPAHE14K SQUARE DISTRIBUTION
	LED BOLLARD AS WHITECROFT BROADWALK L180, 549 LUMEN, 11.5W BLF1824KG
	LED WALL MOUNTED BULKHEAD AS WHITECROFT SPECTRE W1X, 1119 LUMEN, 15W SIPAHE14K
	INGROUND UPLIGHT AS WHITECROFT MARINE LF, 404 LUMEN, 3.9W MRL F33M
	PHOTOCCELL DAYLIGHT SENSOR
	TIMECLOCK
	PIR DETECTOR 'X' DENOTES ABSENCE
	100mm DUCT FOR EXTERNAL POWER & LIGHTING CABLING
	100mm DUCT FOR EXTERNAL COMMS CABLING
	DRAW IN BOX
	ACCESS CONTROL
	POST / WALL MOUNTED CCTV CAMERA
	DOOR ENTRY VIDEO INTERCOM

- NOTES
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL & STRUCTURAL DRAWINGS.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT BUILDING SERVICES DRAWINGS & THE RELEVANT SECTIONS OF THE SPECIFICATIONS & SCHEDULES.
 - THIS DRAWING IS NOT TO BE SCALED.
 - ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
 - THE INFORMATION ON THIS DRAWING IS INDICATIVE ONLY OF THE DESIGN INTENT. THE CONTRACTOR SHOULD USE THIS AS A BASIS ONLY FOR THEIR DESIGN DEVELOPMENT AND THE PRODUCTION OF WORKING DRAWINGS FOR SITE USE. DESIGN DRAWINGS MUST NOT BE USED ON SITE FOR INSTALLATION PURPOSES.
 - ANY DISCREPANCIES, ERRORS OR OMISSIONS ARE TO BE CLARIFIED WITH THE RELEVANT ENGINEER AT THE EARLIEST OPPORTUNITY.
 - ALL WORKS ARE TO BE IN ACCORDANCE WITH THE CURRENT RELEVANT STATUTORY REGULATIONS, BUILDING REGULATIONS, BRITISH STANDARDS, ACCEPTED CODES OF PRACTICE AND TRADE ASSOCIATION REQUIREMENTS.
 - IT IS THE CONTRACTORS RESPONSIBILITY TO LIAISE WITH THE MAIN CONTRACTOR AND ALL OTHER TRADES TO ENSURE THE CORRECT CO-ORDINATION OF WORKS TO SUIT PROGRAMME RESTRAINTS, AND TO AVOID CLASHES.

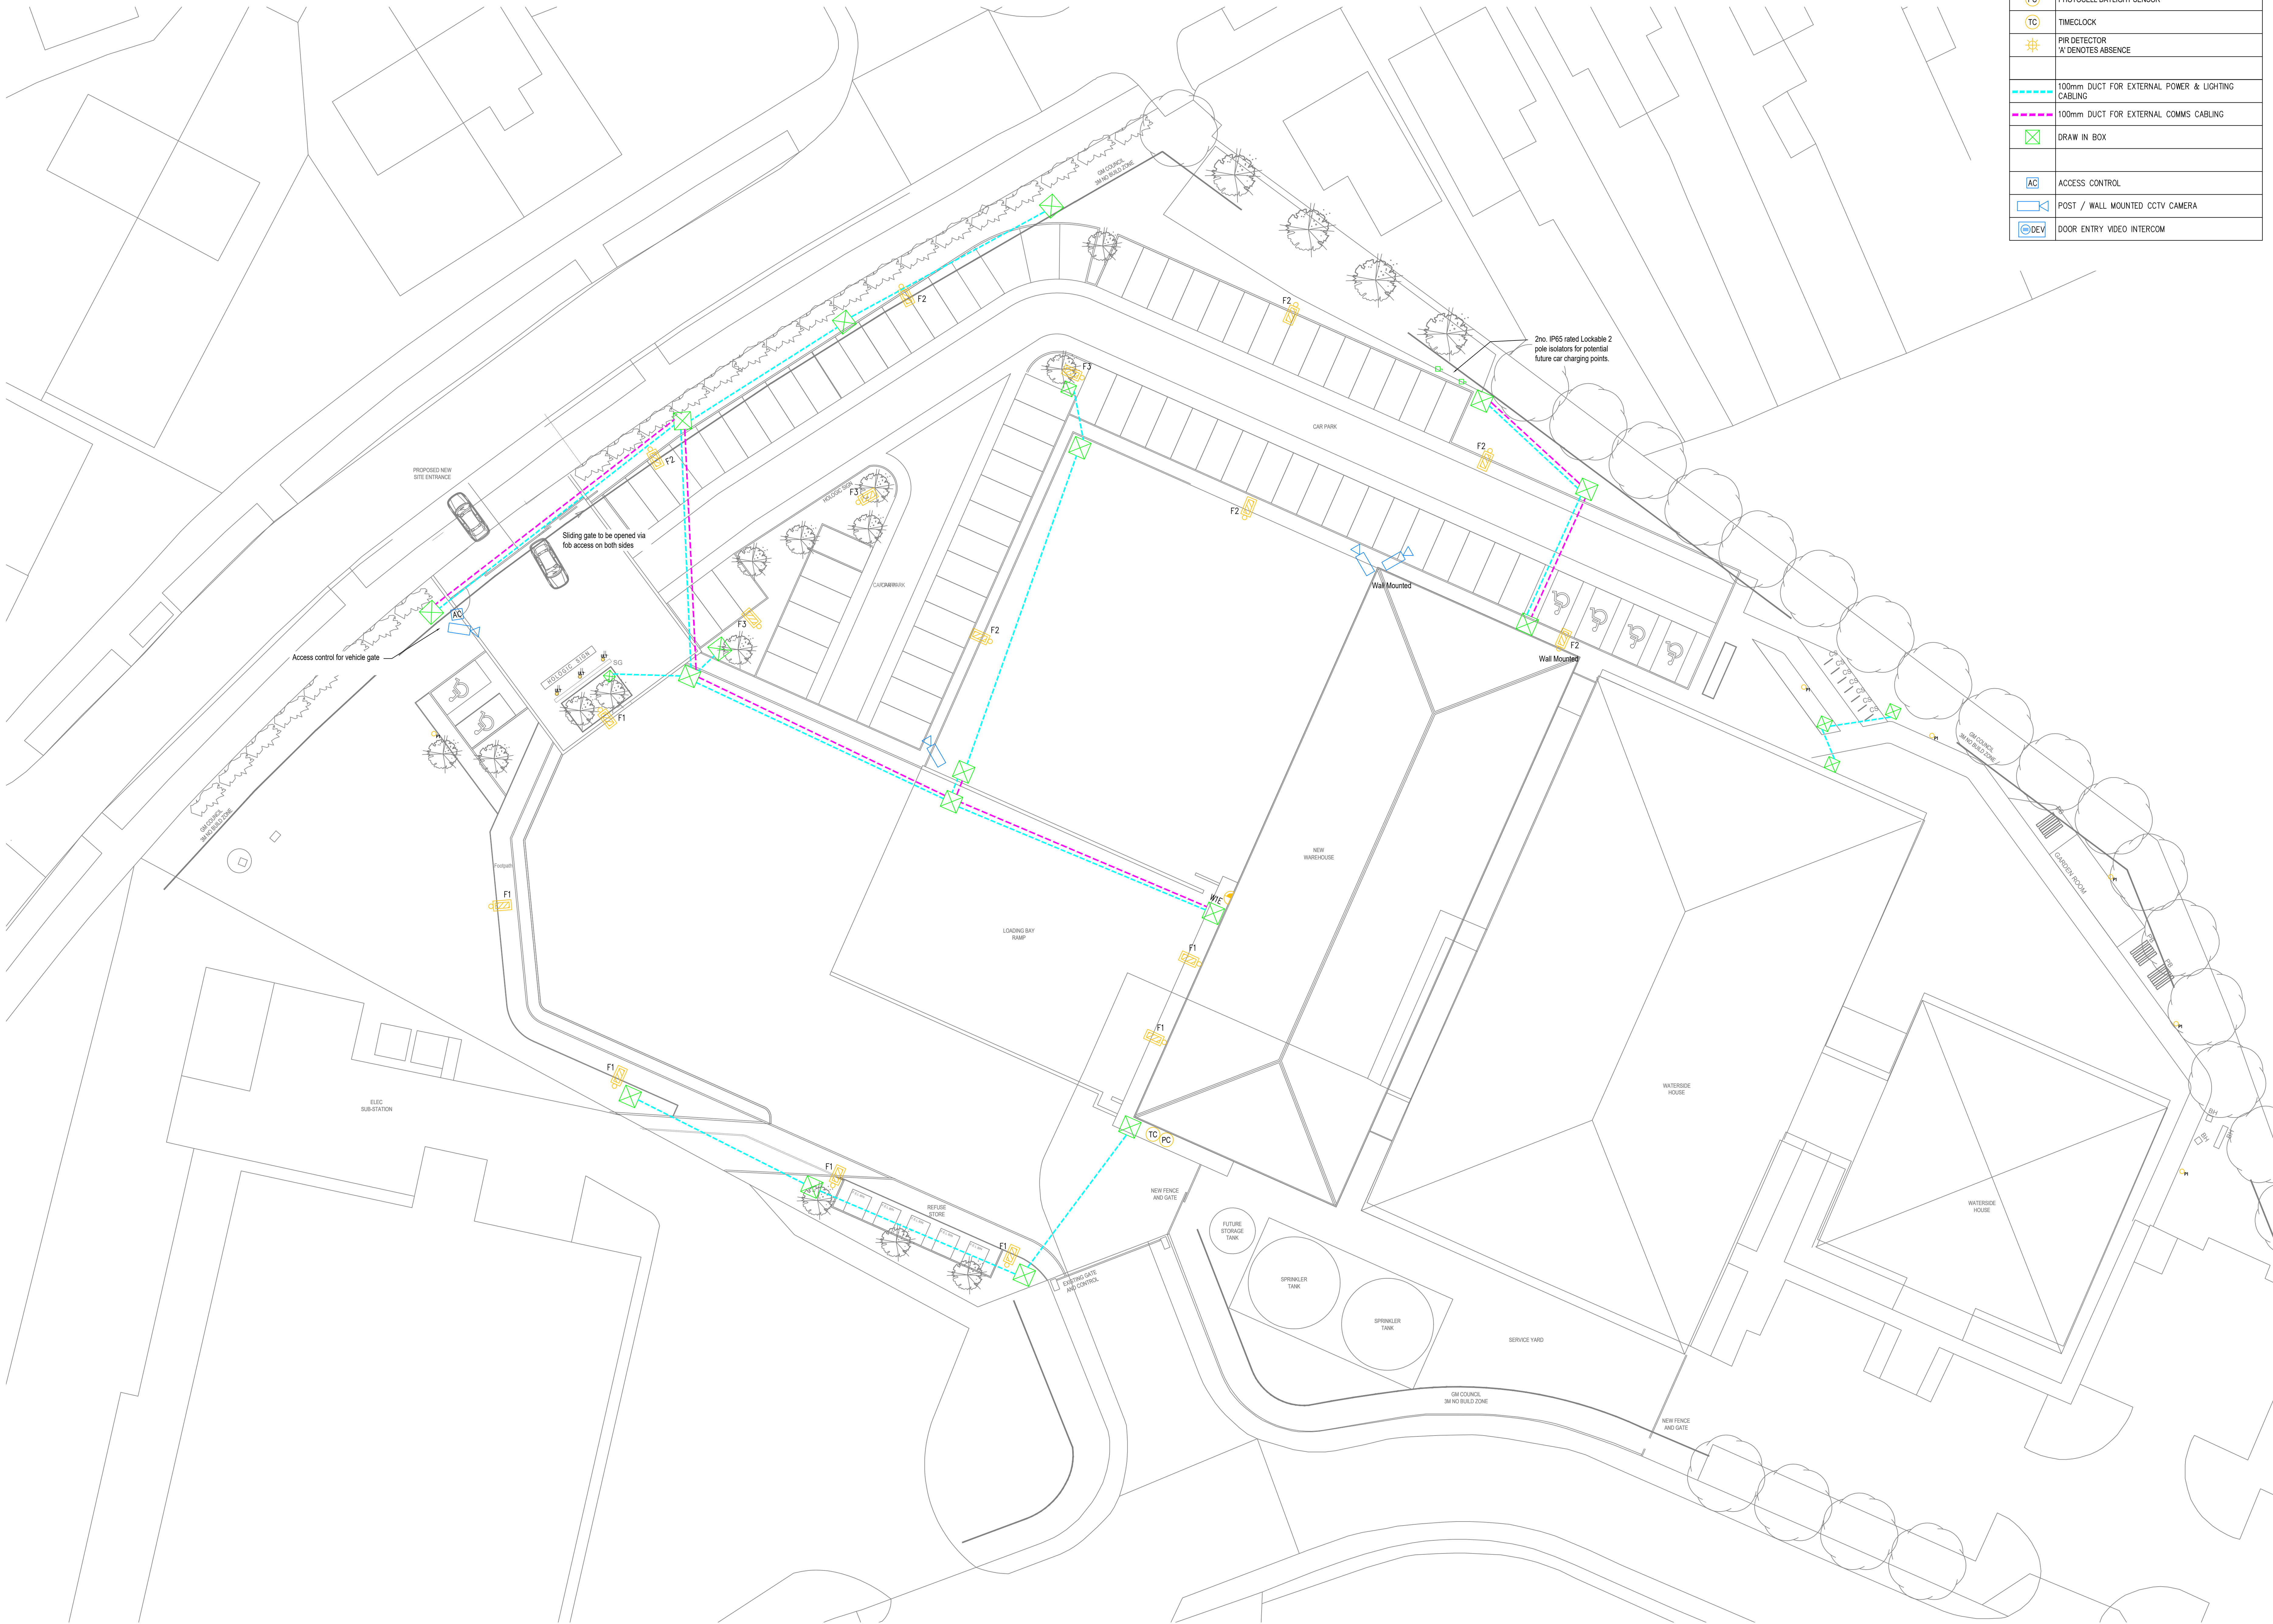

T2	15.05.20	ALL LIGHTING AMENDED IN LINE WITH UPDATED CAR PARK LAYOUT. QUANTITIES AND LEGEND AMENDED	CB	CB
T1	06.05.20	TENDER ISSUE	CB	CB
REV	DATE	DESCRIPTION	BY	CK

SVM BUILDING SERVICES DESIGN
Suite D2, Magnetic House, Salford Quays, M50 3XW
Tel: 0161 8728383 Email: manchester@svm-bsd.co.uk
Website: www.svm-bsd.co.uk

OFFICES at:
Manchester
Leeds
London
Cardiff

Client:
JDA

Project:
CREWE ROAD LOADING BAY

Title:
ELECTRICAL SERVICES
EXTENSION
PROPOSED EXTERNAL LAYOUT

Scale at A3:	Date:	Designed:	Drawn:	Design:	CB
1:200	APR 20	CB	BR	CAD CK:	CO
Drawing No:	200080/E/2800			Rev:	T2

TENDER