


- Legend**
- Highlight indicates emergency luminaires served from central battery unit within Wing Mill LV switchroom.
 - Luminaires to be wired back entry to avoid surface clipped cabling on exterior of building
 - Denote both of the above

- Notes**
- Do not scale from this drawing
 - This drawing is to be read in conjunction with all other documents
 - All external lighting, including that backed by central battery, is to be switched by a photocell and time clock in accordance with the MEP specification.
 - Final coordination of equipment layout to be agreed on site
 - All fixings into listed fabric to be stainless steel

JERSEY STREET

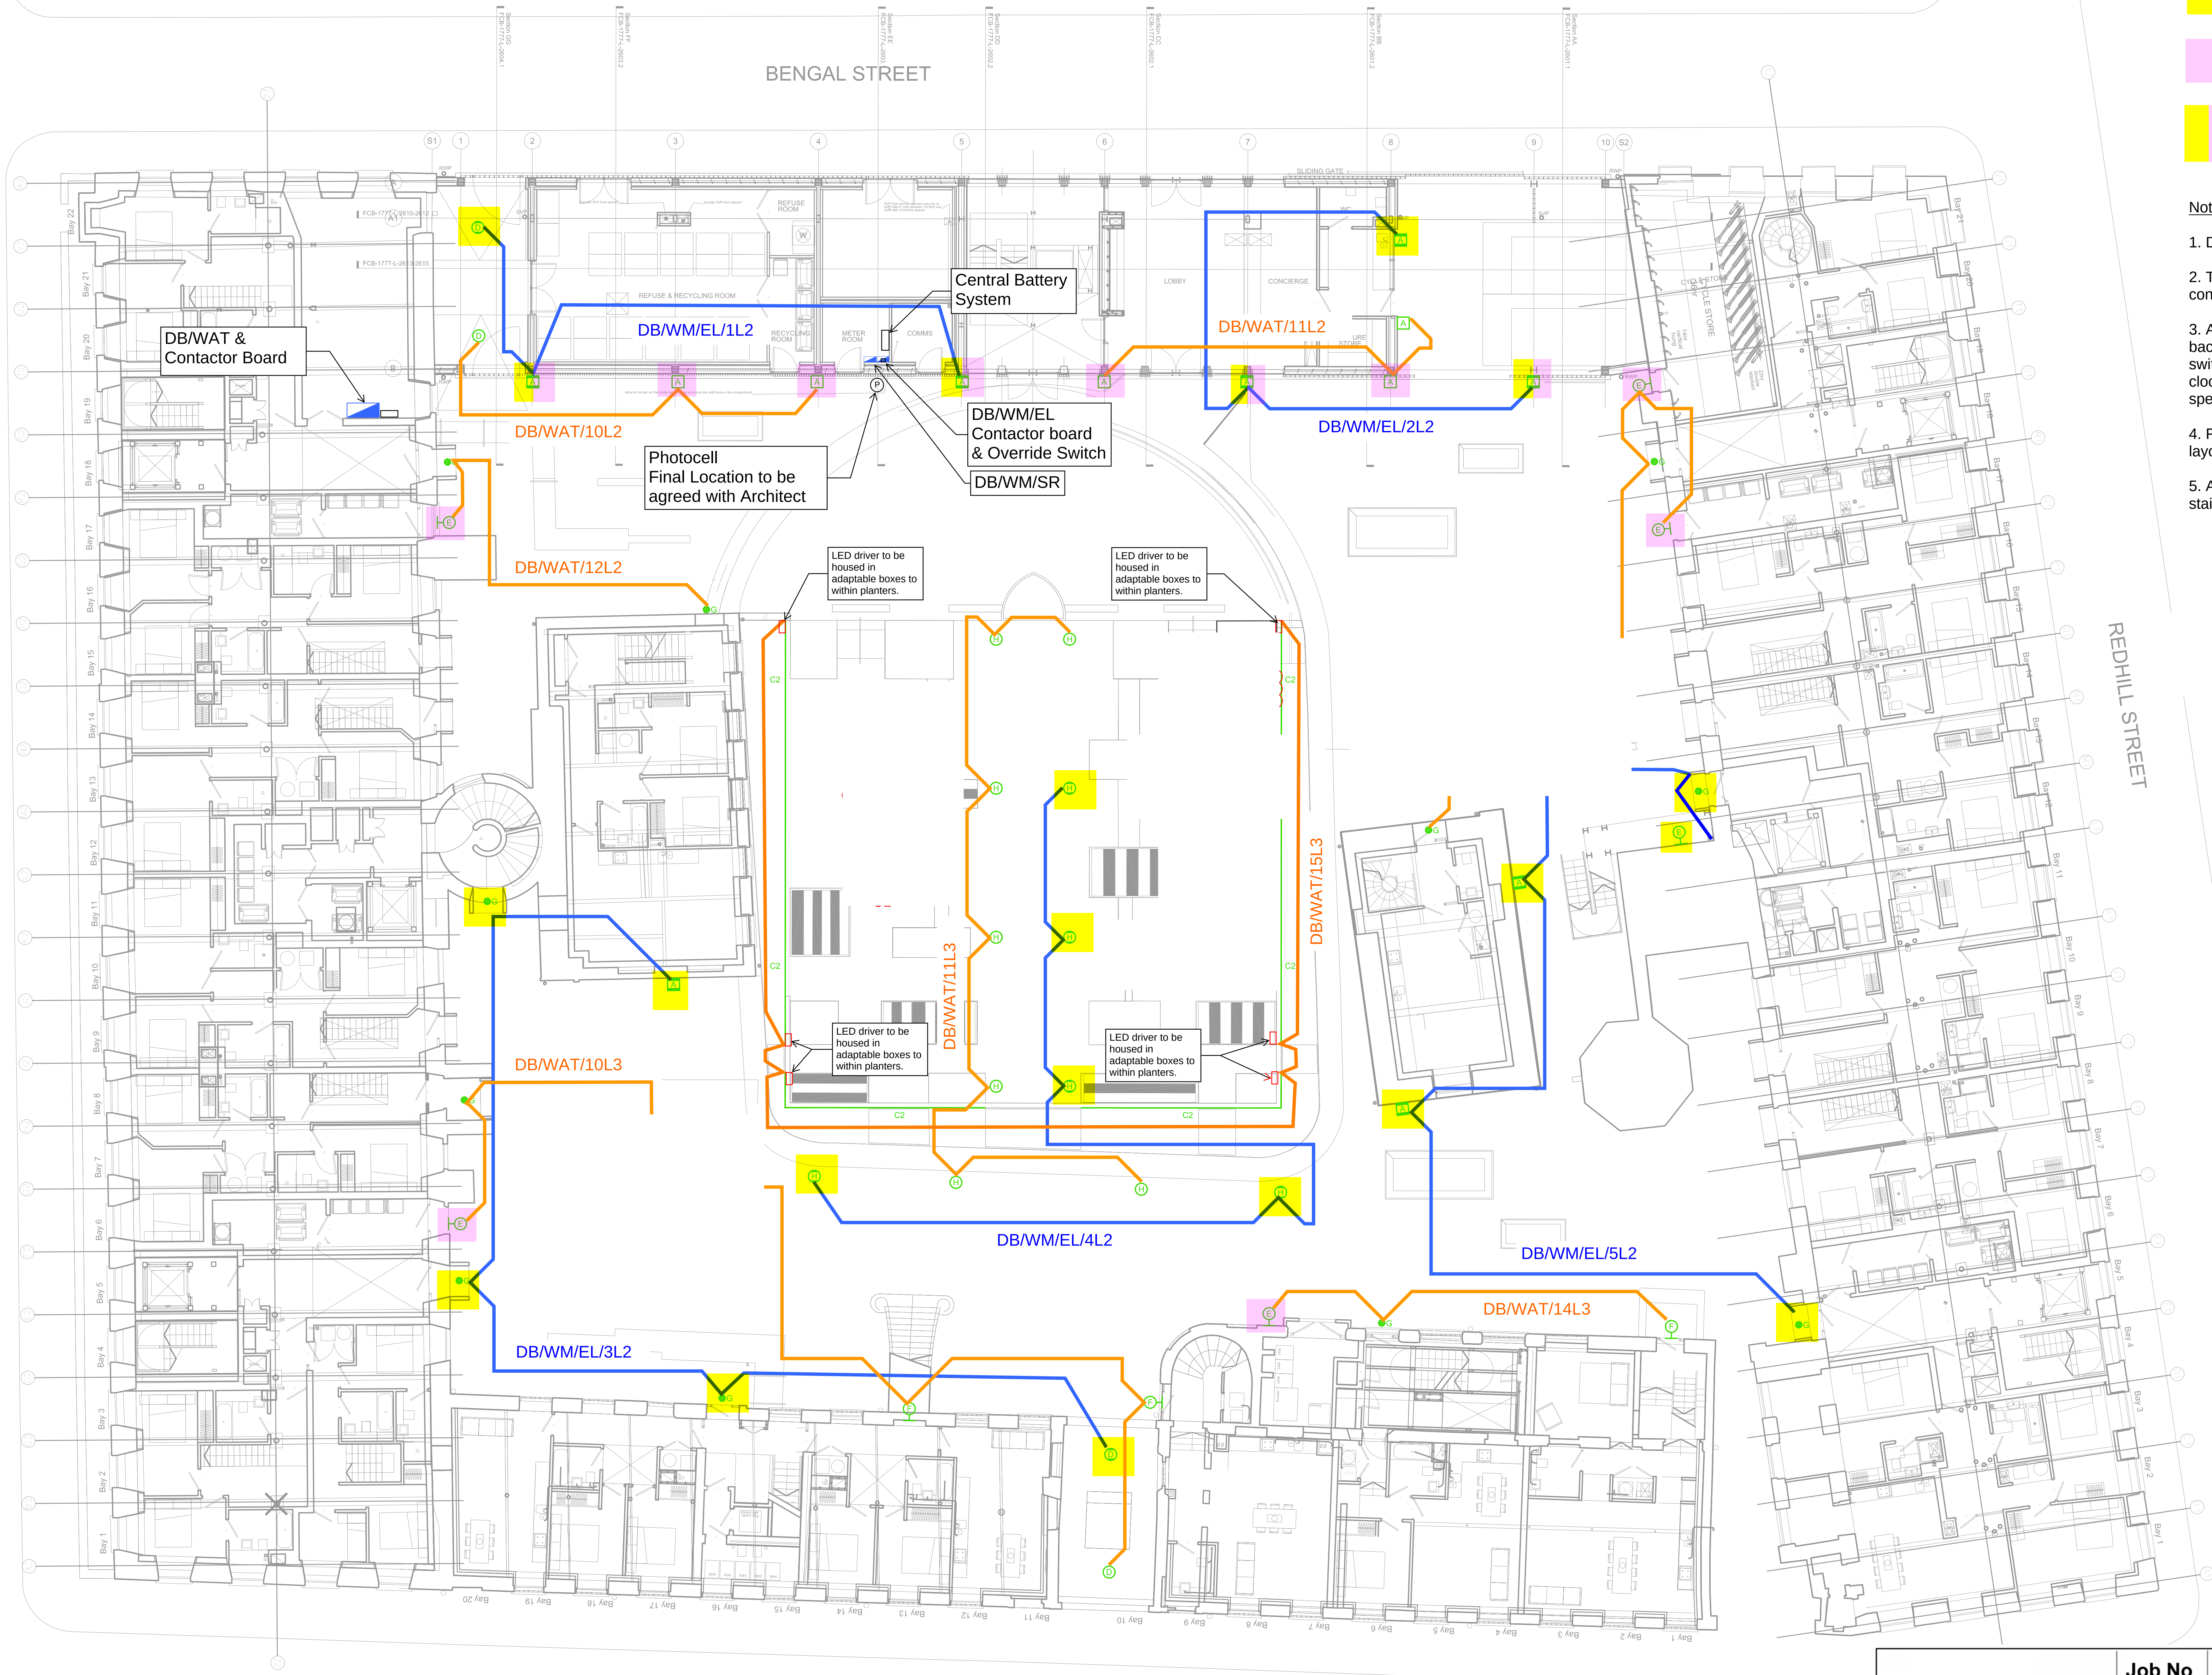

NOTE: All fixings into listed fabric to be stainless steel

MURRAY STREET

ARUP	Job No	235055-00
	Dwg No	MCRL-LOOM-ESK-036
	Date	12/10/2018
Job Title	Manchester Life Plot 3 Loom Cotton	
Dwg Title	Loom External Lighting Revised Scheme Rev C2	