


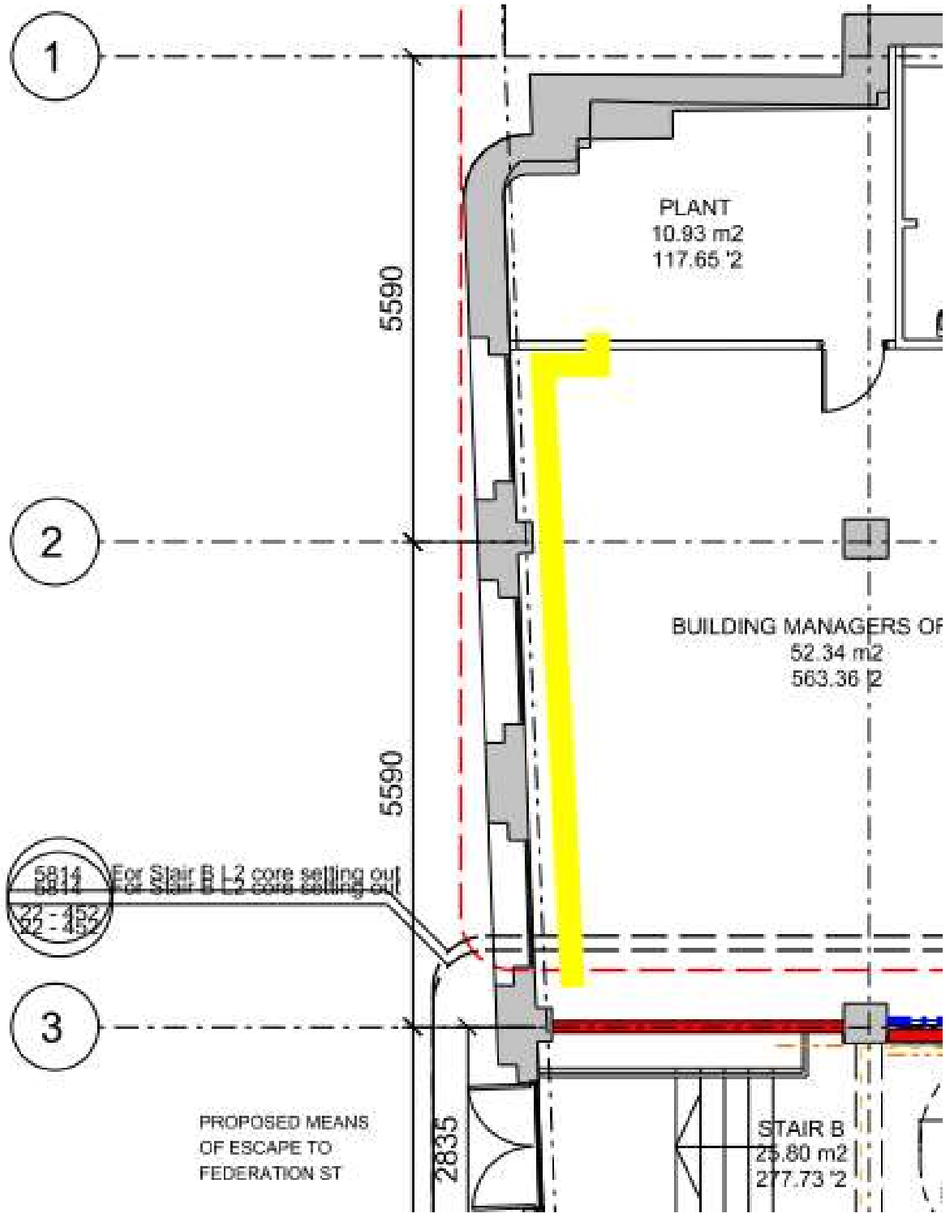

Photograph of sub-basement entry point

Diversion of gas main -
Following a meeting with ENW, the gas main in the Dantzic sub-basement will need to be moved to accomodate the incoming electric supply. ENW require a 300mm service free zone around their cables, which we currently do not comply with. It is proposed that the gas main will be diverted from the flange at GL3 and penertrate through the basement slab. The pipe will then run at low level at the back of the building managers office and into the gas plant room. This will be boxed in and vented. The drainage pipe that also runs through the HV substation will also need to be boxed out to maintain access to this.

Dantzic - Methodology for moving Federation gas main

Russells Construction