Do not scale from this drawing. Work to figured dimensions only

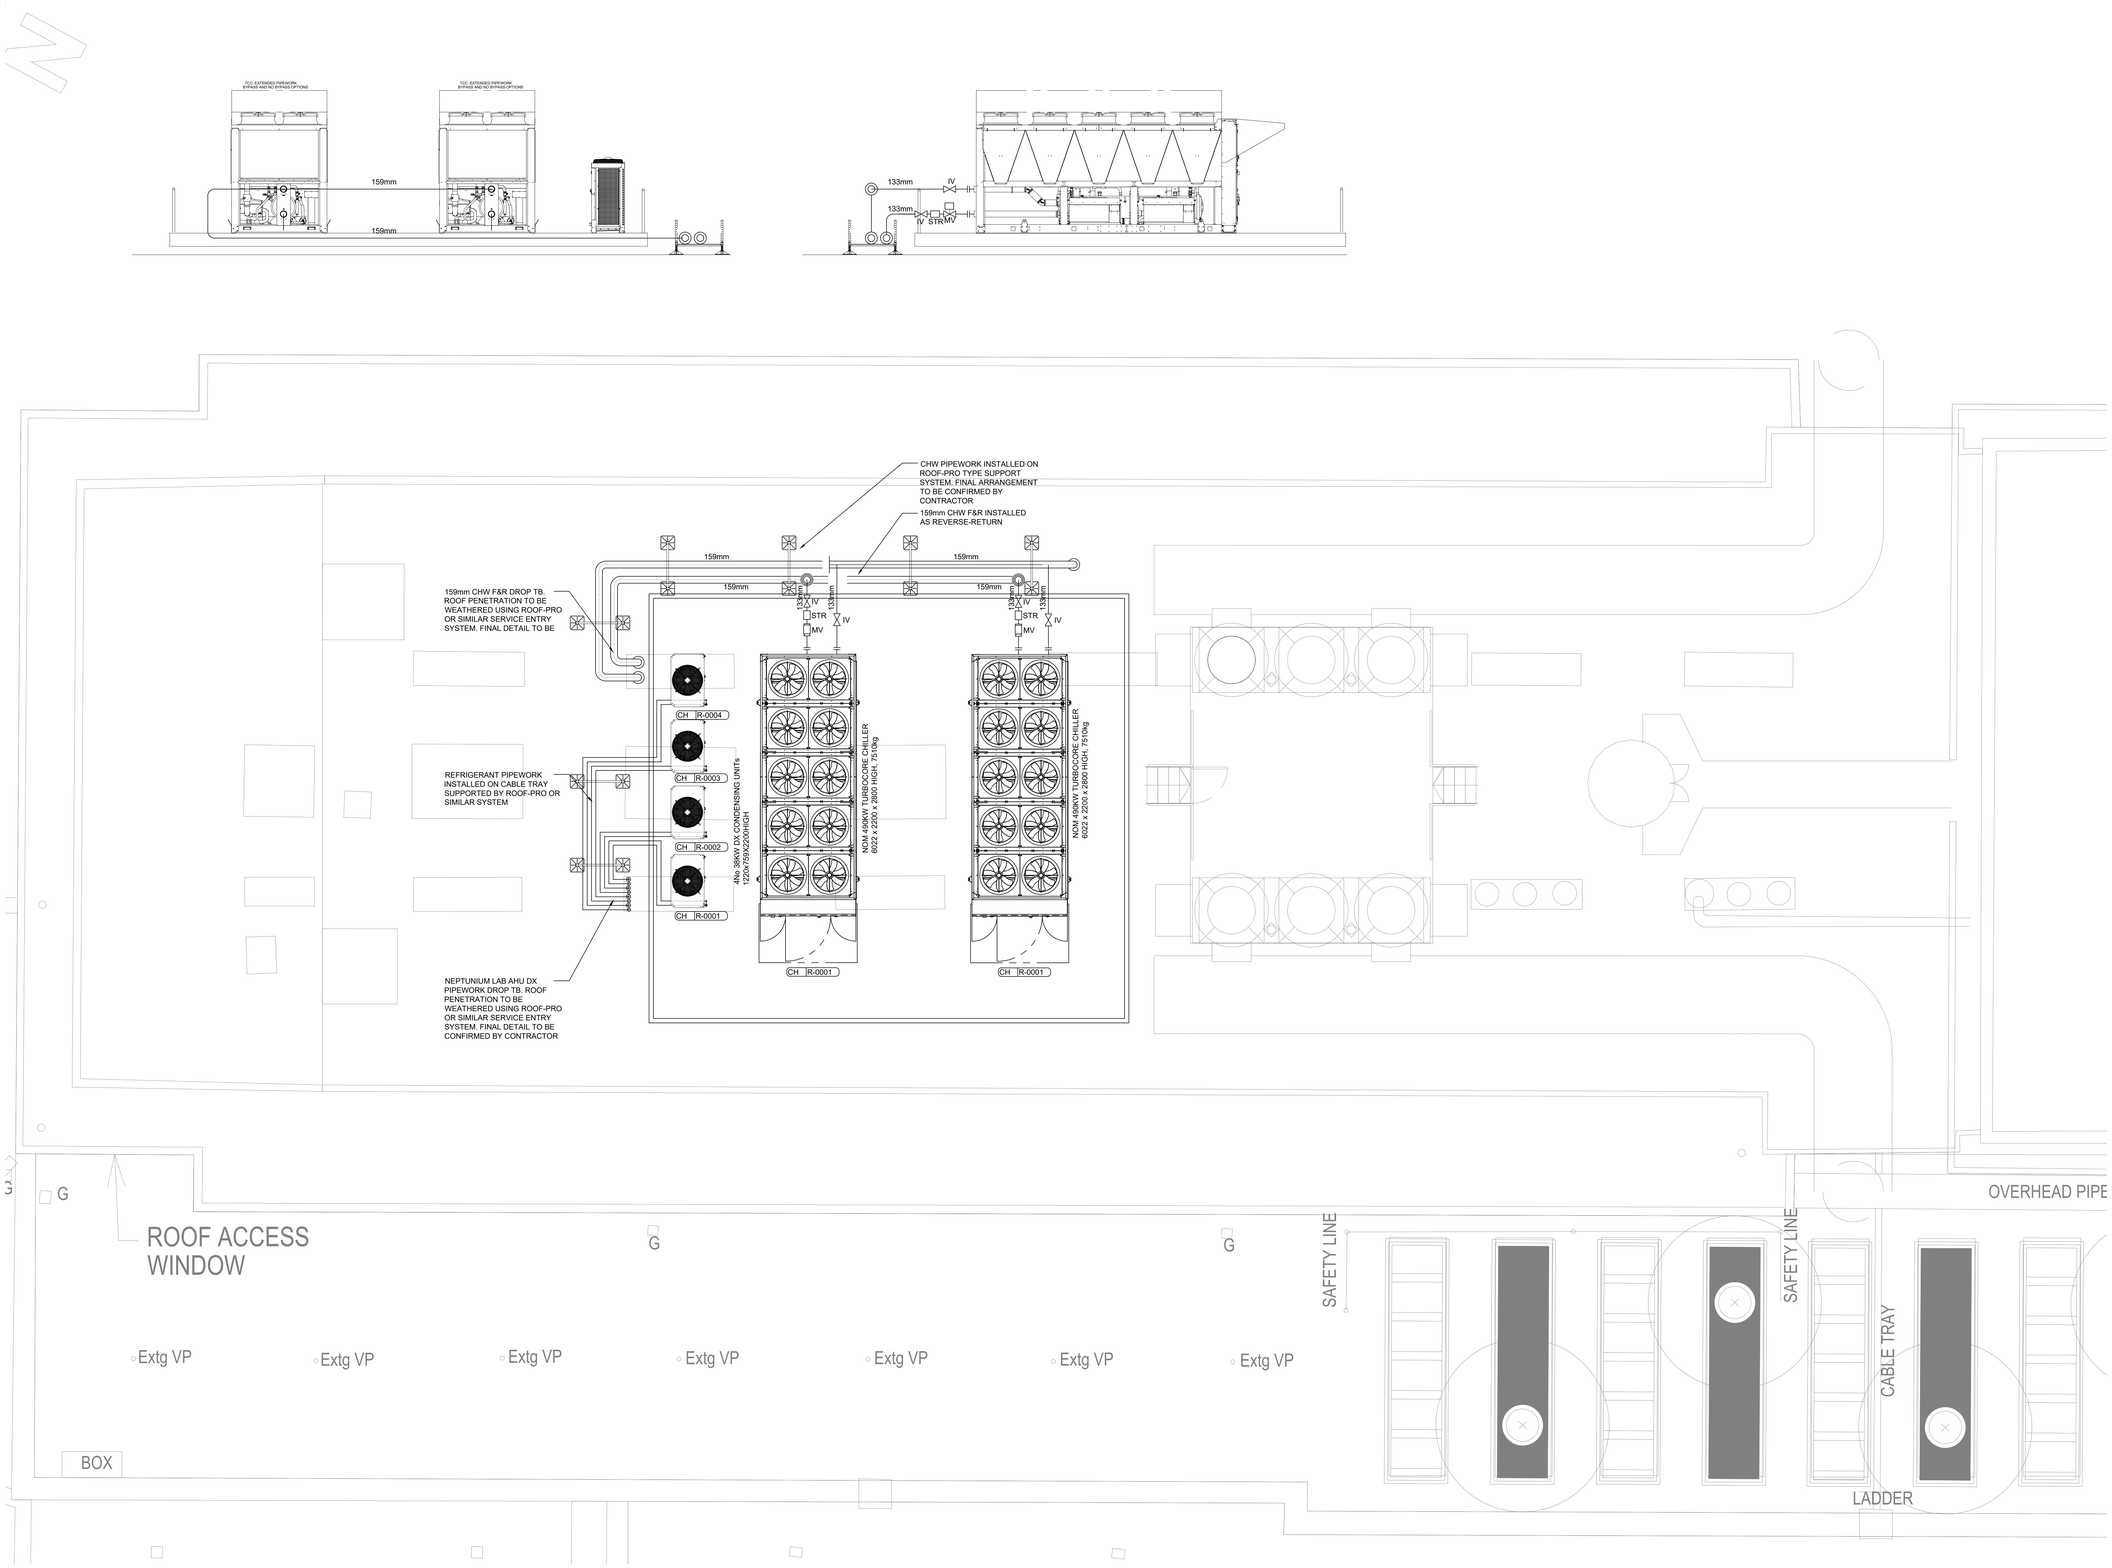

Notes.

1. PLANT AND EQUIPMENT TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATION
2. CHILLED WATER PIPEWORK TO BE COPPER WITH SOLDERED/BRAIZED JOINTS OR HIGH DENSITY PLASTIC WITH ELECTROFUSION THERMALLY WELDED JOINTS, SUBJECT TO AGREEMENT WITH PSU.
3. ALL EXTERNAL PIPEWORK TO BE THERMALLY INSULATED.

Rev.	Revision note	Date	CAD Rev.	Eng Signd	Eng Chkd
1	STAGE 4	21.03.18	–	DD	DB

DRAWING TITLE
UPPER BROOK STREET
ROOF LEVEL
REFRIGERATION LAYOUT

PROJECT
CHEMISTRY BUILDING
RE-ENGINEERING

CLIENT
MANCHESTER 1824
The University of Manchester

EDPI LIMITED
10th Floor, 3 Hardman Street
Manchester, M3 3HF
cad@edpi.ltd.uk
www.edpi.ltd.uk
SUSTAINABLE ENVIRONMENTAL PERFORMANCE

DRAWING NUMBER
5376-EDPI-05-R-DR-M-55-10001

SCALE	DATE	PROJECT NUMBER	REV.
1:50 @ A0	21.03.2018	2207	1
DRAWN: KC	DESIGN: AM		