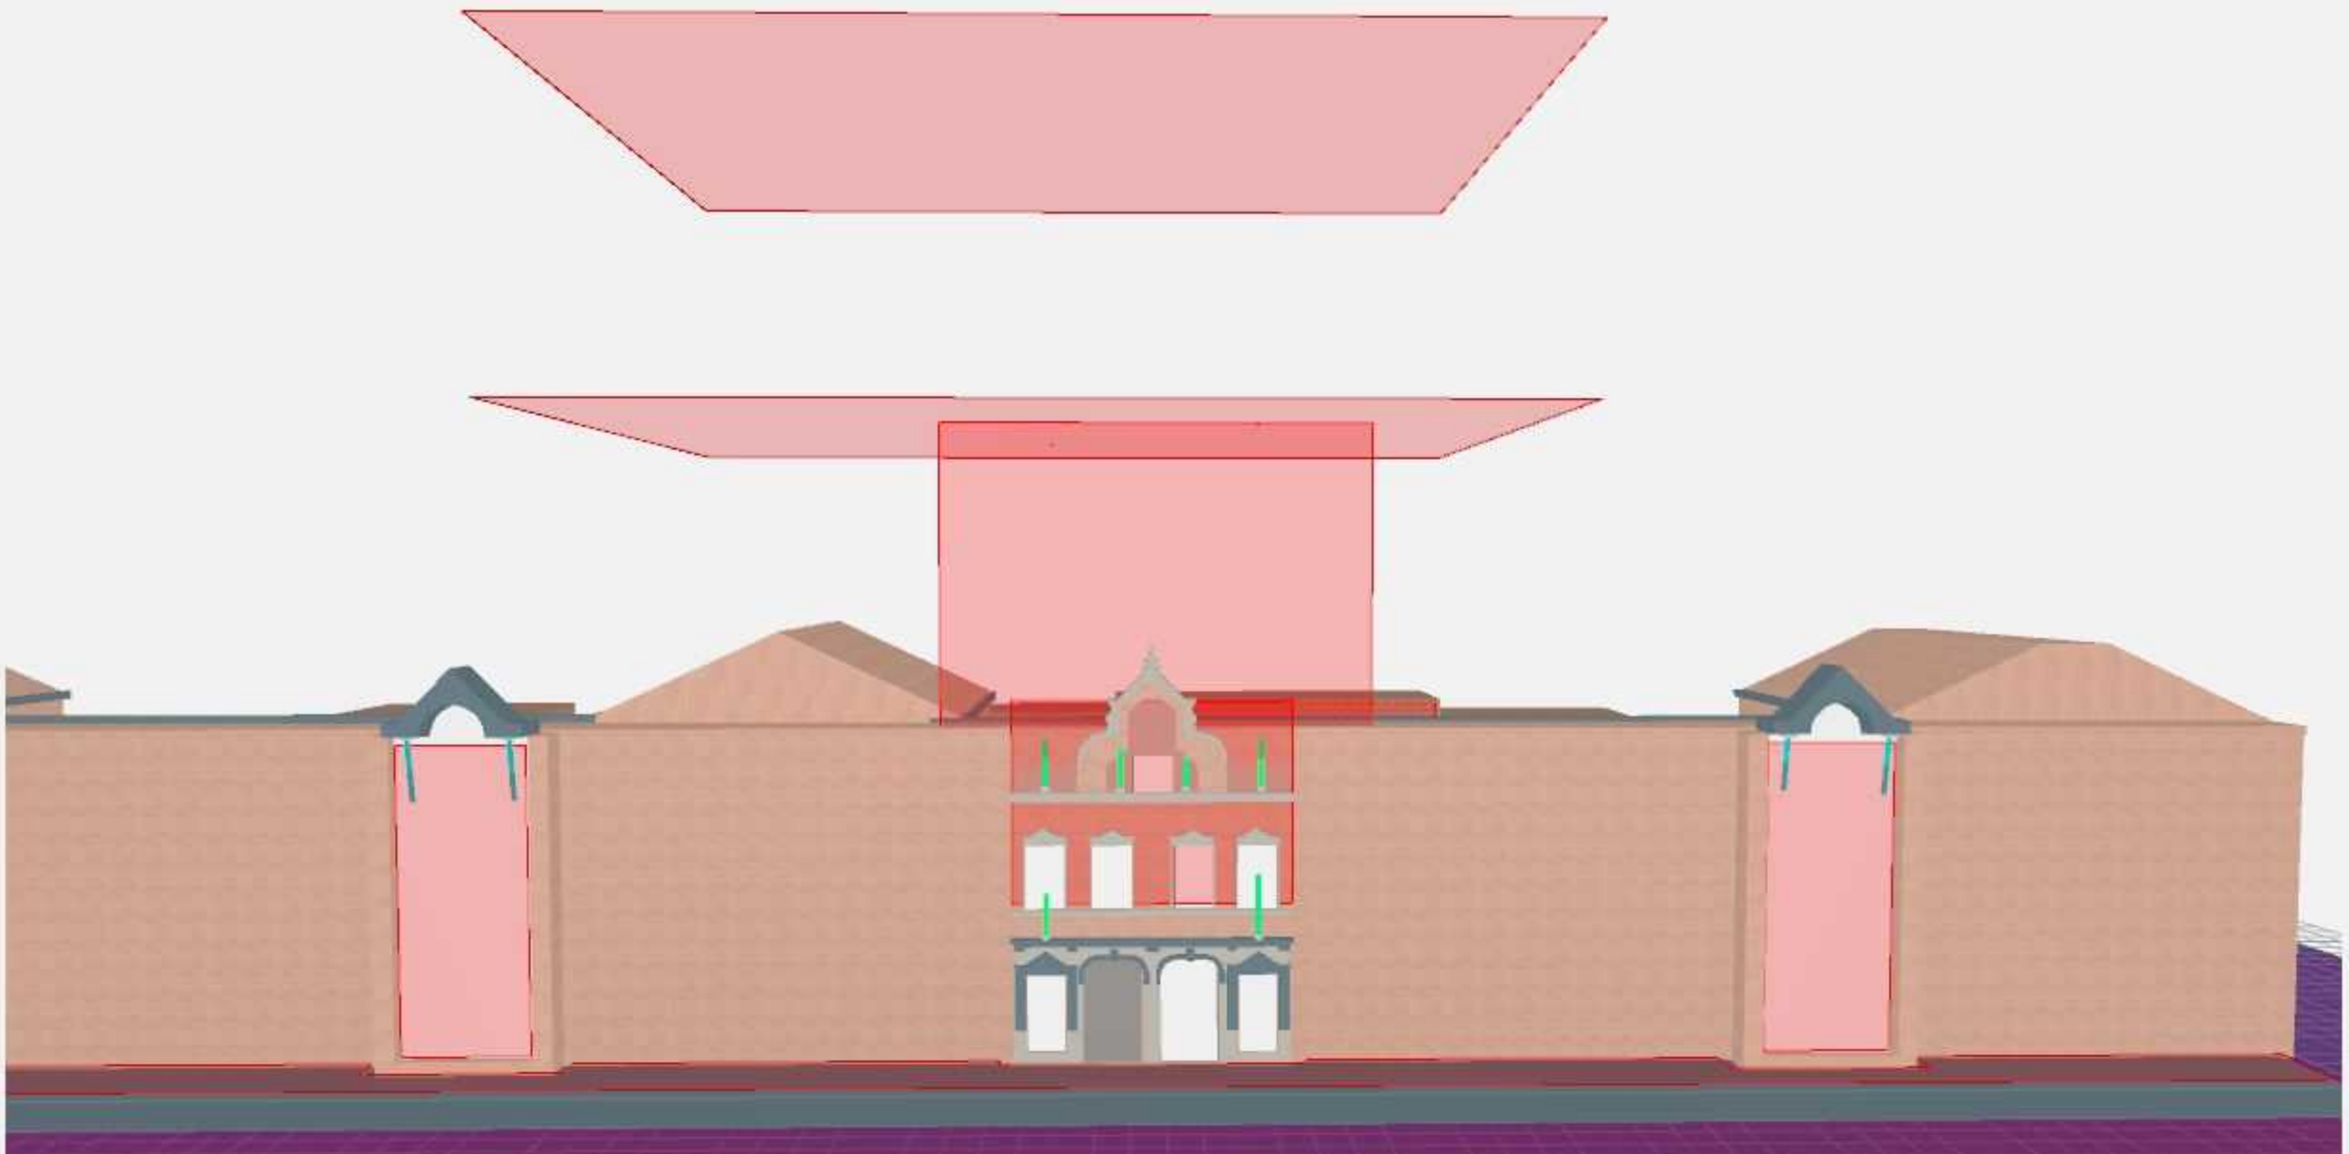

Existing lighting results.

Centre building with upward lighting:
Vertical light spill from 10.5m - 20m : Eav 44lx / Max 145lx
Horizontal light spill from 20m @AFFL: Eav 49lx/ Max 696lx
Horizontal light spill from 30m @AFFL: Eav 40lx/ Max 217lx

LED lighting results

Centre building with upward lighting:
Vertical light spill from 10.5m - 20m : Eav 0.66lx / Max 3.55lx
Horizontal light spill from 20m @AFFL: Eav 3.68lx/ Max 26.5lx
Horizontal light spill from 30m @AFFL: Eav 1.93lx/ Max 8.32lx