Do not scale from this drawing. Work to figured dimensions only

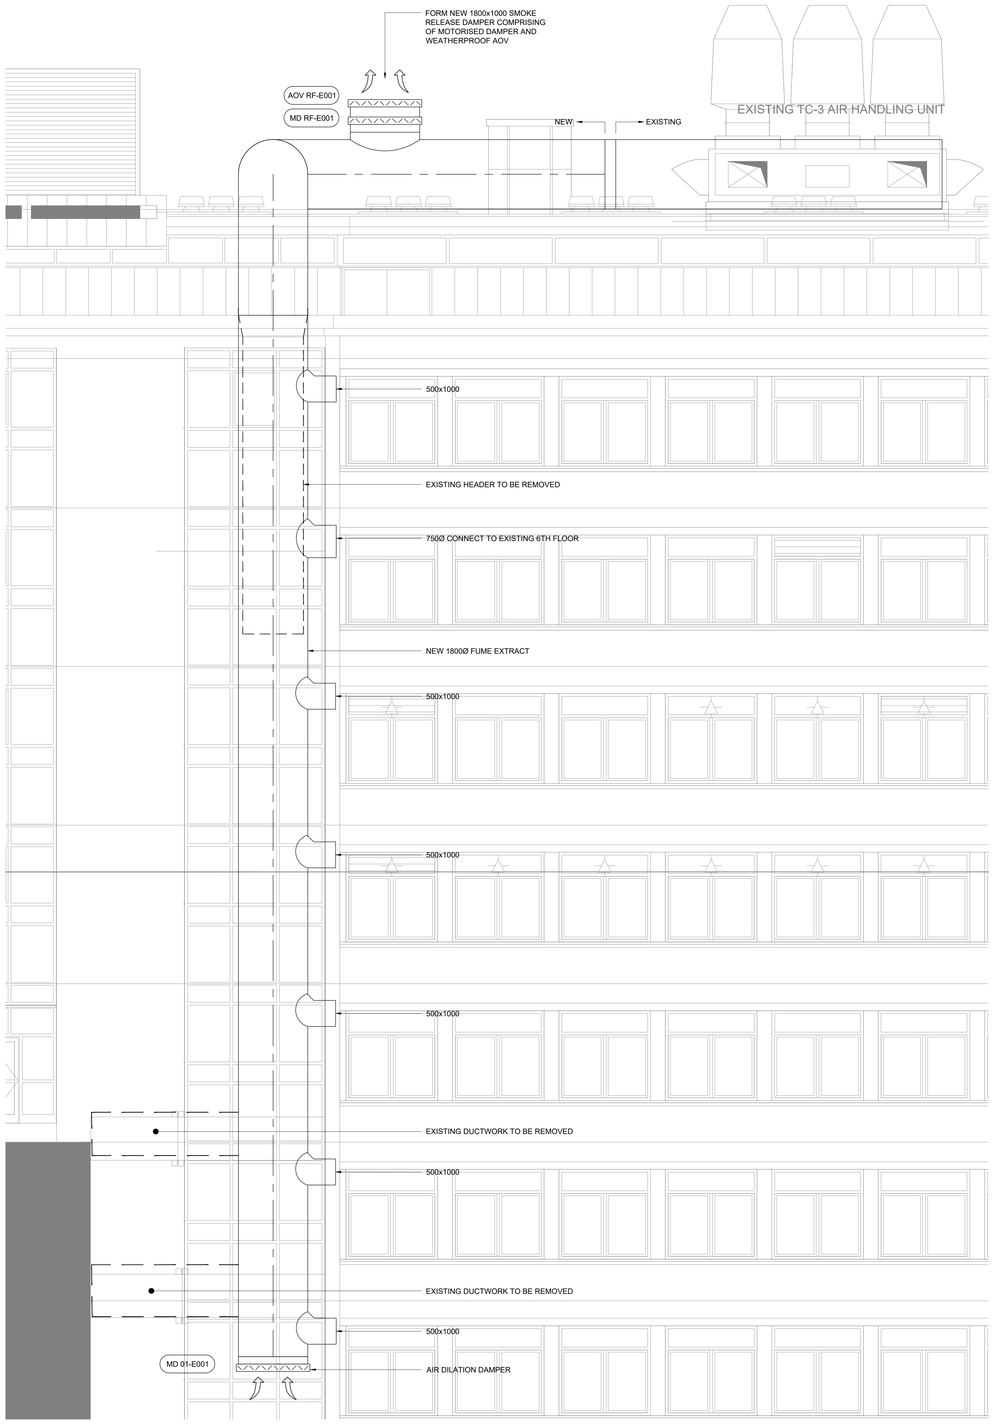

ELEVATION FROM UPPER BROOK STREET

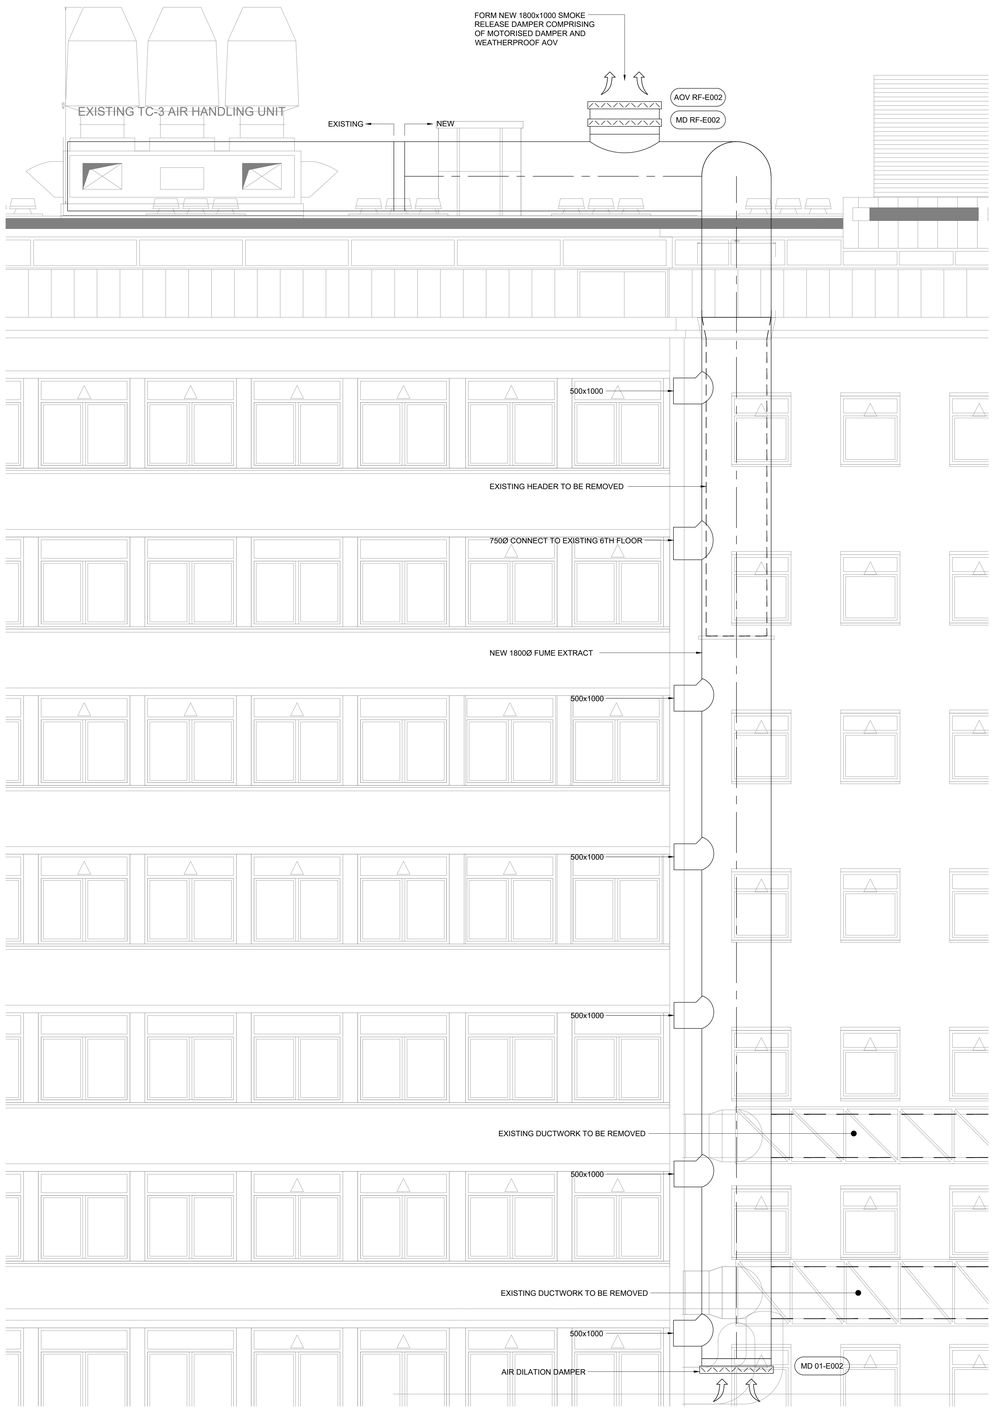

ELEVATION FROM ZOCHONIS

Notes.

1) ALL EQUIPMENT TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATION.
2) FUME EXTRACT DUCTWORK TO BE GLASS REINFORCED POLYPROPYLENE UNLESS OTHERWISE STATED.
3) SUPPLY DUCTOWRK TO BE THERMALLY INSULATED IN ACCORANCE WITH THE SPECIFICATION.
4) ACCESS FOR CLEANING AND MAINTANANCE TO BE PROVIDED IN ACCORDANCE WITH TR19.
5) EXTERNAL DUCTWORK TO BE FIRE RATED (60 MINS). STABILITY, INTEGRITY AND RESISTANCE AT THE RATED PRESSURE
6) REFER TO DRAWING 5376-EDPI-05-ZZ-DR-06-10001 FOR TYPICAL SECTION DETAIL
7) EQUIPMENT REFERENCES OMITTED FOR CLARITY, REFER TO DRAWING 5376-EDPI-05-02-DR-50-10100 FOR FURTHER DETAILS

LEGEND

ACC	ACCESS
HB	HEATER BATTERY
HL	HIGH LEVEL
LL	LOW LEVEL
PSD	PRESSURE STABILIZING DAMPER
SFD	SMOKE FIRE DAMPER
SG	SUPPLY GRILLE
UC	USER CONNECTION POINT
VAV	VARIABLE AIR VOLUME
VCD	VOLUME CONTROL DAMPER

Rev.	Revision note	Date	CAD Rev.	Eng. Sphe	Eng. Chkd
1	STAGE 4	09.05.18	NW	DD	DB

DRAWING TITLE
UPPER BROOK STREET
EXTERNAL FUME EXTRACT
DUCT ALTERATIONS

PROJECT
CHEMISTRY BUILDING
RE-ENGINEERING

CLIENT
MANCHESTER 1824
The University of Manchester

EDPI LIMITED
10th Floor, 3 Hardman Street
Manchester, M3 3HF
cad@edpi.ltd.uk
www.edpi.ltd.uk
SUSTAINABLE ENVIRONMENTAL PERFORMANCE

DRAWING NUMBER
5376-EDPI-05-XX-DR-M-57-10001

SCALE	DATE	PROJECT NUMBER	REV.
1:50 @ A0	09.05.2018	2207	1
DRAWN: NW	DESIGN: DB		